




K ()DI F	Watt	BTU	Watt	BTU
	Δ 50°C	Δ 50°C	Δ 60°C	Δ 60°C
Cannon 50M06	302	1031	382	1303

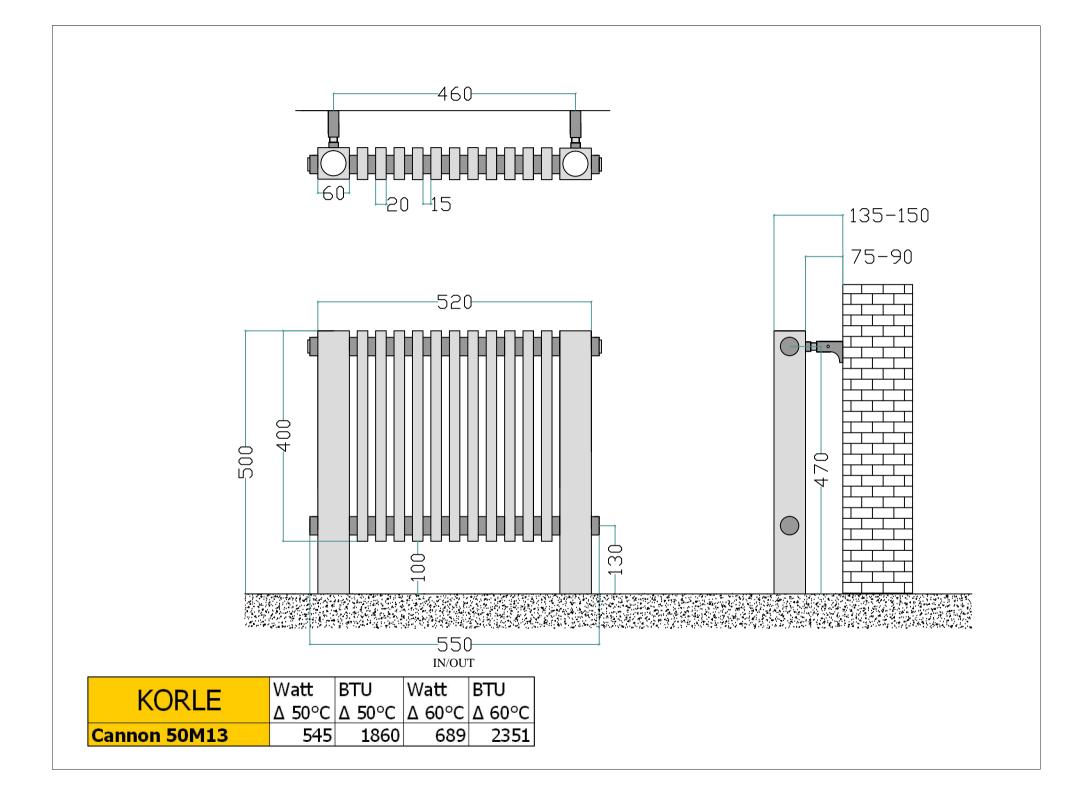


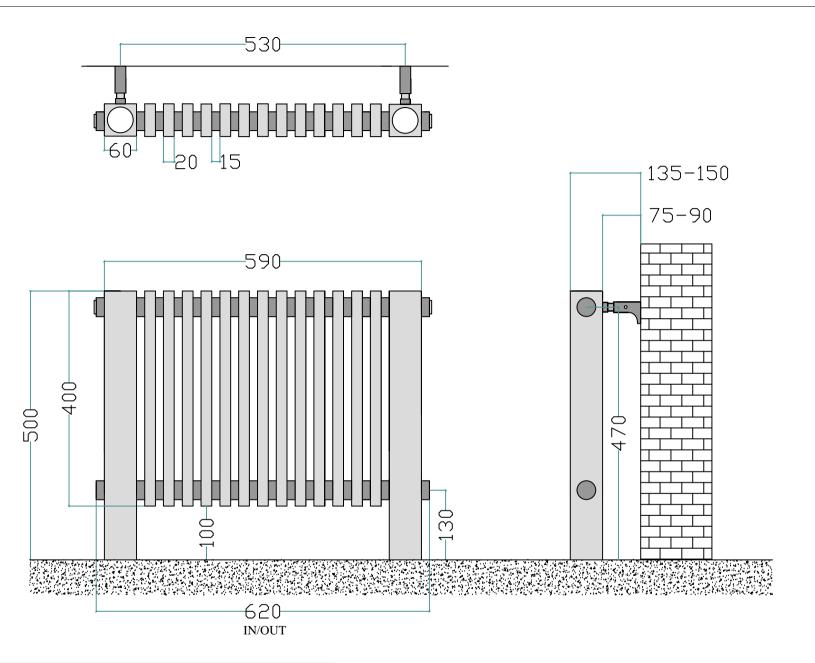


KORLE	Watt	BTU	Watt	BTU
	Δ 50°C	Δ 50°C	Δ 60°C	Δ 60°C
Cannon 50M15	614	2096	777	2651

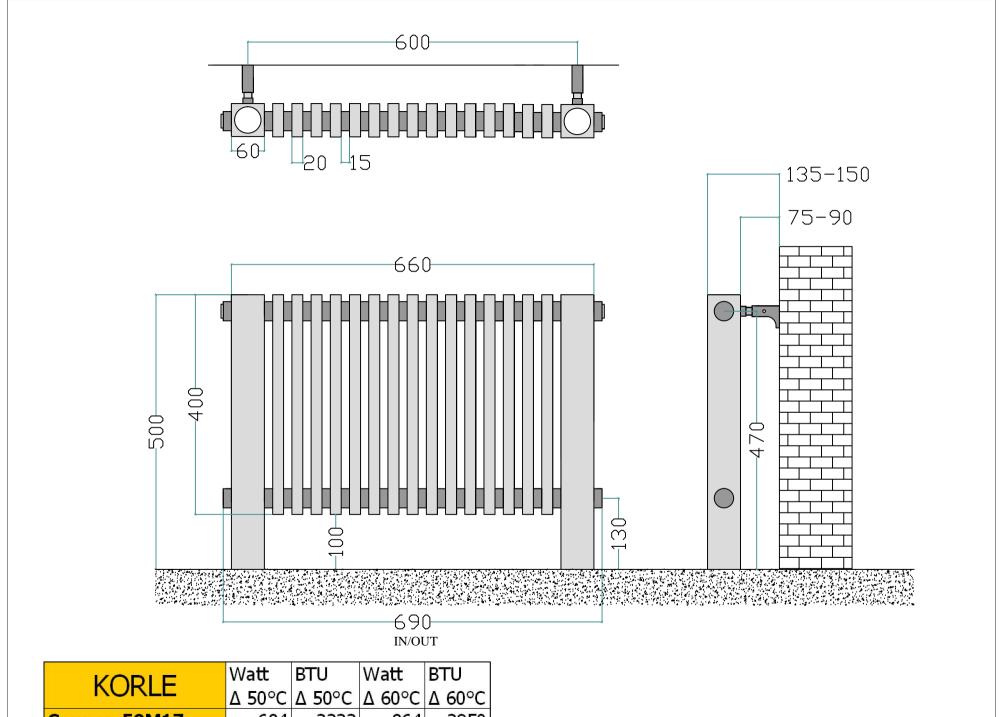


KUDIE	Watt	BTU	Watt	BTU
	Δ 50°C	Δ 50°C	Δ 60°C	Δ 60°C
Cannon 50M17	68 4	2333	864	2950

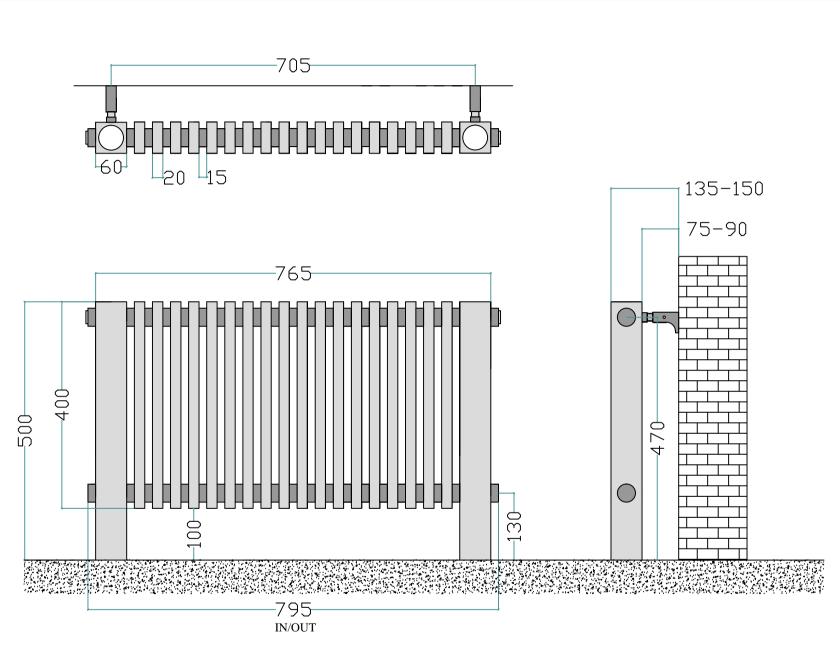


KORLE	Watt	BTU	Watt	BTU
	Δ 50°C	Δ 50°C	Δ 60°C	Δ 60°C
Cannon 50M20	788	2688	996	3399

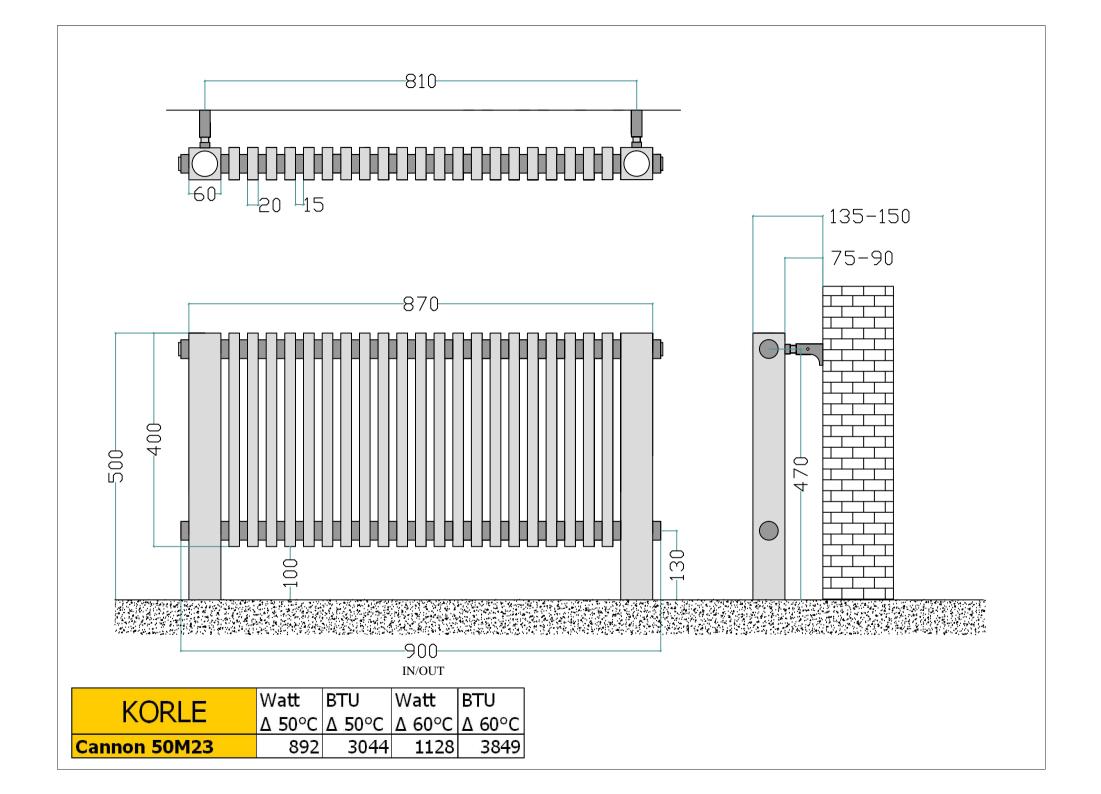


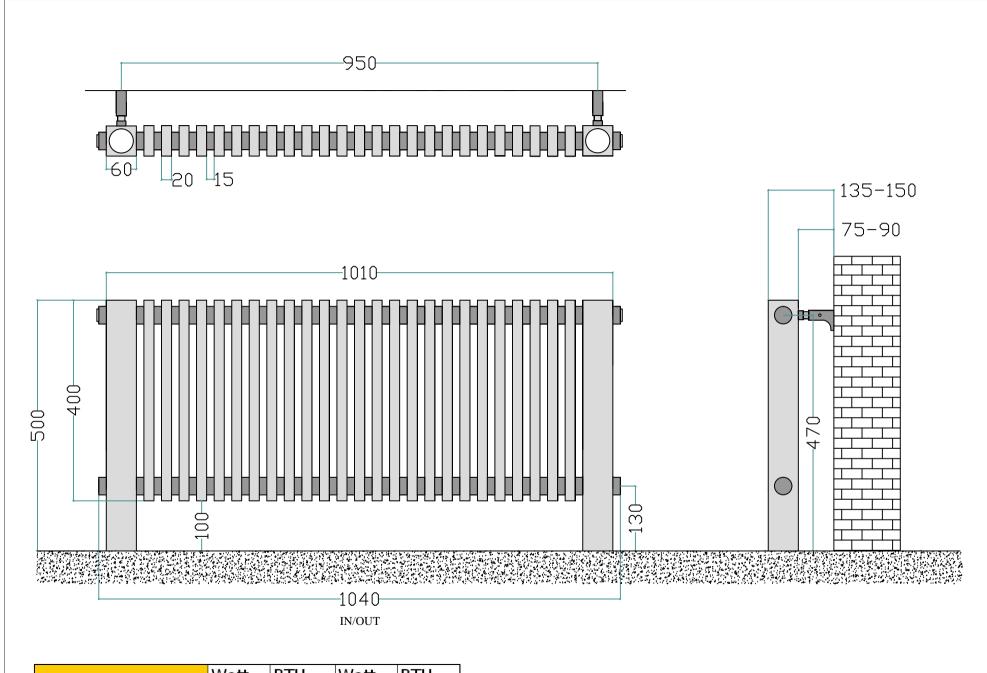



KORI F	Watt	BTU	Watt	BTU
NORLE	Δ 50°C	∆ 50°C	Δ 60°C	Δ 60°C
Cannon 50M27	1030	3517	1303	4447

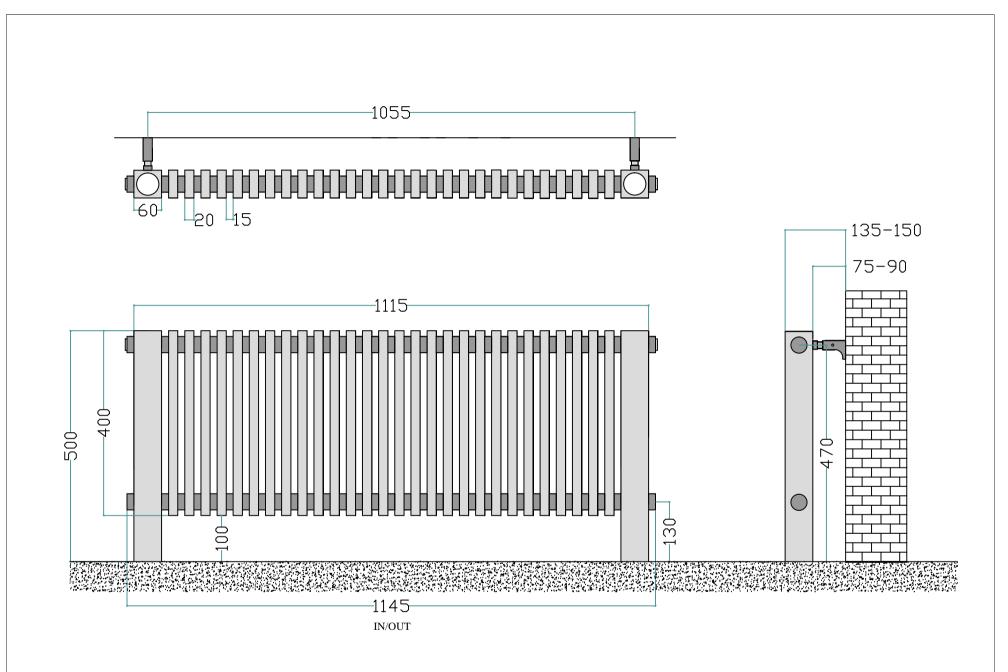


KORI F	Watt	BTU	Watt	BTU
KUKLE	∆ 50°C	∆ 50°C	Δ 60°C	∆ 60°C
Cannon 50M30	1134	3872	1434	4897

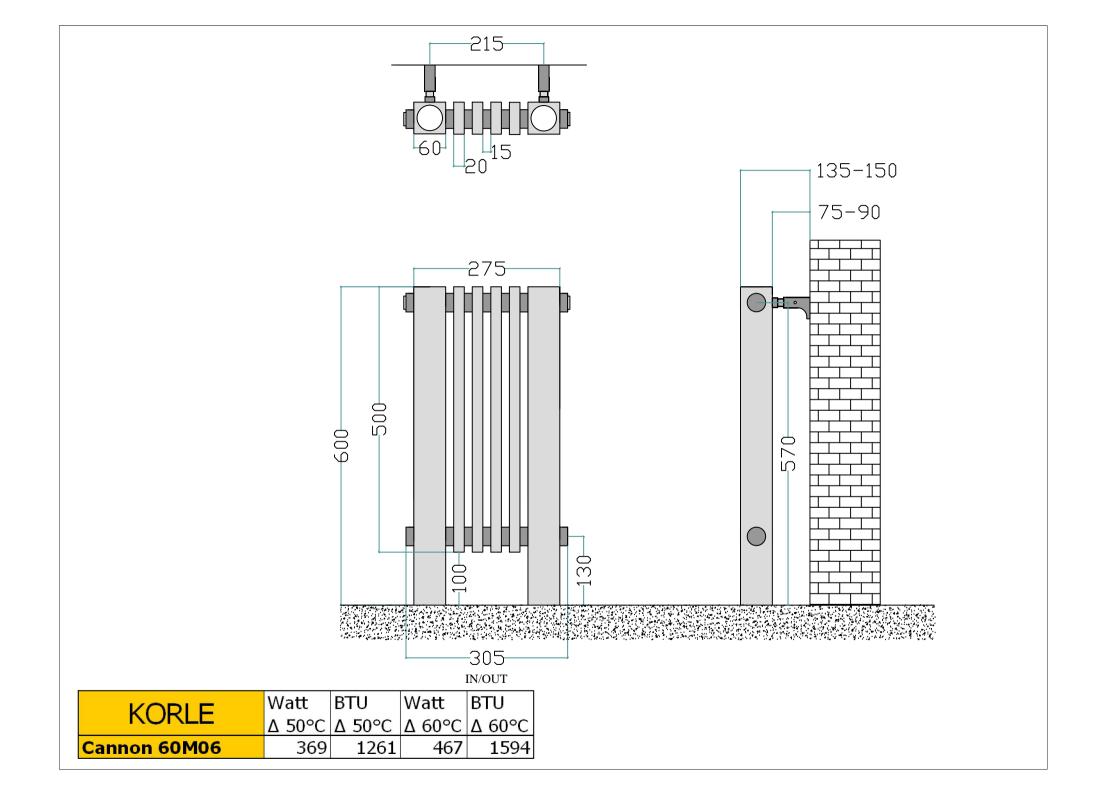

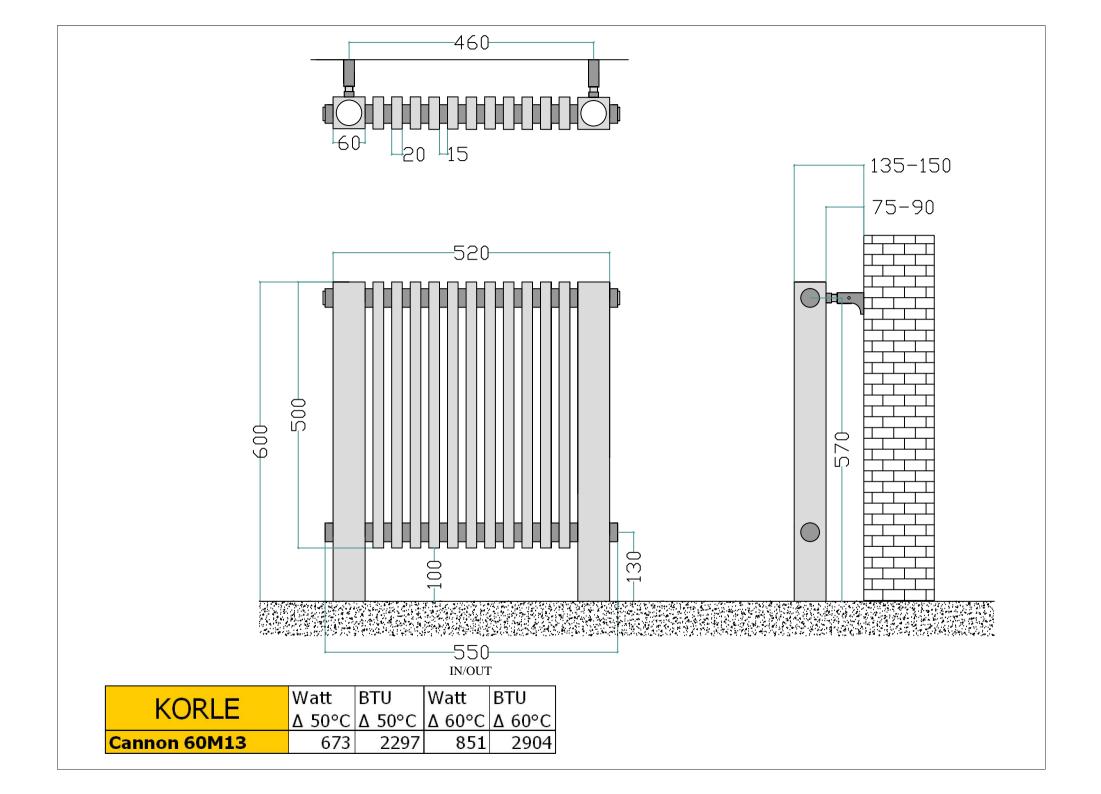


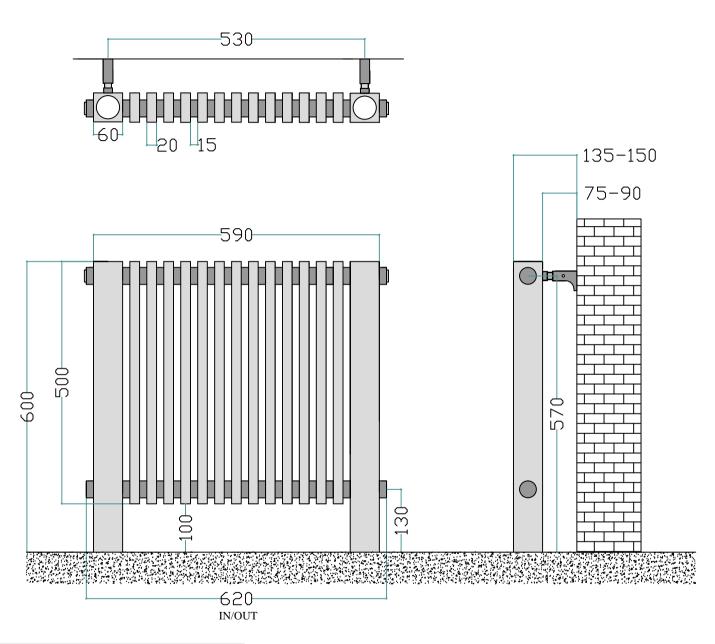



KORI F	Watt	BTU	Watt	BTU
KUKLE	Δ 50°C	Δ 50°C	Δ 60°C	Δ 60°C
Cannon 60M15	760	2593	961	3278

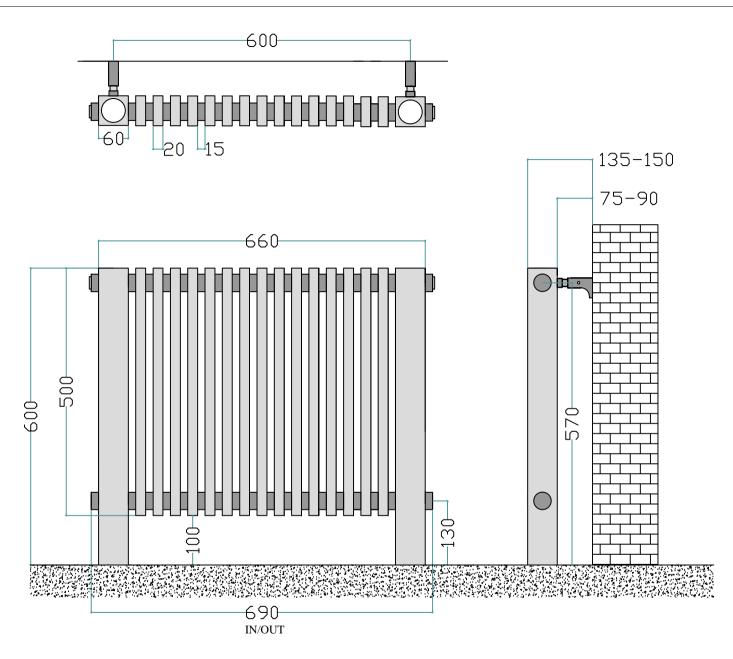


	Watt	BTU	Watt	BTU
	Δ 50°C	∆ 50°C	Δ 60°C	Δ 60°C
Cannon 60M17	846	2889	1070	3653

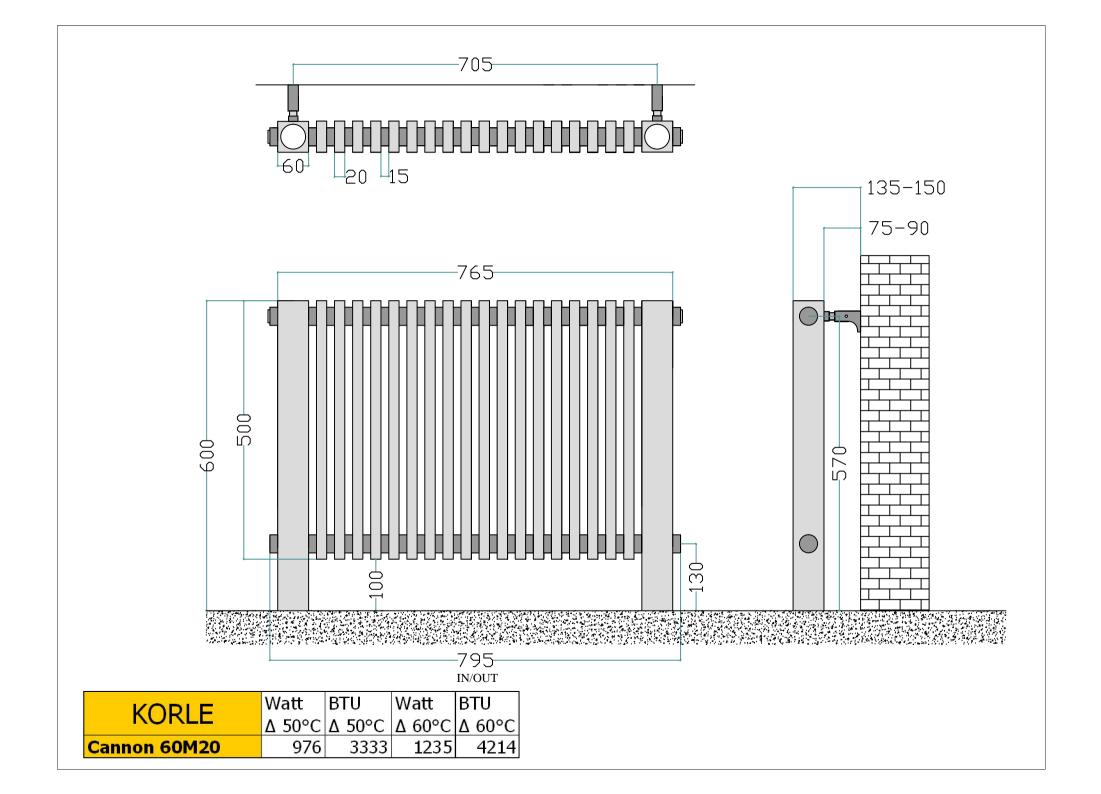

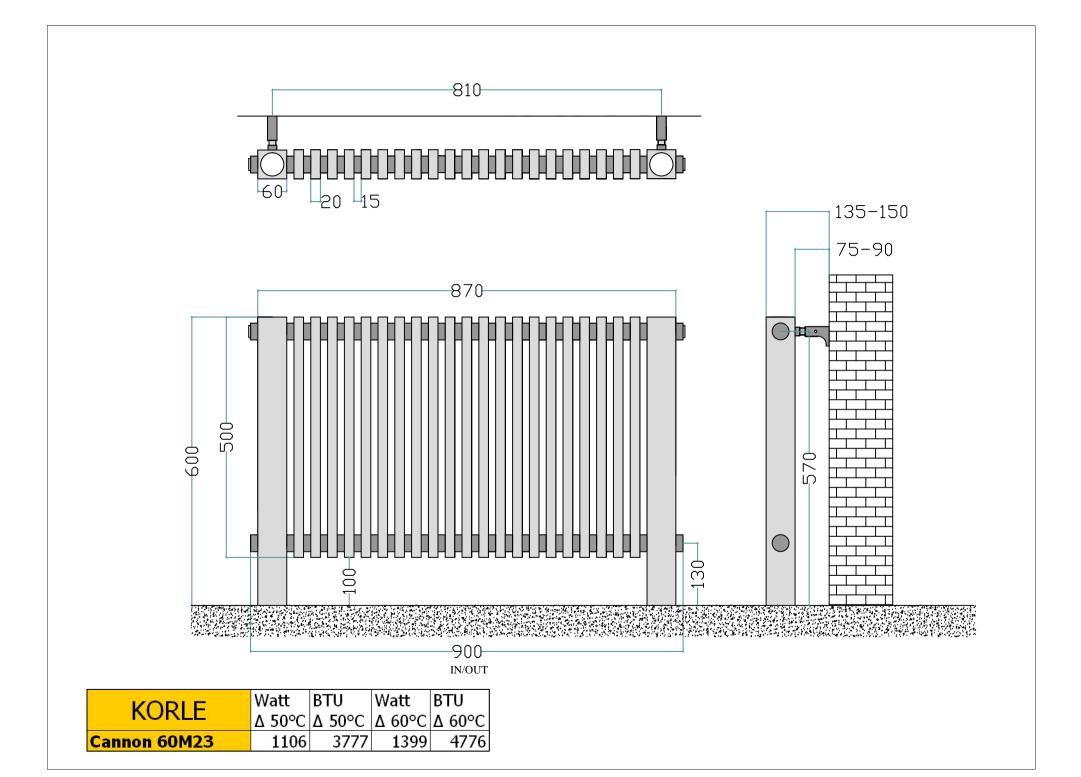


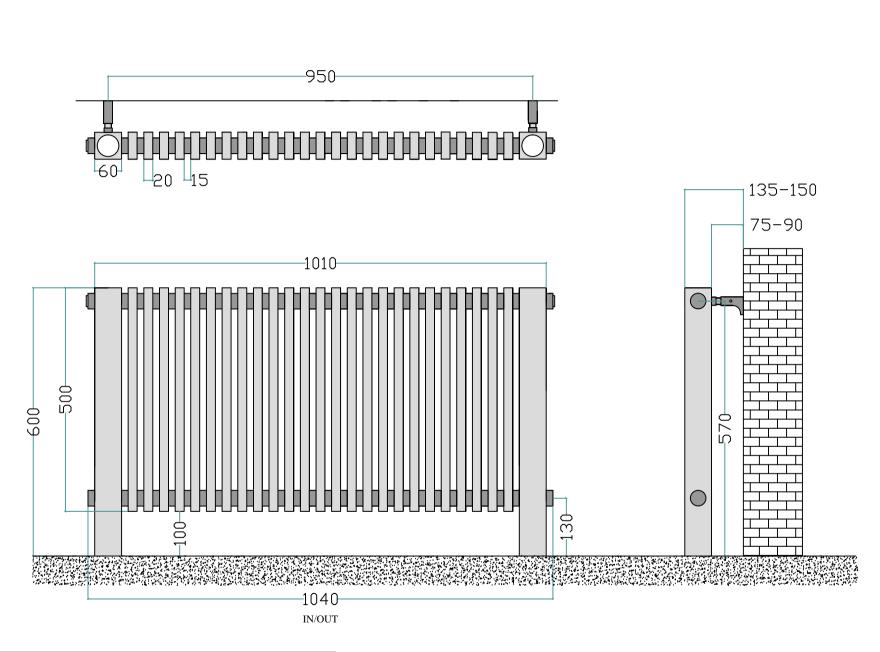


K () D I F	Watt	BTU	Watt	BTU
	∆ 50°C	∆ 50°C	∆ 60°C	Δ 60°C
Cannon 60M27	1280	4369	1618	5524

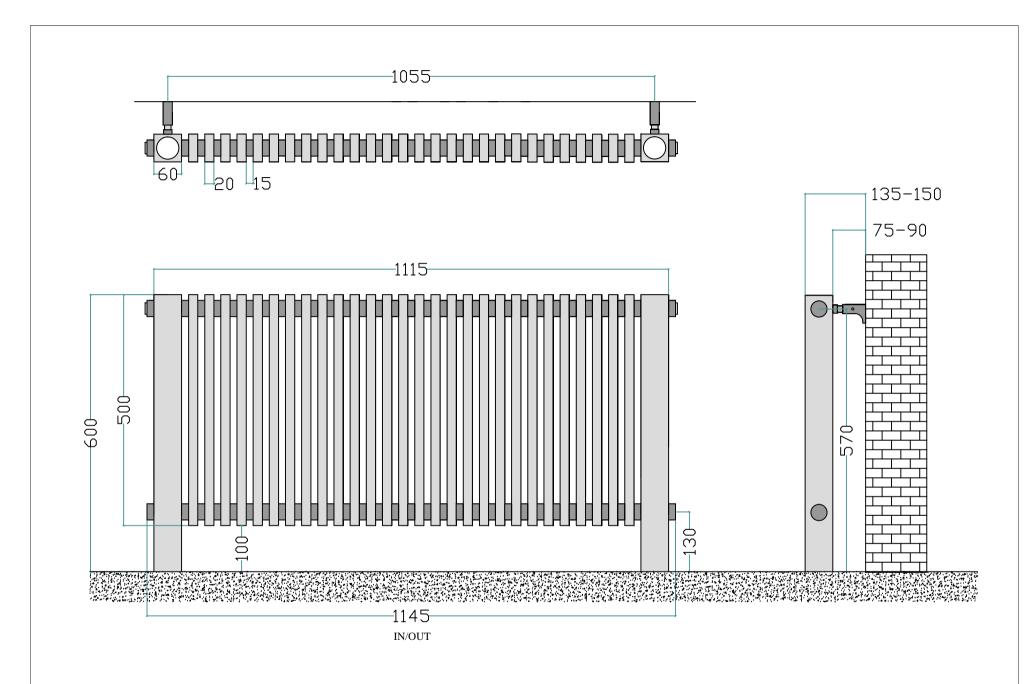


KORLE		BTU Δ 50°C		BTU Δ 60°C
Cannon 60M30	1410	4813	1783	6086

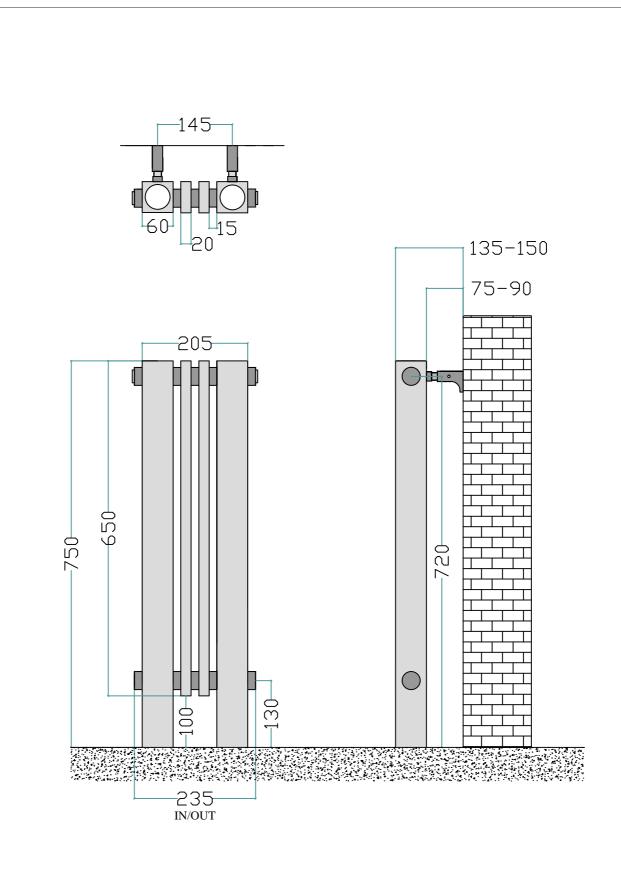



KORLE		BTU Δ 50°C	Watt ∆ 60°C	
Cannon 75M04	358	1221	452	154 3

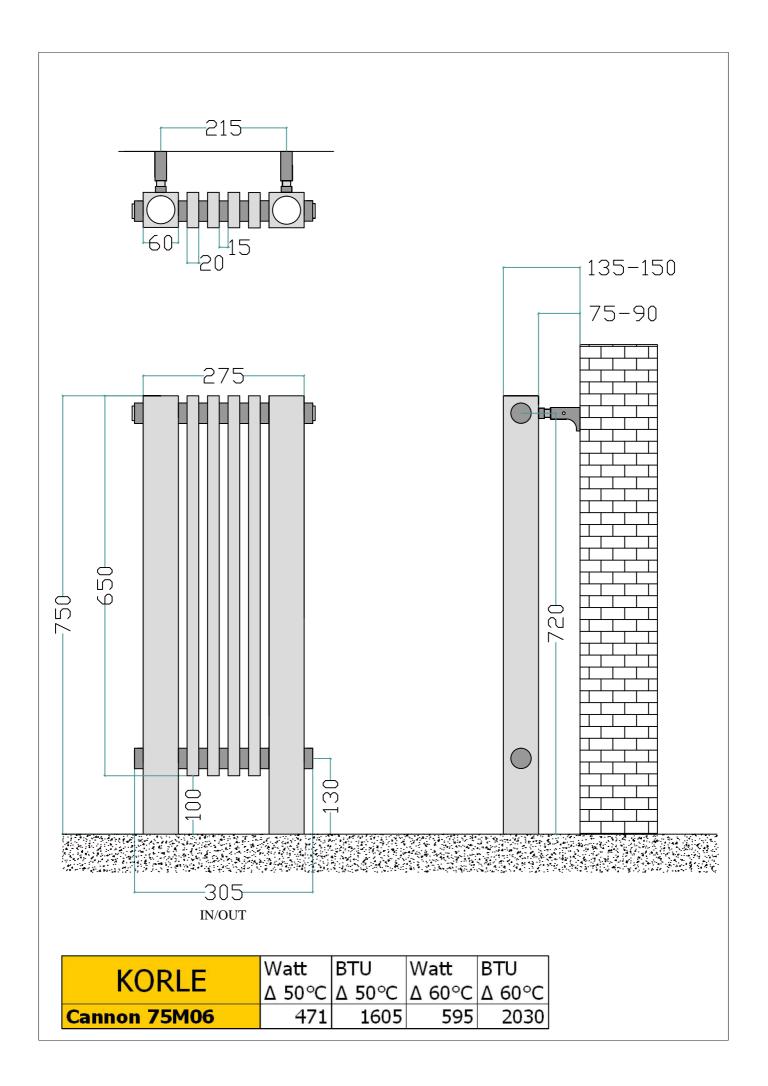

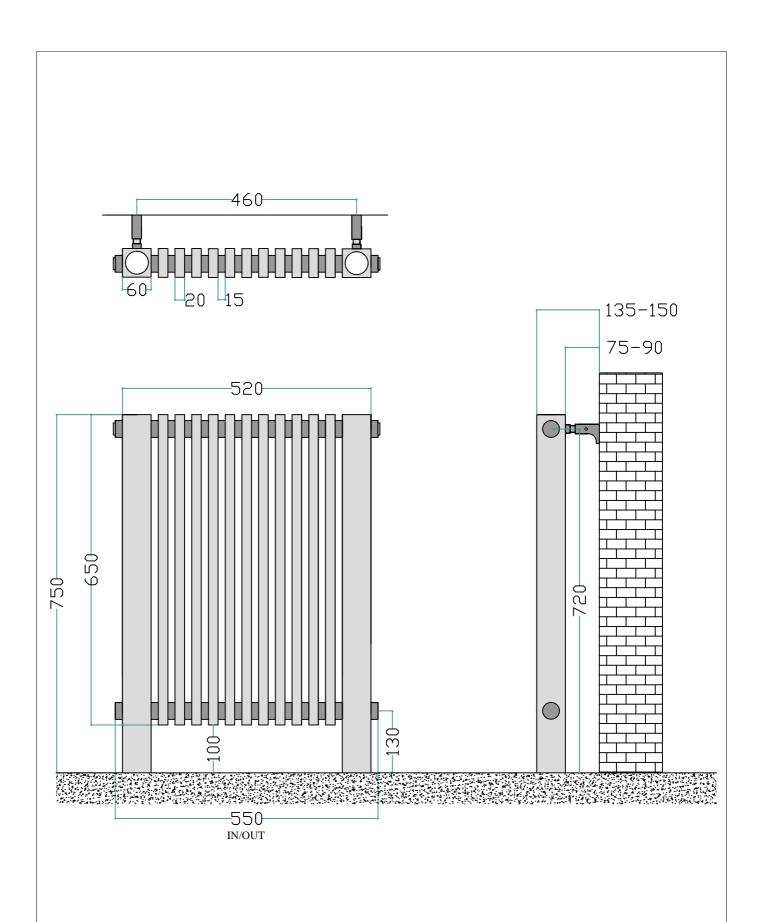



KORLE	Watt	BTU	Watt	BTU
	∆ 50°C	∆ 50°C	Δ 60°C	Δ 60°C
Cannon 75M13	865	2952	1094	3733

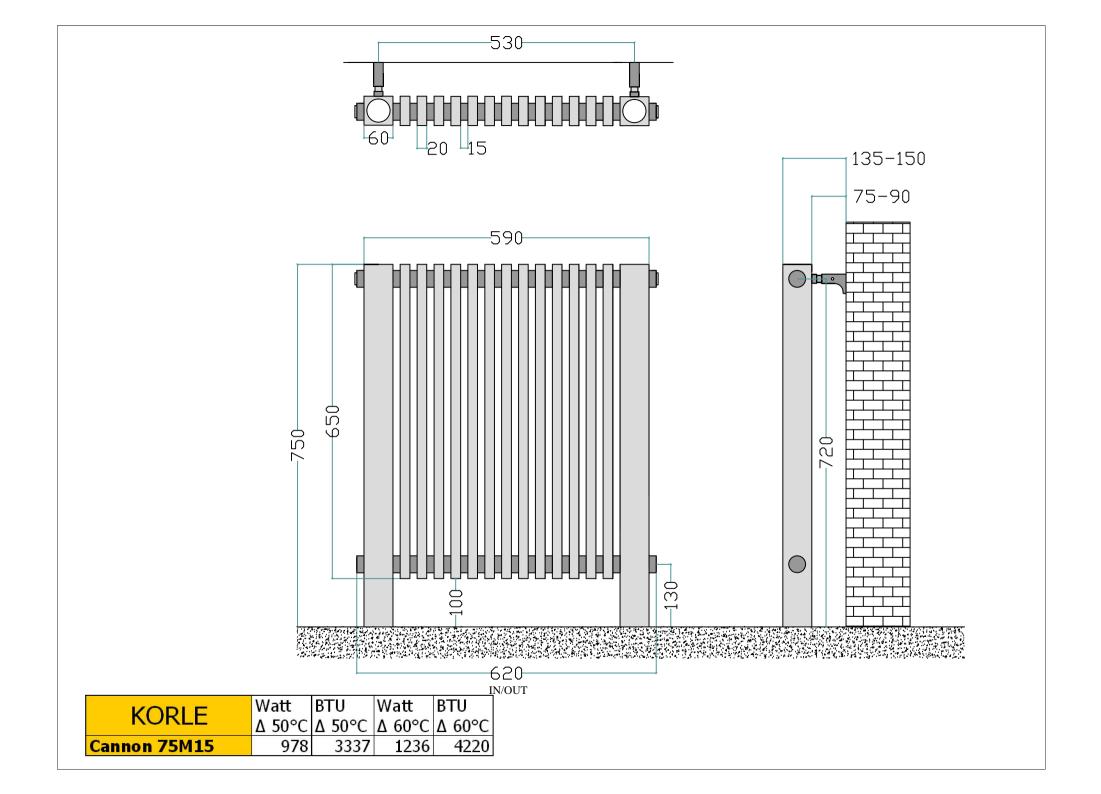


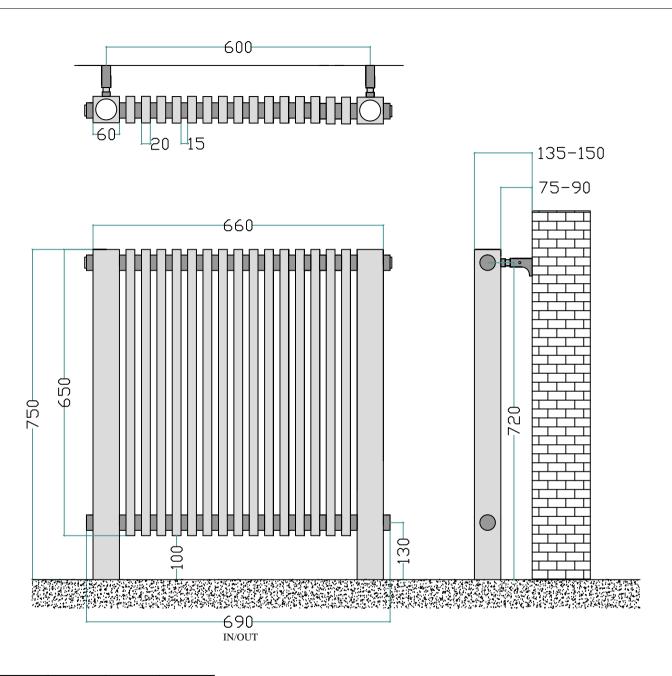


KORLE	Watt	BTU	Watt	BTU
	∆ 50°C	∆ 50°C	∆ 60°C	∆ 60°C
Cannon 75M17	1090	3722	1379	4706

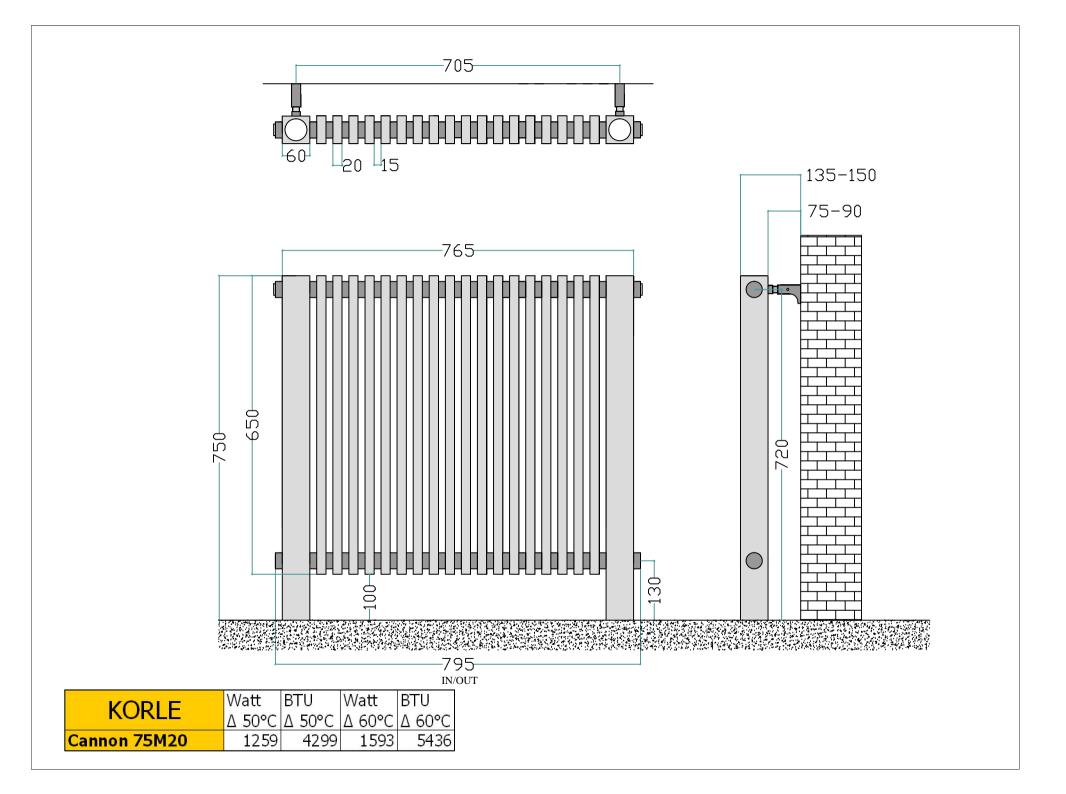

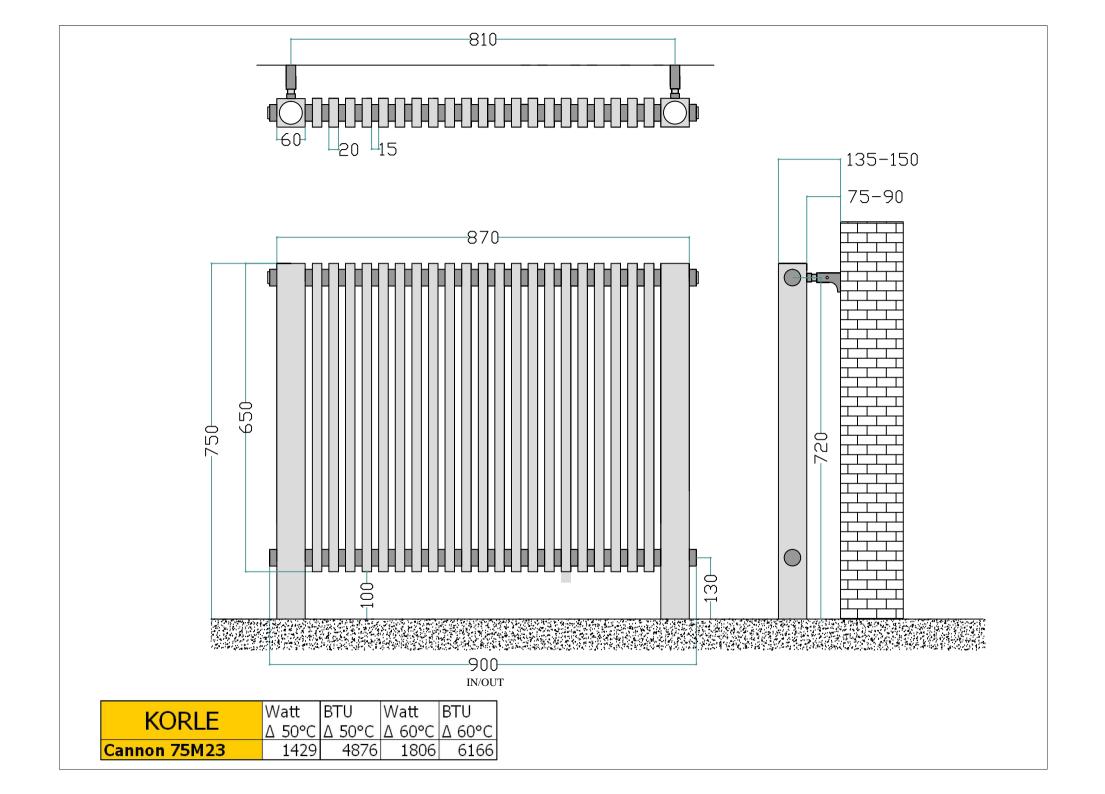

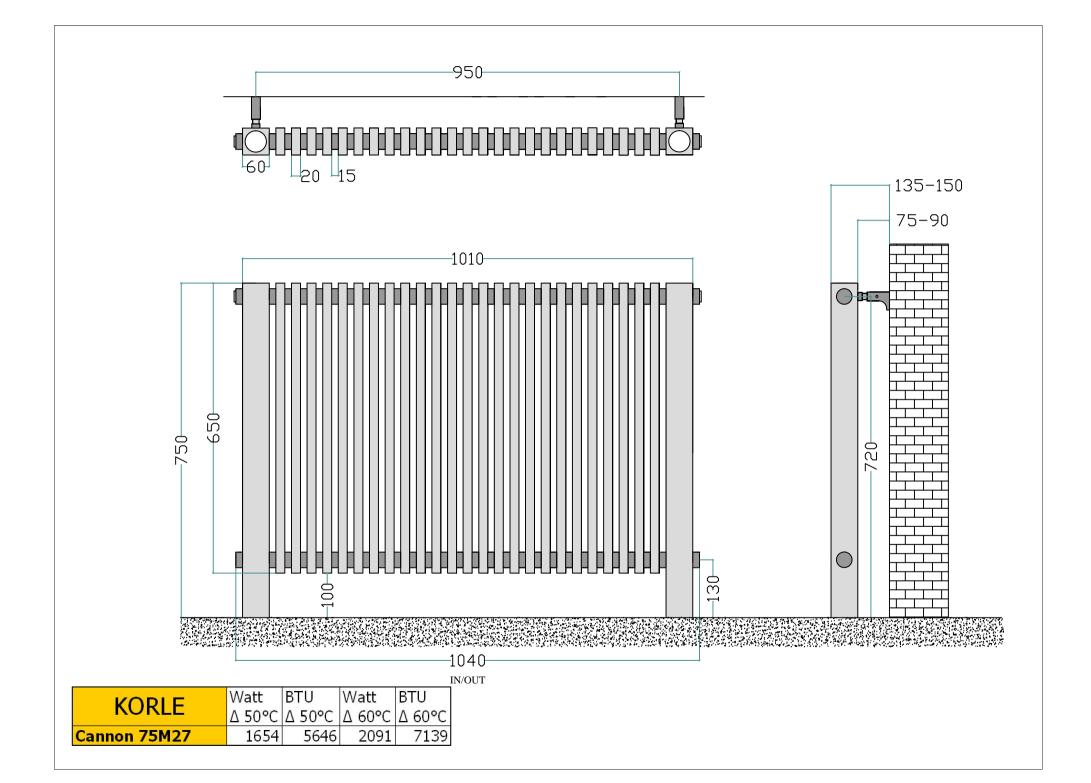

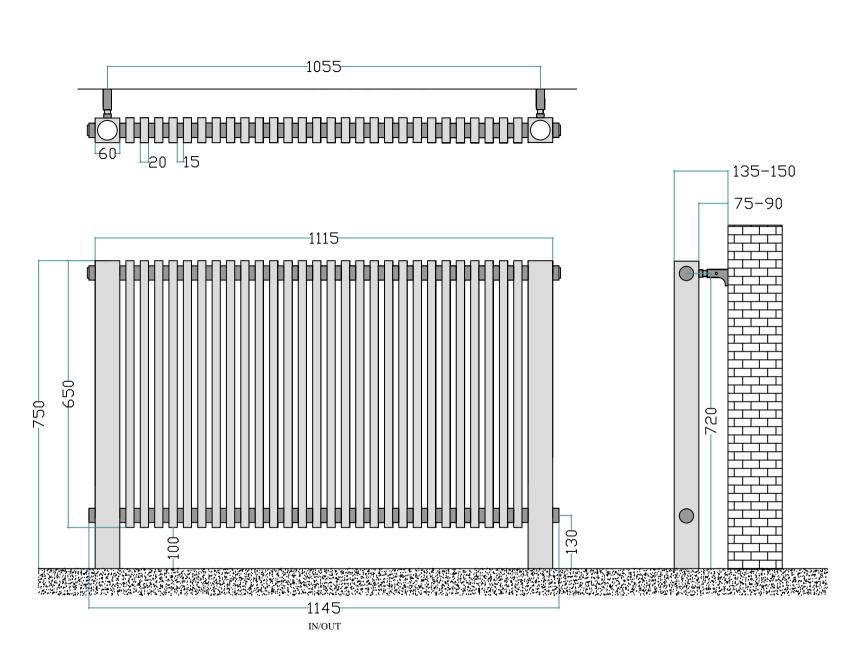

KORLE	Watt	BTU	Watt	BTU
	∆ 50°C	∆ 50°C	Δ 60°C	∆ 60°C
Cannon 75M30	1823	6223	2305	7869