





According to VDI 6022

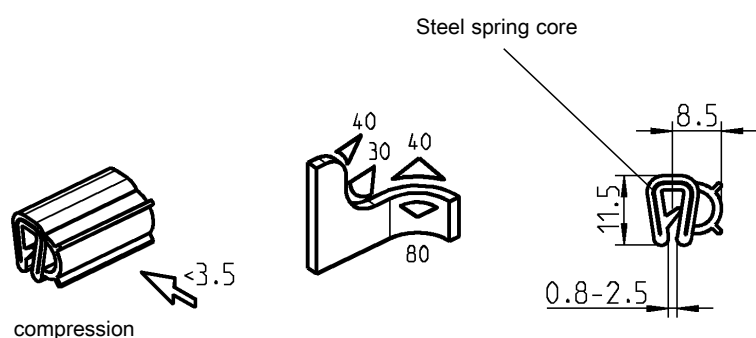

Hollow section (EPDM) black  $45^\circ \pm 5$  Shore A  
Clamping profile (EPDM) black  $60^\circ \pm 5$  Shore A

1011-09-09

According to VDI 6022

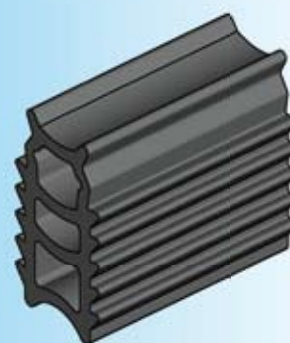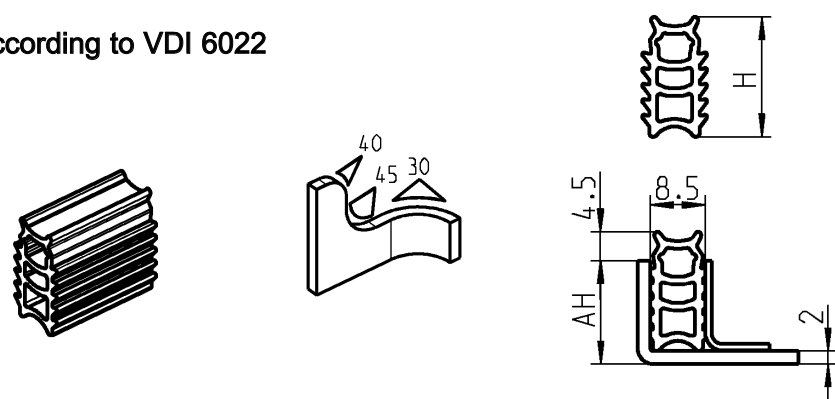

4 lip gasket (EPDM) black  $45^\circ \pm 5$  Shore A

AH	Height H	
16	18,5	1003-11-N9
18	20,5	1003-12-N9

### Information on VDI Guideline 6022:

#### Hygienic standards for ventilation and air-conditioning systems

In guideline 6022 issued by "Verein Deutscher Ingenieure" (VDI) – Association of German Engineers – you can find a description of the minimum hygienic standards for ventilation and air conditioning systems. The guideline formulates requirements that have to be observed for planning, installation, operation and maintenance of ventilation and air-conditioning systems in order to guarantee absolute faultless hygienic condition of the systems as well as the outside air inlets for the air-conditioned premises.

VDI guideline 6022 is valid for the domain of builders, architects, engineers, ventilation planners, manufacturers of air-conditioning systems, machine builders, authorising bodies, operators, service companies, stakeholders of room users (e.g. staff associations or committees as well as company physicians and public health officers).

In line with the latest technical development and scientific knowledge, this guideline is intended to guarantee a precise operation and condition of ventilation and air-conditioning systems by means of preventive technical provisions.