


## RUTLAND RADIATORS – BATHROOM ZONING

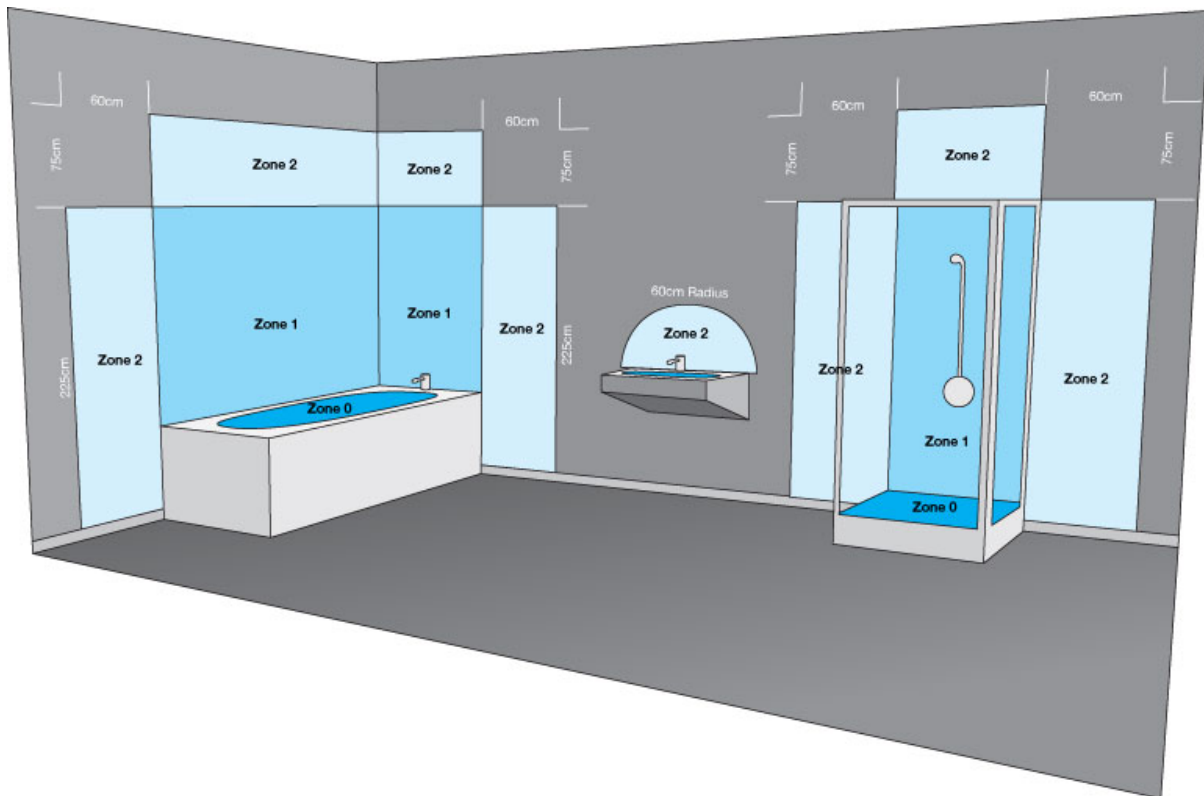

### Location of electrical equipment in bathrooms:

Bathrooms are divided into zones. Each zone is dependant on it's location in regards to areas of water such as baths, showers and sinks. Zones should be adhered to to avoid serious injury or death.

#### **Zone 0:**

This is within the bath or shower tray itself. No Rutland Radiator products should be fitted in this area.

#### **Zone 1:**

This is the area directly above the bath and shower tray to a height of 2.25m. We strongly advise against fitting any products in this area for both your safety and product longevity.

#### **Zone 2:**

The area stretching 60cm from Zone 1 and within a 60cm radius of the top of the sink. Our towel warmers and radiators can be fitted in this area.

#### **Zone 3:**

The area outside zones 1 and 2. Our full range of towel rails and radiators can be fitted in this Zone.

The above diagram is only a guide. Please refer to I.E.E. Wiring Regulations (BS 7671:2008) for detailed information.

**Please Note:** The Queensgate Control Panel is IP65 rated and can be fitted in Zones 2 and 3.

Rutland London Limited: E: [sales@rutland-radiators.co.uk](mailto:sales@rutland-radiators.co.uk) Tel: 01252 790 464

[www.rutland-radiators.co.uk](http://www.rutland-radiators.co.uk)

Rutland Radiators reserves the right to alter finishes and dimensions without prior notification.

All products should only be fitted by competent and experienced professionals.