

KT0016VCSB-ASTM

General Description

- Kit to recess the BabyMedi vertical baby changing station to the wall.
- This kit to recess the BabyMedi vertical baby changing station allows the changing table to be completely flush with the wall once it is closed, not taking up unnecessary space and thus allowing the creation of more open spaces free of obstacles.
- Possibility of combining finishes between the kit for recess and the baby changing station.
- Maximum robustness and vandal-proof design.
- Excellent integration and aesthetic level

Components & Materials

- KT0016VCSB-ASTM: kit for recessing into the wall the BabyMedi baby changing stations CP0016VCS-ASTM or CP0016VCSB-ASTM by Mediclinics. Made of AISI 304 steel with a matte black finish.
- **WALL BOX:** Made of 21 Ga. (1/16" or 0.86mm thick) AISI 304 stainless steel with a matte black finish with four(4) 5/16" (8mm) diameter predrilled side holes for installing the recess wall box into the framed wall opening.
- **FRAME:** Integrated into the stainless wall box and also made of 21 Ga. (1/16" or 0.86mm thick) AISI 304 steel with a matte black finish.
- **MOUNTING HARDWARE: (INCLUDED)** Four(4) 1/4" x 3 1/8" (6mm x 80mm) stainless steel wood screws to attach the stainless Recess Kit to the wood studs. Plus six(6) M6 x 16mm stainless steel machine screws to attach the baby changing station (not included) to the installed recess kit. (Fasteners required for installation of the recess kit into a substrate other than wood studs may be needed but are not provided.)

Technical Specifications

Recess Kit Dimensions (Overall)	25-5/8" W x 40-1/2" H x 4-1/2" D (650mm x 1030mm x 115mm)
Rough Wall Opening Dimensions	24-1/4" W x 38-3/4" H x 4-5/16" D (615mm x 985mm x 110mm)
Thickness of Recess Kit Wall Box	21 GAUGE (1/16" or 0.86mm)
Thickness of Recess Kit Frame	21 GAUGE (1/16" or 0.86mm)
Net Weight (Unboxed)	40.6 lbs (18.41kgs)

MOUNTING

Set the stainless steel recess kit into the framed rough wall opening and affix using the four provided 1/4" x 3-1/8" (6mm x 80mm) stainless wood screws through the four predrilled holes in the sides of the recess kit (for wood studs only). More suitable fasteners may be necessary for wall substrates that are not wood. These alternative fasteners are not provided. Follow all of the step-by-step mounting instructions found in the "Installation and Assembly Manual" provided with the recess kit.

When installing the recessed kit, keep in mind that the bottom of the changing table must be at a height of approximately 31-1/2" (80cm) from the ground.

Warning: Before installation please refer to the supplied installation manual as to ensure the unit will function properly and safely, it must be installed in accordance with these instructions.



code


KT0016VCSB-ASTM

material

AISI 304 steel

finish

matte black

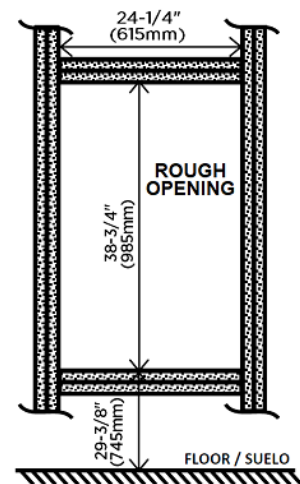

Recommended framing:

Prepare wall opening using double stud and according to the picture measurements
Min opening depth: **4-5/16" (110mm)**

Installation

According to the installation and safety instructions manual supplied with the unit.

IMPORTANT: in order to ensure recessed BabyMedi is properly installed it is recommended that a qualified person carries out the installation of the unit. The unit must be properly installed on a wall that is able to sustain a considerable weight and can accommodate the supplied installation hardware.

Ideal location

Public spaces such as, shopping centers, airports, public buildings, childcare centers, etc. Models suitable for high traffic facilities with high strength and durability.

IMPORTANT: the Congress of the United has taken a further step towards gender equality by implementing law 114-235 (10/07/2016). By this law, the American Government states that restrooms, both for men and women, in public buildings all around the country, must have diaper changing facilities in place.

Guide specification

Kit to recess the BabyMedi vertical baby changing station to the wall.

This kit to recess the BabyMedi horizontal baby changing station allows the changing table to be completely flush with the wall once it is closed, not taking up unnecessary space and thus allowing the creation of more open spaces free of obstacles.

Possibility of combining finishes between the kit for recess and the baby changing station.

Maximum robustness and vandal-proof design.

Excellent integration and aesthetic level.


Overall Dimensions (Recess Kit Only):

25-5/8" W x 40-1/2" H x 4-1/2" D (650mm x 1030mm x 115mm)

Net Weight:KT0016VCSB-ASTM - 40.6 lbs. (18.41kgs)

DIMENSIONS

KT0016VCSB-ASTM

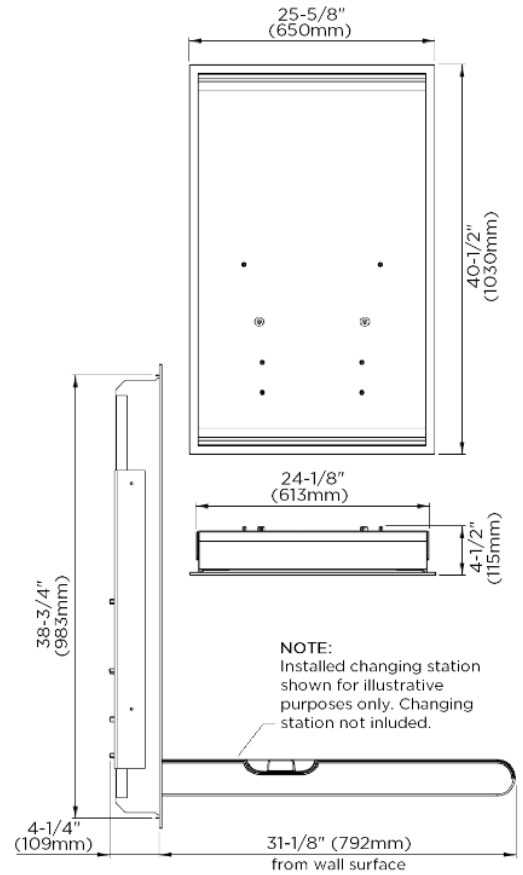

Job:

Architect / Engineer:

City / State / Country:

Model number:

Contractor:

Date:

Variations:

Customer / Wholesaler:

Quantity:

Saniflow Corp reserves the right to make changes and/or modifications to the products and their specifications without warning or notice.

Allied Hand Dryer, Ltd.
706 W Summit Ave
San Antonio, TX 78212

800.535.4393
210.733.5918
210.308.5924 Fax

www.handdryer.com
sales@handdryer.com