



SITE SURVEY SELF ASSESSMENT

SIP Screw Compressor Guidelines

Version 7 Dated 10/01/2022

Section A:- Details. (To be **FULLY** completed by the **SIP Sales Department**).

SIP SALES ORDER REFERENCE	
DISTRIBUTOR ACCOUNT NUMBER	
CUSTOMER NAME	
CUSTOMER ADDRESS	
MODEL	
DATE OF PURCHASE	

Section B Electrical Supply Requirement. (Please tick option 1, 2, 3 or 4)

1	4kw & 5.5kw Screw compressors require a 400v, 3 phase, 20A fused supply with "D" type MCB's.	
2	7.5 / 8kw Screw Compressors require 400v, 3 phase, 32A fused supply with "D" type MCB's.	
3	11kw & 15 Kw Screw compressors require a 400v, 3 phase, 40A fused supply, with "D" type MCB.	
4	22 Kw Screw compressors require a 400v, 3 phase, 63A fused supply, with "D" type MCB.	

By ticking the box you agree that this will be the minimum supply you will provide.

All 8kw, 11kw, 15kw & 22kw Screw compressors are supplied without mains input cable.

Models fitted with a dryer require an additional 230v supply.

All current National Electrical Installation standard should be adhered to.

For cable sizes refer to the instruction manual.

The use of Phase Converters / Inverters is not recommended or any other none Standard Mains Electricity configurations, all of which are NOT covered by our Warranty Conditions.

Section C: Environmental Factors

The area MUST be free of airborne contaminates (i.e. dust, abrasive particles, moisture or gases)
The area of installation MUST be adequately protected from the environment
The area of installation MUST be well ventilated.
Ensure that temperature of the working environment ranges between +2 and + 45 °C. Compressor working temperature shall range between 70 - 85°C (20-25°C room temperature). Lower temperatures may causes condensate accumulation inside the oil separator tank (inside the compressor).

SITE SURVEY SELF ASSESSMENT


SIP Screw Compressor Guidelines

Location Details.

ROOM: The dimensions of the space for the screw compressor shown are only indicative, but it is advisable to follow them as closely as possible.

Access to the rear of the compressor is required for servicing, 50cm is the minimum but 80 - 100cm's is preferable.

Condensate should be collected either into a pit or a tank

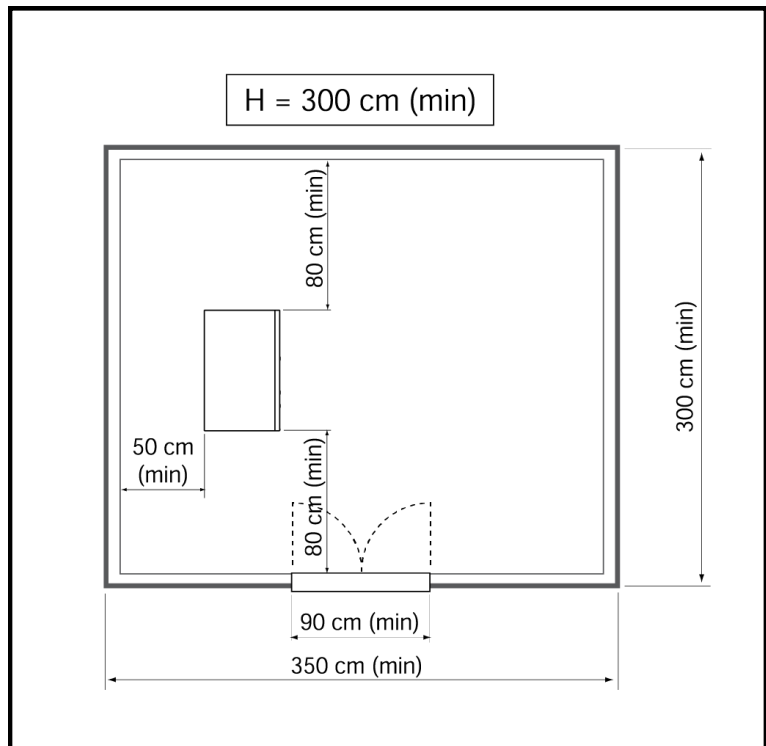

ADDITIONAL NOTES:

* Pipework installations, filter equipment and ALL other ancillary equipment is the responsibility of the user. Any ancillary equipment fitted / supplied incorrectly or omitted is the responsibility of the user. No consequential action will be accepted by SIP under ANY circumstances.

* Screw compressor airends (pump) need to be run for a minimum of 80 hours a month; should the screw compressor not be used for a month or more please contact our After Sales Team for advice.

* Any compressor sited in an unsafe area of access i.e. in roof space, will not be serviced, maintained, repaired or warranted until moved to a safe working environment.

* You will have to provide a fork lift truck or similar when the compressor is delivered.

* This compressor is covered by a 2 year warranty. The compressor must have a paid service after year 1 to qualify.

If this compressor is being purchased for stock please tick the box (you must provide a completed form as soon as you sell the compressor or warranty claims shall be void)

By signing this survey you confirm that the distributor has discussed the suitability of the compressor with you including air consumption assessments, location, electrical installation and environmental conditions.

You also agree to comply with the Environmental Factors as stated in **Section C**.

A miss-sold product is not covered by our warranty terms & conditions; if in doubt consult your distributor or the SIP Customer Service Department.

End User Signature:-

Name:-

Date:-