



1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17


L
K
J
I
H
G
F
E
D
C
B
A




YES

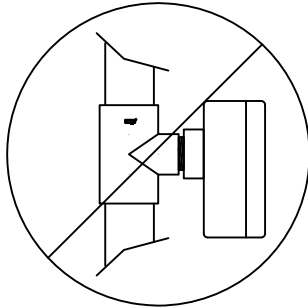


DO NOT
MOUNT
VERTICALLY

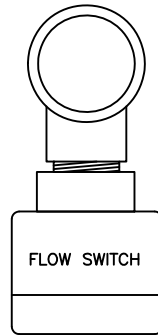


NO

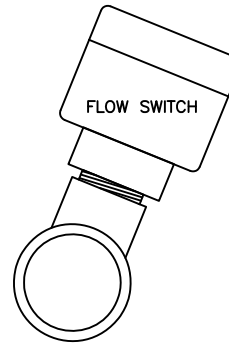

NO

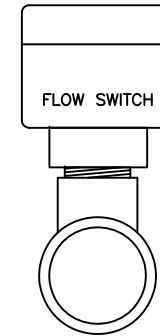


YES

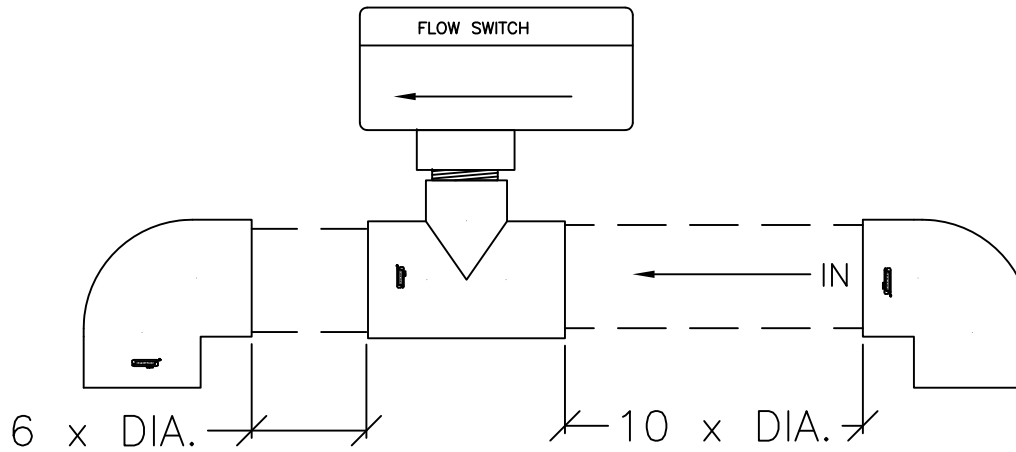

INSTALLATION NOTE:

"FLOW CONTROL" FLOW SWITCH AND TEE FITTING IS FIELD INSTALLED ON TOP OF A HORIZONTAL STRAIGHT PIPE WITH NO LESS THAN 10 TIMES THE DIAMETER OF STRAIGHT ON THE INLET SIDE AND NO LESS THAN 6 TIMES THE DIAMETER ON THE OUTLET SIDE

TITLE	FLOW SWITCH PLUMBING NOTE	PROJECT	FLOW SWITCH	FILE	C:\AutoCad Files\Controls\3in Flow Switch Plumbing Note 4-24-13.dwg	DRAWING NO	FS-01	EDITED	11/13/2015	SCALE	1:1	 AQUA LOGIC, INC 9558 CAMINO RUIZ, SAN DIEGO, CA 92126
		CLIENT	AQUA LOGIC INC		DRAWN BY	CEPPS	CREATED	4/24/2013	PAGE	1 of 1		