

## Technical Specifications

Materials	Aluminium
Connections	½" flow and return.
Test pressure	24 Bar
Testing authority	EN442
Maximum operating pressure	16 Bar
Maximum working temperature	90 °C
Packaging	Polystyrene protection in cardboard box

**PLEASE NOTE:** To reduce the possibility of noise caused by rapid heating and cooling of aluminium radiators; adequate capacity for expansion must be provided within the overall heating system. Systems using micro bore pipework must have adequate pressure and flow rates for the number and style of radiators on the system.

## Terms & Conditions

All products must be inspected once removed from the packaging and The Radiator Company notified within 28 days of delivery of any scratches, blemishes or other damage. The Radiator Company will then replace the radiator.

Imperfect radiators should therefore not be fitted and The Radiator Company will not accept responsibility for replacement of scratched or damaged radiators once they have been fitted. This includes any consequential loss or cost of fitting.

If The Radiator Company are not notified within 28 days of the date on the signed delivery note then it will be deemed that The Radiator Company have fully complied with its obligations and claims will not be considered.

Failure to comply with any of the above may invalidate any claims.

We recommend that after you check the product on delivery that it is stored in its packaging to prevent damage prior to installation. The Radiator Company cannot accept responsibility for items damaged after delivery.

## Guarantees & Liabilities

As we are not the manufacturers of this product we will take all reasonable endeavours to make over to you the benefit of any warranty or guarantee given by the manufacturer, which is usually five years on most of our range. (Copies of specific guarantees for any of our products are available on request).

The guarantees in all cases are subject to the products being installed in accordance with British and or European standards as well as these fitting instructions. The guarantees in all cases are restricted to the free of charge replacement or repair of the failed product only. Our liability will under no circumstances extend beyond the repair or replacement of the product supplied by us. Claims for either labour in replacement or damage to property are not admissible. Any goods that are returned, in the event of a problem, will belong to The Radiator Company.

## Fittings Instructions




Please read these instructions and terms and conditions carefully prior to installation. Failure to do so may invalidate the warranty

The Radiator Company  
Units 13 - 14 Charlwoods Road  
East Grinstead  
West Sussex  
RH19 2HU



EXT\_IR\_1.0

## Diagrams of Extro

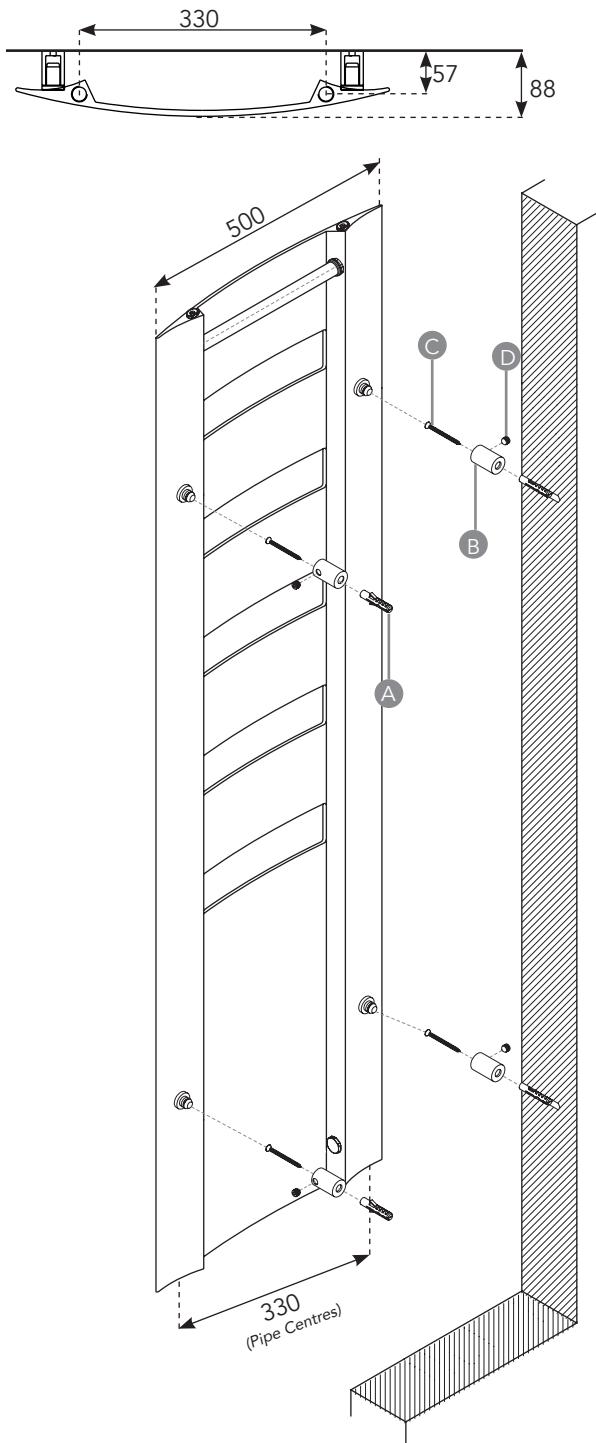


## Pipe Centres

Pipe centres left to right	330mm
Pipe centres from wall	57mm
Depth from wall	88mm

## 1 Unpack & Inspect

The Radiator Company prides itself on selecting products from manufacturers who exercise tight quality control measures. We only select models with excellent standards of welding and brazing, as well as high quality finishes. All of our products are well packaged and should reach you in perfect condition. Just in case however, we offer a minimum 5-year no quibble guarantee for all radiators and towel rails.



The Radiator Company must be notified of any shortages or damage within 28 days of delivery. For further information please see terms and conditions on back page.

## 2 Contents

You should have:

- 1 Radiator
- 4 Bracket Sleeves
- 4 Screws
- 4 Wall Plugs
- 4 Grub screws

You will need:


- Flat-head & cross-head Screwdriver
- Tape Measure
- Electric Drill
- 2.5mm Allen Key
- Spirit Level

**Please Note:** The supplied wall plugs and screws may not be suitable for your wall type. Please ensure appropriate fittings are used dependant on your wall type.

## 3 Installing the Extro

Please refer to the drawings opposite when fitting.

1. Offer up the radiator to the wall and mark out the positions of the top two brackets onto the wall.
2. Using suitable drill bits and plugs 'A' (or other depending on wall type) hang the bracket sleeves 'B' by inserting the provided screws 'C' through the centre of the bracket sleeve 'B' into the wall plugs.
3. Hold up the radiator to ensure the positions are correct, if they are mark out the positions on the wall for the bottom two brackets.
4. Repeat step 2 for the bottom brackets.
5. With all the bracket positions checked, and bracket sleeves 'B' hung, hang the radiator by slotting the bracket studs (already fixed) into the bracket sleeves. To secure, insert the provided Grub Screws 'D' into the side of the bracket sleeves, and tighten using an Allen Key.



### PLEASE NOTE :

It is essential that all brackets are level to ensure a vertical alignment for connecting the pipework.

## 4 Commission

The airvents and blanking plugs are already fixed to the radiator and are suitable for the standard underneath connections.

### Please Note:

In accordance with Part L1 2006 of the Building Regulations and BS7593:1992 code of practice for the treatment of hot water and central heating systems, we strongly recommend flushing the heating system post installation of new radiators and then adding the correct quantity and type of inhibitor for use with your radiator and system to prevent corrosion. Damage caused to systems not protected by a suitable inhibitor will not be covered by manufacturer's guarantee.