

Number: GZHT02739561

Report Ref:	GZHT02739561	HT02739561	
Date Received:	May 15, 2023	Date Issued:	May 16, 2023

Company Name: MEDIFY AIR LLC Address: 150 E PALMETTO PARK RD, SUITE 301, BOCA RATON FL 33432, USA **Contact Name:** Hank Chang

The Following Sample Was Subr	Sample Was Submitted And Identified By/On Behalf Of The Applicant As:	
End Uses	: -	
Ratings	: -	
Sample Name	: Air purifier filter H14 media	
No. Of Sample	: One (8 Pieces)	
Size	: -	
Colour	Blue	
Standard	: -	
Style No.	: MA-40, MA-50-V3.0, MA-112, MA-112-Pro, MA-125, MA-1000, MA-1400	
Date received	May 15, 2023	
Test Started	: May 16, 2023	

Test was conducted on specific items, at our client's request.

Prepared And Checked By:

For Intertek Testing Services Shenzhen Ltd.Guangzhou Branch

James Ma

Textile lab Senior Manager


Page 1 Of 4

Ula / janesyjiang

www.intertek.com



Number: GZHT02739561

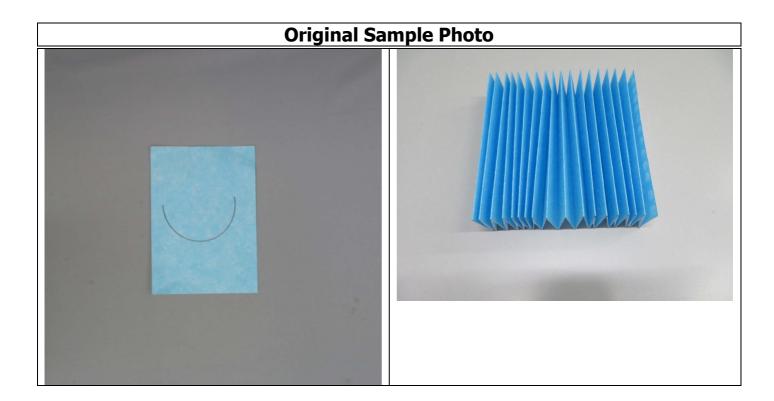

Prepared And Checked By:

For Intertek Testing Services Shenzhen Ltd.Guangzhou Branch

James Ma

Textile lab Senior Manager

Page 2 Of 4

Ula / janesyjiang

www.intertek.com



Number: GZHT02739561

Tests Conducted (As Requested By The Applicant)

Sub-micron Particulate Filtration Efficiency (ASTM F2100-21, Section 9.3, Testing Refer to ASTM F2299/F2299M -03 (2017))

1. Purpose

The purpose of this test method is to measure the initial particle filtration efficiency of materials using monodispersed aerosols containing suspended latex spheres particulates of 0.1µm diameter.

2. Test Method

ASTM F2299/F2299M -03 (2017)

3. Test Apparatus and Materials

- 3.1 Latex sphere particulates penetration efficiency test system
- 3.2 Suspension containing latex spheres particulates of 0.1µm diameter

4. Test Specimen

- 4.1 Minimum 5 specimens are required.
- 4.2 Precondition each material specimen at the test duct conditions at 30 to $50\pm5\%$ relative humidity and a temperature of $(21\pm3)^{\circ}$ C.

5. Procedure

- 5.1 Set main airflow, dilution airflow and aerosol generator airflow to test conditions
- 5.2 Establish airflow controls at test face velocity 5.33 cm/s. Purge main airflow for 10 to 15 minutes.
- 5.3 Warm-up optical particle counter (OPC) for 15 to 30 minutes.
- 5.4 Install the material specimen in the test system.
- 5.5 Sample and record the upstream and downstream aerosol counts for a minimum of five counts at each position using a 1-minute sampling time.
- 5.6 Average the upstream counts and the downstream counts, then calculate the decimal efficiency by the following definition:

Efficiency = 1 - penetration = 1- average downstream counts/average upstream counts.

Ula / janesyjiang

(10)



Number: GZHT02739561

Tests Conducted (As Requested By The Applicant)

Results:

Test Area:	100 cm ²
Aerosol Challenge:	0.1 µm latex spheres (neutralized)
Face Velocity:	5.33 cm/s
Laboratory Condition:	21.5℃, 36.8% Relative Humidity (RH)

Test Specimen Number	Filtration Efficiency (%)	Pass/Fail
1	99.99	-
2	99.99	-
3	99.99	-
4	99.99	-
5	99.99	-

End of Report

This report is made solely on the basis of your instructions and/or information and materials supplied by you. It is not intended to be a recommendation for any particular course of action. Intertek does not accept a duty of care or any other responsibility to any person other than the Client in respect of this report and only accepts liability to the Client insofar as is expressly contained in the terms and conditions governing Intertek's provision of services to you. Intertek makes no warranties or representations either express or implied with respect to this report save as provided for in those terms and conditions. We have aimed to conduct the Review on a diligent and careful basis and we do not accept any liability to you for any loss arising out of or in connection with this report, in contract, tort, by statute or otherwise, except in the event of our gross negligence or wilful misconduct. No copy of the test report(except for full text copy) shall be made without the written approval by Intertek.

Ula / janesyjiang

(10)

Below photos for reference only:

