



Manual

Version
February 2024



EPSILON 12V100Ah
EPSILON 12V150Ah



User Manual Epsilon 12V100Ah / 12V150Ah

Dear customer,

This manual contains all the information necessary to install, use and maintain the Li-ion battery. We kindly ask you to read this manual carefully before using the product. In this manual, the Super B Epsilon 12V100Ah/12V150Ah Li-ion battery will be referred to as: the Li-ion battery. This manual is meant for the installer and the user of the Li-ion battery. Only qualified, certified personnel may install and perform maintenance on the Li-ion battery. Please consult the index at the start of this manual to locate information relevant to you.

During the use of the product, user safety should always be ensured, so installers, users, service personnel and third parties can safely use the Li-ion battery.

Copyright© Super B All rights reserved. Licensed software products are owned by Super B or its subsidiaries or suppliers, and are protected by national copyright laws and international treaty provisions. Super B products are covered by Dutch and foreign patents, issued and pending. Information in this publication supersedes that in all previously published material. Specifications and price change privileges reserved. Super B is a registered trademark.

Table of content

1. Safety guidelines and measures	5
1.1. General	5
1.2. Disposal	5
2. Introduction	6
2.1. Product description	6
2.2. Intended use	6
2.3. Glossary of Terminology	7
2.4. Used symbols	7
3. Product specifications	7
3.1. Product features	7
3.2. Product specifications	8
3.2.1. Electrical specifications	8
3.2.2. Mechanical specifications	8
3.2.3. Charge & discharge specifications	9
3.2.4. Temperature specifications	9
3.2.5. Compliance specifications	10
3.2.6. General product specifications	10
3.3. Environmental conditions	10
3.4. Scope of delivery	11
3.5. Terminals and LED indicators	12
3.5.1. X1 / X2 Battery terminal interface	12
3.5.2. LED Indicators	13
3.6. Signal interfaces	14
3.6.1. J1 CAN	14
3.6.2. FASTON Connections	15
3.6.3. FASTON Connection electrical specifications	16
3.6.4. Bluetooth	16
3.6.5. Modes and states of the Li-ion battery	17
3.6.6. Operational mode: dependencies	18
3.7. Optional Components	19
4. Installation	19
4.1. General information	19
4.2. Unpacking	19
4.3. Placement of the Li-ion battery	19
4.4. Connection wires	19
4.4.1. Connecting power cables with automotive type terminals	20
4.4.2. Connecting power cables with cable lugs	21
4.4.3. Connecting small consumers to the terminals	22
4.5. Communication and FASTON connections	23
4.6. Connecting to the CAN interface	23

4.6.1.	Connecting the data cables	23
4.7.	Connecting to the LIN interface	24
4.7.1.	CI-BUS protocol	25
4.7.2.	Other protocols	25
4.7.3.	IO FASTON connection and functionality	26
4.8.	Connecting a charger to the Li-ion battery	26
4.9.	Connecting Li-ion batteries in parallel	27
4.10.	Disconnecting the Li-ion battery	28
5.	Battery use	28
5.1.	General information	28
5.2.	Charging	28
5.2.1.	Charging rate	29
5.3.	Heater functionality	29
5.3.1.	Heater power source	30
5.3.2.	Heating methods	30
5.4.	Battery balancing	32
5.5.	Shutdown on State of Charge	32
5.6.	Main switch function	33
5.6.1.	Introduction	34
5.6.2.	Li-ion battery firmware	34
5.6.3.	Visual indication (status LEDs)	34
5.6.4.	Operating the main switch	34
5.7.	Be In Charge Software and App	36
5.7.1.	Bluetooth pairing (PIN code)	37
5.7.2.	Battery history recording	37
5.7.3.	Reading the battery's State of Charge (SoC)	37
5.7.4.	Reading the battery's State of Health (SoH)	38
6.	Inspection and cleaning	38
6.1.	General information	38
6.2.	Inspection	38
6.3.	Cleaning	38
7.	Storage	38
8.	Transportation	39
9.	Disposal and recycling	39
10.	Troubleshooting	40
11.	Warranty and liability	42

1. Safety guidelines and measures

1.1. General

- Do not short-circuit the Li-ion battery.
- Treat the Li-ion battery as described in this manual.
- Do not dismantle, crush, puncture, open or shred the Li-ion battery.
- Do not expose Li-ion battery to heat or fire. Avoid exposure to direct sunlight.
- Do not remove the Li-ion battery from its original packaging until required for use.
- In the event of electrolyte leaking, do not allow the liquid to come in contact with the skin or eyes. If contact has been made, wash the affected area with water and seek medical advice.
- Always use a class 2 charger which is specifically provided for use with a Lithium Iron Phosphate battery (LiFePO4). For more information, please refer to the charging manual on our website.
- Observe the plus (+) and minus (–) marks on the Li-ion battery and equipment and ensure correct use.
- Do not mix batteries of different manufacturer, capacity, size, type or age within a system.
- Keep the Li-ion battery clean and dry.
- Secondary batteries need to be charged before use. Always use a correct charger (see charging manual on our website) and refer to this manual for proper charging instructions.
- Do not leave the Li-ion battery on prolonged charge when not in use.
- After extended periods of storage, it may be necessary to charge and discharge the Li-ion battery several times to obtain maximum performance.
- During long periods of storage maintenance, charging is needed to prevent deep discharge by self discharge.
- Retain the original product documentation for future reference.
- Disconnect the Li-ion battery from the equipment when not in use.

⚠ Warning! Keep the Li-ion battery away from water, dust and contamination. Place the Li-ion battery in well ventilated areas.

1.2. Disposal



Dispose the Li-ion battery in accordance with local, state and federal laws and regulations.

Do not mix with other (industrial) waste.



2. Introduction

2.1. Product description

The Epsilon is a self-protected Lithium Iron Phosphate rechargeable battery. The unique combination of state-of-the-art technology and smart software makes this Li-ion battery a robust, safe and easy to use energy storage solution. The Epsilon is available in a 12V100Ah and 12V150Ah variant.

The Li-ion battery uses safe Lithium Iron Phosphate (LiFePO₄) technology. With its integrated battery management system (BMS) the Li-ion battery is protected from deep discharging, overcharging and overheating. Eliminating the need for an external safety relay means the Li-ion battery is very easy to install.

The Li-ion battery also has integrated battery monitoring which provides details about its status such as voltage, current, temperature, state of charge and time remaining. Hands-on monitoring is possible via the Be In Charge app, Be In Charge Software, CAN-bus, external monitoring devices and LED indicators inform you about the actual status of your Li-ion battery.

The Li-ion battery can use the integrated heating to heat up, or keep the cells at a temperature level to be able to charge the battery in sub-zero degrees environment conditions. This ensures that the cells are used within their specifications enlengthening the Li-ion batteries lifetime.

Under the Li-ion batteries protective lid easy to use connections such as configurable inputs / outputs, CAN and LIN connection, external heater power input and accessory power connection can be found. All using standardized connections which makes it very easy to install the Epsilon in the application.

2.2. Intended use

The Epsilon 12V100Ah/12V150Ah Li-ion battery serves as an energy source of 12V in power systems for recreational vehicles, commercial vehicles, leisure boats, commercial vessels and stationary applications. Potential applications of this Li-ion battery include: off grid power supply, marine power supply, medium for (renewable) energy storage and (traction) battery for vehicles. Use as a starter battery is not possible. Never install multiple Epsilon Li-ion batteries in series. Up to 8 batteries can be connected in parallel to increase the total capacity up to 800Ah or 1200Ah depending on the Epsilon variant.

Always connect batteries of the same type / capacity and age in a parallel setup and do not add more batteries to the parallel bank after a certain time. This could lead to a degradation of the total capacity and disturbed current distribution within the system.

2.3. Glossary of Terminology

BMS:	Battery Management System
Charge cycle:	A period of use from fully charged, to fully discharged, and fully recharged again
Endurance Life-cycle:	The products maximum lifespan, achieved by following the guidelines presented in this manual
LiFeP04	Lithium Iron Phosphate
SoC	State of Charge
SoH	State of Health
CCCV	Constant Current - Constant Voltage
DoD	Depth of Discharge
I/O	Inputs and Outputs

Table 1. Glossary of terminology

2.4. Used symbols

The following icons will be used throughout the manual:

- ⚠ Warning!** A warning indicates severe damage to the user and/or product may occur when a procedure is not carried out as described.
- ⚠ Caution!** A caution sign indicates problems may occur if a procedure is not carried out as described. It may also serve as a reminder to the user.

3. Product specifications

3.1. Product features

- A-grade prismatic cells for highest possible energy density and quality
- Lithium Iron Phosphate (LiFeP04): Safe lithium technology
- Integrated short circuit protection
- Integrated protection device for maximum protection and safety
- Integrated BMS (Battery Management System)
- Integrated cell heating to allow safe charging below 0°C (with autonomous operation if needed)
- Adaptive cell balancing
- Robust casing made from environmentally friendly materials (fully recyclable)
- Overheating protection on battery terminals in case of badly connected cables

- Communication interface: Bluetooth (wireless), CAN bus(wired) and LIN bus (wired)
- Configurable general purpose inputs/outputs to control external devices (chargers for example)
- Separate power output connection for powering accessories. Analog SoC output.
- Battery monitoring / History Storage
- Monitoring via Be In Charge Bluetooth app (iOS and Android) and Be In Charge Software (PC)
- Multi-connectable coated aluminium terminals, including temperature sensors for protection.
- LN3 / DIN H6 and LN5 / DIN H8 sizes available in different capacity (100Ah and 150Ah)
- Integrated and configurable discharge limit (Shutdown based on State of Charge)

3.2. Product specifications

3.2.1. Electrical specifications

	Epsilon 12V100Ah	Epsilon 12V150Ah
Nominal capacity	100Ah	150Ah
Energy	1280Wh	1920Wh
Nominal voltage	12.8V	12.8V
Open circuit voltage	13.2V	13.2V
Self discharge	<3% per month	<3% per month

Table 2. Electrical specifications

3.2.2. Mechanical specifications

	Epsilon 12V100Ah	Epsilon 12V150Ah
Dimensions (LxWxH)	278 x 175 x 190 mm 11" x 6.9" x 7.5" [= DIN H6 / LN3]	353 x 175 x 190 mm / 13.9" x 6.9" x 7.5" (= DIN H8 / LN5)
Weight	10.7 kg / 23.6 lbs	15.5 kg / 34.2 lbs
Case material	PC /ABS	PC / ABS
Ingress protection	IP56	IP56
Cell type / chemistry	Prismatic - LiFePO4	Prismatic - LiFePO4

Table 3. Mechanical specifications

3.2.3. Charge & discharge specifications

	Epsilon 12V100Ah	Epsilon 12V150Ah
Charge method	CCCV	CCCV
Recommended charge voltage	14.4V	14.4V
Max charge current	90A	135A
End of discharge voltage	8V	8V
Discharge current continuous	Max. 190A	Max. 200A
Discharge pulse current (10 sec)	300A	350A
Short circuit detection ¹	1550A > 70 us or 610A > 8 ms	1550A > 70 us or 610A > 8 ms

Table 4. Charge and discharge specifications

¹Short circuit detection

In case the Li-ion battery detects a short circuit, the Li-ion battery will turn OFF. The short circuit detection can be triggered also when, for instance, a large capacitive load is connected (An inverter is one example). In this case the current spike will be higher and longer than the values mentioned in the table above and that will cause the Li-ion battery to turn OFF. The Li-ion battery will then start retrying to turn ON and in case of a capacitive load this will charge the load and eventually turn and stay ON again. In the case of a real short circuit or a very large capacitive load where the Li-ion battery is not able to “charge” the load, the battery will stay OFF. To turn the Li-ion battery ON again the short circuit needs to be removed and the battery needs to be taken out of this error mode. This can be done by charging the battery or to reset the battery.

3.2.4. Temperature specifications

Charge temperature (heating off)	0°C to 45°C / 32°F to 113°F
Charge temperature (heating on)	-30°C to 45°C / -22°F to 113°F ²
Discharge temperature	-20°C to 60°C / -4°F to 140°F
Storage temperature short term (<1 month)	-20°C to 45°C / -4°F to 113°F
Storage temperature long term (>1 month)	18°C to 28°C / 64°F to 82°F ³
Relative humidity	10-90%

Table 5. Temperature specifications

²Charging from -30 °C is only possible with an external power source to power the heaters, the correct settings should be used

³Long term exposure to temperatures >35°C / 95°F might affect battery capacity and cycle life.

3.2.5. Compliance specifications

Certifications	CE, UKCA, RED, RoHS ⁴ , FCC ⁵ , UN 38.3, UN ECE R10.06, UL1642 (Cells)
Shipping classification	UN 3480
Bluetooth® certification ⁶	Declaration ID: D061640

Table 6. Compliance specifications

⁴RoHS is only valid for electronics and excludes the battery cells.

⁵FCC/IC Information:

Contains FCC ID: Y82-DA14531MOD

Contains IC ID: 9576A-DA14531MOD

This device complies with part 15 of the FCC rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

⁶Bluetooth® information:

The Li-Ion battery has been certified for Bluetooth® compliancy. Both Epsilon 12V100Ah and 12V150Ah are registered at the Bluetooth® SIG (Special Interest Group) under the declaration ID mentioned in the table above.

3.2.6. General product specifications

	Epsilon 12V100Ah	Epsilon 12V150Ah
Battery designation	IFpP/27/148/135[2p4s] M/-20+60/95	IFpP/27/148/135[3p4s] M/-20+60/95
Cycle life	>5000 (0.3C charge/discharge, DoD 100%) ⁷ >3500 (0.9C charge/discharge, DoD 100%) ⁷	

Table 7. General product specifications

⁷The cycle life value given above is an indication at 23°C. The Li-ion battery cycle life depends strongly on temperature and the applied charging and discharging loads.

3.3. Environmental conditions

- ⚠ Warning!** The Li-ion battery may only be used in conditions specified in this manual. Exposing the Li-ion battery to conditions outside the specified boundaries may lead to serious damage to the product, user and/or environment. Use the Li-ion battery in a dry, clean, dust free, well ventilated space. Do not expose the Li-ion battery to fire, water, solvents or excessive heat.

3.4. Scope of delivery

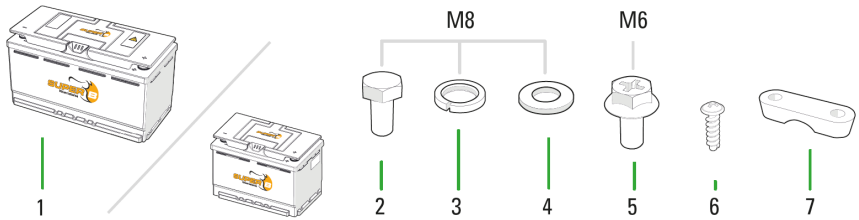


Figure 1. Components

1. (1x) Super B Epsilon 12V100Ah / Epsilon 12V150Ah Li-ion battery
2. (2x) Hex bolt M8x16
3. (2x) Washer M8
4. (2x) Lockring M8
5. (2x) Terminal Screw M6
6. (4x) Philips screw
7. (2x) Cable clamp

3.5. Terminals and LED indicators

The picture below is showing the terminals of the Li-ion battery

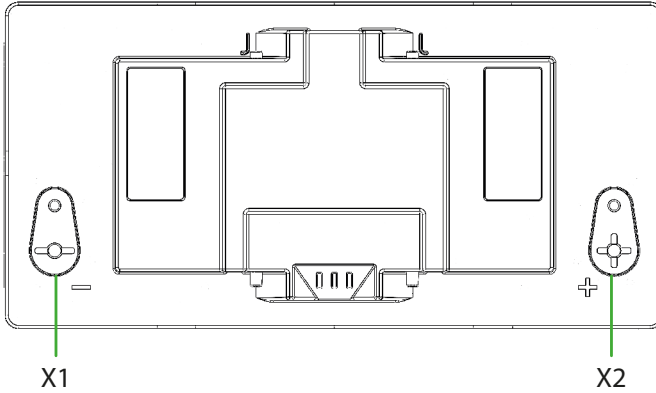


Figure 2. Battery terminals

X1: Battery Terminal up to 1x 95mm² wire connection or standard automotive terminal and 1x M6 bolt for accessory connection

X2: Battery Terminal up to 1x 95mm² wire connection or standard automotive terminal and 1x M6 bolt for accessory connection

3.5.1. X1 / X2 Battery terminal interface

Terminal #	Service description	Function	Range
1	Battery - Terminal	-	Minus supply of battery
2	Battery + Terminal	+	Plus supply of battery

Table 8. Battery terminals interface

3.5.2. LED Indicators

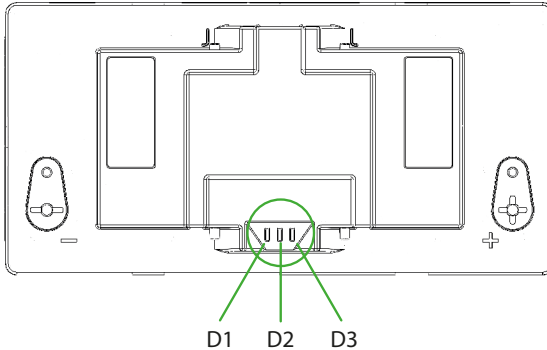


Figure 3. LED Indicators

The Li-ion battery has 3 LEDs which indicate in which state the Li-ion battery is. Depending on the state, the LEDs can:

- Be constantly lit; the Li-ion battery is being charged or discharged at more than 250 mA
- Flash briefly (100 ms on 3 s off); the Li-ion battery is being charged or discharged at less than 250 mA
- Fade (slowly light up and slowly dim again); the main switch is off (see section 5.6)
- Flash quickly; this is for special states

	D1 (Green)	D2 (Yellow)	D3 (Red)	Mode
1	Off	Off	Off	Not operational due to deep discharge or an internal problem
2	Flashing	Off	Off	Operational, normal state. No charge or discharge current.
3	Off	Flashing	Off	Operational, alert state. The Li-ion battery can be used on a limited basis.
4	Off	Off	Flashing	Operational, alarm state. The Li-ion battery can no longer be used while the fault is present.
5	On	Off	Off	Operational, normal state of charging or discharging
6	Off	On	Off	Operational, alert state
7	Off	Off	On	Operational, alarm state. The battery is faulty and must be examined by the dealer

8	Fading	Off	Off	Operational, normal state: the main switch is off
9	Off	Fading	Off	Operational, alert state: the main switch is off. This may indicate a temperature problem or the Li-ion battery is in danger of running out of power
10	Off	Off	Fading	Operational, alarm state: the main switch is off. This may indicate a temperature problem or the Li-ion battery is too low
11	Flashing	Off	Flashing	Special state: firmware update active
12	Off	Flashing alternately		Special state: start-up phase of the Li-ion battery after a reset

Table 9. LED Mode

3.6. Signal interfaces

The signal interfaces are located underneath the removable lid.

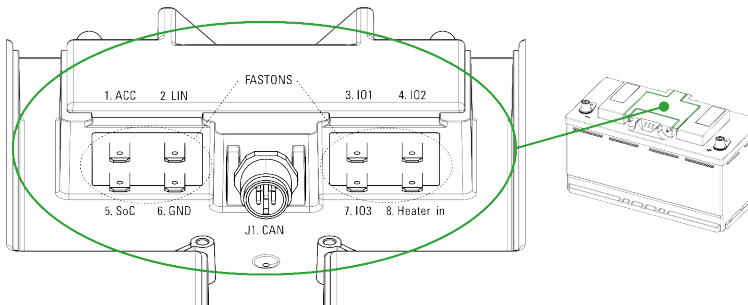


Figure 4. Signal interfaces

3.6.1. J1 CAN

The CAN interface of the Li-ion battery is not galvanically isolated. The CAN ground pin is fused with respect to the terminal minus with a 200 mA resettable fuse.

PIN #	Signal	Description
1	CAN_SHLD	Optional CAN Shield
2	NC	Not in use
3	CAN_GND	Ground / OV
4	CAN_H	CAN_H bus line (dominant high)
5	CAN_L	CAN_L bus line (dominant low)

Table 10. J1 CAN interface¹.

¹Please note: CAN bus is not galvanically isolated

The CAN connector is provided with a protective M12 cap (see figure 5). When CAN is not used it must be mounted to ensure the IP rating of the Li-ion battery.




Figure 5. Protective M12 cap

3.6.2. FASTON Connections

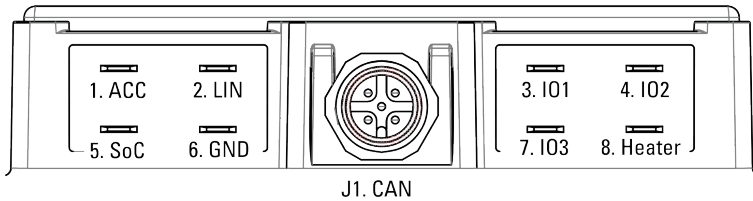


Figure 6. FASTON Connections. Note: FASTON connections are also shown on the inside of the protective lid.

Faston #	Description	Function
1	Accessory power output	Connection for power to accessories (fused internally 1.5A trip current, auto reset)
2	LIN bus connection	LIN bus communication channel (CI-bus support)
3	IO1 connection	Input or output 1 (fused internally 0.6A trip current, auto reset)
4	IO2 connection	Input or output 2 (fused internally 0.6A trip current, auto reset)
5	SOC output (analogue)	Analogue SOC output (0-10V) (load must be higher than 100kOhms)

6	GND connection	GND connection (fused internally 1.5A trip current, auto reset)
7	I03 connection	Input or output 3 (fused internally 0.6A trip current, auto reset)
8	Heater power supply input	External power supply for heater (12-14V) (120W / 10A max)

Table 11. FASTON connections

3.6.3. FASTON Connection electrical specifications

	Description	Value	Units
I/O connection 1-3	Input voltage range	0 .. 15	V
	Input impedance	>100	KOhm
	Input high level	>8.4	V
	Input low level	<6.8	V
	Output current sink (open drain output type)	0.5	A
SoC output	Output voltage range	0.01 .. 10	V
	Output impedance	<1	Ohm
Heater input	Input voltage range	12 .. 15	V
	Power rating 150Ah	120	W
	Power rating 100Ah	80	W

Table 12. FASTON connection electrical specifications

3.6.4. Bluetooth

Service description	Type of signal	Range
Bluetooth Low Energy (5.1 standard)	Communication	10 - 25 meter (typical)

Table 13. Bluetooth

⚠ Caution! Bluetooth range is strongly dependent on the environment and how the Li-ion battery is positioned. Metal parts such as battery boxes, covers and cabling can affect the Bluetooth range and can lead to reduced range. The mentioned range only applies to an “open field situation”, and can be less or more depending on the situation.

3.6.5. Modes and states of the Li-ion battery

The Li-ion battery knows two modes: operational and non-operational.

Non-operational mode

If the Li-ion battery is in non-operational mode, it cannot be used anymore. This can happen if the BMS detects a malfunction in the battery's monitoring and control, or when a deep discharge has occurred which led to cell damage. A deep discharge occurs when one of the cell blocks is 1.5V or lower. This is even possible when the Li-ion battery is at 10V. When this is detected, the Li-ion battery stores this event and is not usable thereafter. The protective shutdown mechanism then prevents charging or discharging.

Operational mode

The Li-ion battery knows 3 states in operational mode:

- Normal state: the units the Li-ion battery monitors (voltage, current and temperature) are within the operational level of the cells and other components in the Li-ion battery.
- Warning state: the units the Li-ion battery monitors are threatened to go beyond the operational level of cells or other internal components. The battery's protective disconnect device will stay on.
- Alarm state: the units the Li-ion battery monitors are beyond the operational level of cells or other internal components. The battery's protective disconnect device will disconnect the cells from the terminals and the Li-ion battery. It can be that charging is disabled, discharging is disabled, or both are disabled.

Main switch function

The Li-ion battery has a main switch function. When the main switch is off, it is not possible to charge or discharge the Li-ion battery. Whether the main switch is on or off, the Li-ion battery continues to monitor all units. This means that regardless of the main switch position, the Li-ion battery can be in normal, alert or alarm state. Section 5.6 describes this function in more detail.

3.6.6. Operational mode: dependencies

State	Main switch on	Main switch off
Normal state	discharging/charging possible	discharging/charging not possible
Alert state	discharging/charging possible	discharging/charging not possible
Alarm state	Charging or discharging or both is not possible, this depends on the alarm type	discharging/charging not possible

Table 14. Operational mode: dependencies

Below is a list of possible causes if the Li-ion battery is in alarm condition:

Charging turned off

Charging shutdown is caused by the following events:

- Overcurrent during charging, the charging current is too high
- Overvoltage during charging:
 - The voltage of the charger is too high
 - The cells are unbalanced
- The temperature to charge is too high or too low
- The main switch is off, the Li-ion battery cannot be charged or discharged

Discharging disabled causes

Discharging disabled causes are triggered in the following events:

- Overcurrent during discharging, the load current is too heavy
- Undervoltage due to discharging, the Li-ion battery is empty
- The SoC 'off' level has been reached
- The temperature to be able to discharge is too high or too low
- The main switch is off, the Li-ion battery cannot be charged or discharged

Discharging and charging disabled causes

- The protective disconnect device is too hot
- The main switch is off, the Li-ion battery cannot be charged or discharged

3.7. Optional Components

Article name	EAN code
Be In Charge Monitoring Kit	8718531362086
Battery Bracket set for Epsilon	8718531362222
CAN Cable 0.4m Y-split straight female to straight male-female	8718531362239
Touch Display + Connection set 5m for Epsilon 12V100/150Ah	8718531362291
Touch Display + Connection set 10m for Epsilon 12V100/150Ah	8718531362307
Touch Display + Connection set 15m for Epsilon 12V100/150Ah	8718531362352
Display BM01 12V + Cable 2.5m for Epsilon 12V100/150Ah	8718531362369
Display BM01 12V + Cable 5m for Epsilon 12V100/150Ah	8718531362260
Display BM01 12V + Cable 10m for Epsilon 12V100/150Ah	8718531362277

Table 15. Optional components that can be used with the Li-ion battery

4. Installation

4.1. General information

- ⚠ **Warning! 12V systems only.** Never install multiple Li-ion batteries in series.
- ⚠ **Warning!** Never install or use a damaged Li-ion battery.
- ⚠ **Caution!** Do not reverse connect the power cables (polarity)

When connecting several batteries in parallel, always use batteries of the same brand, type, age, capacity and state of charge.

4.2. Unpacking

Check the Li-ion battery for damage after unpacking. If the Li-ion battery is damaged, contact your reseller or Super B. Do not install or use the Li-ion battery if it is damaged!

4.3. Placement of the Li-ion battery

Before it is used, the Li-ion battery must be fastened in such a way that it will not move during use. The Li-ion battery may be placed on its long or short side, but not upside down. Use appropriate fastening brackets for mounting (see chapter 3.7; optional components).

4.4. Connection wires

Use appropriate cables and cable lugs for the connection to the terminals. This prevents overheating and unnecessary losses. Use appropriate fuses matching the cables and load. Super B advises to use 95mm² connection cables. Cables with less diameter can cause overheating or unnecessary losses. Always use the correct crimp tools to crimp the cable lugs and follow the instructions provided by the cable lug manufacturer.

⚠ **Caution!** When using more Epsilon Li-ion batteries in parallel the wiring should be sized and specified according to the maximum current the parallel bank can deliver.

4.4.1. Connecting power cables with automotive type terminals

1. Connect the load or charger to the X2 (+) terminal of the Li-ion battery. (Figure 7)
2. Connect the load or charger to the X1 (-) terminal of the Li-ion battery. (Figure 7)
3. Ensure both contacts are tightened. (20Nm)
4. Place the handle covers over the terminals. (Figure 8)

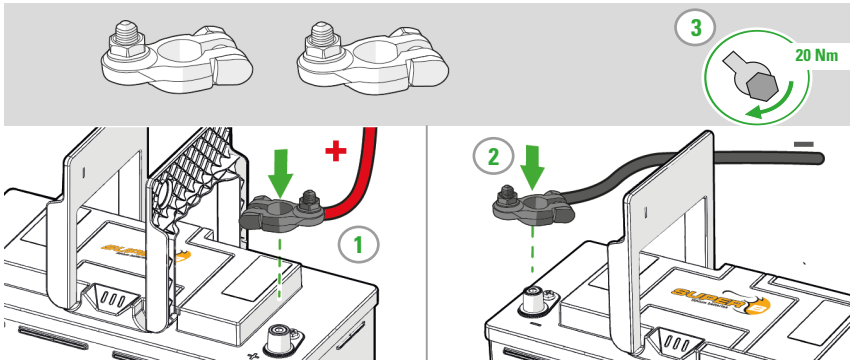


Figure 7. Connecting power cables with automotive type terminals

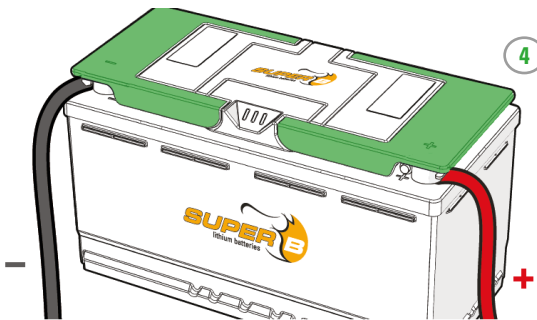


Figure 8. Place the handle covers over the terminals

4.4.2. Connecting power cables with cable lugs

1. Remove the automotive power terminals. (Figure 9)
2. Connect the load or charger to the X2 (+) terminal of the Li-ion battery. (Figure 10)
Use the included M8 bolt, spring washer and plain washer to connect the Li-ion battery cable.
3. Connect the X1 (-) terminal of the Li-ion battery. (Figure 10)
Use the included M8 bolt, spring washer and plain washer to connect the Li-ion battery cable.
4. Ensure both contacts are tightened to 20Nm.
5. Place the handle covers over the terminals. (Figure 11)

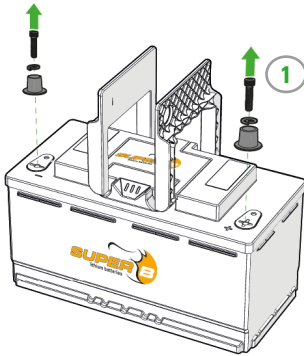


Figure 9. Remove the automotive power terminals.

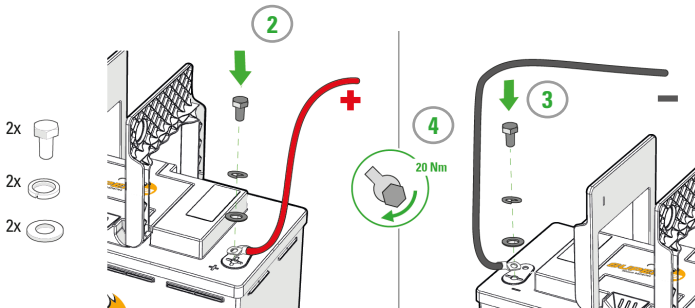


Figure 10. Connecting power cables with cable lugs

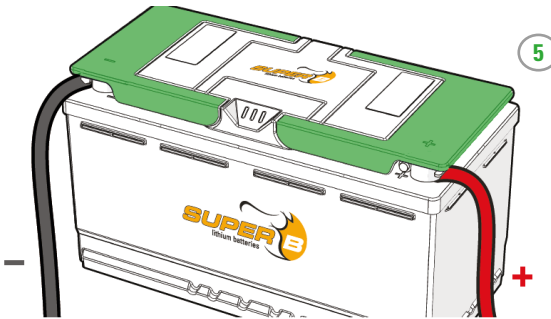


Figure 11. Place the handle covers over the terminals

4.4.3. Connecting small consumers to the terminals

The Li-ion battery has a M6 thread on both terminals that is intended to supply power to small consumers. Below it is described and depicted how to connect small consumers. This is not the accessory power; that one is FASTON 1 underneath the lid (see figure 6, paragraph 3.6.2).

1. Connect the plus of the power cable of the small consumer to the X2 (+) terminal of the Li-ion battery (Figure 12). Use the included M6 bolt.
2. Connect the minus of the power cable of the small consumer to the X1 (-) terminal of the Li-ion battery (Figure 12). Use the included M6 bolt.
3. Ensure both contacts are tightened to 10Nm.
4. Place the handle covers over the terminals. (Figure 11)

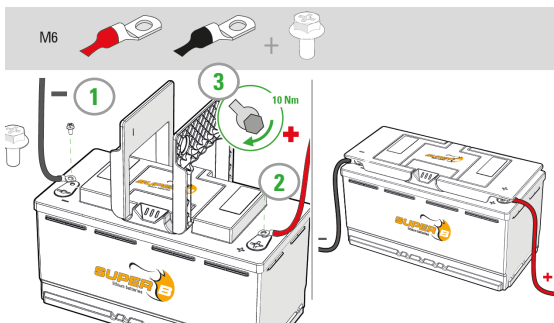


Figure 12. Connecting accessories to the terminals.

4.5. Communication and FASTON connections

All connections, except for the connection terminals, can be made in one central place under the protective lid. This protective lid is mounted and held in place using self-retaining clips, the lid can be easily removed with light force and replaced in the same way.

The specific connections and assignment are indicated on the inside of the lid. The connections can be made using standard 4.75mm wide automotive FASTON crimp terminals.

All connections and cabling can be secured using the integrated cable strain relief, which can easily be unscrewed to secure all cables to the FASTONS. The M12 CAN cable is not fed through the strain relief, as the M12 connector itself has a built-in strain relief (see figure 14) and this would damage the wire.

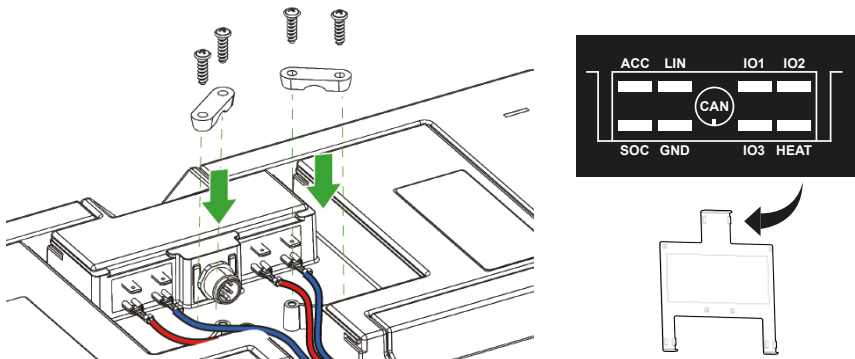


Figure 13. Communication and FASTON connection

- Warning!** Never use the cabling to lift the Li-ion battery, even when the strain relief is holding the wires / cabling in place.

4.6. Connecting to the CAN interface

4.6.1. Connecting the data cables

The wired communication interface must be used in a bus network topology (Table 16). Do not use a ring- or a star topology. The wired communication interface specifications restrict the Bus length/Bus speed.

Bus length (L)	Max. stub length (S)	Accumulated stub length
250 m	11 m	55m

Table 16. Wired network interface cable lengths

CAN Cables

The connection to the CAN bus can be made using standard CAN cable wiring and accessories. An Y-split CAN cable and inline CAN terminator cable is available for easy installation and connection to other Li-ion batteries (see chapter 3.7; optional components).

- ⚠ Warning!** Always use the supplied protective M12 cap when the CAN connection is not used. Otherwise, ingress protection is not guaranteed and water/moisture may enter the Li-ion battery casing, which may cause serious damage.

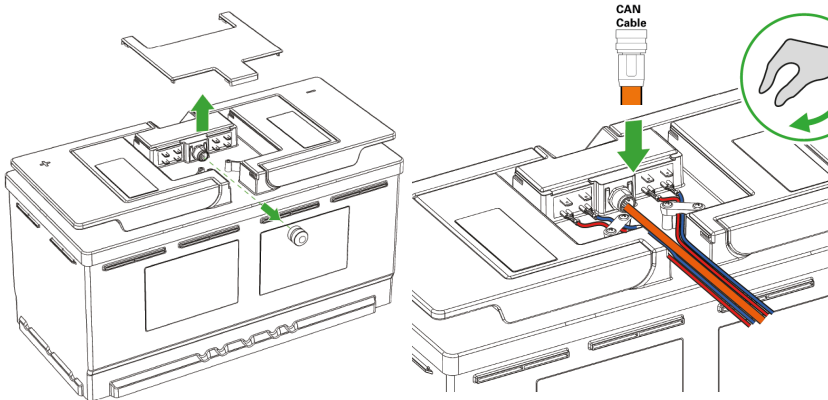


Figure 14. Connecting to the CAN Interface

Termination Resistors

Use termination resistors or the inline CAN terminator cable at the end nodes to impede reflections on the line. The value of this resistor should be +/- 120 ohms. More information on termination resistors can be found in CiA document 303_1 V1.8.0, section 5.

4.7. Connecting to the LIN interface

The Li-ion battery includes a LIN interface (Local Interconnect Network). The LIN interface can be used to connect to a LIN master which are often present in (recreational) vehicles or caravans. The LIN interface is meant to provide the LIN master with information of the Li-ion battery like SoC and other data. The LIN bus is accessible on FASTON 2 under the protective lid. Depending on the electrical installation, LIN ground can be either the terminal minus or the FASTON GND. Make sure no ground loops are made when using the FASTON GND.

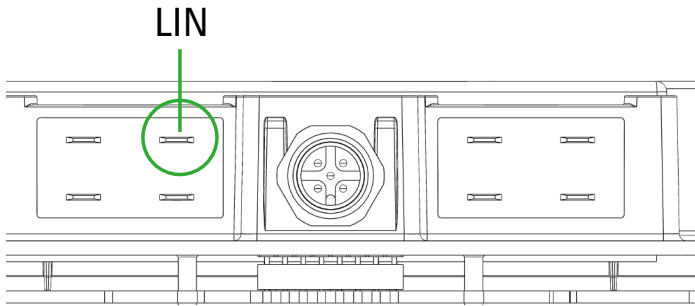


Figure 15. LIN bus FASTON connection

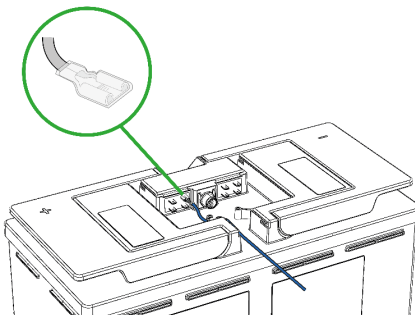


Figure 16. Connecting the LIN Interface using the FASTON connection

4.7.1. CI-BUS protocol

To support easy integration within the RV/caravanning industry the LIN bus protocol is configurable. One of the protocols which can be selected is the CI-BUS protocol. When enabled, the LIN bus provides all information necessary for the system using the CI-BUS protocol. For more information about the CI-BUS visit the CIVD website (<https://www.civd.de/en/artikel/ci-bus-board-management-system/>).

4.7.2. Other protocols

The LIN bus on the Li-ion battery can also support protocols defined by other manufacturers, this support is extended on a regular basis and prone to change. Please contact Super B to gather information about the supported protocols on the LIN bus.

4.7.3. IO FASTON connection and functionality

The Li-ion battery has three digital input or output ports (I/Os) accessible via FASTON 3, 4 and 7 IO1/IO2/IO3). The digital I/Os can be used for various purposes which are shown in the table below

IO functionality	Description
Generator control (IO 1, output)	Active when SoC is below 20%, off when SoC is 100%, hysteresis of 80 %
Inverter control (IO 2, output)	Active when SoC above 21%, off when SoC is below 10 %, hysteresis of 11 %
Main switch function (IO3, input) (Note: from firmware version 1.3.5 onwards)	When 12V is applied to this input, the main switch will be off. The battery cannot be discharged or charged. When 0V is applied, the battery can be discharged and charged again.

Table 17. IO functionality

The functionality of the digital I/Os can be expanded in the future. This will then be added to new firmware. The firmware of the Li-ion battery can be brought up to date by updating it with the Be In Charge App or the Be In Charge PC Software.

All digital I/O ports can function as inputs or outputs. When a port is used as an input, the Li-ion battery determines by its voltage whether it is active or inactive. When used as an output, the digital I/O port behaves as an “open drain” output. This means as much as a switch between the negative of the Li-ion battery and the IO. This switch is closed when the output is active.

All I/O ports are protected by an internal self-resetting fuse. When an output is overloaded, the fuse will trip to protect the internal electronics. To fix this, the overload or short circuit will have to be removed. The output will resume normal operation after that.

For electrical specifications of the digital I/Os, see 3.6.3

If there is any uncertainty about the proper use of the IOs, contact your Super-B dealer.

4.8. Connecting a charger to the Li-ion battery

- ⚠ Warning!** Ensure you have completed all the previous steps described in chapter 4 before connecting the Li-ion battery to the charger.

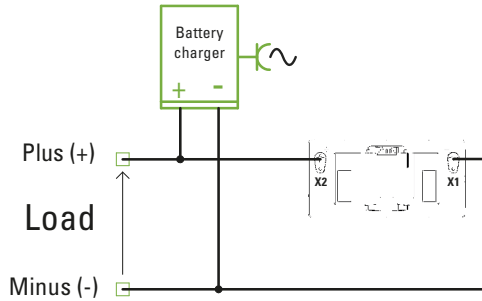


Figure 17. Connecting a charger to the Li-ion battery

4.9. Connecting Li-ion batteries in parallel

⚠ Caution! Before connecting 2 or more Li-ion batteries in parallel, the Li-ion batteries must be charged to 100% SoC.

The max. number of Li-ion batteries in parallel is 8. To divide the current equally amongst batteries, use the schematic below:

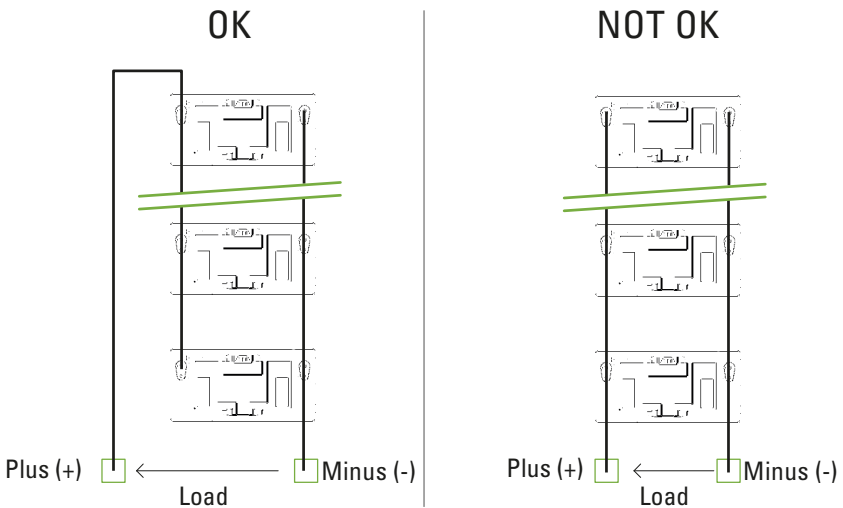


Figure 18. Connecting Li-ion batteries in parallel

OK: Equally divided battery current.

All batteries contribute equally to the current into the load.

NOT OK: Current not equally divided.

Batteries closest to load will have the highest contribution to the current into the load.

Whereas batteries further away from load will have lesser current contribution.

Wear and tear will be higher on the Li-ion battery close to the load. Never connect the setup like this!

4.10. Disconnecting the Li-ion battery

1. Turn off any device or charger the Li-ion battery is connected to.
2. Disconnect the negative wire and accessories connection from the - terminal of the Li-ion battery.
3. Disconnect the positive wire and accessories connection from the + terminal of the Li-ion battery.
4. Disconnect all other connections like the FASTON and communication interface connection which are located under the protective lid.

5. Battery use

5.1. General information

- ⚠ **Warning!** Follow the safety guidelines and measures of chapter 1.
- ⚠ **Caution!** Charge the Li-ion battery before use.
- ⚠ **Caution!** Do not operate the Li-ion battery beyond its maximum specifications.
- ⚠ **Caution!** Charging at deep discharge conditions can lead to venting, excessive heat or thermal runaway of the cells.
- ⚠ **Caution!** This Li-ion battery stores fault conditions and usage storage internally, like excessive charge current or deep discharge situations. Super B uses this information in the warranty process.
- ⚠ **Warning!** Do not overcharge the Li-ion battery.

5.2. Charging

- ⚠ **Warning!** Never charge the Li-ion battery with a charging current higher than mentioned in table 4.
- ⚠ **Caution!** Stop charging in case the Li-ion battery switches into error mode.
- ⚠ **Caution!** Disconnect the charger from the Li-ion battery if it is not used for a long time.
- ⚠ **Caution!** When charging via an externally driven alternator, it must be ensured that an optimal charging curve charges the Li-ion battery (see for instructions the charging manual which can be found on the Super B website). For this, the use of a charge converter (DC/DC booster) is indispensable.
- ⚠ **Caution!** To charge the Li-ion battery, use a charger which follow Super B's charging profile (see charging manual which can be found on the Super B website).

1. Connect the charger to the Li-ion battery as described in paragraph 4.8.
2. Charge the Li-ion battery immediately in case of an under-voltage shutdown or if the state of charge drops below 20% to preserve the lifespan of the Li-ion battery.

⚠ **Note!** When using the main switch (in the OFF position), it is not possible to charge the Li-ion battery. This will also not happen when, for example, automatic charging equipment, a solar charger (MPPT) or an alternator is switched on. Take note of this and make sure the Li-ion battery is fully charged when not in use for an extended period of time.

⚠ **Note!** When using the main switch (in the OFF position), the accessory output is still active and can still supply energy. For example, the voltage can be used for an external display or other device. This output can still discharge the Li-ion battery despite the main switch being off and can cause the Li-ion battery to discharge. Not charging on time during a long period of discharge can lead to deep discharge!

5.2.1. Charging rate

The Li-ion battery can be charged from empty to full in approximately 1 hour and 15 minutes. Table 18 shows the charging times for the Li-ion battery at different charge currents. Always use the indicated charge current and end of charge voltage during charging.

Charging rate Epsilon 12V150Ah		
	Time	Charge current
Maximum	±1 hour 15 minutes	135A
Endurance lifecycle	3 hours	C3 (50A)

Charging rate Epsilon 12V100Ah		
	Time	Charge current
Maximum	±1 hour 15 minutes	90A
Endurance lifecycle	3 hours	C3 (33A)

Table 18. Charging rates at different charge currents

5.3. Heater functionality

The Li-ion battery has functionality to heat up the cells and make charging possible if the ambient temperature is causing the cell temperature to drop below charging temperature level (charging LiFePO4 cells is only allowed if they are above 0°C). The heater for this purpose is internally located in the Li-ion battery and is controlled by the BMS firmware. If heating is requested, this depends on the heating feature configuration and cell temperature, the heater is enabled to heat up and keep the cells at a temperature where they are allowed to be charged.

5.3.1. Heater power source

The internal heater can be powered in two different ways:

1. Power is supplied by the Li-ion battery itself and can be aided or fully supplied by a charger connected to the terminals.
2. Power is supplied by an external source via FASTON Heater power input and the minus terminal.

⚠ **Caution!** Always ensure that the charger or power supply being used is capable of delivering the minimum required power to prevent erratic behavior of the heating functionality. When powering the internal heater from the battery terminals or faston connection, it is necessary to have a charger or power supply that can supply a minimum amount of power. The Epsilon 12V150Ah Li-ion battery requires a minimum of 120 watts, while the Epsilon 12V100Ah Li-ion battery requires at least 80 watts.

⚠ **Caution!** The FASTON GND; GND FASTON is fused at a lower rate than the heater consumes. Do not connect the GND for the heaters at the FASTON GND connection. When an external source is connected, it is automatically used to heat the Li-ion battery cells. The BMS detects whether power is available at the FASTON Heater power input. If the user wants to use external power only, heating from terminal power must be disabled (method 1) or method 2 must be used. This is to prevent the energy from the Li-ion battery from being used when the external source is not present (e.g. a grid power failure)

5.3.2. Heating methods

There are three heating methods that can be used (or heating can be disabled):

1. Heat up before charging (default);
2. Keep at charge temperature by external source;
3. Keep at charge temperature source independent;
4. No heating.

Only one of them can be enabled and which method to use can be selected using the Be In Charge App or Be In Charge Software

Method 1: Heat up before charging

If one or more cells are below 0°C and a charge current is detected, the disconnect device will open the charge path, preventing the Li-ion battery from being charged. The power for the heaters is then taken from the terminals, hence the charger supplies the power to heat the cells. As long as there is charging current, the heaters must be used to keep the cells above 0°C.

If a charger is used that can be regulated by the Li-ion battery, the charging path will remain closed when a charging current is detected. If power is detected on the FASTON Heater power input, it will use that power to heat up the cells to 0 °C before charging, not the chargers power. However, in case of external power, method 2 or 3 are more appropriate to use.

Method 2: Keep at Charge Temperature by external source

This method keeps the cell temperature above the allowable charging temperature of 0°C, and uses power from the FASTON heater power input. If there is no external source available and charging is detected with cells below 0°C, the Li-ion battery will behave as method 1.

Method 3: Keep at charge temperature source independent

This method keeps the cell temperature above 0°C from external power supply energy or the Li-ion battery energy itself. If an external source is available, it will be used for heating. If the external source is not present, energy from the Li-ion battery will be used to keep at 0°C. In that case it will keep it at 0°C until the SoC drops below a configurable level. If that level is reached the heaters will stop to prevent draining the Li-ion battery. In Table 19 the range that can be set is stated.

SoC	SoC Heater Off (%)
Minimum	20
Maximum	80
Default	50

Table 19. SoC Heater levels

Behavior when there is no external source available

- When the SoC is below the ‘Soc Heater OFF’ setting, the heating feature will fall back to method 1: heat up before charging.
- When the external power source is connected/detected again, the Li-ion battery will start heating if needed, independent of the SoC.

Behavior when there is external source available and the battery is drained

If the Li-ion battery is drained due to non-heating use and therefore the SoC level drops below ‘SoC Heater Off’, and the external power source is used to maintain the Li-ion battery at CAT (Charge Accept Temperature) level, the heaters will continue to be powered by the external source

5.4. Battery balancing

The BMS automatically balances the cells if necessary. The Li-ion battery can be used normally during balancing. Balancing ensures all cells are at the same voltage level and enhances usable battery capacity.

5.5. Shutdown on State of Charge

The Li-ion battery has the possibility to switch OFF during discharge when the battery reaches a certain pre-configured SoC (State of Charge) value². The Li-ion battery will protect itself against deep discharge¹ but switching off in time, when there is still energy left in the cells, will have a positive effect on longevity. The shutdown on SoC is on by default but it can be disabled using the Be in Charge App or Software².

SoC shutdown has two settings:

- Switch off level (error level) (by default ON at 10% SoC)
- Warning level (by default ON at 15% SoC)

The warnings are shown on the LEDs on top of the Li-ion battery and also communicated to all the communication channels so that it can be shown on the Be in Charge App / Software or the Display. Both switch-off and warning levels are configurable using the Be in Charge App or Software² and they can be set within the following ranges:

Setting	Default value	Range
Warning level	15%	5-55%
Switch OFF level	10%	0-50%

Table 20. Shutdown on State of Charge (SoC)

Whenever the Li-ion battery is switched OFF on SoC level, it can be turned ON again by charging the Li-ion battery or by forcing the Li-ion battery ON again using the Be in Charge App or Software². The possibility to force the battery ON again will appear whenever the Li-ion battery reaches the warning level.

Example:

The installation consists of an Epsilon 12V150Ah Li-ion battery with a pre-configured warning level of 10% SoC and a switch-off level of 5% SoC. The Li-ion battery is being discharged and has reached an SoC level of 10%. The Li-ion battery will now start showing a warning but is still able to be discharged.

Now the Li-ion battery is discharged further and reaches the level of 5% SoC and switches OFF at this SoC level also showing an alarm (Red LED flashing). The battery now has 5% SoC left in the cells, but this can still be used by forcing the battery ON again using the Be in

Charge App or Software. The Li-ion battery can be discharged further and will switch OFF at 0% SoC.

⚠ Warning! Whenever the Li-ion battery has switched OFF based on the pre-configured SoC level OR when the battery reaches 0% SoC it needs to be recharged immediately to prevent deep discharge!

¹The Li-ion battery will protect itself against deep discharge by turning OFF at 0% SoC or at very low cell voltages, it is very important to charge the battery immediately when this level is reached.

²The SoC shutdown feature is available for firmware version v1.2.0 and higher. The configuration can be done using Be in charge App v1.2.2 and higher and Be in charge Software V1.3.0 and higher.

5.6. Main switch function

⚠ Warning! Use of the main switch ensures that no more discharging or charging can take place. The internal shutdown mechanism is disabled and no current can enter or exit the Li-ion battery. Make sure the Li-ion battery is put away fully charged before using the main switch. Failure to charge on time can cause the Li-ion battery to go into deep discharge, rendering it unusable and irreparably damaged.

⚠ Warning! The main switch can never replace the function of a physical main switch. If a main switch is required by (local) applicable legislation, it must be connected externally in the form of a physical main switch included in the main connection of the Li-Ion battery.

⚠ Warning! The main switch cannot be used to de-energise the system when maintenance is performed or changes are made to the system. In these cases, always disconnect the Li-ion battery completely by removing the main connection to the terminals.

⚠ Warning! Using the main switch in combination with, for example, charging the Li-Ion battery via an alternator can cause a so-called "Load dump" to occur during switch-off. Therefore, always ensure that all sources are switched off before turning off the main switch to avoid damage.

⚠ Note! The main switch only switches off the terminal voltage, the Li-ion battery remains fully functional and the accessory output for powering an external display, for example, also remains active. This can cause the Li-ion battery to discharge. Therefore, if the Li-ion battery is stored for an extended period, make sure it is fully charged and disconnected from all consumers to avoid deep discharge.

- ⚠ **Note!** It may happen that the Li-Ion battery is switched off by means of the main switch but there are still other sources present that can feed the on-board power supply. This could, for example, be a solar installation (MPPT) or a DC-DC converter (booster) between a primary and secondary installation. If the installation is to be completely de-energised, make sure that all sources in the on-board network are switched off.

5.6.1. Introduction

The main switch on the Li-Ion battery can be used to de-energise the system, for example during storage of a vehicle/vessel or other situations where you want to be sure that the Li-ion battery is no longer supplying power. The main switch ensures that the internal disconnect mechanism interrupts the connection between the terminals and the internal battery cells, thus no current can flow into or out of the Li-ion battery through the terminals. The accessory output under the protective cover will always be powered and can thus power an external display to continue reading the status of the Li-ion battery.

The main switch can be implemented by applying a voltage to the Faston connection under the protective cover. The connection to be used for this is the "IO3" input. Once the input is energised, the Li-ion battery will switch off the terminals and no current will be able to flow into or out of the Li-ion battery. When the voltage is removed, the terminal voltage will be switched back on and the Li-ion battery can be used.

- ⚠ **Note!** Respect the minimum and maximum voltage on the input of IO3 mentioned in this manual. This is to prevent damage to this input and internal circuits.

5.6.2. Li-ion battery firmware

The main switch has been introduced from firmware version 1.3.5 and above. To use this functionality if the Li-ion battery still has an older firmware version, the firmware must be updated to version 1.3.5 or higher. Updating the firmware can be done using the latest versions of the Be in Charge software or the mobile Be in Charge App.

5.6.3. Visual indication (status LEDs)

The status LEDs on the top of the Li-ion battery show the status the Li-ion battery is in. The different statuses are described earlier in this manual.

5.6.4. Operating the main switch

There are several different ways to use the main switch, in all cases a voltage will have to be applied to IO3 to use the main switch and switch off the terminals of the Li-ion battery.

Connecting IO3

There are two options for connecting the main switch functionality:

1. An external source;
2. The accessory output of the Li-ion battery.

⚠ **Note!** The terminal of the Li-ion battery cannot be used as a voltage source for the main switch functionality.

⚠ **Note!** Use adequate safety measures when an external source is used as a signal for the main switch function. The connection for this should be adequately protected at the source with a fuse suitable for the wire thickness and voltage used.

Connecting to an external source

The figure below shows the wiring diagram for connecting to an external source.

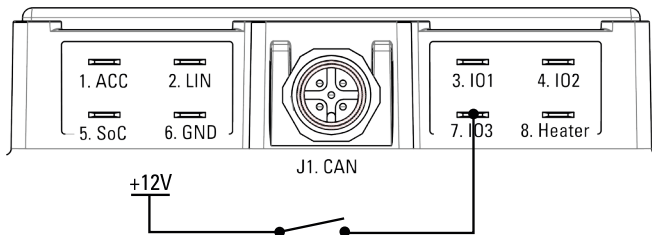


Figure 19. Connecting the main switch to an external source

Connecting to the accessory output

The figure below shows the wiring diagram for connecting to the accessory output.

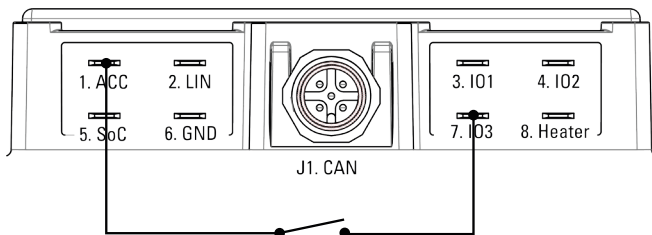



Figure 20. Connecting the main switch to the accessory output

Remark

The accessory output is always active, except when the Li-ion battery is in an SoC shutdown (see section 5.5 “Shutdown on State of Charge”) or undervoltage condition.

When the main switch is used and the terminals are switched off, the charge state of the Li-ion battery may fall below the SoC shutdown level (due to, for example, self-discharge or discharge through the accessory output by a display). At that point, not only the terminal voltage but also the accessory voltage switches off.

The loss of the accessory voltage normally deactivates the main switch function, but because the Li-ion battery is in an SoC shutdown, the Li-ion battery cannot be discharged. The terminal voltage will then remain off but the status LEDs will show normal status again and flash red in this mode.

 **Note!** The Li-ion battery cannot be discharged in this mode but will accept a charging current. When the charging current is applied, the Li-ion battery will be charged. When the Li-ion battery sees a charge current or when the Li-ion battery is switched on via the Be in Charge App, the accessory output will be switched back on and the main switch function will also become active again. So in this situation, make sure the main switch is on otherwise the Li-ion battery will not be charged.

5.7. Be In Charge Software and App

Super B provides a Be In Charge Software tool which can be used to read out the internal BMS system. The software uses a CAN to USB converter to connect to the communication interface. The software is capable of reading out the actual status like battery / cell voltages and temperature but also statistical information. The Be In Charge software can also be used to update the installed firmware of the Li-ion battery. The Be In Charge software and hardware are not part of the Li-ion battery scope of delivery.

Super B also provides a Be In Charge App for mobile devices such as Android and Apple . The app can be found in the Google play store or Apple app store.



The Be In Charge App uses the Bluetooth connection of a mobile device to connect to the Li-ion battery. After the connection has been established all important information can be read out such as voltage / current levels, warnings / errors and state of charge.

⚠ Caution! when updating the battery firmware the battery might become unresponsive and can disable the output voltage on the terminals for a few seconds to minutes. Please be aware of this happening in your application and make sure this firmware update can be carried out safely

5.7.1. Bluetooth pairing (PIN code)

For security reasons the Epsilon Bluetooth connection is protected with a PIN code. This PIN code is needed when pairing to the Li-ion battery and can be found on the label under the protective lid (see figure 19). It is advisable to write down this PIN code before installation of the Li-ion battery.

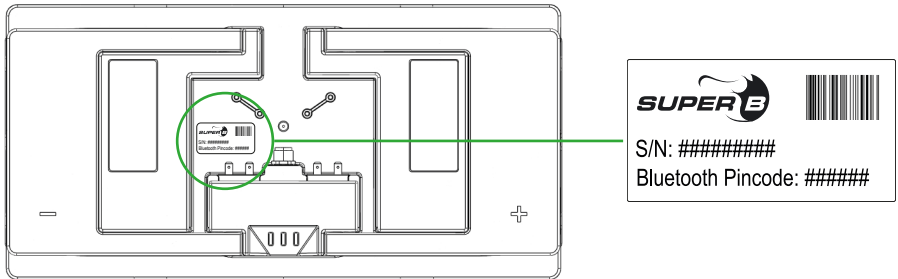


Figure 21. Bluetooth Pairing PIN code

5.7.2. Battery history recording

The complete Li-ion battery history and statistics can be downloaded using the Be In Charge Software.

5.7.3. Reading the battery's State of Charge (SoC)

The Li-ion battery is equipped with an analogue SoC output, this output provides a voltage between 0 and 10 Volts which reflects the 0-100% state of charge value. The state of charge can also be read out using the Be In Charge App for Android and Apple, and with the Be In Charge Software for PC applications. The information is also available via LIN bus (CI-BUS protocol)

5.7.4. Reading the battery's State of Health (SoH)

The Li-ion battery keeps track of its health using algorithms. These algorithms determine the remaining capacity at that specific moment in the battery life, relative to the initial capacity (as new). Example: A state of health of 95% for a Epsilon 12V150Ah, means that the actual remaining usable capacity in the Li-ion battery is 142.5Ah.

6. Inspection and cleaning

6.1. General information

⚠ Warning! Never attempt to open or dismantle the Li-ion battery! The inside of the Li-ion battery does not contain serviceable parts.

1. Disconnect the Li-ion battery from all loads and charging devices before performing cleaning and maintenance activities.
2. Before cleaning and maintenance activities place the enclosed protective caps over the terminals, put the M12 protective cap back in place as well as the protective lid.

6.2. Inspection

1. Inspect for loose and/or damaged wiring and contacts, cracks, deformations, leakage or damage of any other kind. If damage to the Li-ion battery is found, it must be replaced. Do not attempt to charge or use a damaged Li-ion battery. Do not touch the liquid from a ruptured Li-ion battery.
2. Routinely check the Li-ion battery's SoC. Lithium Iron Phosphate batteries continue to slowly self-discharge (<3% per month) when not in use or stored.
3. Consider replacing the Li-ion battery with a new one if you note either of the following conditions:
 - The Li-ion battery run time drops below about 80% of the original run time.
 - The Li-ion battery charge time increases significantly.

6.3. Cleaning


If necessary, clean the Li-ion battery with a soft, dry cloth. Never use liquids, solvents, or abrasives to clean the Li-ion battery.

7. Storage

Follow the storage instructions to optimize the lifespan of the Li-ion battery during storage. If these instructions are not followed and the Li-ion battery has no charge remaining when it is checked, consider it to be damaged. Do not attempt to recharge or use it. Replace it with a new Li-ion battery.

See chapter 3.2.4 for storage temperature conditions.

The self-discharge of the Li-ion battery is <3% per month.

- 
1. Charge the Li-ion battery to 80% of its capacity before storage.
 2. Disconnect the Li-ion battery from all loads and, if present, the charging device.
 3. Place the terminal covers over the Li-ion battery's terminals during storage.
 4. Charge the Li-ion battery to 80% of its capacity every year.

8. Transportation

Always check all applicable local, national, and international regulations before transporting a Li-ion Iron Phosphate battery.

Transporting an end-of-life, damaged, or recalled Li-ion battery may, in certain cases, be specifically limited or prohibited.

The transport of the Li-ion battery falls under hazard class UN3480, class 9. For transport over water, air and land, the Li-ion battery falls within packaging group P1965 Section II.

9. Disposal and recycling

Always discharge the Li-ion battery before disposal. Use electrical tape or other approved covering over the Li-ion battery connection points to prevent short circuits.

Li-ion battery recycling is encouraged. Dispose of the Li-ion battery in accordance with local, state and federal laws and regulations.

10. Troubleshooting

Problem	Possible situation	Solution
The Li-ion battery cannot be discharged.	Li-ion battery is in operation mode Green LED is lit or flashing. No current can be drawn from the battery	Check the installation of the Li-ion battery. Check main switches / fuses or other external disconnect devices.
	All LED's are OFF (Li-ion battery voltage <8V)	Battery is deeply discharged and completely shut down. Do not try to charge or discharge anymore. Contact Super-B's service department or local dealer.
	Red LED is flashing: alarm mode is active. The discharge currents or internal temperature is too high. internal disconnect device is open.	Check the maximum current which the connection installation can draw from the battery. Let the battery cool down and wait for the state to reset (this can take a while). If the LED flashes red after cooling down, the BMS might still detect an Issue. Readout using Be In Charge App or Software might tell more about the issue.
	Red LED is flashing: alarm mode is active. The battery is drained and an undervoltage has occurred. internal disconnect device is open.	Recharge the battery to 100% again.
The Li-ion battery cannot be charged.	Li-ion battery is in operation mode. Green LED is lit or flashing.	Check the installation of the Li-ion battery. check all main switches / fuses and other external disconnect devices.
	Li-ion battery is in alarm mode because the charging voltage is too high. Red LED is lit or flashing.	Verify that the charging voltage is within the Li-ion battery specifications. Discharge the Li-ion battery.
	Li-ion battery is in alarm mode because of high temperature. Red LED is lit or flashing.	Disconnect the Li-ion battery from load/ charger and wait for it to cool down.
	Li-ion battery is in alarm mode because of too high charge current. Red LED is lit or flashing	Discharge the Li-ion battery, lower charge current.

The heater does not seem to work	Li-ion battery is in operational mode but temperature is within normal cell specifications. No need to heat up the cells	Heater is not broken, when the temperature drops below zero degrees it will turn on when the settings are correct.
	Li-ion battery is in operational mode. temperature is below zero degrees C and there is a need to charge.	Check settings for the heaters. Check if external power is active and can deliver enough power to supply the heaters.
The capacity of the Li-ion battery has decreased.	The cells within the Li-ion battery are not properly balanced or the Li-ion battery is worn out.	Perform one full charge (100% SoC) cycle to balance the cells.
Bluetooth errors / connection problems	Connection rejected.	Remove Bluetooth pairing from device settings. Verify no other device is using the Bluetooth connection. re-pair again. use correct PIN code supplied with the Li-ion battery.
	Connection cannot be made or battery cannot be found.	Check if the Phone and Li-ion battery are within range. Make sure the Li-ion battery has a working LED Indication. Check if no other devices are connected to the Li-ion battery. Switch off/on bluetooth on your phone and retry.
Touch display errors	Touch display show CAN error.	Make sure the cables are connected the right way. Always use the termination resistors and undamaged / correct CAN cabling.
CAN connection errors	CAN connections does not seem to work stable or does not work at all.	Make sure to use the right CAN cables. make sure all connections are made and all connectors are screwed down. Make sure to always use two terminator resistors in the CAN bus at both ends of the bus. Make sure that the cables are in good condition and connectors are not broken or damaged.

Table 21. Troubleshooting



11. Warranty and liability

No rights can be derived from this document. Any installation or use contrary to these instructions may void the warranty granted to you. Please refer to the sales agreement for warranty and other provisions applicable to your purchase. If the product is defective, please contact the dealer, reseller or retailer that you purchased the product from. Super B's liability for any of its products is limited to the corresponding provisions under mandatory applicable law.



CE