


AIRCYCLER® G2-K WIRING

COMMUNICATING THERMOSTAT WIRING



With a system that uses a communicating thermostat, use the 110VAC EAC (Electronic Air Cleaner) terminal and using a 24VAC door bell transformer, generate the 24VAC signal required to indicate to the AirCycler controller when the blower is running.

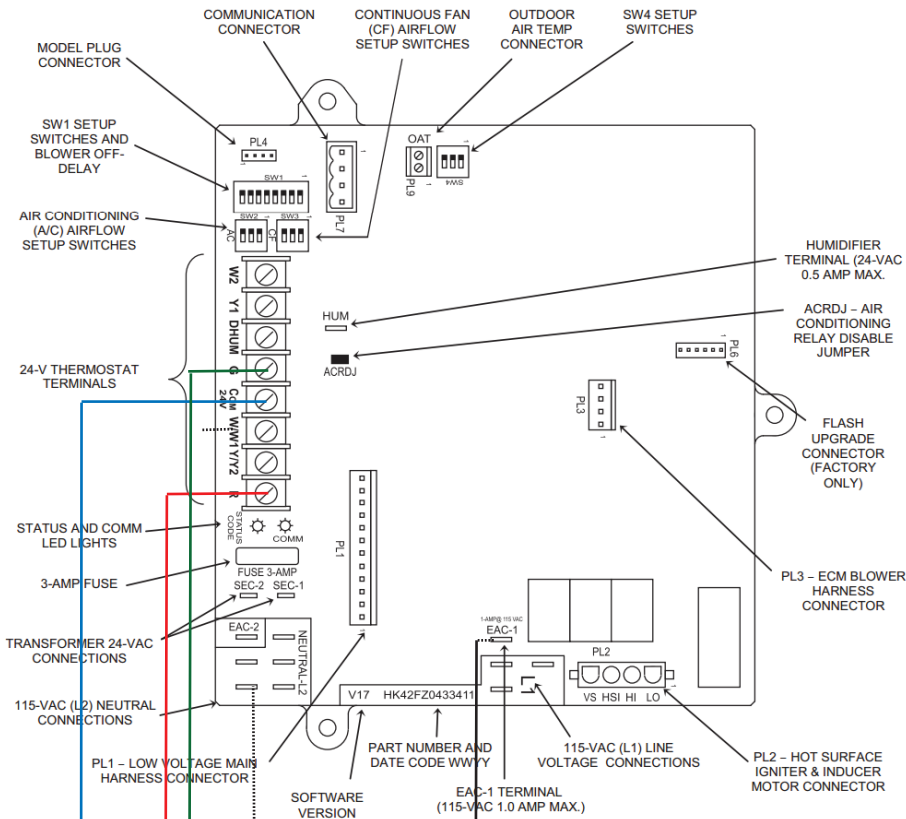