



Hybrid

Uses **either**
Exhaust or
Supply

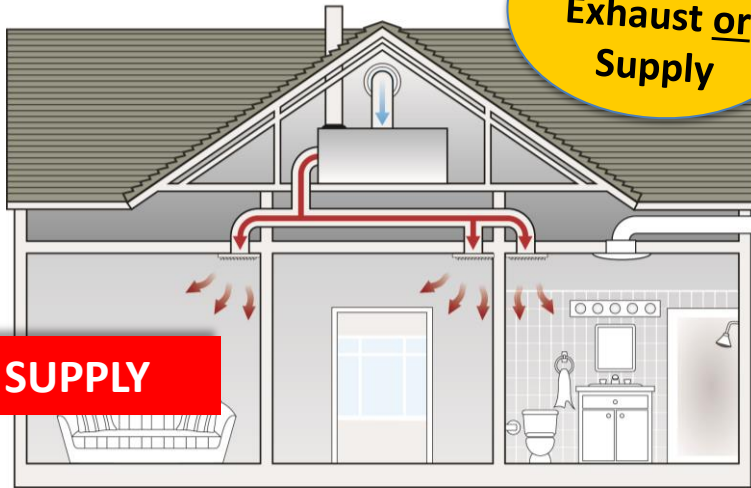

SUPPLY


OR

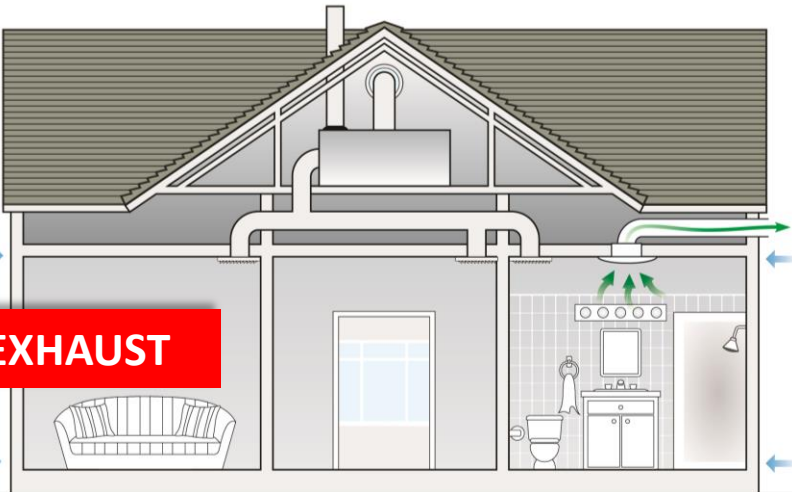

EXHAUST


Balanced

Exhaust +
Supply at the
same time

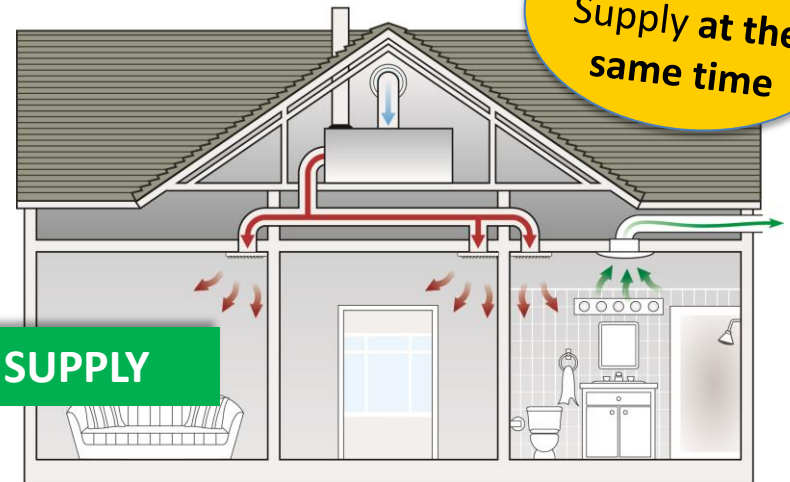

SUPPLY

AND

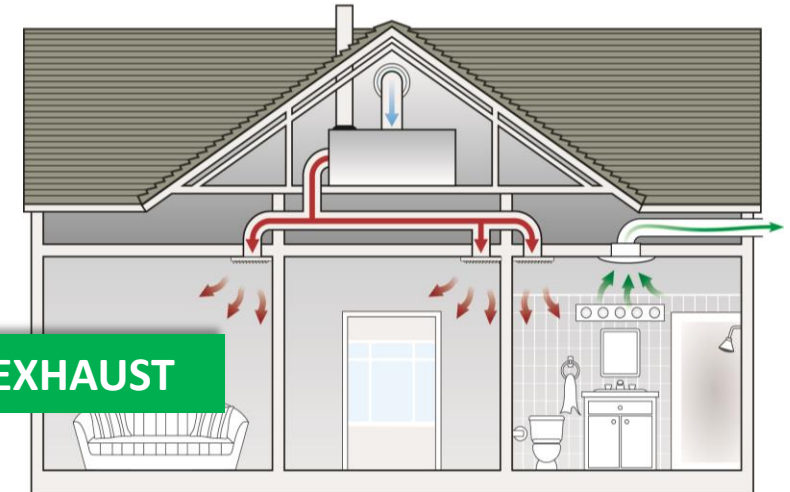

EXHAUST



Hybrid vs. Balanced Ventilation Methods

	HYBRID OPERATION	BALANCED OPERATION
Normal Ventilation Cycle	SUPPLY ONLY Motorized damper is open when central fan is operating for heating or cooling until ventilation requirements are met	SUPPLY + EXHAUST Motorized damper is open and exhaust fan is running when central fan is operating for heating or cooling until ventilation requirements are met
Supplemental Ventilation <i>If ventilation requirement has not been met by normal ventilation cycle</i>	EXHAUST ONLY Motorized damper open and exhaust fan is operating to finish ventilation requirement for the hour	SUPPLY + EXHAUST Motorized damper is open and exhaust fan and central fan are running to finish ventilation requirement for the hour