


Pre Pipe details : Beretta Mynute X


System only and combination models

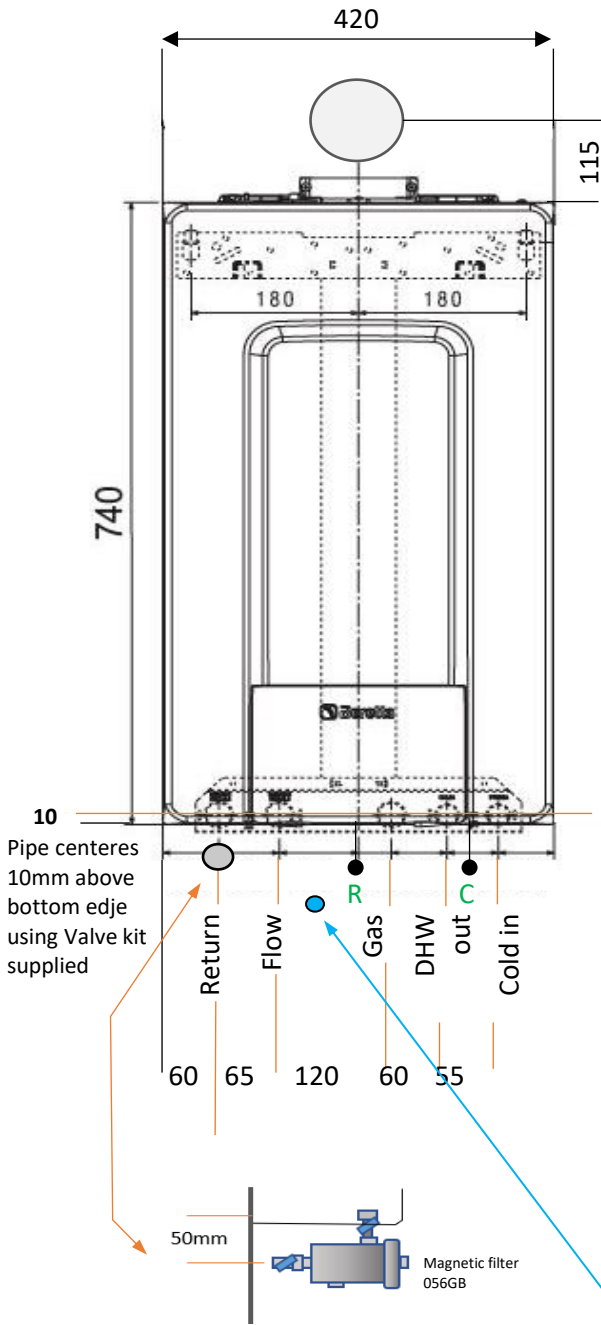

- A=**
 Mynute X 20 275
 Mynute X 30 350
 Mynute X 35 350
 Mynute X 40 350

- C =** Condensate outlet.
R = Pressure relief outlet

C & R can be combined to one drain (Min 20mm)

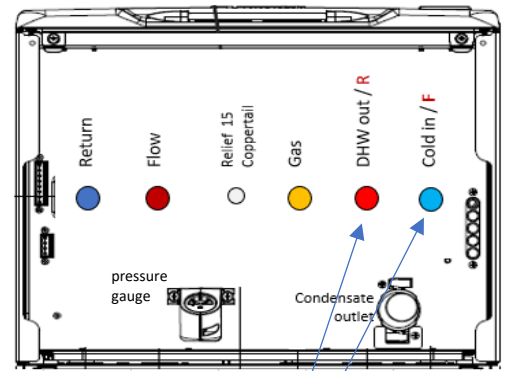

For combi boilers These connections are the cold inlet and Hot output.

For System boilers The two connections provided Capped - can be used to include an optional F and R to heat a cylinder (utilising the diverter valve in the boiler)
 See manual for full details


When installing with magnetic filter HIQ 056GB The return pipe center must be lowered by 50mm

For system only boilers

A filling loop will need to be formed - Provide a cold fill point with a removable flexi hose into the Heating return line.

For Combi Boilers

A filling loop is part of the valve kit no additional cold point is required.

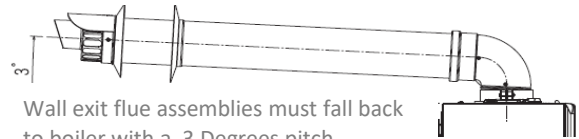

Always Flush your Heating system Before commisioning