
MATLOG MORNSUN®

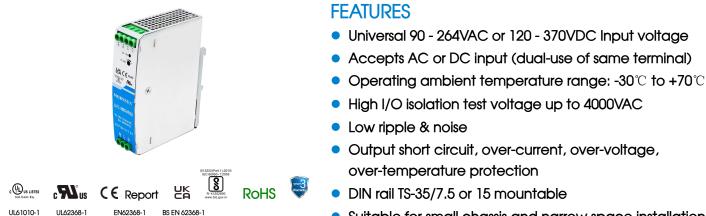

• Suitable for small chassis and narrow space installation

L175-20BxxR2S is Mornsun AC-DC converter series featuring a cost-effective, energy efficient green power supply solution for standard DIN-rail mounting. The products offer a high level of stability and immunity to noise for industrial control equipment, machinery, and other industrial equipment in a variety of harsh environments. These light weight AC-DC converters have an extremely compact design and the standard rail installation for space saving. With good EMC performance, compliant with international UL61010, IEC/EN/UL/BS EN62368 standards for EMC and safety.

Selection Guide						
Certification	Part No.	Output Power (W)	Nominal Output Voltage and Current (Vo/Io)	Output Voltage Adjustable Range (V)	Efficiency at 230VAC (%) Typ.	Max. Capacitive Load (µF)
	LI75-20B12R2S	75.6	12V/6.3A	12-14	86	6000
UL/EN/BIS	LI75-20B24R2S	76.8	24V/3.2A	24-28	89	1500
	LI75-20B48R2S	70.0	48V/1.6A	48-53	90	1000

Input Specifications							
Item	Operating Condition	Operating Conditions		Min.	Тур.	Max.	Unit
	AC input	AC input		90		264	VAC
Input Voltage Range	DC input		120		370	VDC	
Input Voltage Frequency			47		63	Hz	
Input Current	115VAC				2	_	
Input Current	230VAC				1		
In with Comment	115VAC	Cala			25		A
Inrush Current	230VAC	COIC	Cold start		45]
Leakage Current	240VAC		<0.5mA				
Hot Plug					Unavo	alable	

Output Specification	าร					
ltem	Operating Conditions		Min.	Тур.	Max.	Unit
	Full load range	12V		±2.0		
Output Voltage Accuracy		24V/48V		±1.0		
Line Regulation	Rated load	Rated load		±0.5		%
Load Regulation	0% - 100% load			±1.0		
	20MHz bandwidth (peak-to-peak value)	12V			80	mV
Ripple & Noise*		24V			120	
		48∨			150	
Temperature Coefficient				±0.03		%/ ℃
Minimum Load			0			%
Hold-up Time	115VAC		12			ms

MORNSUN®



	230VAC	60				
Short Circuit Protection	Recovery time < 3s after the short circuit disappear.	Constar	nt current, cor	ntinuous, self-	recovery	
	Normal temperature	105% - 150% Io, constant current mode, automatic recover after fault condition is removed				
Over-current Protection	Low temperature, high temperature	≥105%lo constant current			· · · · · · · · · · · · · · · · · · ·	
	12V	<17V (Output voltage turn off, re-power on for recover)				
Over-voltage Protection	24V	33V (Output voltage turn off, re-power on for recover)				
	48V	60V (Output voltage turn off, re-power on for recover)				
Over-temperature Protection			tage turn off, after the tem			

Note: "The "Tip and barrel method" is used for ripple and noise test, output parallel 47uF electrolytic capacitor and 0.1uF ceramic capacitor, please refer to Enclosed Switching Power Supply Application Notes for specific information.

General S	Specification	าร					
Item		Operating Conditions		Min.	Тур.	Max.	Unit
	Input - 🕀			2000			VAC
Isolation Test	Input - output	Electric strength test for 1n	4000				
	Output - 🕀		500			-	
1	Input - 🕀						
Insulation	Input - output	At 500VDC		50			MΩ
Resistance	Output - 🕀		50			-	
Operating Temperature				-30		+70	Ĉ
Storage Temperature				-40		+85	
Storage Humi	dity	Non-condensing		10		95	%RH
Operating Hu	midity			20		90	
Switching Free	quency				65		kHz
		Operating temperature	-30℃ to -10℃	2.0			%/ ℃
Power Deratin	g	derating	+45℃ to +70℃	2.0			
		Input voltage derating	90VAC - 100VAC	2.0			%/VAC
Safety Standard), UL61010-1 s BS EN 62368-1	
Safety Class				CLASS I			
MTBF		MIL-HDBK-217F@25°C		≥300,000 h			

Mechanical Specifications				
Case Material	Metal (AL1100, SGCC)			
Dimensions	32.00mm x 125.00mm x 87.50mm			
Weight	350g (Typ.)			
Cooling Method	Free air convection			

Electromagne	tic Compatibility	(EMC)	
	CE	CISPR32/EN55032 CLASS B	
Emissions	RE	CISPR32/EN55032 CLASS B	
	THD	IEC/EN 61000-3-2 CLASS A	
	ESD	IEC/EN 61000-4-2 Contact ±6KV/Air ±8KV perf	. Criteria A
lmmunit.	RS	IEC/EN 61000-4-3 10V/m perf	. Criteria A
Immunity	EFT	IEC/EN 61000-4-4 ±2KV perf	. Criteria A
	Surge	IEC/EN 61000-4-5 line to line ±2KV/line to ground ±4KV perf	. Criteria A

MORNSUN[®]


MORNSUN Guangzhou Science & Technology Co., Ltd.

AC/DC 75W Din-Rail Power Supply LI75-20BxxR2S Series




CS	IEC/EN61000-4-6 10 Vr.m.s	perf. Criteria A
Voltage dips, short interruptions and voltage variations immunity	IEC/EN61000-4-11 0%, 70%	perf. Criteria B


Product Characteristic Curve

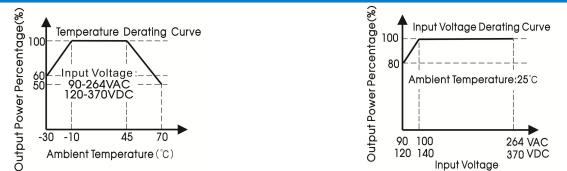


Note: 1. With an AC input voltage between 90 -100VAC and a DC input between 120-140VDC the output power must be derated as per the temperature derating curves;

2. This product is suitable for applications using natural air cooling; for applications in closed environment please consult Mornsun FAE.





Installation Diagram

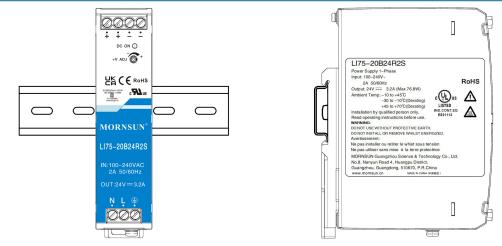


Note: Keep the following installation clearances: 20mm on top, 20mm on the bottom, 5mm on the left and right sides are recommended when the device is loaded permanently with more than 50% of the rated power. Increase this clearance to 15mm in case the adjacent device is a heat source (e.g. another power supply).

Dimensions and Recommended Layout





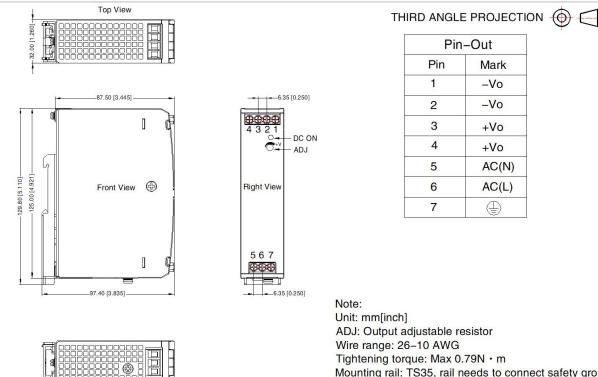

Bottom View

Mounting rail: TS35, rail needs to connect safety ground General tolerances: ± 1.00[±0.039]

Note:

- 1. For additional information on Product Packaging please refer to www.mornsun-power.com. Packaging bag number: 58220214;
- Unless otherwise specified, parameters in this datasheet were measured under the conditions of Ta=25°C, humidity<75% RH with 2. nominal input voltage and rated output load;
- 3. All index testing methods in this datasheet are based on our company corporate standards;
- In order to improve the efficiency at high input voltage, there will be audible noise generated, but it does not affect product 4. performance and reliability;
- 5. We can provide product customization service, please contact our technicians directly for specific information;
- Products are related to laws and regulations: see "Features" and "EMC"; 6.
- The out case needs to be connected to PE (\bigoplus) of system when the terminal equipment in operating; 7.
- The output voltage can be adjusted by the ADJ, clockwise to increase; 8.
- Our products shall be classified according to ISO14001 and related environmental laws and regulations, and shall be handled by 9. qualified units;
- The power supply is considered a component which will be installed into a terminal equipment. All EMC tests should be confirmed with 10. the final equipment. Please consult our FAE for EMC test operation instructions.

Matlog

4 avenue du Vieil Etang | Espace Ouest - Hall A | 78180 Montigny le Bretonneux +33 1 80 97 92 70 | contact@matlog.com |www.matlog.fr

MORNSUN®