

Best Doors PA 30 Hinged Door Set -/30/30sm Installation

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 30mm)

Fasteners:

Frame - Either nailed (75 x 3.2mm) or screwed (10g x 75mm) at 600mm centres nominal. Two fixings per location.

Stops - nailed (50 x 3.2mm) at 200mm centres.

Architrave - nailed (50 x 3.2mm) at 400mm centres.

Pryda Jam b-fixa brackets Type JFB100 at 500mm centres may be used to fix profiles A & B to approved walls.

Head Fixing (minimum):

Single door - none required


Paired door - double central fastener required

Stud size:

Ex 75 x 50 minimum.

Wedging gap:

0-10mm

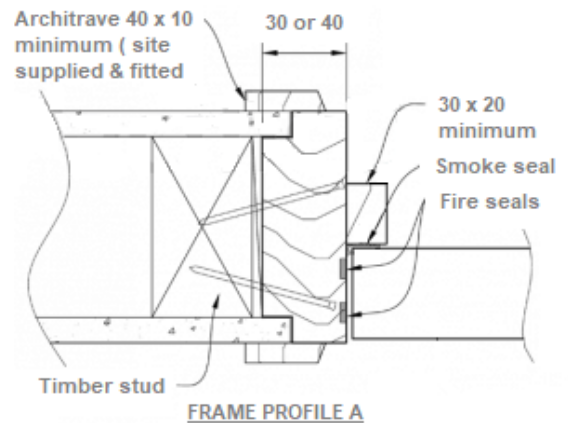

FRAME PROFILE A

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 30mm)

Fasteners:

Frame - Either nailed (75 x 3.2mm) or screwed (10g x 75mm) at 600mm centres nominal. Two fixings per location.

Stops - nailed (50 x 3.2mm) at 200mm centres.

Architrave - nailed (50 x 3.2mm) at 400mm centres.

Pryda Jam b-fixa brackets Type JFB100 at 500mm centres may be used to fix profiles A & B to approved walls.

Head Fixing (minimum):

Single door - none required


Paired door - double central fastener required

Stud size:

Ex 75 x 50 minimum.

Wedging gap:

0-10mm

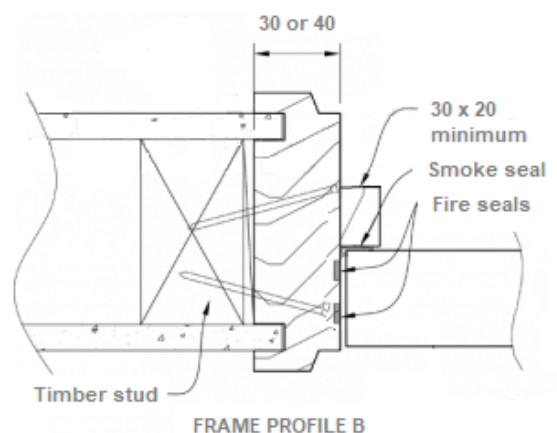

FRAME PROFILE B

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 30 mm)

Fasteners:

Frame - Either nailed (75 x 3.2 mm) or screwed (10g x 75 mm) at 600 mm centres. Two fixings per location.

Stops - nailed (50 x 3.2 mm) at 200 mm centres.

Architrave - nailed (50 x 3.2 mm) at 400 mm centres.

Head Fixing (minimum):

Single door - none required


Paired door - double central fastener required

Stud size:

Ex 75 x 50 minimum.

Wedging gap:

0-15 mm

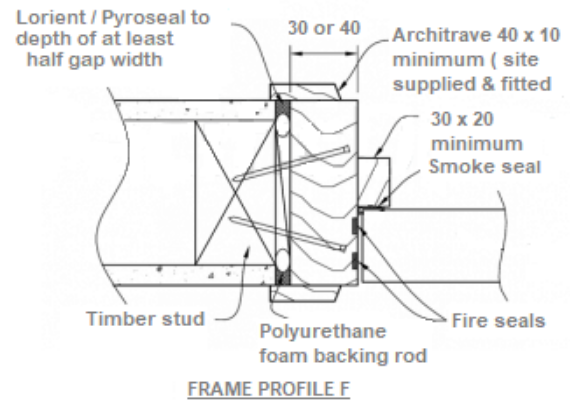

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 40 mm)

Fasteners:

Frame - Either nailed (75 x 3.2 mm) or screwed (10g x 75 mm) at 600 mm centres nominal. Two fixings per location.

Stops - nailed (50 x 3.2 mm) at 200 mm centres.

Architrave - nailed (50 x 3.2 mm) at 400 mm centres.


Pryda Jam b-fixa brackets Type JFB 100 at 500 mm centres may be used to fix profiles A & B to approved walls.

Stud size:

Ex 75x50 minimum.

Wedging gap:

0-10 mm

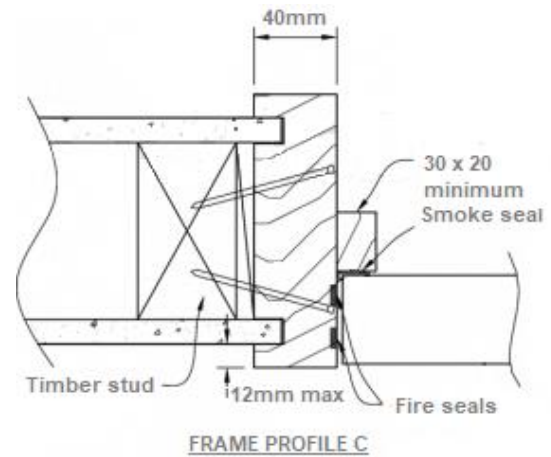

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL (2 PART)**

Frame materials available:

* EG Z - 1.6 mm

* Cold rolled galvanized - 1.6 mm

* Stainless Steel - 1.5 mm

Fasteners:

Frame to be screw fixed (8g x 50 mm self tapping through frame straps, timber packers and into timber stud. Standard is 4 No. per Jamb (Front section), 2 No. Per Jamb (Rear section)

Head Fixing (minimum):

Single door - none required

Paired door - 2 No. fasteners required (Front section only)

Stud size:

Ex 100x50 minimum

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)


No frame packing equals no insulation rating (i.e. -/xx/-)

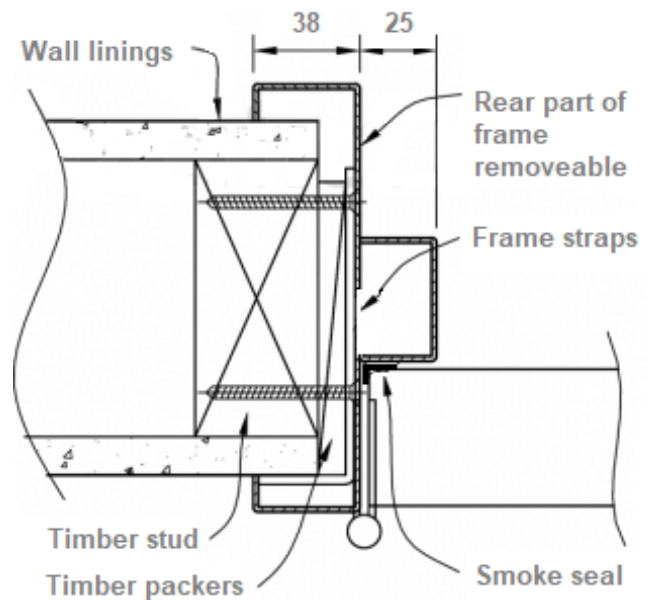

FRAME PROFILE D4
same method applies for D2

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL (2 PART)**

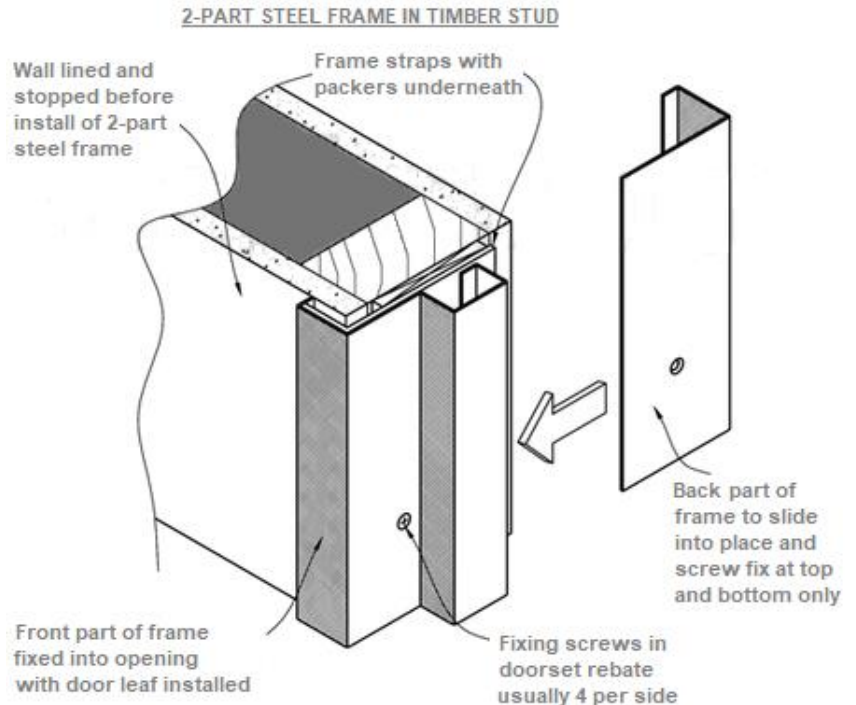

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EGZ - 1.6mm

Cold rolled galvanized - 1.6mm

Stainless Steel - 1.5mm

Fasteners:

Folded steel connection plates (as shown) to be supplied with frames.

Hook onto frame bracing straps and nail or screw to timber studs.

Frame connection plates either clouts (30 x 2.5mm gib clouts) or screw fixed.

Head Fixing (minimum):

Single door - none required

Paired door - single central fastener required

Stud size:

Ex 100 x 50 minimum

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

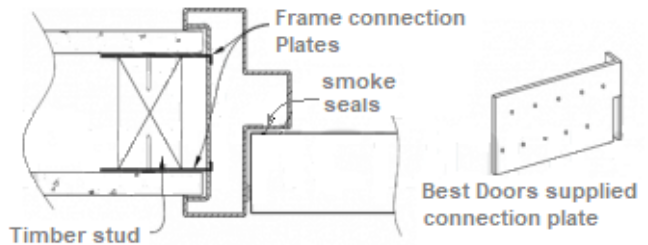

FRAME PROFILE D3

Same method for G & J : wall thickness will determine profiles available

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EGZ - 1.6mm

Cold rolled galvanized - 1.6mm

Stainless Steel - 1.5mm

Fasteners:

Framing stud No.1 screwed to jamb.

Connection to stud No.2 via rebated nail on plates. One fastener per location except at bottom where two fasteners are required.

Frame to be screw fixed (10g x 50mm self tapping) at 600mm nominal centres. Two fasteners per location where applicable.

Frame to be screw fixed (10g x 50mm self tapping) at 600mm nominal centres. Two fasteners per location where applicable.

Frame to be screw fixed (10g x 50mm self tapping) at 600mm nominal centres. Two fasteners per location where applicable.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:

Ex 100x50 minimum

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

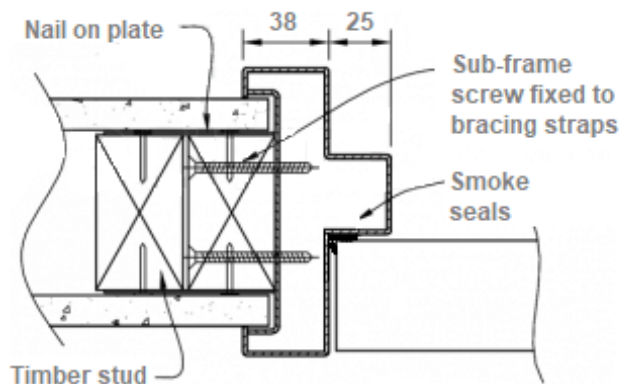

FRAME PROFILE D3

Same method for G & J : wall thickness will determine profiles available

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EG Z - 1.6 mm

Cold rolled galvanized - 1.6 mm

Stainless Steel - 1.5 mm

Fasteners:

Frame screwed to stud through Gib Fyreline packing between stud and shims. Frame to be screw fixed (10g x 50mm self tapping) at 600mm nominal centres. Two fasteners per location where applicable.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:


Ex 100 x 50 minimum

Wedging gap:

0-10 mm

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;
Plasterboard (30 minutes)
Cornice plaster (30 minutes)
Grout (60 minutes)
Mineral Wool (30 minutes)
No frame packing equals no insulation rating (i.e. -/xx/-)

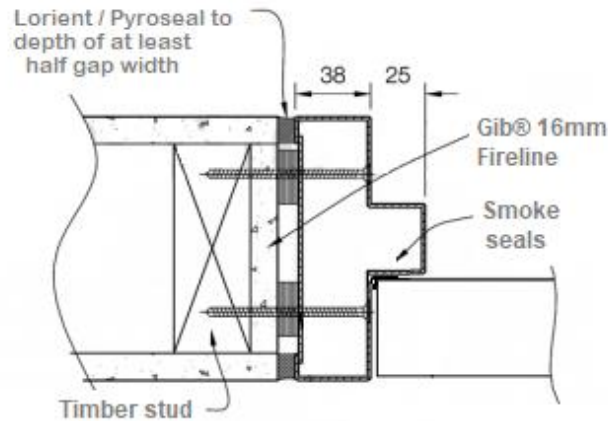

FRAME PROFILE D3

Same method for G & J: wall thickness will determine profiles available

WALL TYPE: **TIMBER STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EG Z - 1.6 mm

Cold rolled galvanized - 1.6 mm

Stainless Steel - 1.5 mm

Fasteners:

Frames may be screwed directly to studs either through the stud and into the frame bracing straps or through the frame into the timber stud at 600mm centres nominal. Frame to be screw fixed (10g x 50mm self tapping) at 600mm centres nominal. Two fasteners per location where applicable.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:


Ex 100 x 50 minimum

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;
Plasterboard (30 minutes)
Cornice plaster (30 minutes)
Grout (60 minutes)
Mineral Wool (30 minutes)
No frame packing equals no insulation rating (i.e. -/xx/-)

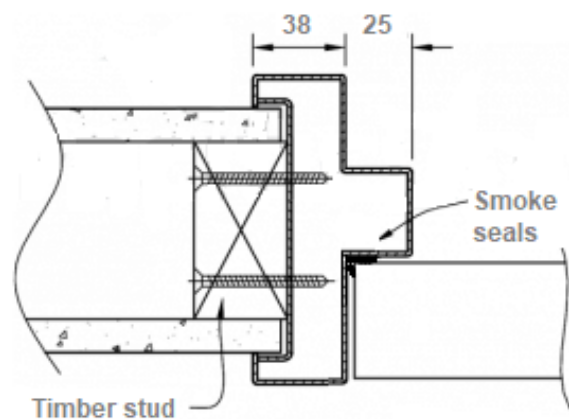

FRAME PROFILE D3

Same method for G & J: wall thickness will determine profiles available

WALL TYPE: MASONRY

FRAME TYPE: TIMBER

Frame materials available:

Timber (minimum thickness is 30mm)

Fasteners:

Frame - M8 or M10 'Ramset' Dynabolts at 600mm centres nominal. Fixings on or near centre of frame jamb.

Stops - nailed (50 x 3.2mm) at 200mm centres.

Architrave -nailed (50 x 3.2mm) at 400mm centres.


Head Fixing (minimum):

Single door - none required

Paired door - single central fastener required

Wedging gap:

0-15mm

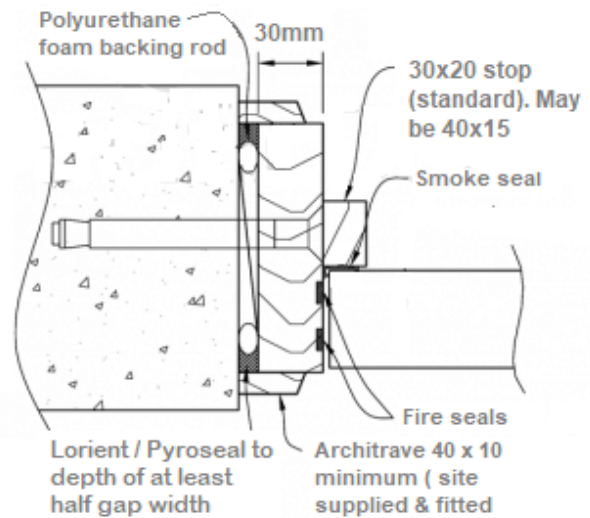

FRAME PROFILE F

WALL TYPE: MASONRY

FRAME TYPE: STEEL

Frame materials available:

EGZ - 1.6mm

Cold rolled galvanized - 1.6mm

Stainless Steel - 1.5mm (Must be fully grouted frame PR90-PR120)

Fasteners:

Jamb fixing at 600mm centres minimum

Expansion anchors eg. M10 countersunk

'Ramset' Dynabolts

M12 countersunk masonry screwbolts

Head Fixing (minimum):

Single door - none required

Paired door - single central fastener required

Wedging Gap:

0-15mm

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

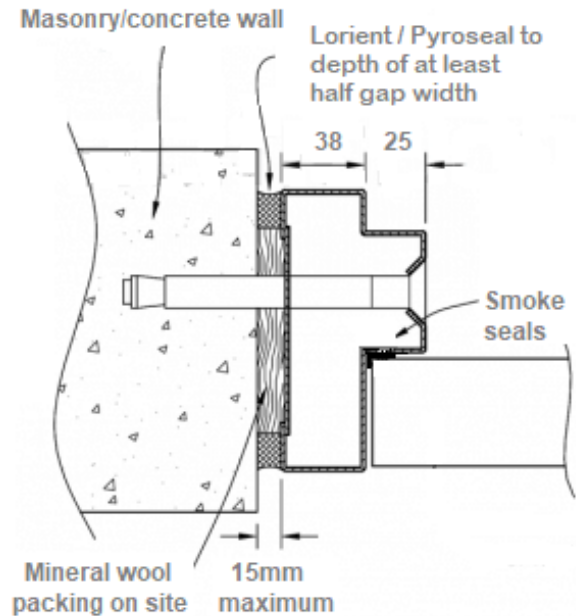

FRAME PROFILE D3

Same method for G & J : wall thickness will determine profiles available

WALL TYPE: **STEEL STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 30 mm)

Fasteners:

Frame - Screwed (10g x 50mm self tapping) at 600mm centres nominal. Minimum of one screw per location. Frames may also be installed by screw fixing the steel studs to the back of the timber frame during wall construction.

Stops - nailed (50 x 3.2mm) at 200mm centres.

Architrave - nailed (50 x 3.2mm) at 400mm centres.

Head Fixing (minimum):

Single door - none required


Paired door - double central fastener required

Stud size:

65 x 34mm minimum of 0.55 MSG gauge.

Wedging gap:

0-10mm

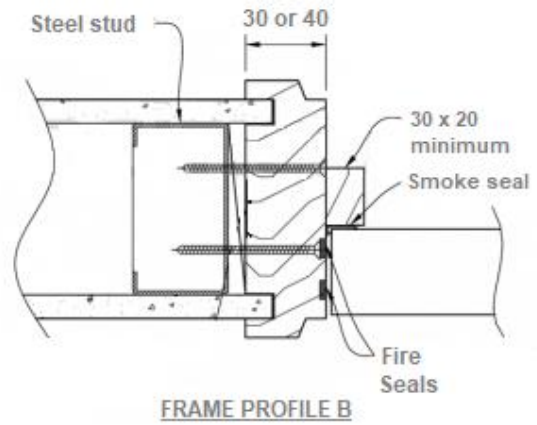

WALL TYPE: **STEEL STUD**

FRAME TYPE: **TIMBER**

Frame materials available:

Timber (minimum thickness is 30 mm)

Fasteners:

Frame - Screwed (10g x 50mm self tapping) at 600mm centres nominal. Minimum of one screw per location. Frames may also be installed by screw fixing the steel studs to the back of the timber frame during wall construction.

Stops - nailed (50 x 3.2mm) at 200mm centres.

Architrave - nailed (50 x 3.2mm) at 400mm centres.

Head Fixing (minimum):

Single door - none required


Paired door - double central fastener required

Stud size:

65 x 34mm minimum of 0.55 MSG gauge.

Wedging gap:

0-10mm

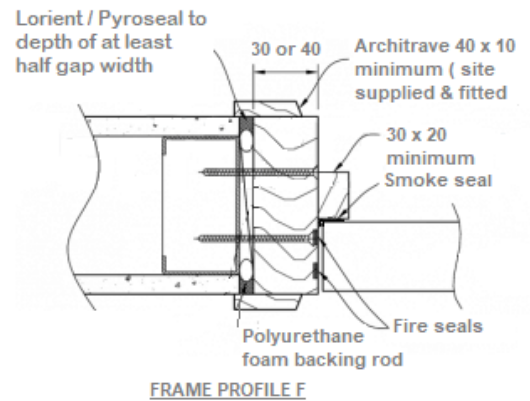

WALL TYPE: **STEEL STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EG Z - 1.6 mm

Cold rolled galvanized - 1.6 mm

Stainless Steel - 1.5 mm

Fasteners:

Frame screwed to boxed stud at 600 mm centres nominal with self tapping screws.

Steel studs may be riveted (steel pop rivets) or screwed (9g x 45 mm self tapping) to the frame bracing straps at 600 mm centres nominal.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:

65 x 34 mm minimum of 0.55 SM G gauge

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

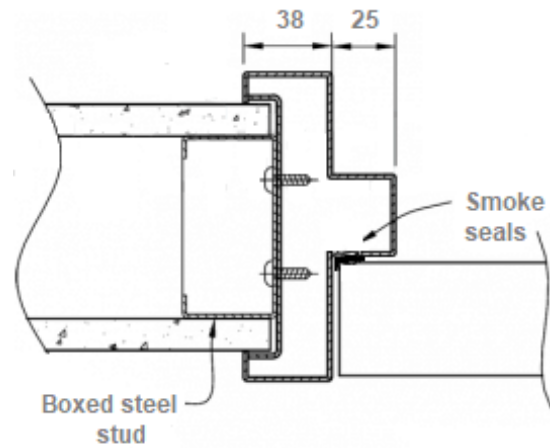

FRAME PROFILE D3

same method for G & J: wall thickness will determine profiles available

WALL TYPE: **STEEL STUD**

FRAME TYPE: **STEEL**

Frame materials available:

EG Z - 1.6 mm

Cold rolled galvanized - 1.6 mm

Stainless Steel - 1.5 mm

Fasteners:

Frame screwed to boxed stud at 600 mm centres nominal with self tapping screws.

Steel studs may be riveted (steel pop rivets) or screwed (9g x 45 mm self tapping) to the frame bracing straps at 600 mm centres nominal.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:

65 x 34 mm minimum of 0.55 SM G gauge

Wedging gap:

Not applicable

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;


Plasterboard (30 minutes)

Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

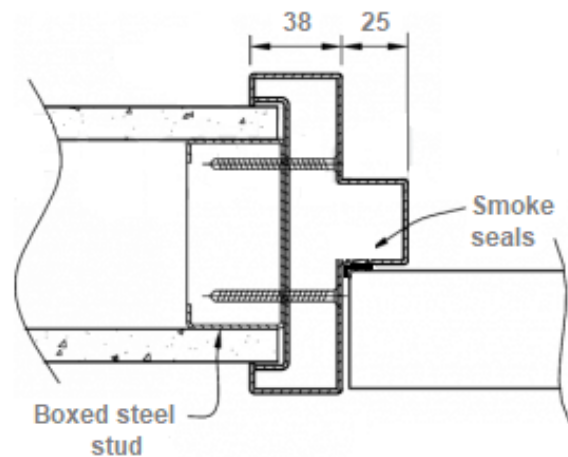

FRAME PROFILE D3

same method for G & J: wall thickness will determine profiles available

WALL TYPE: STEEL STUD

FRAME TYPE: STEEL

Frame materials available:

EGZ - 1.6 mm

Cold rolled galvanized - 1.6 mm

Stainless Steel - 1.5 mm

Fasteners:

Frame screwed to boxed studs with packing steel shims at 600 mm centres nominal.

Steel studs may be riveted (steel pop rivets) or screwed (9g x 45 mm self tapping) to the frame bracing straps at 600 mm centres nominal.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required

Stud size:

65 x 34 mm minimum of 0.55 SMG gauge

Wedging Gap:

0-10 mm

Insulation rating:

To obtain an insulation rating, the steel frame must be packed with either;

Plasterboard (30 minutes)


Cornice plaster (30 minutes)

Grout (60 minutes)

Mineral Wool (30 minutes)

No frame packing equals no insulation rating (i.e. -/xx/-)

Lorient / Pyroseal to depth of at least half gap width

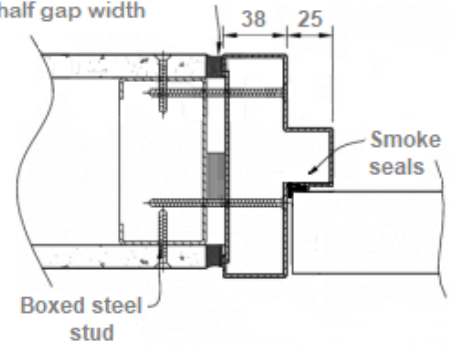

FRAME PROFILE D3

same method for G & J: wall thickness will determine profiles available

WALL TYPE: STEEL STUD

FRAME TYPE: TIMBER

Frame materials available:

Timber minimum 30 mm thick (standard thicknesses are 30 mm or 40 mm)

Fasteners:

Frame - either nailed (75 x 3.2 mm) or screwed (10g x 75 mm) at 600 mm centres. Two nails or screws per location.

Stops - nailed (50 x 3.2 mm) at 200 mm centres.

Architrave - nailed 50 x 3.2 mm) at 400 mm centres.

Pryda Jam b-fixa brackets Type JBF100 at 500 mm centres.

Head Fixing (minimum):

Single door - none required

Paired door - double central fastener required


Stud size:

Steel stud minimum 63 mm, timber stud to match

Wedging gap:

0-6 mm

Lorient / Pyroseal to depth of at least half gap width

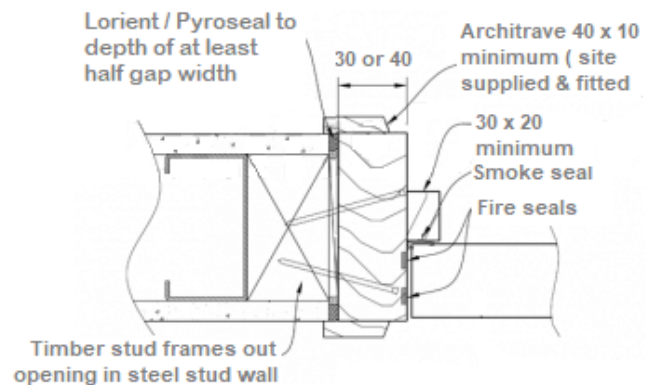

FRAME PROFILE F