


1.1 CATERPILLAR PACKAGE GENSET TYPE:C18- 706 KVA Prime

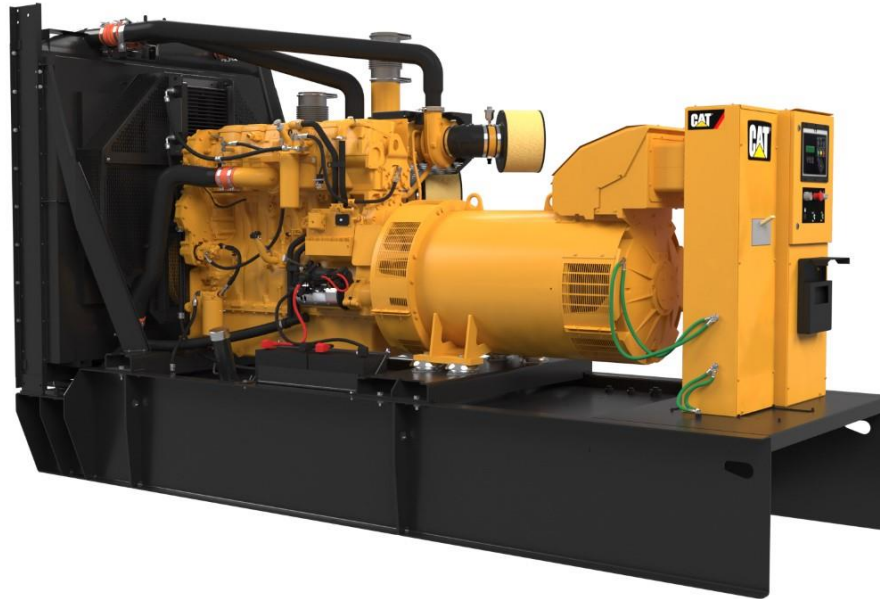

1.1.1 Engine Technical Data:

Maker:	Caterpillar Inc.
Type of Engine:	Four-Stroke, Diesel Fuel
Application:	Power Generation, Prime Power.
Cylinders Arrangement:	Inline-Type
No. Of Cylinders:	6 Cylinder
No. Of Strokes:	four Strokes
Bore:	145mm
Stroke:	183mm
Displacement:	18.13 L
Aspiration:	Turbocharged Air-to-Air Aftercooled
Compression Ratio:	14:1
Genset Output:	706 KVA - 564 eKW
Revolutions Per Minute:	1500 RPM

Mansour House, 188 Bath Road
Slough SL1 3GA, Berkshire, UK

1.1.2 Air Inlet System:

- Air cleaner, dual element.
(Not for Outdoor Use. Requires protection for outdoor storage)
- Turbocharger

1.1.3 Exhaust System

- Stainless steel exhaust flex
- Industrial silencer

1.1.4 Fuel System

- Standard open set fuel tank / base supplied base, formed steel with single wall integral 8-hour fuel tank.

1.1.5 Starting System

- Batteries with rack and cables
- Battery Charger 5 Amp

1.1.6 Cooling System:

- Radiator and cooling fan with guard
- Coolant drain line with valve
- Fan drive, battery charging alternator drive
- Caterpillar Extended Life Coolant
- Low coolant temperature alarm

1.1.7 Lubrication System:

- Lubricating oil
- Oil drain valves

1.1.8 Governing System:

- Cat Electronic Governor (ADEM A4).

1.1.9 Mounting System:


- Captive linear vibration isolators between base and engine-generator.
- Includes lifting provisions and termination points for coolant and lube oil drain lines

1.1.10 Generator Technical Data:

Rating:	706 KVA - 564 eKW @ 0.8 P.F.
Voltage:	400 Volts
Frequency:	50 Hz
Speed:	1500 RPM
Insulation:	Class "H"
No. of Bearing:	Single Bearing
Alignment:	Pilot Shaft
Excitation:	Self-Excited
Over Speed Capability:	150% of Synchronous speed
Wave Form:	Less than 2% deviation
Voltage Regulator:	Integrated Voltage Regulator (IVR)
Voltage Regulation:	±0.5% (steady state)
Circuit breaker:	1250-amp, 3 poles

1.1.11 Control Panel:

Generator - mounted, EMCP4.2B The Cat® EMCP 4.2 offers fully featured power metering, protective relaying and engine and generator control and monitoring. Engine and generator controls, diagnostics, and operating information are accessible via the control panel keypads (Electronic Modular Control Panel 4.2B), includes the followings:

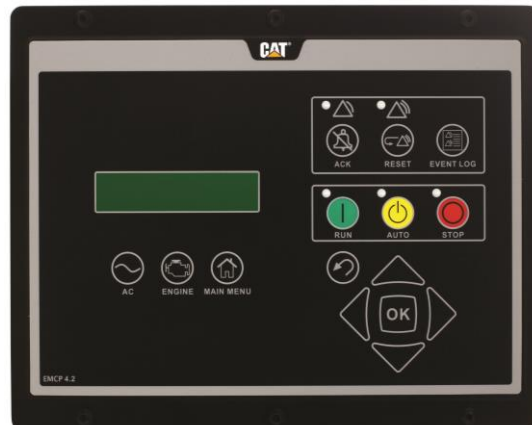

1.1.11.1 CONTROLS:

- Run / Auto / Stop control
- Speed and voltage adjust
- Local and remote emergency stop
- Remote start/stop
- Cycle crank
- Programmable cycle timer

Mansour House, 188 Bath Road
Slough SL1 3GA, Berkshire, UK

1.1.11.2 MONITORING:

- Coolant temperature
- Oil pressure
- Engine speed (RPM)
- Battery voltage
- Run hours
- Crank attempt and successful start counter
- Voltage (L-L, L-N)
- Current (Phase)
- Average Volt, Amp, Frequency
- kW, kVAr, kVA (Average, Phase, %)
- Power Factor (Average, Phase)
- kW-hr, kVAr-hr (total)

1.1.11.3 WARNING/SHUTDOWN INDICATION:

- Control switch not in auto (alarm)
- High coolant temp (alarm and shutdown)
- Low coolant temp (alarm)
- Low coolant level (alarm)
- Low Oil Pressure (alarm and shutdown)
- High engine oil temp (alarm and shutdown)
- Low, high and weak battery voltage
- Over speed shutdown
- Over crank

1.1.11.4 INPUTS & OUTPUTS:

- Two dedicated digital inputs
- Six programmable digital inputs
- Six programmable form A dry contacts
- Two programmable form C dry contacts
- Two digital outputs

1.1.11.5 PROTECTIVE RELAYING:

- Generator phase sequence
- Over/Under voltage (27/59)
- Over/Under frequency (81 O/U)
- Reverse Power (kW) (32)
- Reverse Reactive Power (kVAr) (32RV)
- Overcurrent (50/51)

Mansour House, 188 Bath Road
Slough SL1 3GA, Berkshire, UK

1.1.11.6 COMMUNICATION:

- Primary CAN data link