

Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Performance

Indoor Unit Model No: CDXS18LVJU
Outdoor Unit Model No: _____
Rated Cooling Capacity (Btu/hr): 18000
Sensible Capacity (Btu/hr): N/A
Max/Min Cooling Capacity (Btu/hr / kW): tabook/databook
Cooling Input Power (kW): 0.164
SEER: data book
Rated Heating Capacity (Btu/hr): 21600
Max/Min Heating Capacity (Btu/hr / kW): tabook/databook
Heating Input Power (kW): 0.164
Heating COP (Btu/hr / Btu/hr): data book
HSPF: data book

Indoor Unit Type: Concealed Ceiling (Low Static)
Condensing Unit Type: _____
Rated Cooling Conditions Indoor: 80°F DB/67°F WB
 Outdoor: 95°F DB/75°F WB
Rated Heating Conditions Indoor: 70°F DB/60°F WB
 Outdoor: 47°F DB/43°F WB
Rated Piping Length(ft) _____
Rated Height Separation(ft) _____

Indoor Unit Details

Power Supply (V/Hz/Ph): 208-230/60/1ph
Power Supply Connections: L1, L2, Ground
Min Circuit Amps MCA (A): 1
Max Overcurrent Amps MFA (A): _____
Dimensions (HxWxD): 7-7/8x35-7/16x24-7/16
Panel (HxWxD): N/A
Net Weight (lbs): 75
Weight with Panel (lbs): _____

Airflow Rate (CFM wet coil) 424/353/297
Moisture Removal (pt/h): 2.9
Gas Pipe Connection (inch): 1/2
Liquid Pipe Connection (inch): 1/4
Condensate Connection (inch): 25/32
Sound Pressure Level (dBA): 37
Sound Power Level (dBA): _____
Static Pressure Rated/Max (inWg) 0.16/0.16

Condensing Unit Details

Power Supply (V/Hz/Ph): _____
Power Supply Connections: L1, L2, Ground
Min. Circuit Amps MCA (A): _____
Max. Overcurrent Amps MFA (A): _____
Max. Starting Current MSC(A): _____
Rated Load Amps RLA (A): _____
Dimensions (HxWxD): N/A
Net Weight (lbs): _____

Compressor Type: Inverter
Capacity Control Range (%): _____
Airflow Rate (CFM): _____
Gas Pipe Connection (inch): _____
Liquid Pipe Connection (inch): _____
Sound Pressure Level (dBA): _____
Sound Power Level (dBA): _____

System Details

Refrigerant Type: R-410A
Holding Refrigerant Charge (lbs): -
Additional Charge (oz/ft): -
Pre-charge Piping (Length ft): -
Max. Pipe Length (Total ft): data book

Max. Pipe Length (Vertical ft): data book
Cooling Operation Range (°F): 14 - 115
Cooling Range w/Baffle (°F): _____
Heating Operation Range (°F): 5 - 64
Heating Range w/Baffle (°F): _____


Project Name: _____
 Location: _____
 Engineer: _____
 Submitted to: _____
 Submitted by: _____
 Reference: _____

Approval: _____
 Date: _____
 Construction: _____
 Unit #: _____
 Drawing #: _____

Dimensional Drawing - Indoor Unit

CDXS18LVJU

CDXS15_18LVJU

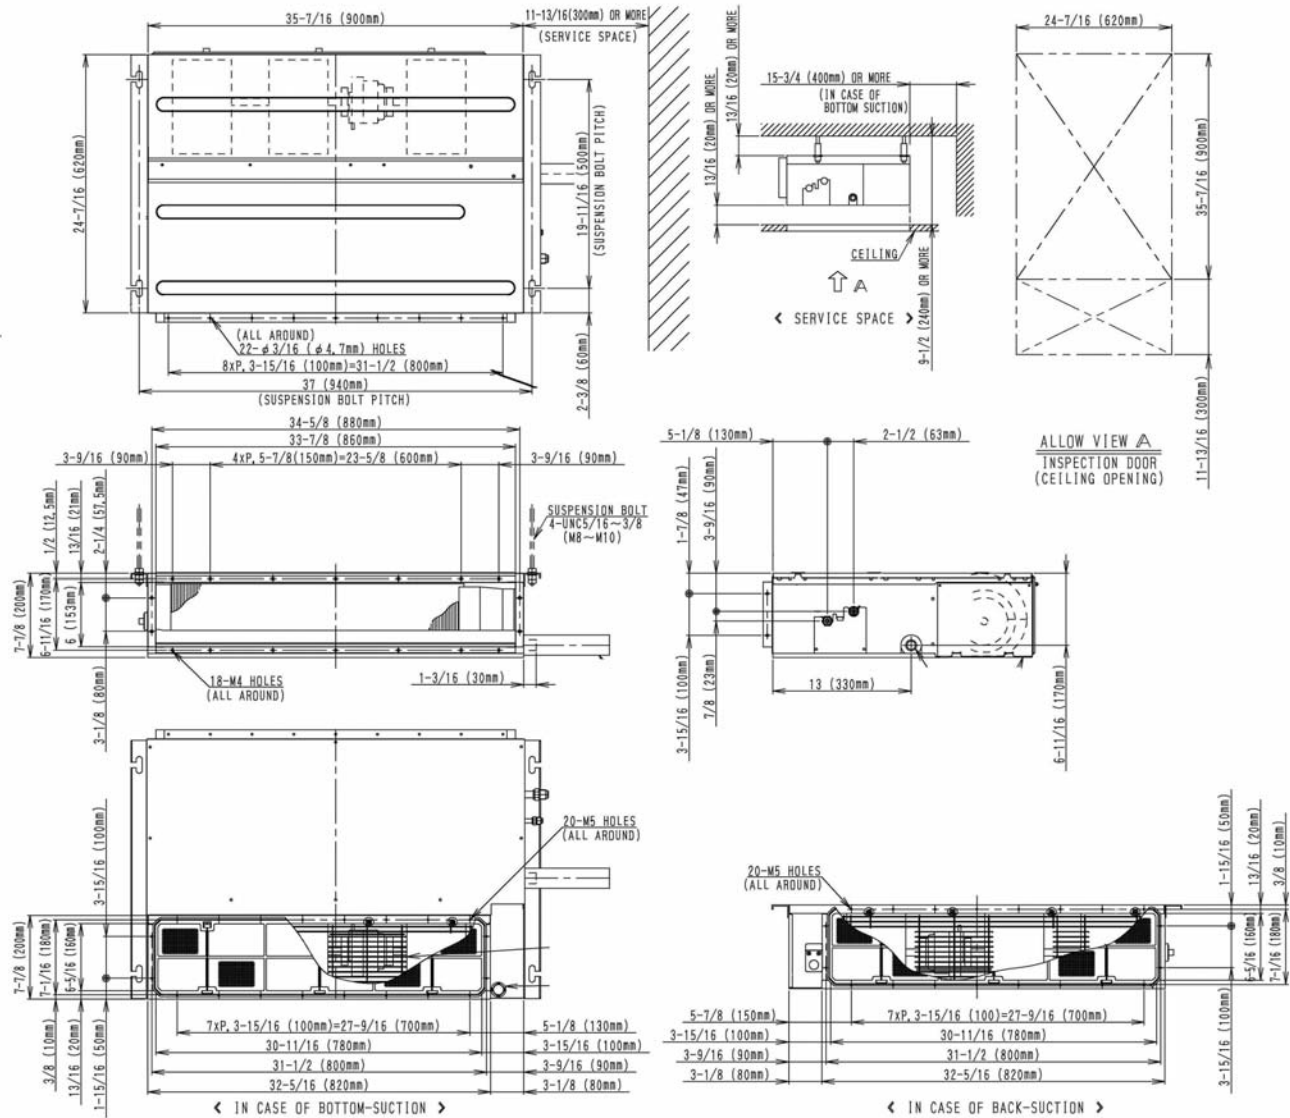

Project Name: _____
Location: _____
Engineer: _____
Submitted to: _____
Submitted by: _____
Reference: _____

Approval: _____
Date: _____
Construction: _____
Unit #: _____
Drawing #: _____

CDXS18LVJU



CDXS18LVJU

Options include Wind Baffle, Wired Remote Controller, Mounting Bracket, Std U.S. Warranty: 6yrs Compressor, 2yrs Parts

Options include Wind Baffle, Wired Remote Controller, Mounting Bracket, Std U.S. Warranty: 6yrs Compressor, 2yrs Parts