


Fire Pit Cavity Components

- (A) GFCI Outlet
- (B) Location for remote receiver (optional)
- (C) Pigtail plug included for easy installation
- (D) Electronics Box (Houses 120V - 24V Transformer)
- (E) 24V Power from Transformer to Gas Valve
- (F) Platinum Ignition / Control Box
- (G) Pilot Assembly
- (H) Gas Valve Supply IN
- (I) Gas Stub from source - Gas stub to be 2" - 6" min off the center & 3.5" - 5.5" high max
- (J) Plate/ Pan supports (not included)

External power switch required for all electronic ignitions (other than battery operated ignitions)


2 hr or 12 hr Dial Timer (Optional)



Emergency Stop Push Button (Optional)

Required 18 sq. inches of venting, or equivalent, on OPPOSING sides of fire pit. (36 inches total)

Clearances from combustible structure or materials

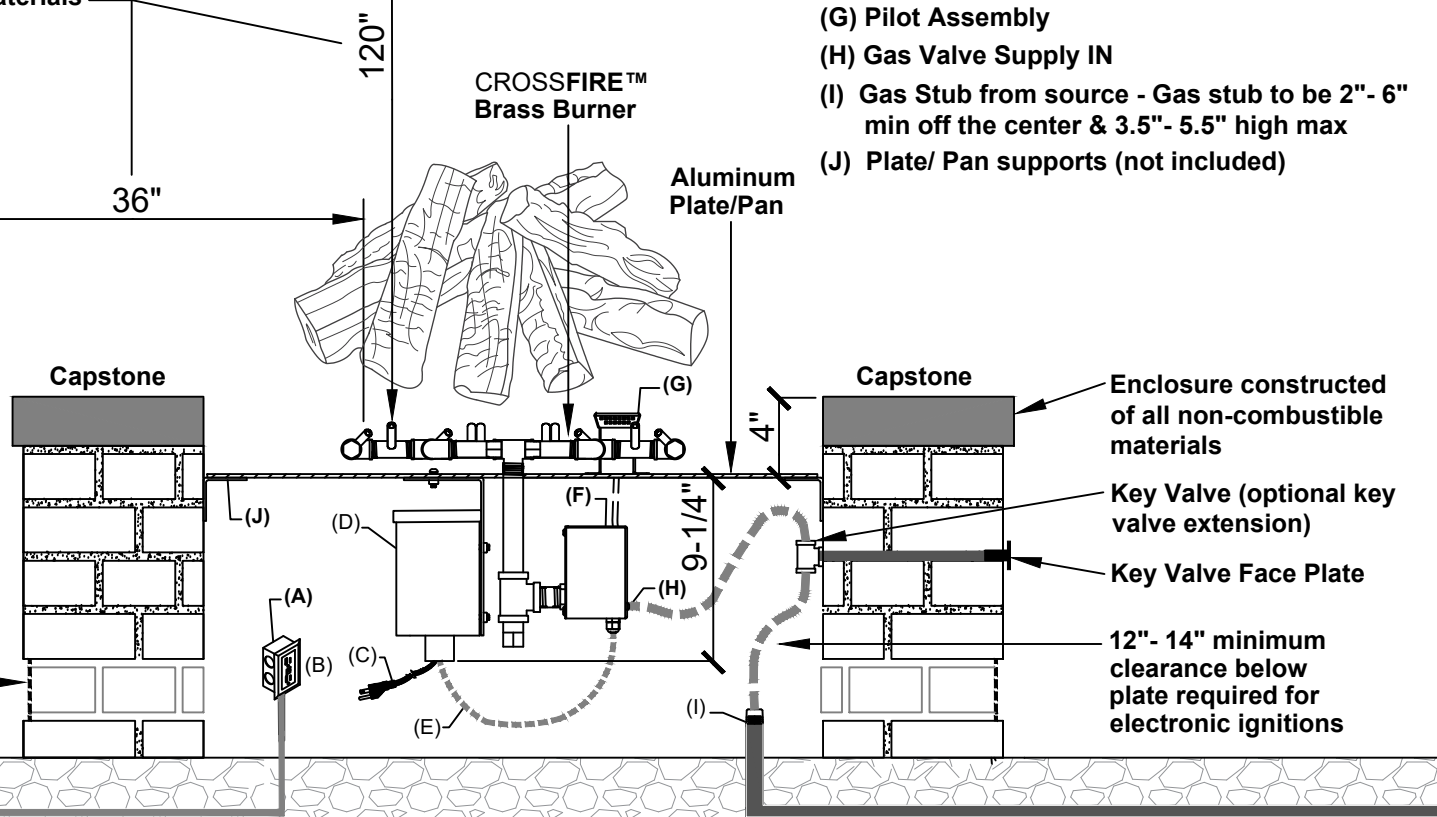

Enclosure constructed of all non-combustible materials

Key Valve (optional key valve extension)

Key Valve Face Plate

12" - 14" minimum clearance below plate for electronic ignitions

CONFIDENTIAL:

Any information data and drawings embodied in this document are proprietary and strictly confidential, are to be held as confidential and supplied with the understanding that they will not be disclosed, in whole or in part or in any form, to third parties without the prior written consent of Warming Trends, Inc. All information, illustrations, screen shots, and data contained are herein Copyright © Warming Trends Inc. all rights reserved.

Date: 08/02/2023

Customer:

Approved by: KO

Scale: NTS

Estimate #:

Approval Date: 08/02/2023

Tolerance: 0.75"

Revision Date:

Designer: BLD

WARMING TRENDS

CROSSFIRE
BRASS BURNERS

www.warming-trends.com