


# CWP PUMP STATION SYSTEM (SINGLE PUMP AND SWITCH)



BR = BROWN  
 BU = BLUE  
 GN/YE = GREEN/YELLOW

EARTH NEUTRAL LIVE  
 MAINS SUPPLY 230V 50Hz

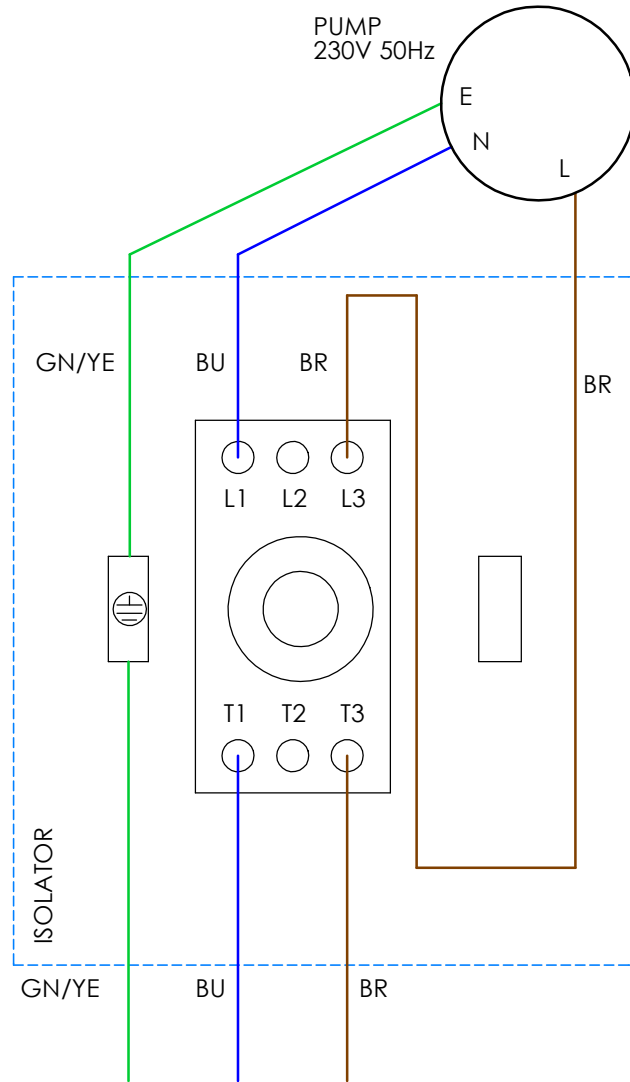

SEWAGE PUMP  
 GRUNDFOS UNILIFT  
 AP50B.50.08.A1.V  
 230V 50Hz  
 5.37 Amp



ISOLATOR  
 LOVATO GAZ016  
 16 Amp

### HEALTH AND SAFETY AT WORK ACT 1974

To ensure that the equipment described is safe both for personnel and property, it should be installed, commissioned and maintained by or under the supervision of qualified persons. Regard should be taken of IEE wiring regulations, codes of practice, statutory requirements and any specific instructions issued by the supplier of these drawings.

EARTHING: All equipment must be earth bonded in accordance with the latest IEE wiring regulations.

Please check with Kingspan Environmental that this drawing is the latest issue			
Issue	Date	Drawn by	Approved by
01	19/06/19	J.Belovic	

Material :	Tolerance :
Finish :	Thickness :
Weight : Kgs	Surface Area :

Drawing : DS1356B	
Electrical Diagram CWP Pump Chambers	

Page 1 of 1

All dimensions in mm

Scale: Not to scale

Clearwater reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Clearwater.

