Model S0000-FLW1

Flow Switch, 1-1/4" NPTI



SPECIFICATIONS:

Model S0000-FLW1 is a 1-1/4" NPTI DPDT double pole, double throw flow switch has contacts which allow for remote monitoring (by others) and audio/visual alarms (by others). Switch is installed in the water supply line prior to the emergency equipment and is activated once it senses the movement of water in the supply line.

STANDARD EQUIPMENT:

Flow Switch and Enclosure: 1-1/4" NPTI, DPDT Double Pole Double Throw, 125 volt, 5 amp flow switch. Flow Switch assembly is Exposion Proof and Weatherproof. Listed with UL & CSA, for the following:

Class I Groups B, C, D Class II Groups E, F, G

Mounting: The switch is provided with a tee fitting for mounting the unit in the vertical position prior to the supply inlet of the emergency equipment.



OPTIONAL ACCESSORIES:

Additional costs may be incurred





Acorn Safety assumes no responsibility for use of void or superseded data. © Copyright Acom Safety®, City of Industry, CA, Division of Acom Engineering Company®, Member of Morris Group International™. Please visit www.acorneng.com for most current specifications.

Submittal # S0000-FLW1 [ACC] Date: 08/30/17

Product complies to the following standards:



Acorn Engineering Company®, Morris Group International™


ACORN SAFETY P.O. Box 3527

City of Industry, CA 91744 U.S.A. Phone 800-591-9372 626-855-4804 www.acorneng.com

TECHNICAL DIMENSIONS

All dimensions are subject to manufacturer's tolerance of plus or minus 1/2" nominal and subject to change without notice. Acorn Safety® assumes no responsibility for use of void or superseded data. Dimensions may change with the addition of optional accessories. © Acorn Safety®, A Division of Acorn Engineering Company®, Member of Morris Group International™. Please visit www.acorneng.com for most current specifications.

■ Model S0000-FLW1: Flow Switch, 1-1/4" IPS

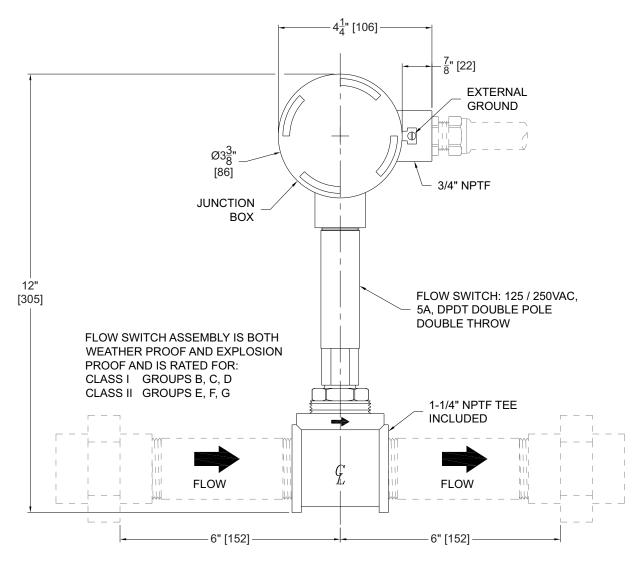

NOTES:

- 1. ALL DIMENSIONS ARE IN INCHES [MM].
- 2. OPERATING VOLTAGE: 125 / 250 VAC.
- 3. FLOW SWITCH MUST BE INSTALLED VERTICALLY WITH HORIZONAL FLOW.
- 4. DIRECTION OF FLOW MUST BE IN SAME DIRECTION AS SHOWN ON FLOW SWITCH.

▲ WARNING: Cancer and Reproductive Harm - www.P65Warnings.ca.gov

\$0000-FLW1 Date: 08/30/17

Acorn Safety warrants that its products are free from defects in material or workmanship under normal use and service for a period of one year from date of shipment. Acorn's liability under this warranty shall be discharged solely by replacement or repair of defective material, provided Acorn is notified in writing within one year from date of shipment, F.O.B. Industry, California.

UMMARY L FOR URING	Model Number & Options	Quantity	ACORO
lg ₹Ē	Company		G SAFETY
CTION SI PPROVA NUFACT	Contact	Title	800-591-9372
SELEC & A MAI	Signature (Approval for Manufacturing)	Date	or 626-855-4804 www.acorneng.com