

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400 Fax (03) 9371 2499

TEST REPORT

Client : New Oz Building Material Group P/L 2/262 Parramatta Road Granville NSW 2142

 Test Number
 :
 17-004936

 Issue Date
 :
 15/09/2017


 Print Date
 :
 15/09/2017

Sample Description	Clients Ref : "Stonefloor" Composite flooring End Use : Floating Floors Nominal Composition : Stone powder composite Nominal Thickness : 8mm					
AS/ISO 9239.1-2003	Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source					
	Date of Sample Arrival	08/09/2017				
	Date Tested	14/09/2017				
	CHF Value	1	2	3	Mean	
	Length	11.2	11.0	11.0	11.1	kW/m²
	Width	11.2	-	-	-	kW/m²
	Smoke Value	1	2	3	Mean	
	Length	76	59	86	74	%.min
	Width	67	-	-	-	%.min
	Melting				Yes	
	Blistering				Yes	

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2001 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Each specimen was clamped to a substrate of 6mm thick fibre reinforced cement board prior to testing.

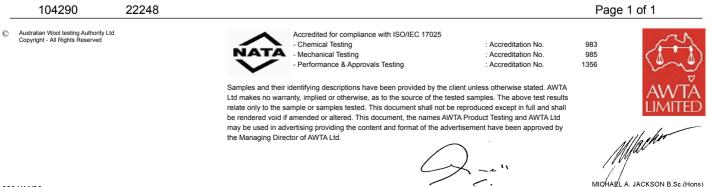

ANAGING DIRECTOR

Α