


WATER/GAS/PULSE
OUTPUT TYPE METERING

P-TRACKER
PANEL#XXXX

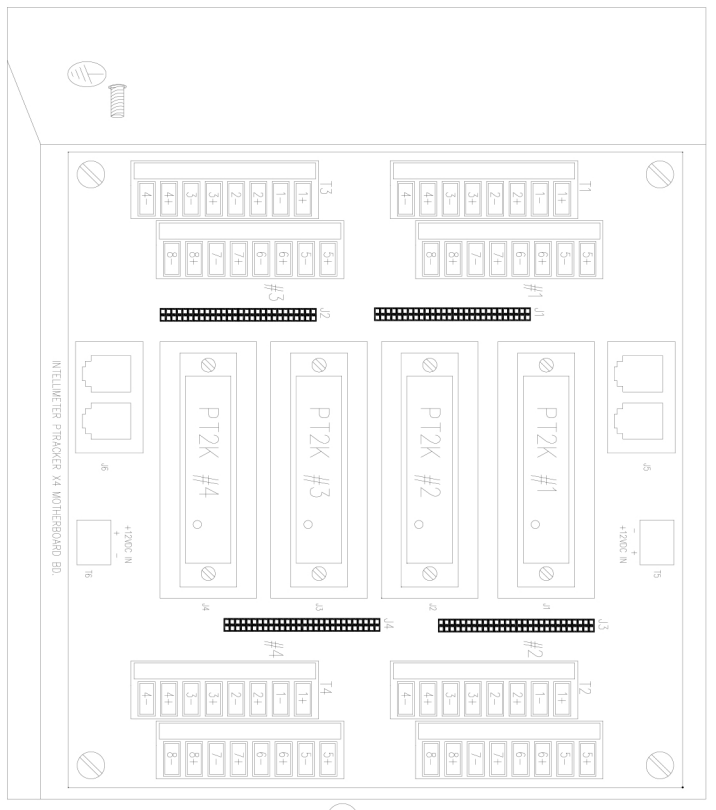

CH#	SUITE#	PT2K #1	SUITE#	CH#
01				05
02				06
03				07
04				08

CH#	SUITE#	PT2K #2	SUITE#	CH#
01				05
02				06
03				07
04				08

CH#	SUITE#	PT2K #3	SUITE#	CH#
01				05
02				06
03				07
04				08

CH#	SUITE#	PT2K #4	SUITE#	CH#
01				05
02				06
03				07
04				08

NOTE: FOR ALL PULSE OUTPUT
TYPE METER CABLE TO BE
#20 AWG TWISTED PAIR SHIELD (MIN).
* SHIELDED TO BE GROUNDED IN PANEL.



revision	A	Initial Design	DATE
	B	Issued for ordering	
	C	Issued for mfg	
		CANCELLED	

Project Name: _____

Engineer: _____

Manufacturer: _____

Rev. No.: _____ Date: _____

Contractor: _____

Drawn By: _____
HOSSSEIN PAKBIN

Date: _____
APR. 21, 2005

P.O.# _____

Drawing Number: _____

Project Number: _____

Drawing: _____