


Typical i-meter 636 EXTC Installation

MDU

Communication Box

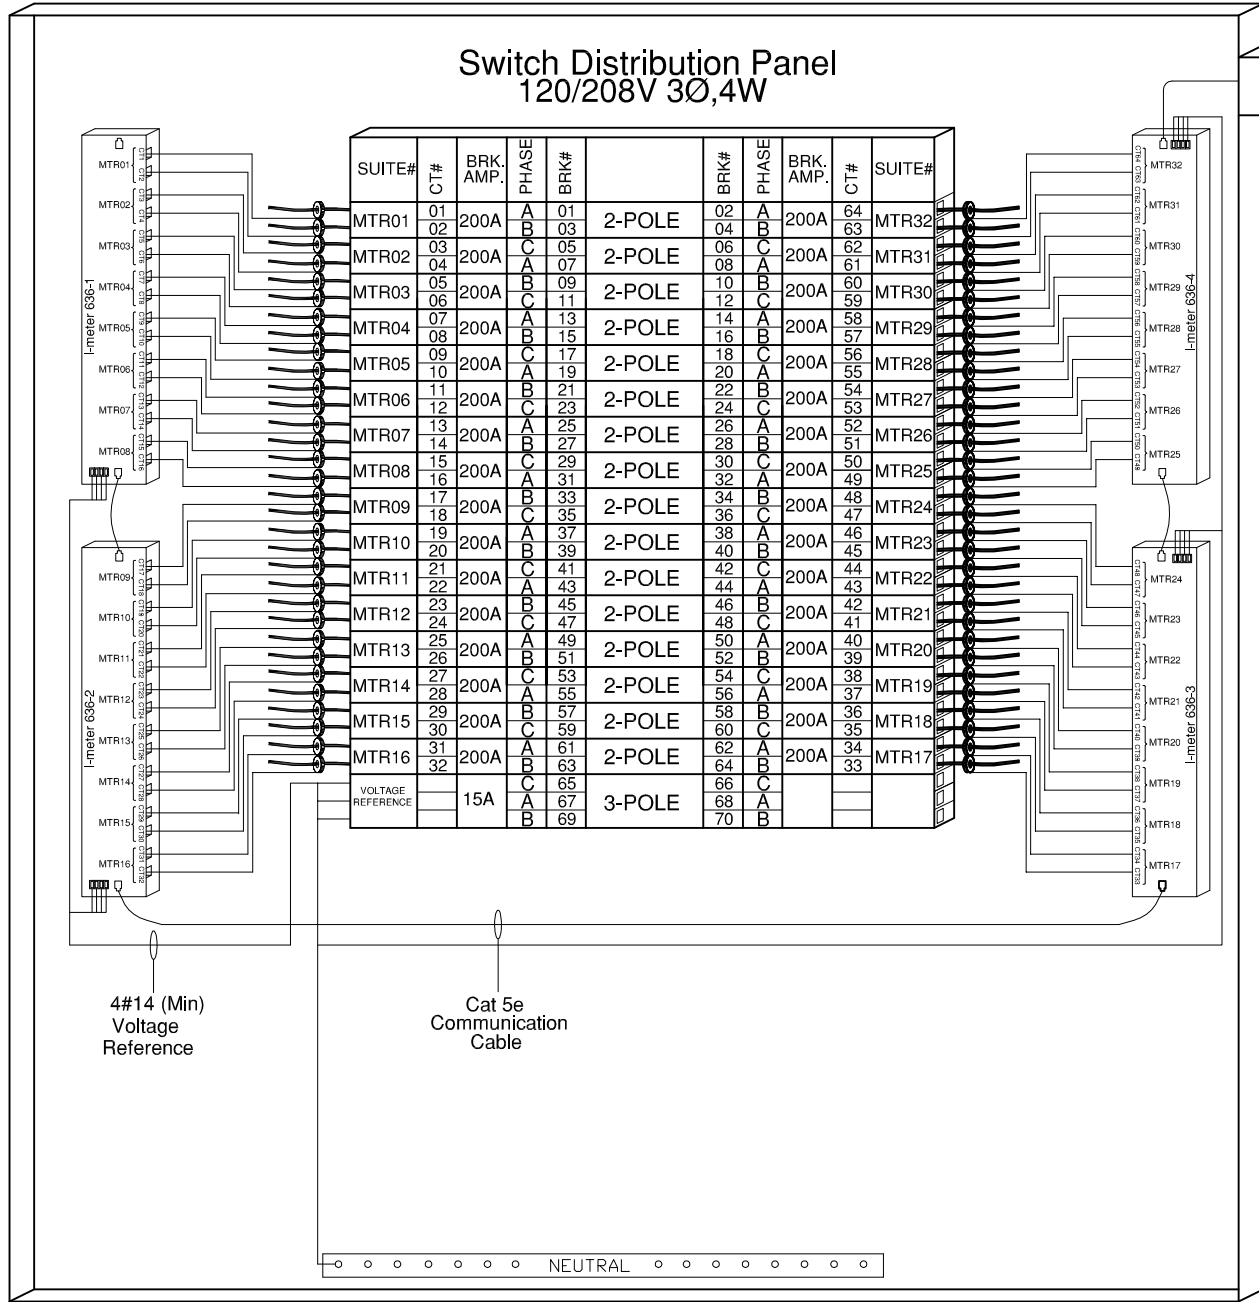

WARNING: METERING PANEL HAS BEEN PHASED ACCORDINGLY. DO NOT CHANGE ASSIGNED DISTRIBUTION.

SDP and EMP Designation

i-meter 636-1		i-meter 636-2		i-meter 636-3		i-meter 6363-4	
SUITE NO.	METER NO.	SUITE NO.	METER NO.	SUITE NO.	METER NO.	SUITE NO.	METER NO.
	METER#01		METER#09		METER#17		METER#25
	METER#02		METER#10		METER#18		METER#26
	METER#03		METER#11		METER#19		METER#27
	METER#04		METER#12		METER#20		METER#28
	METER#05		METER#13		METER#21		METER#29
	METER#06		METER#14		METER#22		METER#30
	METER#07		METER#15		METER#23		METER#31
	METER#08		METER#16		METER#24		METER#32

N.B.: PLEASE COMPLETE THE SHOP DRAWING WITH THE APPROPRIATE SUITE IDENTIFICATION.
SDP : Switch Distribution Panel EMP: Electronic Metering Panel

 Innovative Metering Solutions	Project Name:	Distributor:	Engineer:	P.O.#:	Date:	Rev:	Project#:	Drawing#:	Drawn:	Checked:	Drawing:
									C.H.	H.P.	i-meter 636 EXTC Installation (2 Pole)