


Flanged Butterfly Valves


F6, F7 HDU **Ductile Butterfly Valves**

Service	_	chilled, hot water, 60% glycol	
0011100		• • • • • • • • • • • • • • • • • • • •	
FIOW CHARACTERISTIC		modified equal percentage	
01	F7	linear	
Sizes	_	2" to 12"	
Type of end fitting		for use with ANSI Class 125/150 flanges	
Materials			
Body		ductile iron ASTM A536	
Body finish		epoxy powder coated	
Disc		304 stainless steel	
Seat		EPDM	
Shaft		416 stainless steel	
O-ring		EPDM	
Bushings		RPTFE	
Media temperature range		-22°F to 250°F [-30°C to 120°C]	
Body pressure rating		232 psi cold working pressure (CWP)	
Close-off pressure		50 psi	
Rangeability		10:1 (for 30° to 70° range)	
Maximum velocity	_	12 FPS	
Leakage		0%	

F6, F7 HD, L **Ductile Butterfly Valves**

Technical Data			
Service		chilled, hot water, 60% glycol	
Flow characteristic F6		modified equal percentage	
	F7	linear	
Sizes F6		2" to 30"	
	F7	2" to 24"	
Type of end fitting		for use with ANSI 125/150 flanges	
Materials			
Body		ductile iron ASTM A536	
Body finish		HD Series: epoxy powder coated	
		L Series: polyester powder coat	
Disc		304 stainless steel	
Seat		EPDM standard	
Shaft		HD Series: 416 stainless steel	
		L Series: 420 stainless steel	
O-ring		EPDM	
Bushings		HD Series: RPTFE	
		L Series: bronze, steel, PTFE	
Media temperature range		-22°F to 250°F [-30°C to 120°C]	
Body pressure rating		232 psi cold working pressure (CWP)	
Close-off pressure		200 psi (2"-12"), 150 psi (14"-30")	
Rangeability		10:1 (for 30° to 70° range)	
Maximum velocity		12 FPS	
Leakage		0%	

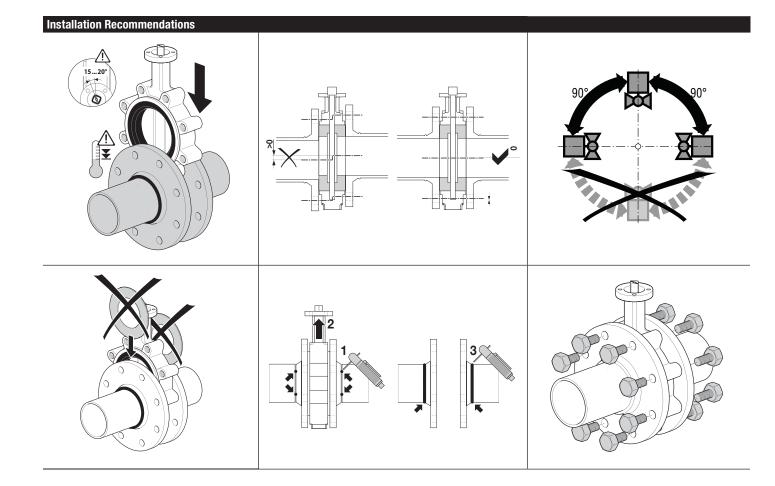

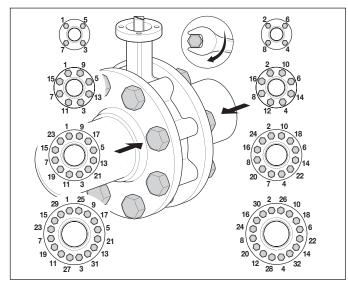

Max Torque for Bolts					
Valve Size	Bolt Size	Max Torque [ft-lbs]			
2"-4"	5/8"	70			
5"-8"	3/4"	120			
10"-12"	7/8"	200			
14"-16"	1"	240			
18"-20"	1-1/8"	380			
24"-30"	1-1/4"	520			
32"-48"	1-1/2"	800			
54"-60"	1-3/4"	1800			

Valve Installation Procedure

Position the connecting pipe flanges in the line to insure proper alignment prior to valve installation. Spread the pipe flanges apart enough to allow the valve body to be located between the flanges without actually contacting the flange surfaces. Exercise particular care in handling the valve so as to prevent possible damage to the disc or seat faces.

Note: Actuator must be mounted at or above pipe center line for all actuator types.

- When installing in Victaulic piping systems, use Victaulic 41 series flange nipples. 741 flanges not recommended without the use of adapter rings.
- HD-Series Butterfly valves are designed to be installed between ANSI 125/150 flat-faced, raised face, slip-on or weld neck flanges.
- 3. Do NOT use flange gaskets on HD-Series Butterfly valves.
- 4. For Lug style valves:
 - a. Place the valve between the flanges.
 - b. Install all bolts between the valve and the mating flanges. Hand tighten bolts as necessary.
- Before completing the tightening of any bolts, the valve should be centered between the flanges and then carefully opened and closed to insure free, unobstructed disc movement.
- Using the sequence, tighten the flange bolts evenly to assure uniform compression. In assembling flange joints, the resilient seating surface shall be uniformly compressed.
- If an actuator is to be operated, electricity should be connected to the unit in accordance with the local electrical codes.
- 8. Cycle the valve to the fully open position, then back to the fully closed position, checking the actuator travel stop settings for proper disc alignment. The valve should be operated to assure that no binding is taking place. If no power is available, use the manual handwheel.
- 9. The valve is now ready for operation.

General Maintenance

The following periodic preventative maintenance practices are recommended for all Butterfly Valves.

- 1. Operate the valve from full open to full closed to assure operability.
- Check flange bolting, actuator mounts and hangers for evidence of loosening and correct as needed.
- 3. Inspect the valve and surrounding area for previous or existing leakage at flange faces or shaft connections.
- Check piping and/or wiring to actuators and related equipment for looseness and correct as needed.
- If not in use, exercise the butterfly valve (full open and close) at least once a month.

Note: Run an adaptation when a new MFT actuator is installed.

Safety Precautions

Before removing the valve from the line or loosening any bolts, it is important to verify the following conditions:

- 1. Be sure the line is depressurized and drained.
- 2. Be sure of the pipeline media. Proper care should be taken for protection against toxic and/or flammable fluids.
- 3. Never remove the valve without an Operator (Manual or Automatic) already attached to the valve shaft.
- 4. Never remove the Operator from the valve while the valve is in the pipeline under pressure.
- 5. Always be sure that the disc is cracked approximately 5° off of the closed position before removing the valve.

Storage of Butterfly Valve Assemblies

- Assemblies must be stored indoors, protected from the elements.
- Materials received on job sites that have long installation lead times should receive extra protection from construction damage.
- Valve faces must be protected from abrasion, cutting and nicking, as this will damage the face and may cause flange area leaks.
- Electric actuators cannot be stored in wet, damp or caustic areas.
- Do not store construction material on top of valve assemblies.

Valve Installation- Dead End Service

INSTALLATION NOTES

- 1. Follow previously described pre-installation and installation procedures.
- To achieve the full close-off pressure of the HD/HDU series, a flange is required on the open or down stream side of the valve (See diagram below)

