



Lithernet - Casambi Gateway v3.26

User Manual
Revision: 14.03.2023

Table of contents

1. Hardware	7
1.1. LED Status Display	8
1.2. Hardware Revision	9
1.2.1. Hardware Revision 0	10
1.2.2. Hardware Revision 1	11
1.2.3. Hardware Revision 2	12
1.3. Watchdog	13
1.4. Reset Button	14
1.5. Conformity	15
1.5.1. Hardware Revision 1	16
1.5.2. Hardware Revision 2	17
1.6. Bluetooth module	18
1.6.1. Hardware Revision 0 und 1	20
1.6.2. Hardware Revision 2	22
1.7. Type label	24
1.7.1. Hardware Revision 1	25
1.7.2. Hardware Revision 2	26
1.8. Firmware Version	27
1.9. Software Librarys	28
2. Areas of application	29
2.1. Gateway to an existing lighting control system (Netcomposer)	30
2.2. Gateway to an existing lighting control system (Helvar)	32
2.3. Gateway to a system using UDP or TCP (ASCII based commands)	34
2.4. Bridge between individual Casambi networks	35
2.5. Coupling to an existing evaluation system / visualization	37
2.6. ArtNet gateway	39
2.7. BacNet/IP gateway	40
2.8. MQTT	41
2.9. Example implementations	42
3. Login	43
4. General setting	45
4.1. Firmware warning	46
4.2. Network	47
4.2.1. IP settings	48
4.2.2. Webserver Login	49
4.2.3. NTP-Client	50
4.2.4. Restart gateway	51
4.3. System	52
4.3.1. Control system wizard	55
4.3.1.1. Netcomposer system	57
4.3.1.2. Art-Net	58
4.3.1.3. Free commands over UDP	59
4.3.1.4. HelvarNet (TCP)	60
4.3.1.5. Free commands over TCP	61
4.3.1.6. UDP Casambi Command	62
4.3.1.7. TCP Casambi Command	63
4.3.1.8. UDP Casambi Bridge	64
4.3.1.9. BacNet/IP	65
4.3.1.10. MQTT	67
4.3.2. Casambi Settings	69

4.3.3. LED settings	70
4.3.4. Date and time	71
4.3.5. Automation	72
4.3.6. Restart gateway	73
4.4. Memory	74
4.4.1. Update firmware	75
4.4.2. Import / Export	76
4.4.3. System memory	77
4.4.4. UDP Debug Port	78
4.4.4.1. LanLog.exe	79
4.5. Reset device	80
5. Protocol-specific settings	82
5.1. ArtNet	83
5.1.1. To Casambi	84
5.1.2. From Casambi	87
5.2. BacNet/IP	88
5.2.1. View in the gateway	89
5.2.1.1. To Casambi	90
5.2.1.1.1. Commands	91
5.2.1.1.2. Sensors	92
5.2.1.1.2.1. Lightsensor	94
5.2.1.1.2.2. Presence	95
5.2.1.2. From Casambi	96
5.2.2. View in BacNet	97
5.2.2.1. To Casambi	99
5.2.2.2. From Casambi	101
5.2.2.3. Sensor Value To Casambi	102
5.2.2.4. Broadcast	103
5.2.2.5. Device	104
5.2.2.6. Ungrouped	106
5.2.2.7. Group	107
5.2.2.8. Scene	108
5.2.3. Polling	109
5.3. Free commands over TCP	110
5.3.1. To Casambi	111
5.3.1.1. Select storage location	112
5.3.1.2. Trigger	113
5.3.1.3. Action	114
5.3.2. From Casambi	115
5.3.2.1. Select storage location	116
5.3.2.2. Trigger	117
5.3.2.3. Action	119
5.4. Free commands over UDP	120
5.4.1. To Casambi	121
5.4.1.1. Select storage location	122
5.4.1.2. Trigger	123
5.4.1.3. Action	124
5.4.2. From Casambi	125
5.4.2.1. Select storage location	126
5.4.2.2. Trigger	127
5.4.2.3. Action	129
5.5. HelvarNet (TCP)	130

5.5.1. To Casambi	131
5.5.1.1. Commands	132
5.5.1.1.1. Select storage location	133
5.5.1.1.2. Trigger.....	134
5.5.1.1.3. Action.....	135
5.5.1.2. Sensors.....	136
5.5.2. From Casambi.....	137
5.5.2.1. Select storage location.....	138
5.5.2.2. Trigger.....	139
5.5.2.3. Action.....	141
5.5.3. HelvarNet Command Builder	142
5.5.3.1. Recall Scene (Group).....	143
5.5.3.2. Recall Scene (Device).....	144
5.5.3.3. Direct Level (Group).....	145
5.5.3.4. Direct Level (Device).....	146
5.5.3.5. Dimm (Group).....	147
5.5.3.6. Dimm (Device).....	148
5.6. MQTT.....	149
5.6.1. View in the gateway.....	150
5.6.1.1. To Casambi	151
5.6.1.1.1. Commands	152
5.6.1.1.2. Sensors MQTT	153
5.6.1.1.2.1. Lightsensor	154
5.6.1.1.2.2. Presence.....	155
5.6.1.2. From Casambi.....	156
5.6.2. View in MQTT	157
5.6.2.1. MQTT data received	158
5.6.2.1.1. Gateway.....	159
5.6.2.1.2. Broadcast.....	160
5.6.2.1.3. Device.....	161
5.6.2.1.4. ungrouped.....	164
5.6.2.1.5. Groups	165
5.6.2.1.6. Scenes.....	166
5.6.2.2. Send MQTT data.....	167
5.6.3. Poling.....	171
5.7. Netcomposer	172
5.7.1. To Casambi	173
5.7.1.1. Select storage location.....	174
5.7.1.2. Trigger.....	175
5.7.1.3. Action.....	176
5.7.2. From Casambi.....	177
5.7.2.1. Select storage location.....	178
5.7.2.2. Trigger.....	179
5.7.2.3. Action.....	181
5.7.3. Netcomposer Command Builder	182
5.7.3.1. Device Level.....	183
5.7.3.2. Scene	184
5.7.3.3. Group with Scene.....	185
5.7.3.4. Group with Level	186
5.7.3.5. Sequence.....	187
5.8. UDP Casambi Command.....	188
5.8.1. View in the gateway.....	189

5.8.1.1. To Casambi	190
5.8.1.2. From Casambi	191
5.8.2. Control in the network	192
5.8.2.1. Commands from the Casambi system	194
5.8.2.1.1. 0x0D - scene called	195
5.8.2.1.2. 0x1A - SetParameterValue	196
5.8.2.1.3. 0x1B - ParametersComplete	197
5.8.2.1.4. 0x28 - time received from the Casambi network	198
5.8.2.1.5. 0x39 - node status	199
5.8.2.1.6. 0x3A - notify node removed	200
5.8.2.1.7. 0x45 - scene status	201
5.8.2.1.8. 0x46 - target status	202
5.8.2.1.9. 0x49 - Target Color	203
5.8.2.1.10. 0x4B - NotifyControlValues Responses	204
5.8.2.2. Commands to the Casambi system	206
5.8.2.2.1. 0x10 - Push Button Pressed	207
5.8.2.2.2. 0x11 - Push Button Released	208
5.8.2.2.3. 0x1D - GetParameterValue	209
5.8.2.2.4. 0x1E - Set the level of a scene	210
5.8.2.2.5. 0x1F - Set level of a group	211
5.8.2.2.6. 0x20 - Set the level of a target	212
5.8.2.2.7. 0x21 - Set the level of a button's target	213
5.8.2.2.8. 0x28 - Request time from the Casambi network	214
5.8.2.2.9. 0x28 - Set time in the Casambi network	215
5.8.2.2.10. 0x2B - Set presence sensor	216
5.8.2.2.11. 0x2C - Set light sensor	217
5.8.2.2.12. 0x2F - Set color via RGBW	218
5.8.2.2.13. 0x31 - SetTargetVerticalRatio	219
5.8.2.2.14. 0x38 - SetColor X/Y	220
5.8.2.2.15. 0x39 - Node state	221
5.8.2.2.16. 0x3D - Set Color via Hue / Sat	222
5.8.2.2.17. 0x3E - SetTargetDimmers	223
5.8.2.2.18. 0x3F - SetTargetElements	224
5.8.2.2.19. 0x45 - Scene state	225
5.8.2.2.20. 0x46 - Target Status	226
5.8.2.2.21. 0x48 - Set color temperature	227
5.8.2.2.22. 0x49 - Target Color	228
5.8.2.2.23. 0x4A - Resume Automation	229
5.8.2.2.24. 0x4B - NotifyControlValues	230
5.8.2.3. Demo programs	231
5.9. TCP Casambi Command	232
5.9.1. View in the gateway	233
5.9.1.1. To Casambi	234
5.9.1.2. From Casambi	235
5.9.2. Control in the network	236
5.10. UDP Casambi Bridge	237
5.10.1. Bridge Mode Command Builder	238
5.10.2. To Casambi	239
5.10.2.1. Select storage location	240
5.10.2.2. Action	241
5.10.3. From Casambi	242
5.10.3.1. Select storage location	243

5.10.3.2. Trigger.....	244
5.10.3.3. Action.....	246
5.11. Casambi.....	247
5.11.1. Ping.....	248
5.11.2. Set Level.....	249
5.11.3. Push Button Pressed.....	250
5.11.4. Push Button Released.....	251
5.11.5. Set Presence.....	252
5.11.6. Set Scene Level.....	253
5.11.7. Set Group Level.....	254
5.11.8. Set Push Button Level.....	255
5.11.9. Set Lux Sensor.....	256
5.11.10. Set Tc.....	257
5.11.11. Set RGBW.....	258
5.11.12. Set Hue / Sat.....	259
5.11.13. Set Vertical.....	260
5.11.14. Start Automation.....	261
5.11.15. SetTargetDimmers.....	262
5.11.16. SetTargetElements.....	263
6. Console.....	264
6.1. console.....	267
6.2. Parameter.....	268
7. Settings in the Casambi app.....	269
7.1. Profile selection.....	270
7.2. Behave as a lamp.....	271
7.3. Settings as a lamp.....	272
7.4. Settings as a button.....	274
7.5. Settings as a PIR sensor.....	275
7.6. Settings as a lux sensor.....	276
7.7. Identify.....	277
8. Changelog Firmware.....	278
9. Support.....	279

1. Hardware



The device has only one connection for network (RJ-45). The power is supplied via POE.

The gateway consumes one address in the Casambi network.

There are 4 LEDs on the front panel for status indication.

1.1. LED Status Display



The module has 4 LEDs on the front. From bottom to top:

- 1) Operating LED - flashes green regularly (1 second)
- 2) Network status - lights up yellow when the network is plugged in
- 3) UDP LED - Lights up red when there is no UDP connection, green when one is established
- 4) TCP / IP LED - Lights up red when there is no TCP / IP connection, green when one has been opened

The LEDs can also be switched off in the software.

When the device is set to identify mode via the surface, the LEDs 2-4 start to flash in ascending and descending order for 10 seconds.

The LEDs with the numbers 3 and 4 can take up to 60s to display the status after a restart.

1.2. Hardware Revision

1.2.1. Hardware Revision 0

Hardware Revision 0

Supports firmware versions 1.XX with "_REV0" in the name.



1.2.2. Hardware Revision 1

Hardware Revision 1

Supports firmware versions 1.XX and 2.XX as well as 3.XX with "_REV1" in the name.



On the type plate recognizable by the "01-XXXXX" to begin.



1.2.3. Hardware Revision 2

Hardware Revision 2

Supports firmware versions 3.XX and 4.XX with "_REV2" in the name.



On the type plate recognizable by the "02-XXXXX" to begin.




1.3. Watchdog

A watchdog runs in the gateway with a set time of 90s in order to restart the device automatically if necessary.

1.4. Reset Button



The hardware button is only functional from devices with manufacturing date > 03/2022.

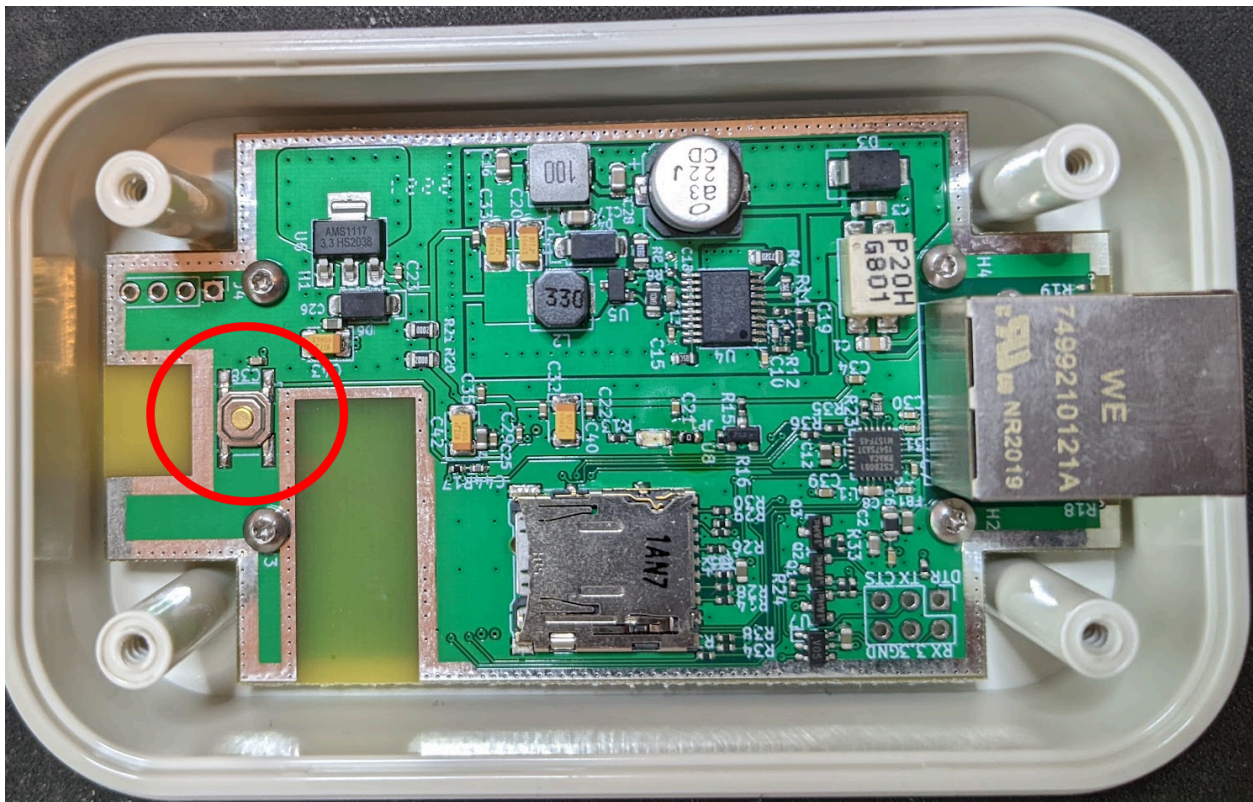

There is a small push button on the circuit board. This can be reached by opening the 4 screws on the underside.

Depending on how long the button is pressed, different actions are performed.

- > 0s and < 15s = LED test program
- >15s and <30s = soft reset
- > 30s = hard reset

With a soft reset, only the IP-> settings and the login data are set to factory settings.

With a hard reset, all settings are set to factory settings and the memory is also completely erased.

1.5. Conformity

1.5.1. Hardware Revision 1

EC Declaration of Conformity

Lichtmanufaktur Berlin GmbH hereby declares that the radio equipment type "Lithernet - Casambi Gateway" is in compliance with Directive 2014/53/EU.

The full text of the EU Declaration of Conformity is available at the following internet address: <https://archiv.intelligent-lighting.de/index.php/s/XoR27GRkiMWLyeD>

UKCA

The full text of the UKCA declaration of conformity is available at the following internet address: <https://archiv.intelligent-lighting.de/index.php/s/wH7fddqRoGSK7dE>

1.5.2. Hardware Revision 2

EC Declaration of Conformity

Currently being created. Device is still in beta test stage.

UKCA

Currently being created. Device is still in beta test stage.

1.6. Bluetooth module



All information on this page relates only to the radio module used. Not the entire product.

The CBM-002A module from Casambi Oy is used as the Bluetooth module

The declaration of conformity for the radio module can be found at the following Internet address: <https://casambi.com/static/datasheets/CBM-002-DoC.pdf>

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:

- (1) This device may not cause harmful interference, and
- (2) this device must accept any interference received, including interference that may cause undesired operation.

Contains FCC ID: 2ALA3-CBM002A

This device complies with Industry Canada's licenseexempt RSSs. Operation is subject to the following two conditions:

- (1) This device may not cause interference; and
- (2) This device must accept any interference, including interference that may cause undesired operation of the device.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes:

- (1) l'appareil ne doit pas produire de brouillage;
- (2) l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

Contains IC: 22496-CBM002A

Compliance Information		
Radio	USA	FCC Part 15 Subpart C
	FCC ID (CBM-002A):	2ALA3-CBM002A
	FCC ID (CBM-002B):	2ALA3-CBM002B
	Canada	RSS-247
	IC (CBM-002A):	22496-CBM002A
	IC (CBM-002B):	22496-CBM002B
	Europe	ETSI EN 300 328 v2.1.1
Environmental	RoHS	RoHS compliant
	REACH	REACH compliant

1.6.1. Hardware Revision 0 und 1



All information on this page refers only to the radio module used. Not to the complete product.

The Bluetooth module used is the CBM-002A module from Casambi Oy.

The declaration of conformity of the radio module can be found at the following Internet address: <https://casambi.com/static/datasheets/CBM-002-DoC.pdf>

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:

- (1) This device may not cause harmful interference, and
- (2) this device must accept any interference received, including interference that may cause undesired operation.

Contains FCC ID: 2ALA3-CBM002A

This device complies with Industry Canada's licenseexempt RSSs. Operation is subject to the following two conditions:

- (1) This device may not cause interference; and
- (2) This device must accept any interference, including interference that may cause undesired operation of the device.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes:

- (1) l'appareil ne doit pas produire de brouillage;
- (2) l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

Contains IC: 22496-CBM002A

Compliance Information		
Radio	USA	FCC Part 15 Subpart C
	FCC ID (CBM-002A):	2ALA3-CBM002A
	FCC ID (CBM-002B):	2ALA3-CBM002B
	Canada	RSS-247
	IC (CBM-002A):	22496-CBM002A
	IC (CBM-002B):	22496-CBM002B
	Europe	ETSI EN 300 328 v2.1.1
Environmental	RoHS	RoHS compliant
	REACH	REACH compliant

1.6.2. Hardware Revision 2



All information on this page refers only to the radio module used. Not to the complete product.

The Bluetooth module used is the CBM-002B module from Casambi Oy.

The declaration of conformity of the radio module can be found at the following Internet address: https://f.hubspotusercontent40.net/hubfs/7177595/Data%20sheets/English/CBM-003/CBM-003_DoC_2022-01-14.pdf

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Note: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between equipment and receiver.

To comply with FCC RF exposure guidelines, the transmitter and your body must be separated from each other by a minimum of 20 cm and fully supported by the operating and installation configurations of the transmitter and its antenna(s).

- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Contains FCC ID: 2ALA3-CBM003B

This device complies with Industry Canada's licenseexempt RSSs. Operation is subject to the following two conditions:

- (1) This device may not cause interference; and
- (2) This device must accept any interference, including interference that may cause undesired operation of the device.

Le présent appareil est conforme aux CNR d'Industrie Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes:

- (1) l'appareil ne doit pas produire de brouillage;
- (2) l'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

The device has been evaluated as meeting general RF exposure requirements. To maintain compliance with RSS-102 radio frequency (RF) exposure guidelines, this equipment should be installed and operated with a minimum distance of 20 cm between the radiator (transmitter?) and your body.

Le dispositif de a été évalué à répondre général rf exposition exigence. Pour maintenir la conformité avec les directives d'exposition du RSS-102-Radio Fréquence (RF). Ce matériel doit être installé et exploité à une distance minimale de 20 cm entre le radiateur et votre corps.

Contains IC: 22496-CBM003B

1.7. Type label

1.7.1. Hardware Revision 1

There are 2 nameplates on the back of the device.

Lithernet - Casambi Gateway

Licht Manufaktur Berlin GmbH
Stresemannstr.15
10963 Berlin
Germany

Contains FCC ID: 2ALA3 - CBM002A
Contains IC: 22496 - CBM002A



Here you can see in the barcode that:

01 : Litehrnet - Casambi Gateway Revision 1
41/2020: week and year of production in this case week 41 in 2020
00000001: Serial number of the device


The second nameplate contains the information that must be present for the CBM-002 module installed:

Contains FCC ID: 2ALA3 - CBM002A

Contains IC: 22496 - CBM002A

1.7.2. Hardware Revision 2


There are 2 nameplates on the back of the device.

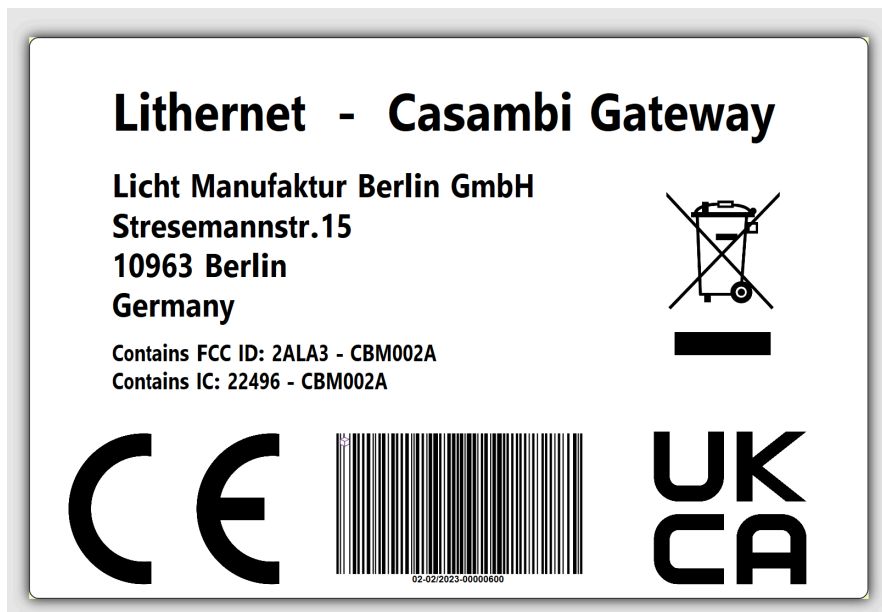

Here is recognizable in the barcode that:

02 : Litehrnet - Casambi Gateway Revision 2
41/2020: week and year of production in this case week 41 in 2020
00000001: Serial number of the device

The second nameplate contains the information that must be present for the installed CBM-003B module:

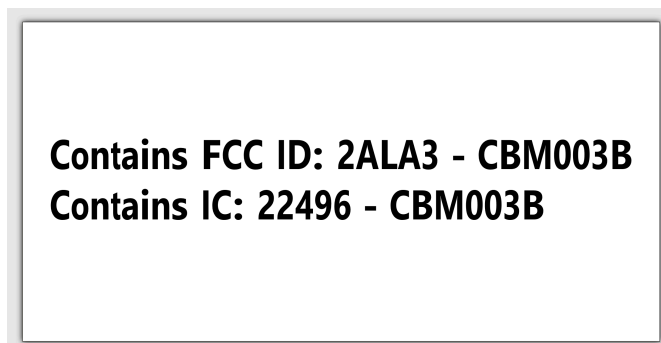

1.8. Firmware Version


There are currently 3 versions of the gateway firmware.


There is the firmware 1.XX, this is compatible with the Casambi Classic firmware and the Casambi Evolution firmware with a version lower than 33.22.

There is the firmware 2.XX, this is compatible with the Casambi Evolution firmware with a version greater or equal 33.22.

There is the firmware 3.XX, this is compatible with the Casambi Evolution firmware with a version greater than or equal to 34.50.

Translated with www.DeepL.com/Translator (free version)

 The backup files of version 1.XX and 2.XX and 3.XX are not compatible with each other. In the event of an update, the device must be set up again.

 Between version 3.04 and 3.10 there were some memory adjustments. It could happen that an older backup will be not successfully imported.

The system will show a warning if the Casambi firmware version does not match the gateway firmware version.

1.9. Software Librarys

Here is a list of the software libraries used by the Lethernet Casambi Gateway:

1) AsyncTCP-esphome

Version: 1.2.2

URL: <https://github.com/esphome/AsyncTCP>

Lizenz: LGPL-3.0 License

2) Async MQTT client for ESP8266 and ESP32

Version: 0.8.6

URL: <https://github.com/OttoWinter/async-mqtt-client>

Lizenz: MIT License

3) ArduinoJson

Version: 6.19.1

URL: <https://github.com/bblanchon/ArduinoJson>

Lizenz: MIT License

4) NeoPixelBus

Version: 2.7.1

URL: <https://github.com/Makuna/NeoPixelBus>

Lizenz: LGPL-3.0 License

5) Espressif32 Framework for Platformio

Versionn: 3.5.0

URL: <https://github.com/platformio/platform-espressif32>

Lizenz: Apache-2.0

Until version 3.16 the following library was still in use:

4) Adafruit NeoPixel Library

Version: 1.10.6

URL: https://github.com/adafruit/Adafruit_NeoPixel

Lizenz: LGPL-3.0 License

2. Areas of application

The Ethernet gateway can be used in various ways.

[2.1 Gateway to an existing lighting control system \(Netcomposer\)](#)

[2.2 Gateway to an existing lighting control system \(Helvar\)](#)

[2.3 Gateway to a system using UDP or TCP \(ASCII based commands\)](#)

[2.4 Bridge between individual Casambi networks](#)


[2.5 Coupling to an existing evaluation system / visualization](#)

[2.6 ArtNet gateway](#)

[2.7 BacNet/IP gateway](#)

[2.8 MQTT](#)

2.1. Gateway to an existing lighting control system (Netcomposer)

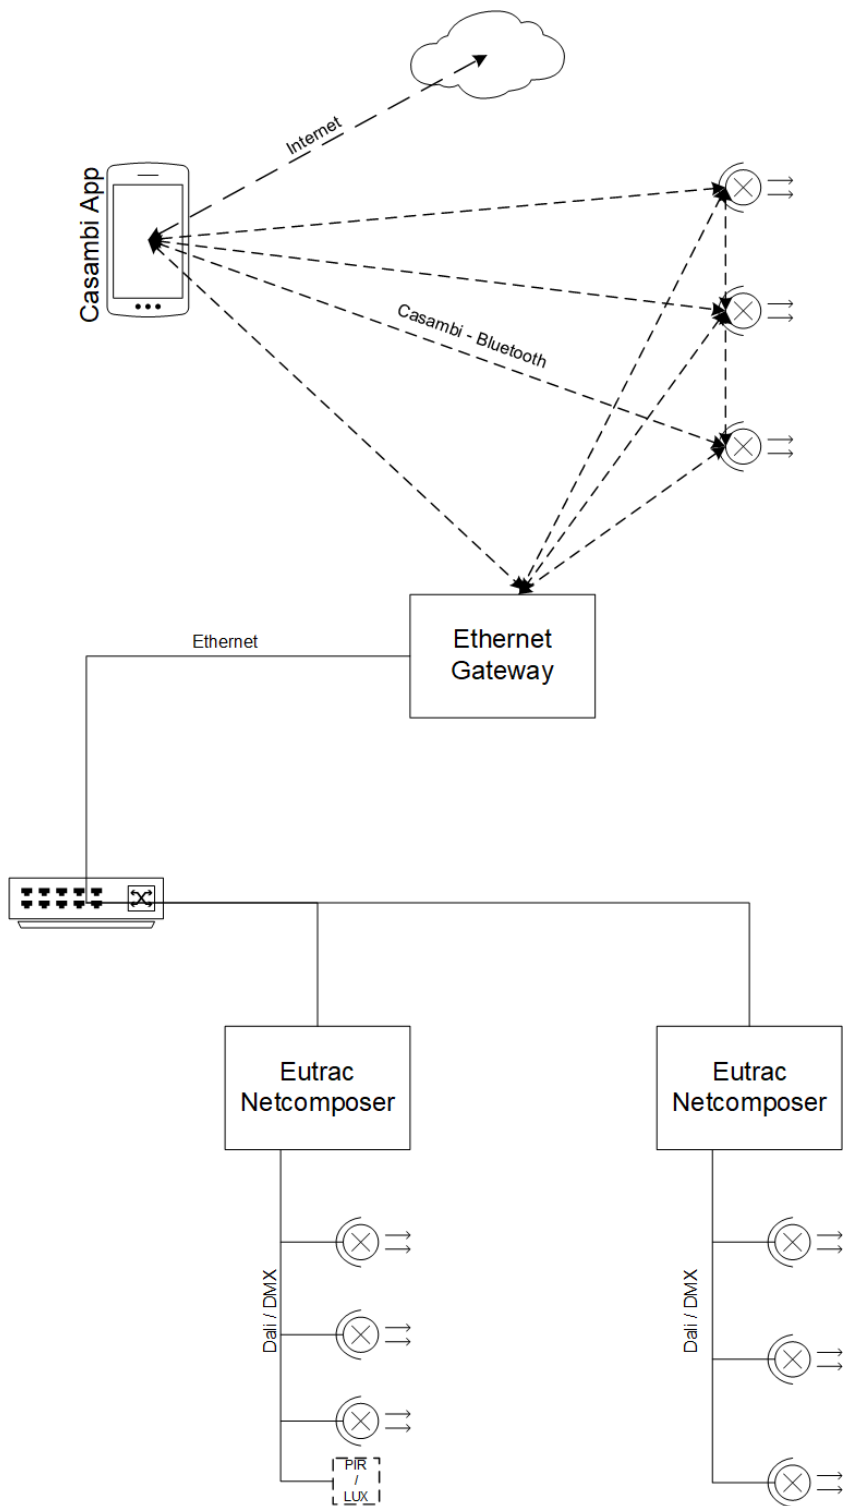

In this operating mode it is possible to establish a coupling to a system with the Eutrac Netcomposers.

It is possible to communicate bidirectionally between the two systems. A total of 32 triggers can be set in each direction per gateway.


The programming uses a wizard, which simplifies the creation of the commands.

The operating mode to be selected here would be "[Netcomposer](#)".

The connection via Netcomposer is explained here: [Protokolle/Netcomposer](#)

Video: <https://youtu.be/fxEkgmlicBc>

2.2. Gateway to an existing lighting control system (Helvar)

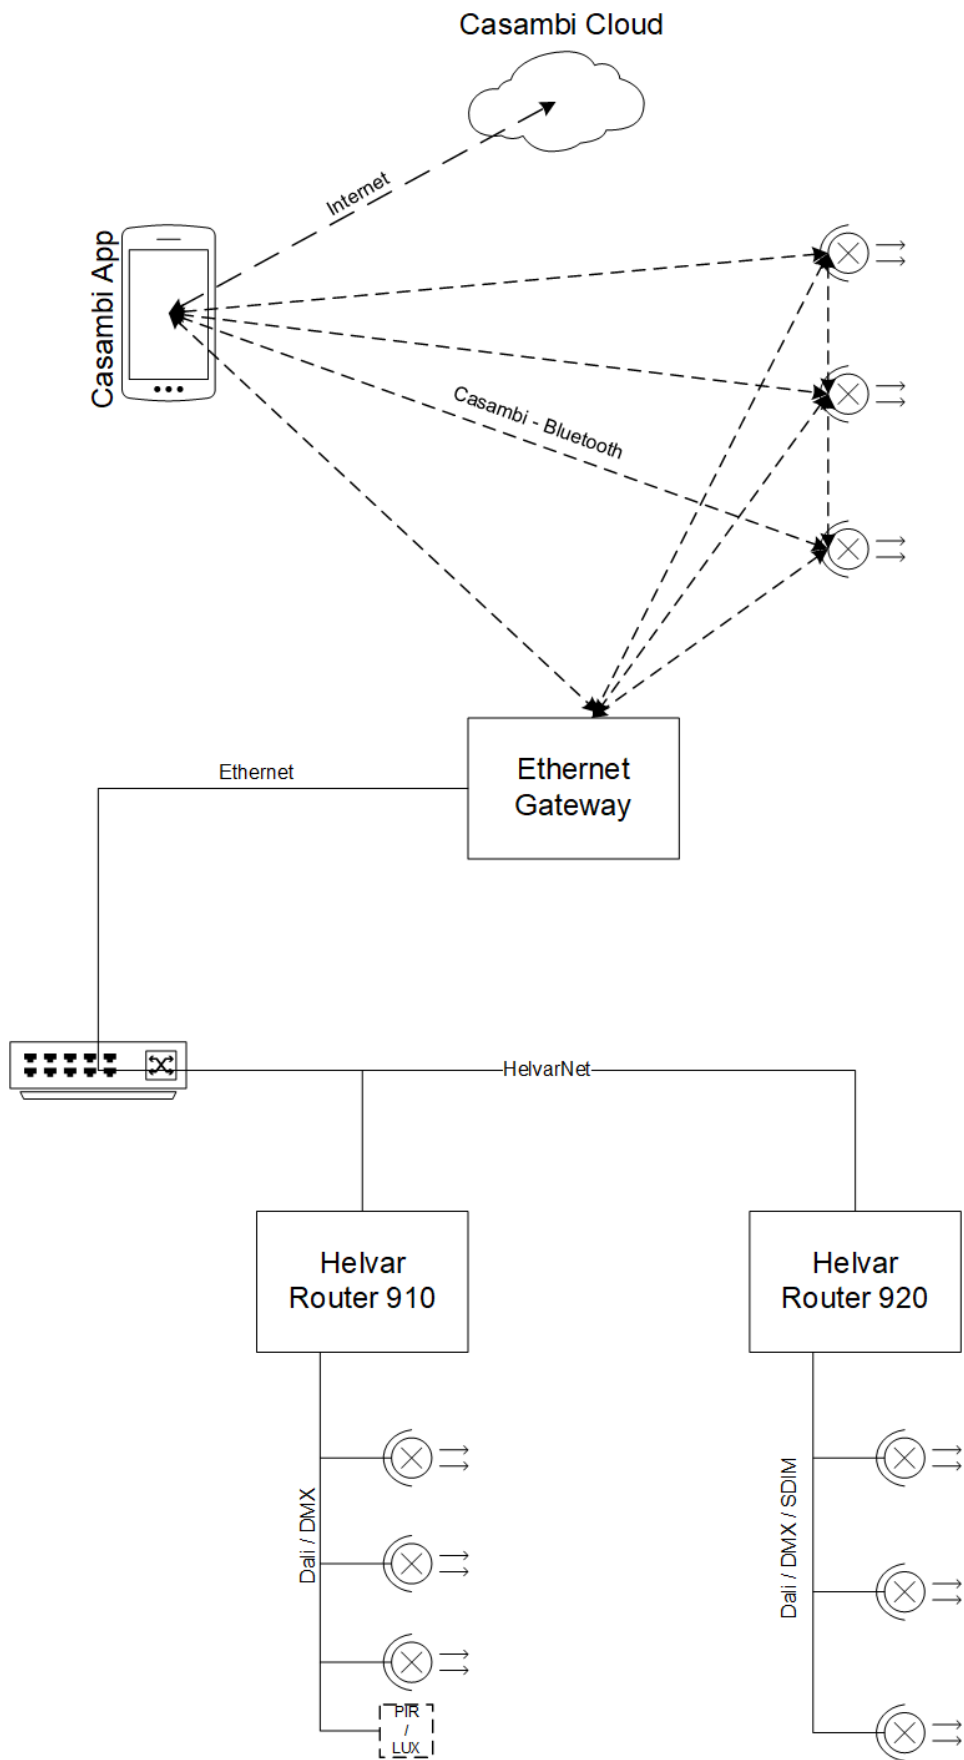

In this operating mode it is possible to establish a coupling to a system with the Helvar router system.

It is possible to communicate bidirectionally between the two systems. A total of 32 triggers can be set in each direction per gateway.

The programming uses a wizard, which simplifies the creation of the commands.


An IP address of a router must be specified as the destination of the connection.

The operating mode to choose would be here "[HelvarNet \(TCP\)](#)".

The connection via HelvarNet is explained here: [Protokolle/HelvarNet](#)

Video: <https://youtu.be/Uu9n5WTbBqI>

2.3. Gateway to a system using UDP or TCP (ASCII based commands)

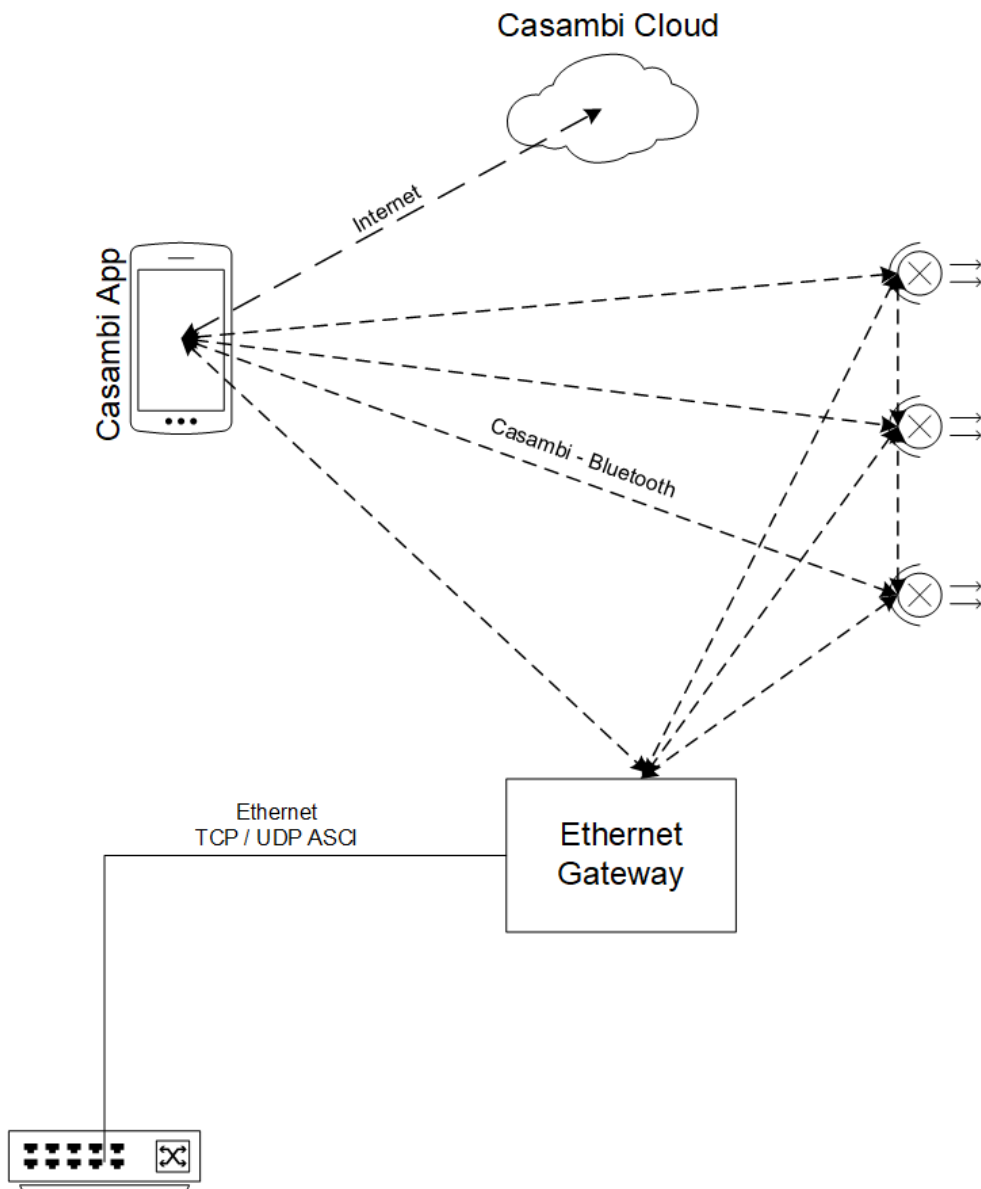

In this operating mode it is possible to establish a link to a system that has not been defined in advance using UDP / TCP ASCII commands.

This could be e.g. media controls (Crestron, ...) or KNX systems where this integration is possible via network.

It is possible to communicate bidirectionally between the two systems. A total of 32 triggers can be set in each direction per gateway.

The operating mode to be selected here would be "[UDP Free Messages](#)" or "[TCP Free Messages](#)"


The connection via "UDP Free Messages" is explained here: "[Protokolle/UDP Free Messages](#)"

The connection via "TCP Free Messages" is explained here: "[Protokolle/TCP Free Messages](#)"

Video - Crestron: <https://youtu.be/gpAQnBhzsz8>

Video - KNX / Loxone: <https://youtu.be/04bY2onxfj4>

2.4. Bridge between individual Casambi networks

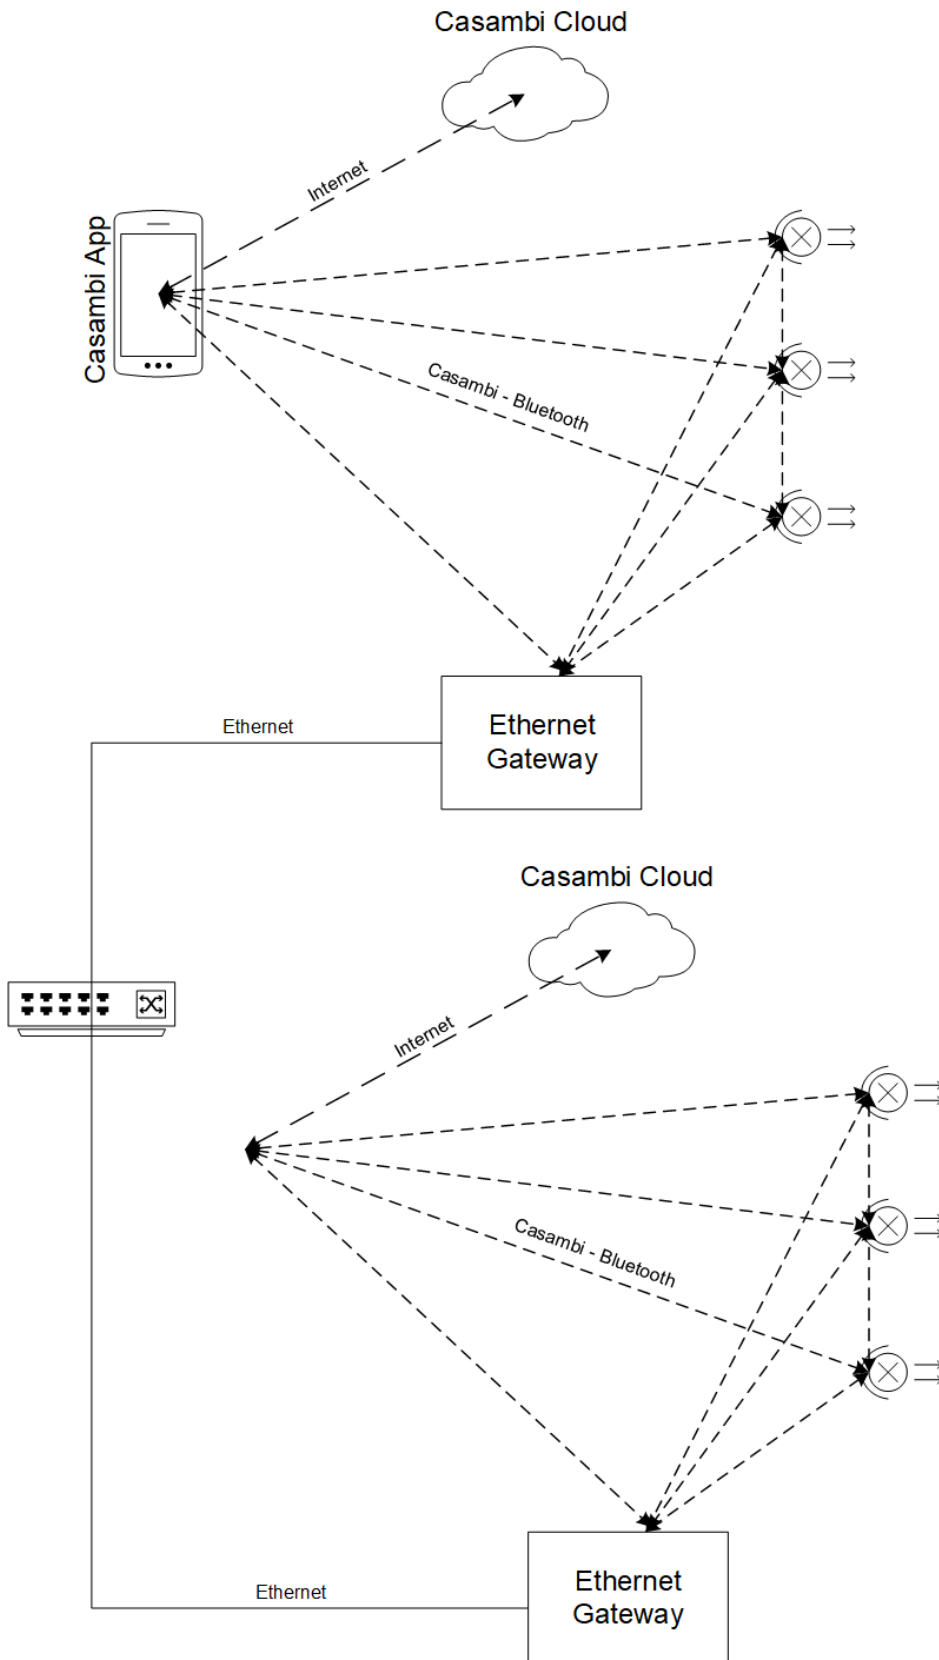

In this operating mode it is possible to connect several autarkic Casambi networks via the gateway.

It is possible to communicate bidirectionally between the two systems. A total of 32 triggers can be set in each direction per gateway.


Of course, several gateways can also react to the same commands.

The gateways communicate with each other via UDP broadcast commands on a freely adjustable port.

The operating mode to choose would be here "[UDP Casambi Bridge](#)".

The connection via "UDP Casambi Bridge" is explained here: "[Protokolle/Casambi Bridge](#)"

2.5. Coupling to an existing evaluation system / visualization

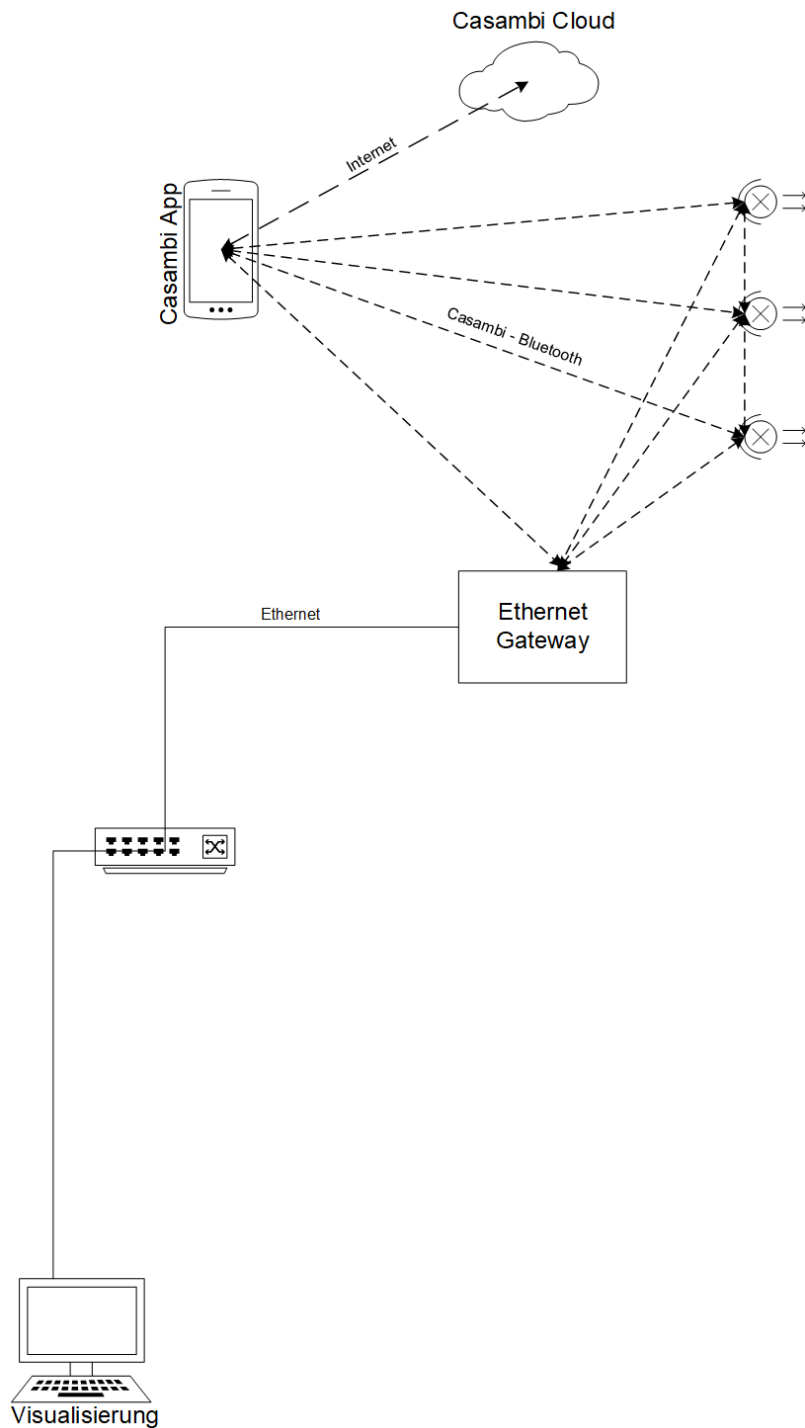

In this operating mode it is possible directly via a gateway. Each gateway receives a BridgeID which makes it identifiable in the commands.

It is possible to communicate bidirectionally between the two systems. A total of 32 triggers can be set in each direction per gateway.

Of course, several gateways can also react to the same commands.


The gateways communicate with each other via UDP broadcast commands on a freely adjustable port.

The operating mode to choose would be here "[UDP Casambi Command](#)" or "[TCP Casambi Command](#)".

The connection via "UDP Casambi Command" is explained here: ["Protocol-specific setting/UDP Casambi Command"](#) or ["Protocol-specific setting/TCP Casambi Command"](#)

There are also [demo programs](#) that show you the connection and use on the evaluation page.

2.6. ArtNet gateway

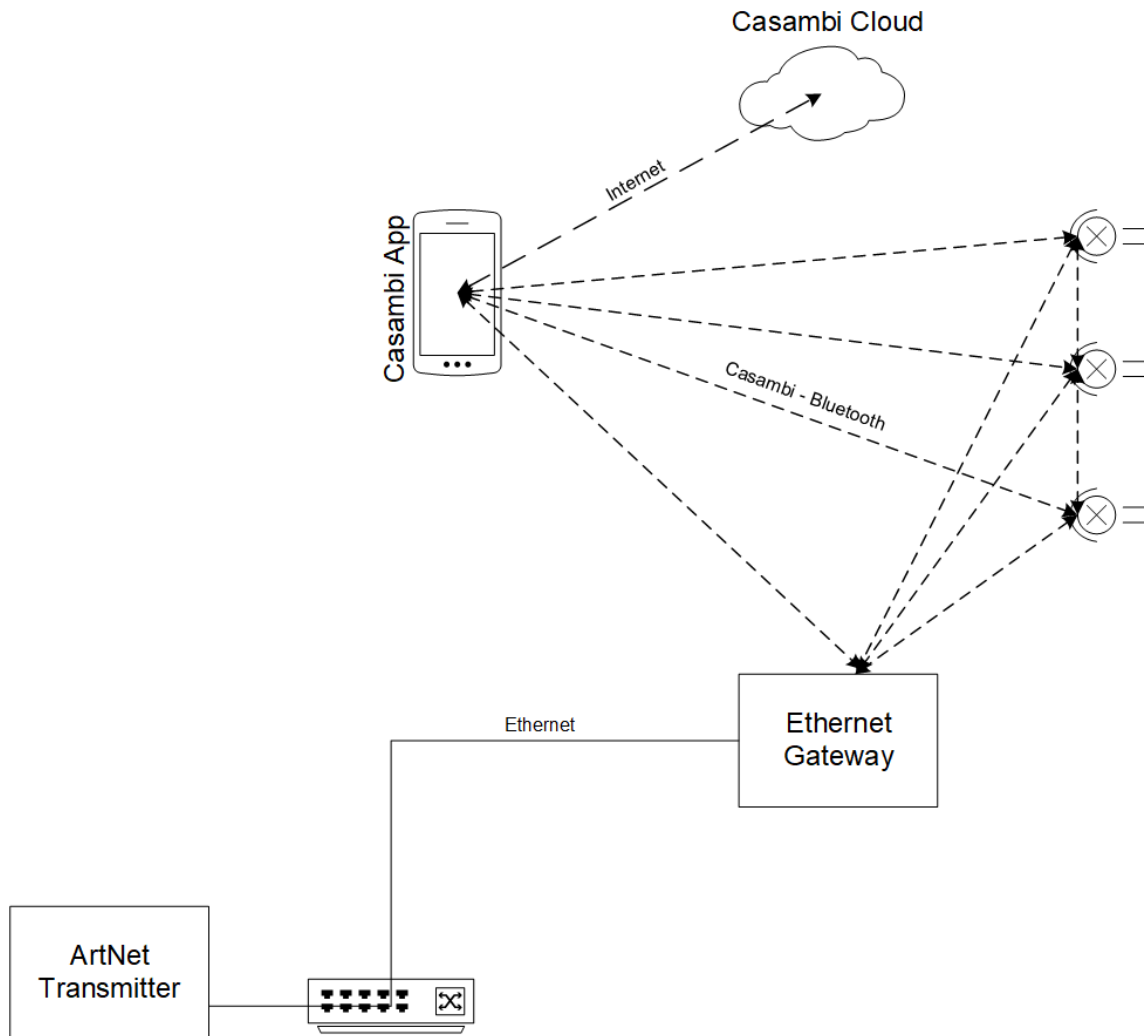

In this operating mode it is possible to address the gateway directly with ArtNet commands.

It is possible to control 512 Casambi commands (scenes, groups, devices, broadcast) using ArtNet. The level is sent from the ArtNet to the Casambi system.

The operating mode to choose would be here "[ArtNet \(Input Only\)](#)".

Video: <https://youtu.be/WNfn9LiD4Cw>

The connection via ArtNet is explained here: [Protokolle/Artnet](#)

2.7. BacNet/IP gateway

In this operating mode it is possible to address the gateway directly via BacNet/IP.

For this purpose, the number of devices to be controlled is transferred when setting up the protocol.

It can:

- Broadcast
- Equipment
- ungrouped devices
- Groups
- Scenes

in the values: brightness, scene, color temperature, fade time can be controlled.

The Casambi devices / groups are queried cyclically and the corresponding value is also made available in the BacNet in the event of a change.

A parameter-based system is available for special commands, with which many special commands can also be transmitted.

The commands are set via BacNet/IP and started using a "run" value.

Sensor data can also be reported directly to the Casambi system via BacNet.



The commands Multiple_Write and Multiple_Read as well as Range are currently not supported. Segmentation is also not supported.

The operating mode to choose would be here [BacNet/IP](#).

The connection via BacNet / IP is explained here: [Protokolle/BacNet/IP](#)

A modified version of the YABE software with faster timeout is available for download here: <https://archiv.intelligent-lighting.de/index.php/s/wwF3SdELB5RGZxT>

2.8. MQTT

In this operating mode it is possible to integrate the gateway directly via MQTT.

It is possible to send an unlimited number of commands to the Casambi system.

The Casambi system also reports back which scene has currently been called up.

Sensor data can also be reported directly to the Casambi system via MQTT.

Video: <https://youtu.be/KNUSViU-HsY>

Node-RED Flow: <https://flows.nodered.org/flow/21bc268af8cbcfbf0658c02868ae294>

The operating mode to choose would be here [MQTT](#).

The connection via MQTT is explained here: [Protokolle/MQTT](#)

2.9. Example implementations

1) Demo programs for API Lithernet Casambi Gateway

At the following URL we offer 2 test programs (including source code) that show how to use UDP to talk to the gateway in the "UDP Casambi Command" operating mode.

https://github.com/KLKG/Casambi_Gateway_API_Test

There is a program (UDP_Test) that cyclically queries all Casambi participants in a command line. Source code in C++.

The other program (UDP_WPF) is a C# application with a graphical interface. Other commands can also be sent here than just the cyclic query.

Both are demonstration programs and only show what is possible.

2) Demo programs for different controlsystems

At the following URL we offer sample programs for various control systems. Depending on demand, these will also be expanded.

<https://archiv.intelligent-lighting.de/index.php/s/Xkr2mGYHZ4ttAYx>

Currently there are:

1) Node Red

- 1.1) Node Red for communication with Casambi via MQTT. Including small surface
- 1.2) Node Red for communication with Steinel MQTT sensors. Includes small surface

2) Loxones

- 2.1) Communication with Loxone in "[UDP Free Command](#)" mode
- 2.2) Communication with Loxone via the "[UDP Casambi Command](#)" mode including value transfer of analog values

3) Crestron

- 3.1) Visualization + CP2 program for communication with Casambi in "[Netcomposer](#)"
- 3.2) Visualization + CP2 program for communication with Casambi in "[UDP Casambi Command](#)" including value transfer of analog values

4) ArtNet


- 4.1) File to send DMX commands to the gateway with the QLight ArtNet software.

3) BacNet monitor and readout program

Likewise under <https://archiv.intelligent-lighting.de/index.php/s/Xkr2mGYHZ4ttAYxT> in the folder BacNet a slightly modified version of the software YABE is available, where the timeout was shortened.

This allows a faster readout of the variables from our gateway.

3. Login

 From 2023, the devices will be delivered with version 3.14. In this version, the device is set to DHCP in the delivery state and uses a fallback IP of 192.168.1.90.

The settings that can be made on the gateway website are described here.

Up to version 3.14:

On delivery, the gateway is equipped with the address 192.168.1.90.

As of version 3.14:

On delivery, the gateway is set to DHCP. If there is no DHCP server available, the fallback IP 192.168.1.90 is used. It is not checked if the address is free.

With a web browser, you can now call up the IP address that the device has and get to the corresponding start page.

Casambi Ethernet Gateway - 3.10 - REV1

Set Login Credentials

Welcome

Welcome to the Lithernet Casambi Gateway.

Please take a note of the login credentials you set here and the mac address you see below.

Store these information in an safe place.

We cant recover your login details. If you forget the password you can do an full reset with the mac address.

For more details, take a look in the manual.

MAC Address

Mac 3C:71:BF:62:35:97

User Management

Username

Password

© [Licht Manufaktur Berlin GmbH 2022](#)

To continue, a user name and password must be set here.

The MAC of the device is also displayed at the top under "Mac Address". You should make a note of this and keep it.

With this you can reset the device in case of emergency.

The password is stored encrypted and can not be read out in plain text.

After pressing "Continue" you will get to a page that will redirect you to the settings page after a short time.

Translated with www.DeepL.com/Translator (free version)

Casambi Ethernet Gateway - 3.10 - REV1


General Setting

Warning!

Userdata set. Please Login. Redirect in 5s.

4. General setting

The basic settings can be made on this settings page.

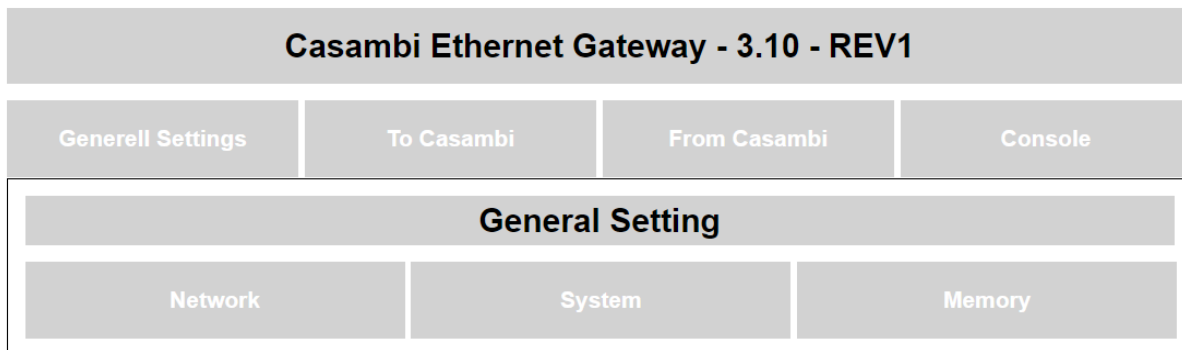

There are 3 subcategories. Network, System, Memory.

Network: Setting of all values that have something to do with the network.

System: All system related settings like "Control System", Casambi settings, time.

Memory: Firmware update, creating and importing backups and diagnostic settings.

4.1. Firmware warning

The screenshot displays the web interface for a Casambi Ethernet Gateway. At the top, a grey header bar contains the text "Casambi Ethernet Gateway - 2.00 - REV1". Below this, a navigation bar has four tabs: "Generell Settings", "To Casambi", "From Casambi", and "Console". The "Generell Settings" tab is selected, leading to a "General Setting" page. This page has three sub-tabs: "Network", "User and Time", and "Configuration". Below the sub-tabs, a white box with a black border contains an "Attention!" warning: "Please update Evolution Firmware to 33.22 or higher for full feature support."

This warning message appears if the Casambi firmware is smaller than the one needed for all functions. If this is the case not all commands used by the gateway are supported.

If an older firmware is used, an older firmware version of the gateway should be used.

4.2. Network

Casambi Ethernet Gateway - 3.22_beta - REV1

Generell Settings	To Casambi	From Casambi	Console
-------------------	------------	--------------	---------

General Setting

Network	System	Memory
---------	--------	--------

IP-Settings

DHCP	<input type="text" value="inactive"/>
Hostname	<input type="text" value="casambi-gateway-4C75255CE213"/>
IP-Adress	<input type="text" value="192.168.1.90"/>
Subnet	<input type="text" value="255.255.255.0"/>
Gateway	<input type="text" value="192.168.1.1"/>
Namserver 1	<input type="text" value="192.168.1.1"/>
Namserver 2	<input type="text" value="0.0.0.0"/>

Webserver Login

Username	<input type="text" value="admin"/>
Password	<input type="password"/>

NTP-Client

NTP-Client	<input type="text" value="inactive"/>
NTP-Server	<input type="text" value="pool.ntp.org"/>
gmtOffset in sec	<input type="text" value="0"/>
daylightOffset in sec	<input type="text" value="3600"/>

Restart Gateway

4.2.1. IP settings

Settings for the IP configuration can be made here.

In the factory state, it is delivered with the IP address 192.168.1.90.

IP-Settings

DHCP	<input type="text" value="inactive"/>
Hostname	<input type="text" value="casambi-gateway-4C75255CE213"/>
IP-Adress	<input type="text" value="192.168.1.90"/>
Subnet	<input type="text" value="255.255.255.0"/>
Gateway	<input type="text" value="192.168.1.1"/>
Namserver 1	<input type="text" value="192.168.1.1"/>
Namserver 2	<input type="text" value="0.0.0.0"/>

DHCP: DHCP active or inactive

Host name: host name of the device

IP address: IP address of the device

Subnet: subnet mask

Gateway: Gateway address

Name servers 1 and 2: The DNS entries for the gateway

These are accepted with "Save".

After applying, the device must be restarted once.

4.2.2. Webserver Login

Here you can set the username and password of the user who should have access to all functions of the system.

Only one user can be created.

Webserver Login

Username

Password

With the button "Change Login" username and password are transferred.

The password field is always empty, since this cannot be read out and is stored in encrypted form.

4.2.3. NTP-Client

NTP-Client

NTP-Client	<input type="text" value="inactive"/>
NTP-Server	<input type="text" value="pool.ntp.org"/>
gmtOffset in sec	<input type="text" value="0"/>
daylightOffset in sec	<input type="text" value="3600"/>

The parameters for the built-in NTP client are set here.


The NTP client field can either be activated or deactivated. If it is activated, the gateway gets the current time of the NTP server when it starts and when queried via the "Date and Time" function.

NTP server is the address / URL of the server. This can be assigned externally if the address of the gateway is obtained via DHCP, or a local address if the IP address is fixed.

gmtOffset is the specification of the time zone in seconds.

daylightOffset is the indication of the time difference due to daylight saving time in seconds.

4.2.4. Restart gateway

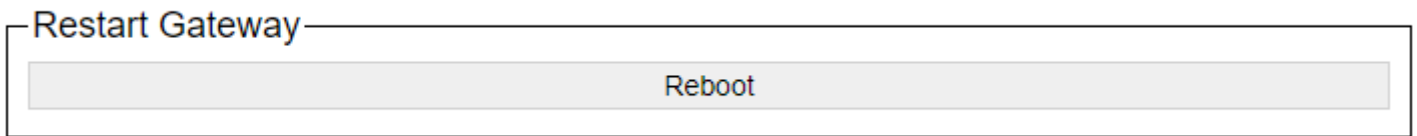

This can be used to restart the gateway.

4.3. System

Casambi Ethernet Gateway - 3.10 - REV1

Generell Settings

To Casambi

From Casambi

Console

General Setting

Network

System

Memory

Control System

Type none
State no connection established

Wizard

Casambi Settings

Casambi Version 36.30
Casambi Network paired
Polling Method active

Save

LED Settings

LED Level 25%
invert Colour normal

Save

Identify Device for 10s

Date and Time

Date 1 . 1 . 2020
Time 0 : 20 : 30

Get Date and Time from Casambi

Get Date and Time from NTP

Send Date and Time to Casambi

Refresh

Restart Gateway

Reboot

4.3.1. Control system wizard

Control System

Type	UDP Casambi Command
Net ID	0
UDP-Port	10010
State	UDP Listening on IP: 192.168.20.112 Port: 10010

Wizard

Here all current settings are displayed to the user, as well as the state of the connection in which the device is currently in "State".

The settings dialog is called via the Wizard button.

Control System Wizard

Type

next step

The wizard supports you in creating the settings for the control system.

With "Type" different systems are available with which the gateway can communicate.

- [Netcomposer](#)
- [ArtNet](#)
- [Free commands over UDP](#)
- [HelvarNet \(TCP\)](#)
- [Free commands over TCP](#)
- [UDP Casambi Command](#)
- [TCP Casambi Command](#)
- [BacNet/IP](#)
- [MQTT](#)

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Control System Wizard

Type	UDP Free Messages
UDP-Port	<input type="text" value="10010"/>
Delimiter (ASCII DEC)	<input type="text" value="37"/>
<input type="button" value="step back"/>	
<input type="button" value="reboot.."/>	

After entering all the settings, the device can be restarted directly with reboot and the set values are adopted.

4.3.1.1. Netcomposer system

Control System Wizard

Type	Netcomposer
UDP-Port	10009

step back

reboot..

The Eutrac Netcomposersystem transmits its data via broadcast on port 10009.

These values are also permanently stored in the profile.

4.3.1.2. Art-Net

Control System Wizard

Type	Artnet (Input Only)
UDP-Port	6454
Universe	<input type="text" value="0"/>

With Art-Net it is possible to address the gateway via DMX commands.

In this case, the port is fixed at 6454. The universe is freely adjustable.

"Art-Net™ Designed by and Copyright Artistic License Holdings Ltd"

4.3.1.3. Free commands over UDP

Control System Wizard

Type	UDP Free Messages
UDP-Port	<input type="text" value="10010"/>
Delimiter (ASCII DEC)	<input type="text" value="37"/>

Here commands are sent by broadcast to the specified port.

4.3.1.4. HelvarNet (TCP)

Control System Wizard

Type	HelvarNet (TCP)
TCP-Port	50000
Delimiter	#
Router IP	<input type="text" value="192.168.178.222"/>
Start Device	<input type="text" value="1"/>
Device Count	<input type="text" value="20"/>
Start Group	<input type="text" value="1"/>
Group Count	<input type="text" value="20"/>
Start Scene	<input type="text" value="1"/>
Scene Count	<input type="text" value="20"/>

The TCP port and the delimiter between the commands are fixed according to the protocol and cannot be adjusted.

For the IP address of the router, an existing HelvarNet router address must be specified, to which the gateway then connects.

For Device Count, Group Count, Scene Count a 0 means that this value is inactive and not used.

Start Device / Device Count (0 to 250): From the start device as many devices are queried as DeviceCount is large.

Start Group / Group Count (0 to 255): From the start group as many groups are queried as Group Count is large.

Start Scene / Scene Count (0 to 255): From the start scene, as many scenes are queried as the Scene Count is large.

4.3.1.5. Free commands over TCP

Control System Wizard

Type	TCP Free Messages
TCP-Port	<input type="text" value="50000"/>
Delimiter (ASCII DEC)	<input type="text" value="35"/>
System IP	<input type="text" value="10.254.1.1"/>

The "System IP" is the address of the controller / server to which the gateway is to connect.

The delimiter is the separator between the individual commands. The ASCII number of the corresponding character must be entered here. 35 corresponds to the "#".

4.3.1.6. UDP Casambi Command

Control System Wizard

Type	UDP Casambi Command
Net ID	<input type="text" value="0"/>
DEC or HEX	<input type="text" value="Hex with dot"/> ▼
Send Ack	<input type="text" value="false"/> ▼
UDP-Port	<input type="text" value="47808"/>

To identify from which bridge the command comes the parameter "Net ID" is needed. It can be selected from 0 - 254.

255 is the broadcast ID. This cannot be selected here. But it can be used in commands for all gateways connected to the network.

In the field "DEC or HEX" the type of data transmission can be selected:

Decimal with hash: The commands are transmitted as decimal values (always 3 digits) with a "#" as separation between each value.

Hex with dot: The commands are transmitted as hexadecimal values (2 digits) with a "." as separation between the individual values.

The end of a command is always indicated by "\a\n".

The hexadecimal commands can be used for integration into existing systems which can be programmed more freely by the integrator. They save some network traffic because they are shorter.

The decimal commands are needed for the integration into other systems like Loxone to be able to send and read analog values.

If "Send Ack" is activated, a confirmation is sent when the command has arrived.

The parameter UDP port is used to select the port on which listening and sending should take place.

4.3.1.7. TCP Casambi Command

The screenshot shows a configuration window titled "Control System Wizard". It contains the following fields and controls:

- Type: TCP Casambi Command
- TCP-Port: 50000
- Net ID: 0
- DEC or HEX: Hex with dot (dropdown menu)
- System IP: 10.254.1.1
- Buttons: "step back" and "reboot.."

To identify from which bridge the command comes the parameter "Net ID" is needed. It can be selected from 0 - 254.

255 is the broadcast ID. This cannot be selected here. But it can be used in commands for all gateways connected to the network.

In the field "DEC or HEX" the type of data transmission can be selected:

Decimal with hash: The commands are transmitted as decimal values (always 3 digits) with a "#" as separation between each value.

Hex with dot: The commands are transmitted as hexadecimal values (2 digits) with a "." as separation between the individual values.

The end of a command is always indicated by "\a\n".

The hexadecimal commands can be used for integration into existing systems which can be programmed more freely by the integrator. They save some network traffic because they are shorter.

The decimal commands are needed for the integration into other systems like Loxone to transfer and read analog values.

With the settings TCP-Port and System-IP the parameters of the server to which the gateway should connect are set.

4.3.1.8. UDP Casambi Bridge

Control System Wizard

Type	UDP Casambi Bridge
Bridge ID	<input type="text" value="0"/>
UDP-Port	<input type="text" value="6454"/>

The "Bridge ID" parameter is required to identify which bridge the command comes from. It can be selected from 0-254.

With the UDP port parameter, you select which port is to be used for listening and sending.

4.3.1.9. BacNet/IP

Control System Wizard

Type	BacnetIP
Local Device ID	<input type="text" value="400001"/>
UDP-Port	<input type="text" value="47808"/>
Use BBMD Server / FDT	<input type="text" value="false"/> ▼
BBMD Server IP	<input type="text" value="192.168.1.255"/>
<hr/>	
Use Broadcast	<input type="text" value="true"/> ▼
<hr/>	
Start Device	<input type="text" value="1"/>
Device Count	<input type="text" value="250"/>
<hr/>	
Use Ungrouped	<input type="text" value="true"/> ▼
<hr/>	
Start Group	<input type="text" value="1"/>
Group Count	<input type="text" value="50"/>
<hr/>	
Start Scene	<input type="text" value="1"/>
Scene Count	<input type="text" value="50"/>

Local Device ID: ID of the device in the BacNet/IP

UDP-Port: Port for the BacNet communication (Default: 47808)

For Device Count, Group Count, Scene Count a 0 means that this value is inactive and not used.

Use Broadcast: Enables the entries for broadcast control via Bacnet when set to 1.

Start Device / Device Count (0 to 250): From the start device as many devices are queried as DeviceCount is large.

Use Ungrouped: Activates the entries for "ungrouped" when set to 1.

Start Group / Group Count (0 to 255): From the start group as many groups are queried as Group Count is large.

Start Scene / Scene Count (0 to 255): From the start scene, as many scenes are polled as Scene Count is large.

These values are also used to poll information from the Casambi network. Only within the limits set here devices in BacNet/IP mode are cyclically polled for status changes and these are then displayed.

4.3.1.10. MQTT

Control System Wizard

Type	MQTT
MQTT-Port	<input type="text" value="1883"/>
MQTT IP	<input type="text" value="10.254.1.1"/>
Net ID	<input type="text" value="8"/>
Authentication	<input type="text" value="inactive"/> ▼
User	<input type="text" value="admin"/>
Pasword	<input type="text"/>
<hr/>	
Use Broadcast	<input type="text" value="true"/> ▼
<hr/>	
Start Device	<input type="text" value="1"/>
Device Count	<input type="text" value="250"/>
<hr/>	
Start Group	<input type="text" value="1"/>
Group Count	<input type="text" value="50"/>
<hr/>	
Start Scene	<input type="text" value="1"/>
Scene Count	<input type="text" value="50"/>
<hr/>	
<input type="button" value="step back"/>	
<input type="button" value="reboot.."/>	

The port and the IP address can be specified here.

Net ID is a unique number (0-255) with which the gateway can be identified on the MQTT side.

Authentication switches the authentication with user and password on and off.

For Device Count, Group Count, Scene Count a 0 means that this value is inactive and not used.

Use Broadcast: Activates the request for the broadcast value when set to 1.

Start Device / Device Count (0 to 250): From the start device as many devices are queried as DeviceCount is large.

Start Group / Group Count (0 to 255): From the start group as many groups are queried as the Group Count is large.

Start Scene / Scene Count (0 to 255): From the start scene, as many scenes are queried as the Scene Count is large.

4.3.2. Casambi Settings

Casambi Settings

Casambi Version	37.82
Profile	Ethernet_Gateway_REV1
Casambi Network	paired
Polling Method	<input type="text" value="passive_37_80"/>

"Casambi Version" displays the Casambi firmware version of the device.

Profile displays the name of the profile selected in the Casambi software.

There are the variants:

"Ethernet_Gateway_REV[X]": 16 scenes, 16 groups on the console side.

"Ethernet_Gateway_REV[X]_EVO": 32 scenes, 32 groups on the console side

"Ethernet_Gateway_REV[X]_EVO_Groups": 64 groups on the console side

"Ethernet_Gateway_REV[X]_EVO_Scenes": 64 scenes on the console side

"Casambi Network" shows if the device is connected to a network or not.

At polling Method you can set how the polling of the operating data works.

"active": The Casambi nodes are polled cyclically. This can cause somewhat slow status messages. But the polling is very stable.

"passive": The Casambi devices report their status change via notification and are then polled for their current values.

current values. This results in somewhat faster status changes.

Scenes and groups are still queried cyclically, because there are no notifications for them in Casambi.

"passive_37_80": The Casambi participants (devices) report their status change via notification and are then queried for their current values.

In times in which no notifications come, the devices are queried cyclically one after the other.

Scenes and groups are still queried cyclically, because there are no notifications for them in Casambi.


"passive_37_90": Casambi participants (devices) report their state via notification and are no longer actively polled.

Scenes and groups will continue to be queried cyclically, since no notifications exist for them in Casambi.

Queries that are not based on the notifications pass every 300ms one value each.

Translated with www.DeepL.com/Translator (free version)

4.3.3. LED settings

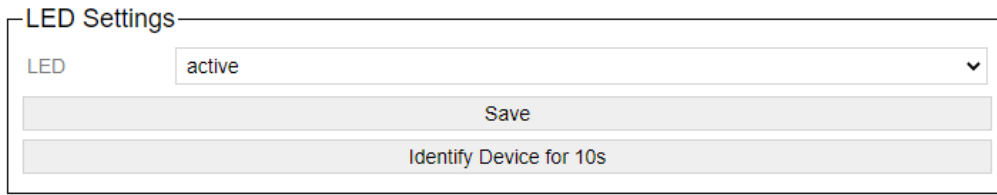

The screenshot shows a web interface for LED settings. At the top left, the text "LED Settings" is displayed. Below it, there is a label "LED" followed by a dropdown menu currently showing "active" with a downward arrow. Underneath the dropdown are two buttons: "Save" and "Identify Device for 10s".

Various LED features can be deactivated or activated here.

LED on inactive means that the LEDs have no function. They are always out.

With the Identify button, the 3 upper LEDs of the device start to go up and down in ascending and descending order.

4.3.4. Date and time

Date and Time

System Date	<input type="text" value="1"/>	.	<input type="text" value="1"/>	.	<input type="text" value="2020"/>
System Time	<input type="text" value="0"/>	:	<input type="text" value="1"/>	:	<input type="text" value="44"/>

Casambi Time 10:51:38
Casambi Day 1.3.2023

NTP Time 00:00:00
NTP Day 1.1.2020

With System Date and System Time the current time in which the gateway is running is always displayed.

The System Time serves as an intermediate buffer between the different systems.

With Casambi Date and Time the current time of the Casambi system is retrieved.

With NTP Date and Time the time of the NTP server is displayed.

With "Get Date and Time from Casambi" the current time can be fetched from the Casambi network. Because Casambi needs some time to send the data, the page can be reloaded with the Refresh button. This time is then taken over from the Casambi system into the system time.

With "Get Date and Time from NTP" the current time of the set NTP server is queried and accordingly taken over and displayed in the gateway. This time is then taken over into the system time.

With "Send Date and Time" the displayed system time can be sent to the Casambi network.

4.3.5. Automation

Automation


Auto Time Update

Save

Here a time span can be specified in hours. Always after X hours the current time is fetched either with activated NTP from the NTP server or fetched from the Casambi system and taken over into the system time. The time from the NTP server is then also sent to the Casambi system every X hours.

A time span of 0 disables the automatic time update.

4.3.6. Restart gateway

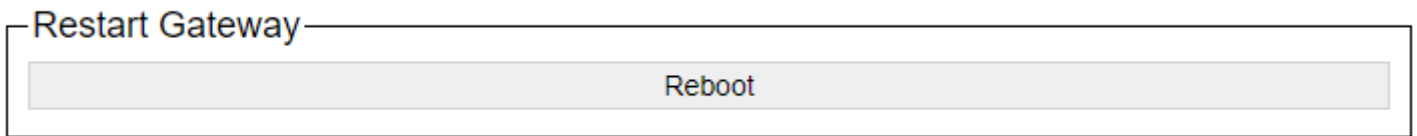

This can be used to restart the gateway.

4.4. Memory

Casambi Ethernet Gateway - 3.10 - REV1

Generell Settings	To Casambi	From Casambi	Console
-------------------	------------	--------------	---------

General Setting

Network	System	Memory
---------	--------	--------

Update Firmware

Configuration

System Memory

Slide for Reset

Debug Settings

Debug Port Active

4.4.1. Update firmware

A firmware update of the gateway can be carried out here.

Update Firmware

Keine ausgewählt

The firmware file is selected with "Select file". The update button then transfers it.

If the update was successful, you will be redirected to the start page after a short time.

4.4.2. Import / Export

Configuration

Export Configuration


Keine ausgewählt

The Export button generates a file with the format "* .ceg". This file is downloaded and can then be saved as a backup.


The filename of the file is always automatically "export_ [IP address with _ instead of.]. Ceg

Such a * .ceg file can be selected and re-imported via import.

All settings are read from the file and saved in the gateway. When done, the gateway restarts.


 The backup files of the main versions are not compatible with each other. In case of an update, the device must be set up again.

4.4.3. System memory

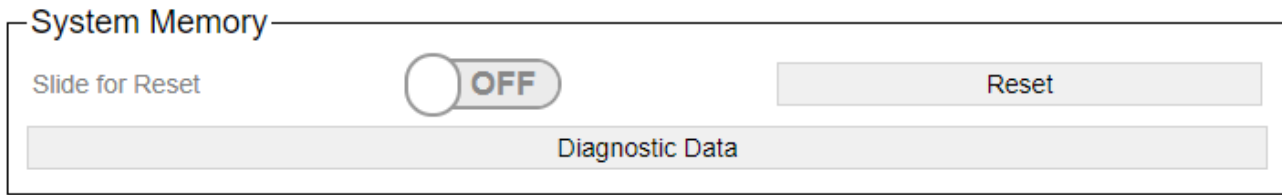

The system can be reset to the factory settings with the "Reset" button. To do this, the "Slide for Reset" slider must be set to "On".

With the "Diagnostic Data" button, a website is displayed in which the currently available parameterization of the gateway is displayed. This can then be saved as a file.

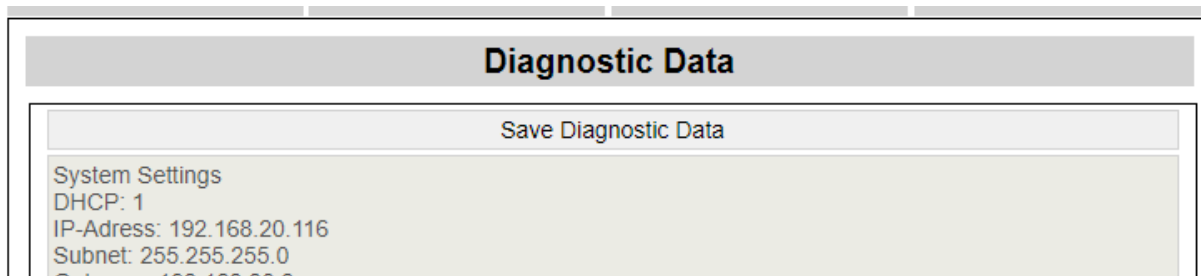

Clicking on "Save Diagnostic Data" creates a file with the name "Casambi_GW_[IP address]_DD.txt" and automatically downloads it from the browser.

4.4.4. UDP Debug Port



A debug port can be opened here. This can only send data, not receive data.

It runs on port 10006 and sends everything via UDP broadcast.

```
17.01.2022 15:23:26          Connected to 192.168.1.100:10006
17.01.2022 15:23:28    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:28    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:29    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:29    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:32    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:33    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: -----
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: Free Memory:
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: Time: 06:09:32
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: Free heap: 189348
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: Startup: 717
17.01.2022 15:23:34    192.168.1.90:10006    local:10006    System: -----
17.01.2022 15:23:35    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:35    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:38    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:39    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:41    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:41    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:44    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:45    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:47    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:47    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:50    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:51    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:54    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:54    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:23:56    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:23:57    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:24:00    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:24:00    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:24:02    192.168.1.90:10006    local:10006    Casambi Output: 1.68
17.01.2022 15:24:02    192.168.1.90:10006    local:10006    Casambi Input: 13.44.90.37.4c.a8.20.82.25.6a.64.d5.22.99.69.49.0.0.0.22
17.01.2022 15:24:02    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
17.01.2022 15:24:02    192.168.1.90:10006    local:10006    Casambi Input: 5.46.0.0.ff.7f
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: -----
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: Free Memory:
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: Time: 06:10:02
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: Free heap: 189348
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: Startup: 717
17.01.2022 15:24:04    192.168.1.90:10006    local:10006    System: -----
17.01.2022 15:24:06    192.168.1.90:10006    local:10006    Casambi Output: 2.70.0
```

Using an appropriate program, more information can now be recorded here for diagnostic purposes.


The device also remembers that this option has been activated and activates it again after a restart if it was active before.

A reset or switching off deactivates the function again.

A possible tool to display the console is the [LanLog.exe](#) tool, which we also provide.

4.4.4.1. LanLog.exe

The tool can be found at the following URL: <https://archiv.intelligent-lighting.de/index.php/s/V6uglwZDeI3HR3V>

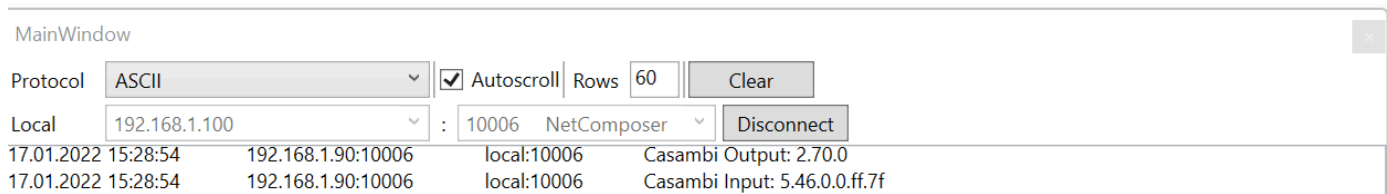


After starting, "ASCII" must be selected as the protocol.

Under Local, select the appropriate network interface based on the IP address and enter 10006 for the port.

Then you connect with connect and see the first entries.

The lower area is not functional here because the gateway does not receive any commands on port 10006:

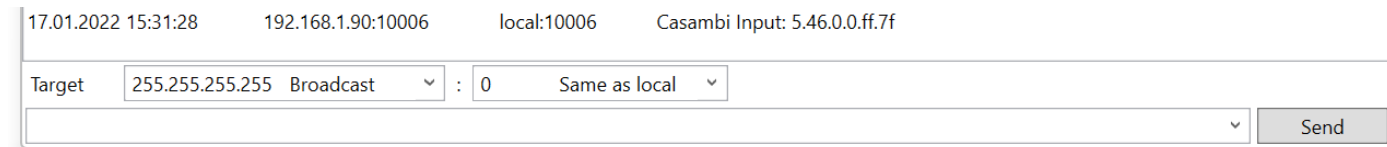


4.5. Reset device

For devices from the date of manufacture 3/2022, a reset of the device can be initiated via an internal button.

More information under [1.4 Reset button](#).

From firmware 2.11 it is possible to reset the entire memory of the device under the URL `"/reset_full_flash"`.

After the call you will (if not already logged in) be greeted with the login screen.

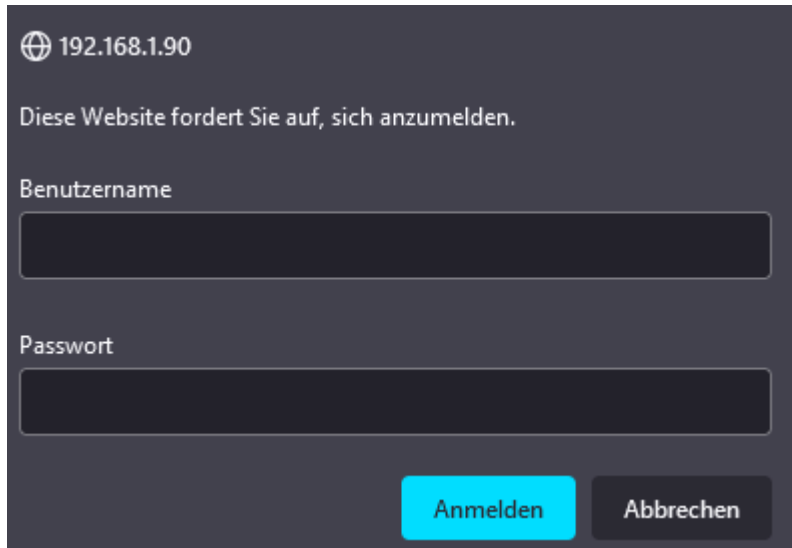

If known, login is possible with the username/password used in the facility. If this is no longer known, the MAC address of the device can also be used as login and password for this page.

As an example (must be the address of the actual gateway):

Users: 4C:75:25:5C:E1:E7

Password: 4C:75:25:5C:E1:E7

This login only works for this URL.

After logging in, you can reset the device.

Full Reset

Attention!

You have to confirm the full reset with the slide switch below.

Hard Reset

Slide for reset



Hard reset

Confirm with the slide switch that the reset is desired and then carry out the reset with a click on the button.

Please note that the entire memory will then be deleted and reset to the factory settings.

This reset can last between 30 and 180s. During this time, the device is no longer accessible.

5. Protocol-specific settings

The settings that are possible for the respective control system are described here.

These refer to the two tabs "To Casambi" and "From Casambi".



These two points can be found under the respective protocol and explain the settings in this.

If the protocol has additional settings, these are also explained in the corresponding chapter.

Possible protocols:

- [Artnet](#)
- [BacNet/IP](#)
- [Free commands over TCP](#)
- [Free commands over UDP](#)
- [HelvarNet](#)
- [MQTT](#)
- [Netcomposer](#)
- [UDP Casambi Command](#)
- [TCP Casambi Command](#)
- [UDP Casambi Bridge](#)

5.1. ArtNet

In this operating mode, various actions can be carried out on the Casambi in an ArtNet universe.

All 512 channels are available in total.

Our ESTA ID is: 0x02F1

Our Artistic License OEM Code: 0x2AB4

Once it has been set up on ArtNet, the gateway can also be configured on the network side via ArtNet. So e.g. the IP address as well as the subnet and the port can be set using the ArtIp command.

The gateway also reacts to ArtPoll requests, e.g. to be found better in media controls.

5.1.1. To Casambi

The DMX address range can be selected in the upper area of the page. 50 channels are displayed per page.

The screenshot shows the 'DMX-Address Page' interface. At the top, there is a dropdown menu currently set to '0' and a 'change Page' button. A dropdown menu is open, showing a list of page numbers from 0 to 16, with '3' selected and highlighted in blue. Below the page selection, a table lists channel configurations. The table has three columns: 'Command', 'Typ', and 'Address'. Each row also includes a 'Save' button.

Command	Typ	Address	Save
l	Broadcast	0	Save
	Not used	0	Save
e	Not used	1	Save
e	Not used	2	Save
	Not used	3	Save


page
0: address 1 - 25
1: address 26 - 50
..
20: address 501-512

The channels and their functions are then listed below this page.


DMX-Address 1 - 25

DMX-Address	DMX-Value	Command	Typ	Address	
1	0	Set Level	Broadcast	0	Save
2	0	none	Not used	0	Save
3	0	Set Scene	Not used	1	Save
4	0	Set Scene	Not used	2	Save
5	0	Set Scene	Not used	3	Save
6	0	Set Scene	Not used	13	Save
7	0	Set Scene	Not used	14	Save
8	0	Set Scene	Not used	15	Save
9	0	none	Not used	0	Save
10	0	Set Level	Device	18	Save
11	0	Set Color Red	Device	18	Save
12	0	Set Color Green	Device	18	Save
13	0	Set Color Blue	Device	18	Save
14	0	Set Color White	Device	18	Save

The following functions are available:

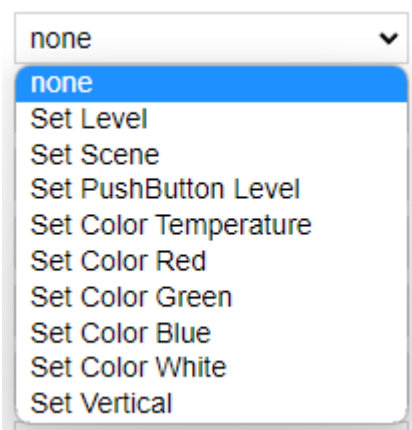

After the command the type must be selected. Here are available for selection:

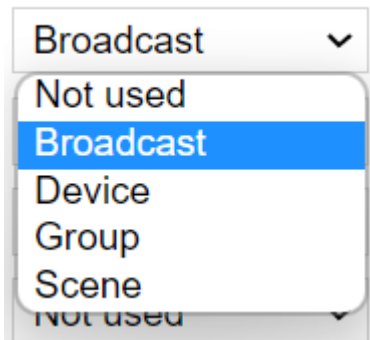

and in the connection still another address must be indicated.

- 1) none => No function
- 2) Set Level => type and address needed, DMX level is transmitted to Casambi (0 - 255)
- 3) Set Scene => Address 1 - 255 specify the scene address in the Casambi, type is ignored, DMX level is transmitted to Casambi (0 - 255)
- 4) Set PushButton Level => Address 1 - 4 specify the button input on which the command should act, type is ignored, DMX level is transmitted to Casambi (0 - 255)
- 5) Set Color Temperature => type and address required, DMX level is transmitted to Casambi as Tc (0 = warm white - 255 = cool white)
- 6) Set Color Red=> type and address needed, DMX level is transmitted as Red to Casambi
- 7) Set Color Green=> type and address needed, DMX level will be send as Green to Casambi
- 8) Set Color Blue=> type and address needed, DMX level will be transmitted to Casambi as Blue
- 9) Set Color White=> Type and Address needed, DMX Level will be transmitted as White to Casambi
- 10) Set Vertical => Type and Address needed, DMX Level is transmitted as Vertical to Casambi

Address and Type are composed as follows:

- 1) Not used => Nothing additional is needed.
- 2) Broadcast => Nothing additional is needed
- 3) Device => Address 1-250 specify the devices the command should affect
- 4) Group => Address 0 controls all ungrouped Casambi modules, address 1-255 control the groups
- 5) Scene => Address 1-255 control the scenes

With the Save button behind each line the entry is saved.

5.1.2. From Casambi

Communication from Casambi Network

Warning!

This settings are not used in "ArtNet" mode.

This page is not used under ArtNet.

5.2. BacNet/IP

In this operating mode, the gateway can be addressed via BacNet / IP and also accepts control commands.

5.2.1. View in the gateway

Settings of the gateway via the internal website.

5.2.1.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.57			
Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Commands		Sensors	

5.2.1.1.1. Commands

Warning!

This "Command" settings are not used in "Bacnet" mode. Please Refer to the Manual.


These settings are not used in the BacNet / IP operating mode.

5.2.1.1.2. Sensors


Communication to Casambi Network	
Commands	Sensors
Lightsensor	
Lightsensor	<input type="text" value="inactive"/>
Raw Value	0
Factor	<input type="text" value="1,00"/>
Value	0
<input type="button" value="Save"/>	
Presence	
Presence Detection	<input type="text" value="inactive"/>
State	inactive
<input type="button" value="Save"/>	

The parameters for setting sensor messages can be set here.

This looks like this in the BacNet:

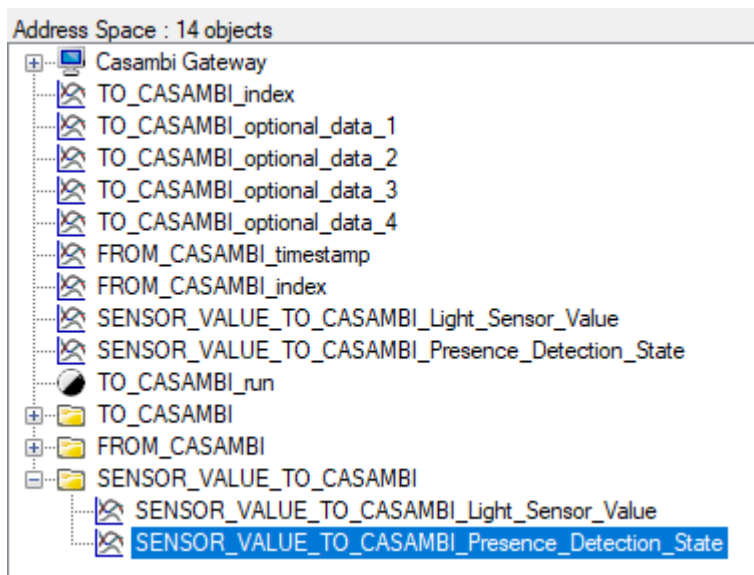


For the light sensor part:

Properties	
	
▼ BacnetProperty	
> Object Identifier	OBJECT_ANALOG_VALUE:12
Object Name	SENSOR_VALUE_TO_CASAMBI_Light_Sensor_Value
Object Type	2 : Object Analog Value
Present Value	0
Property List	85

Here, the value for the value of the light sensor can simply be transferred for Present Value.

For the motion detector part:

Properties	
	
▼ BacnetProperty	
> Object Identifier	OBJECT_ANALOG_VALUE:13
Object Name	SENSOR_VALUE_TO_CASAMBI_Presence_Detection_State
Object Type	2 : Object Analog Value
Present Value	0
Property List	85

Here, the value for the presence sensor can simply be transferred for Present Value.

0 = no presence detected

1 = presence detected

5.2.1.1.2.1. Lightsensor

Lightsensor

Lightsensor	<input type="text" value="inactive"/>
Raw Value	0
Factor	<input type="text" value="1,00"/>
Value	0

Mit der Dropdown Liste "Lightsensor" kann die Übernahme der Lichtsensordaten in das Casambi System gestartet werden.

Bei "Raw Value" wird ein Wert der per BacNet/IP übertragen wird angezeigt.

Der Wert Faktor kann benutzt werden um den Wert der über BacNet/IP geliefert wird anzupassen.

Bei Value wird ein Wert angezeigt der an das Casambi System übertragen wird. Er wird mit der Formel: $\text{Value} = \text{Raw Value} * \text{Faktor}$ berechnet.

Jeder geänderte Wert per BacNet/IP wird an das Casambi System weitergegeben wenn "Lightsensor" auf aktiv steht.

5.2.1.1.2.2. Presence

Presence

Presence Detection

State inactive

Save

Mit der Dropdown Liste "Presence Detection" kann die weitergabe eines Wertes als Präsenzerkennung gestartet werden.

Bei State wird einem inactive oder active angezeigt. Je nach Parameter der per BacNet/IP übertragen wird.

0 = inactive

1 = active

5.2.1.2. From Casambi

Warning!

This settings are not used in "BacNet" mode. The Values are stored in The BacNet Objects: "From Casambi" in "index" and "timestamp".

This page is not used in the BacNet / IP operating mode.

5.2.2. View in BacNet

Address Space : 14 objects

- + Casambi Gateway
 - TO_CASAMBI_index
 - TO_CASAMBI_optional_data_1
 - TO_CASAMBI_optional_data_2
 - TO_CASAMBI_optional_data_3
 - TO_CASAMBI_optional_data_4
 - FROM_CASAMBI_timestamp
 - FROM_CASAMBI_index
 - SENSOR_VALUE_TO_CASAMBI_Light_Sensor_Value
 - SENSOR_VALUE_TO_CASAMBI_Presence_Detection_State
 - TO_CASAMBI_run
- TO_CASAMBI
 - TO_CASAMBI_index
 - TO_CASAMBI_optional_data_1
 - TO_CASAMBI_optional_data_2
 - TO_CASAMBI_optional_data_3
 - TO_CASAMBI_optional_data_4
 - TO_CASAMBI_run
- FROM_CASAMBI
 - FROM_CASAMBI_timestamp
 - FROM_CASAMBI_index
- SENSOR_VALUE_TO_CASAMBI
 - SENSOR_VALUE_TO_CASAMBI_Light_Sensor_Value
 - SENSOR_VALUE_TO_CASAMBI_Presence_Detection_State

Properties

Bacnet Property	
Apdu Timeout	3000
Application Software Version	1.70
Description	Casambi Ethernet Gateway
Firmware Revision	1.70
Max Apdu Length Accepted	1472
Model Name	Lithemet Casambi Gateway
Number Of Apdu Retries	3
> Object Identifier	OBJECT_DEVICE:400001
Object Name	Casambi Gateway
Object Type	8 : Object Device
> Property List	Object[] Array
Protocol Revision	14
Protocol Version	1
Segmentation Supported	3 : None
Segmentation Supported	3 : None
System Status	1 : Operational Readonly
Vendor Identifier	1287
Vendor Name	LichtManufaktur Berlin GmbH

The device can be found in the network via BacNet / IP.

The port and the local device ID can be freely [set](#).

The device has three structured views, each with its own parameters.

"[To Casambi](#)" is responsible for the communication BacNet / IP -> Casambi.

"[From Casambi](#)" is responsible for feedback from the Casambi system.

"[Sensor Value To Casambi](#)" is used to pass on light sensor values and presence reports from the BacNet a Casambi.

The Structured_Views are currently used to simplify the assignment of the variables. Unfortunately not all BacNet programs support this. Therefore, the values are all listed again individually.

With software version 2.0 we have introduced 6 possible further structured views.

[Broadcast](#) directly controls all existing lights in the system via level or Tc with adjustable fad time.

[Device](#) directly controls a single device in Level or Tc with adjustable fad time.


[Ungrouped](#) controls all ungrouped lights in Level or Tc with adjustable fad time.


[Groups](#) controls all ungrouped lights in Level or Tc with an adjustable fade time.

[Scenes](#) controls all scenes in level or Tc with adjustable fad time.

With software version 3.0, color control is added.

5.2.2.1. To Casambi

 These settings are the same as in version 1 and are still available for reasons of compatibility. These also work with Evolution firmware lower than 33.22.

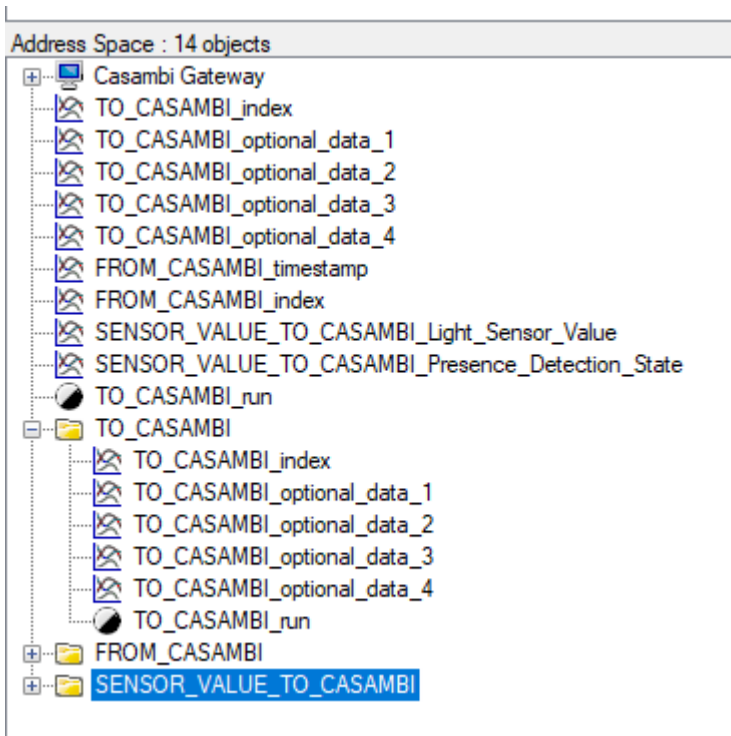

In this operating mode, the values index and optional data 1 - 4 are set first. As soon as this is done, the value "run" can be set to 1 / true and the command is transferred to the Casambi system.

After the transfer, the values index and optional data 1 - 4 remain at the previously transferred values. Only run is set to 0 / false again immediately after execution.

Only a restart of the device resets the values index and optional data 1- 4 to 0.


Index defines the command to be executed; in Optional Data 1-4, different parameters can then be transferred depending on the command.


More details can be found in the following table.

Befehl	index	Optional Data 1	Optional Data 2	Optional Data 3	Optional Data 4
nichts	0	---	---	---	---
Set Level	1	Level	Duration_high_byte	Duration low_byte	---
Set Push Button Pressed	2	Button	---	---	---
Set Push Button Released	3	Button	---	---	---
Set Scene Level	4	Scene	Level	Duration_high_byte	Duration low_byte
Set Group Level	5	Group	Level	Duration_high_byte	Duration low_byte
Set Push Button Level	6	Button	Level	---	---

Duration: value is given in 10ms. 0 Means that he uses the value from the luminaire module.


5.2.2.2. From Casambi


 These settings are the same as in version 1 and are still available for reasons of compatibility. These also work with Evolution firmware lower than 33.22.

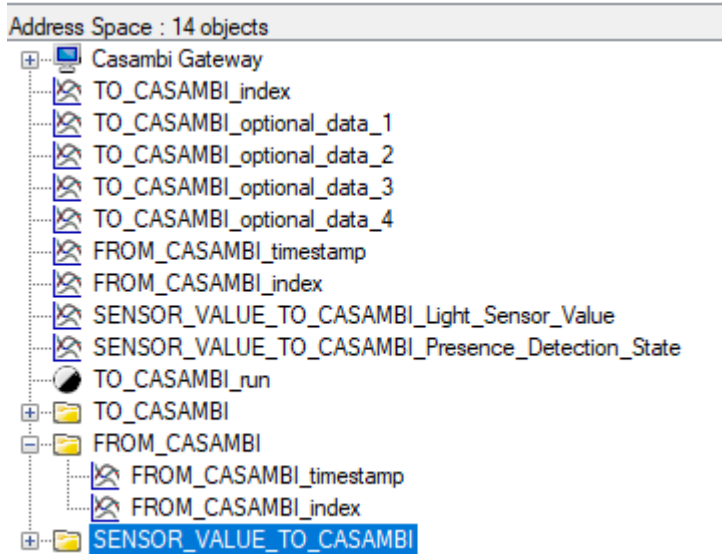


If the gateway is added to a scene in the Casambi system, a binary number can be set using the gateway's 8 sliders. This number is then returned when the scene is called via the value index. With timestamp, the time in seconds that the gateway runs is set. This shows whether it is a new or an old value. If the value range overflows, the timer starts again at 0.

5.2.2.3. Sensor Value To Casambi

 These settings are the same as in version 1 and are still available for reasons of compatibility. These also work with Evolution firmware lower than 33.22.

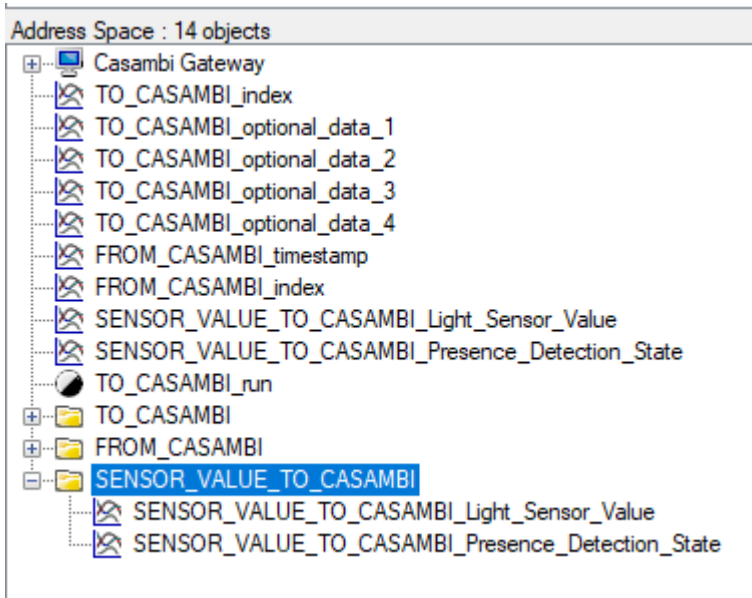


For the light sensor part:

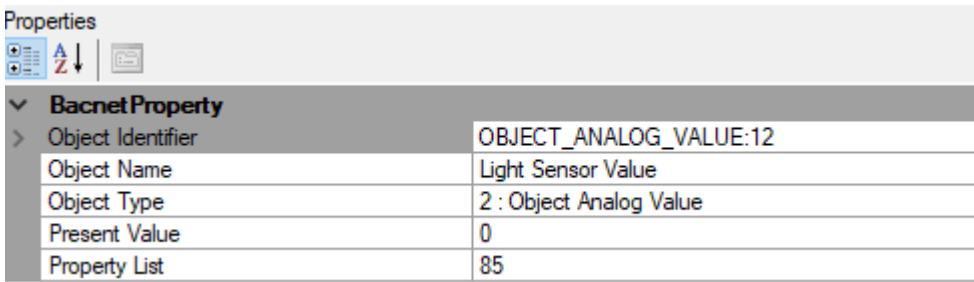

Properties	
BacnetProperty	
Object Identifier	OBJECT_ANALOG_VALUE:12
Object Name	Light Sensor Value
Object Type	2 : Object Analog Value
Present Value	0
Property List	85

Here, the value for the value of the light sensor can simply be transferred for Present Value.

For the motion detector part:

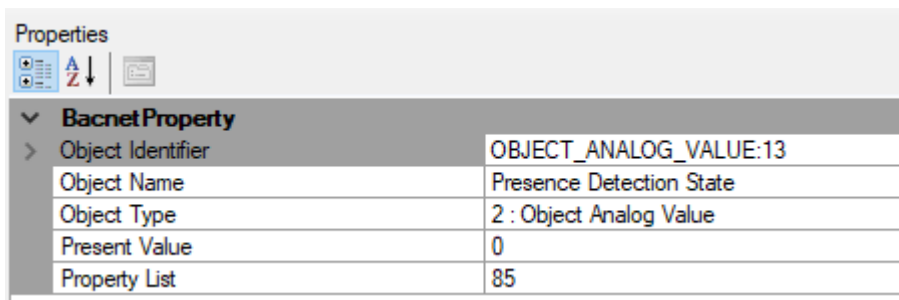

Properties	
BacnetProperty	
Object Identifier	OBJECT_ANALOG_VALUE:13
Object Name	Presence Detection State
Object Type	2 : Object Analog Value
Present Value	0
Property List	85

Here, the value for the presence sensor can simply be transferred for Present Value.

0 = no presence detected
1 = presence detected

However, the transfer of the values must also be [set](#) to active in the gateway.

5.2.2.4. Broadcast




These settings only work with Evolution firmware greater than or equal to 33.22.

Red, Green, Blue, White, Sat and Hue from Evolution firmware greater than or equal to 34.50.

Vertical from Evolution firmware greater or equal 37.00.

start_automation from Evolution firmware greater or equal 37.80.

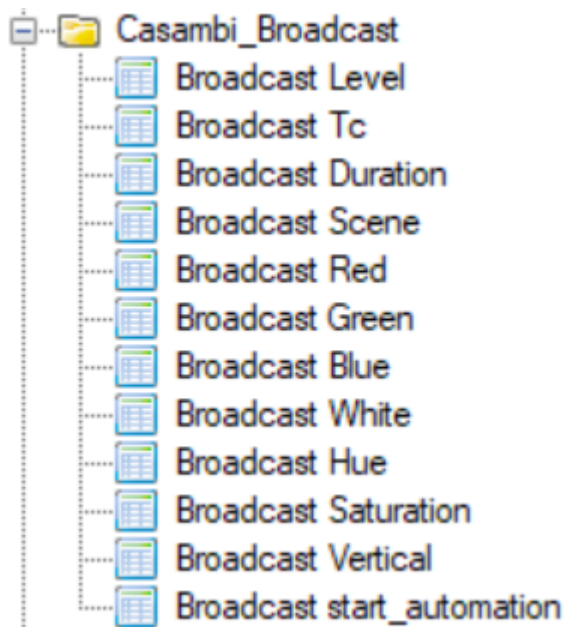

The fade time is set with Broadcast Duration. The value is taken internally in Casambi * 10ms.

0 = default

1 = 0s

100 = 1s

The values to be called up are entered in Level, Tc, Red, Green, Blue, White, Hue and Sat.

Red, Green, Blue, White, Level are necessary for the RGBW control.

Hue, Sat, White, Level for the Hue/Sat control.

For Hue applies:

0x0000 - 0xFFFF = Color

The following applies to Tc:

Tc	Kommentar
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

If a value is specified in the two variables, it is called with the fade time set under Duration.

start_automation starts automation for all nodes in the network as soon as the value is greater than or equal to 1.

5.2.2.5. Device




These settings only work with Evolution firmware greater than or equal to 33.22.

Red, Green, Blue, White, Sat and Hue from Evolution firmware greater than or equal to 34.50.

Vertical from Evolution firmware greater or equal 37.00.

start_automation, sensor_lux, sensor_pir from Evolution firmware greater or equal 37.80.

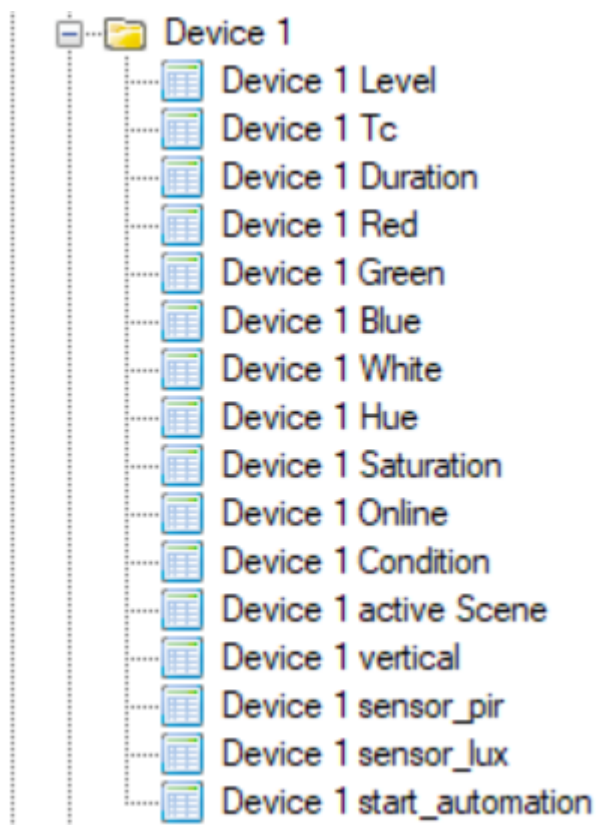

The fade time is set with Duration. The value is taken internally in Casambi * 10ms.

0 = default

1 = 0s

100 = 1s

The values to be called up are entered in Level, Tc, Red, Green, Blue, White, Hue and Sat.

Red, Gree, Blue, White, Level are necessary for the RGBW control.

Hue, Sat, White, Level for the Hue/Sat control.

For Hue applies:

0x0000 - 0xFFFF = Color

The following applies to Tc:

Tc	Kommentar
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

If a value is specified in the two variables, it is called with the fade time set under Duration.

Online indicates whether the fixture was found in the system or is currently not in the system.

Condition indicates the state of the device:

0x00, 0x80, 0xA0: ok

0x01: "overheated

0x09: "overload" (current limit)

0x81: "thermal_overload

0x82: "lamp_failure

0x83: "driver_failure

0x85: "incompatible_hw"

0x86: "hw_not_found"

0x87: "configuration_failed

Active Scene" shows which scene is currently active in the participant.

Sensor_pir as well as sensor_lux show the values of a Casambi sensor, if the participant is one, or if it is assigned with the corresponding information in the profiles.

start_automation starts the automation for exactly this participant as soon as the value is greater than or equal to 1.

5.2.2.6. Ungrouped




These settings only work with Evolution firmware greater than or equal to 33.22.

Red, Green, Blue, White, Sat and Hue from Evolution firmware greater than or equal to 34.50.

Vertical from Evolution firmware greater or equal 37.00.

start_automation from Evolution firmware greater or equal 37.80.

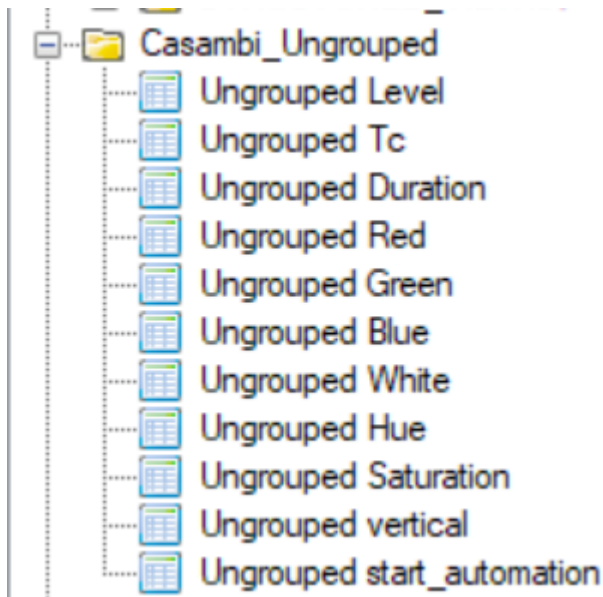

The fade time is set with Duration. The value is taken internally in Casambi * 10ms.

0 = default

1 = 0s

100 = 1s

The values to be called up are entered in Level, Tc, Red, Green, Blue, White, Hue and Sat.

Red, Green, Blue, White, Level are necessary for the RGBW control.

Hue, Sat, White, Level for the Hue/Sat control.

For Hue applies:

0x0000 - 0xFFFF = Color

The following applies to Tc:

Tc	Kommentar
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

If a value is specified in the two variables, it is called with the fade time set under Duration.

start_automation starts automation for all ungrouped participants as soon as the value is greater than or equal to 1.

5.2.2.7. Group




These settings only work with Evolution firmware greater than or equal to 33.22.

Red, Green, Blue, White, Sat and Hue from Evolution firmware greater than or equal to 34.50.

Vertical from Evolution firmware greater or equal 37.00.

start_automation from Evolution firmware greater or equal 37.80.

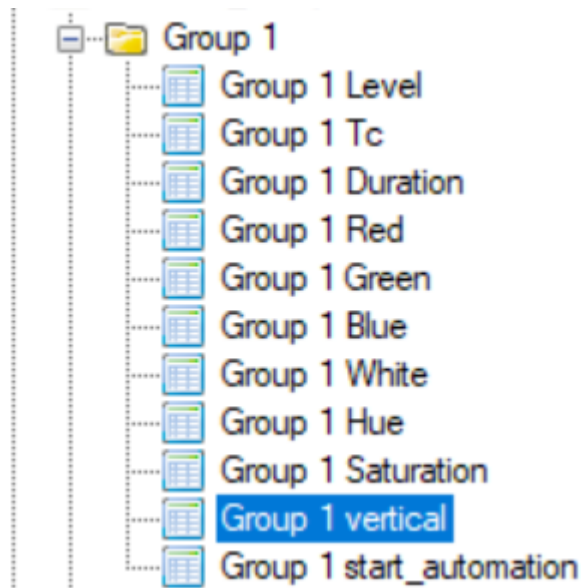

The fade time is set with Duration. The value is taken internally in Casambi * 10ms.

0 = default

1 = 0s

100 = 1s

The values to be called up are entered in Level, Tc, Red, Green, Blue, White, Hue and Sat.

Red, Gree, Blue, White, Level are necessary for the RGBW control.

Hue, Sat, White, Level for the Hue/Sat control.

For Hue applies:

0x0000 - 0xFFFF = Color

The following applies to Tc:

Tc	Kommentar
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

If a value is specified in the two variables, it is called with the fade time set under Duration.

start_automation starts automation for all participants in the group as soon as the value is greater than or equal to 1.


5.2.2.8. Scene



These settings only work with Evolution firmware greater than or equal to 33.22.

Red, Green, Blue, White, Sat and Hue from Evolution firmware greater than or equal to 34.50.

start_automation from Evolution firmware greater or equal 37.80.

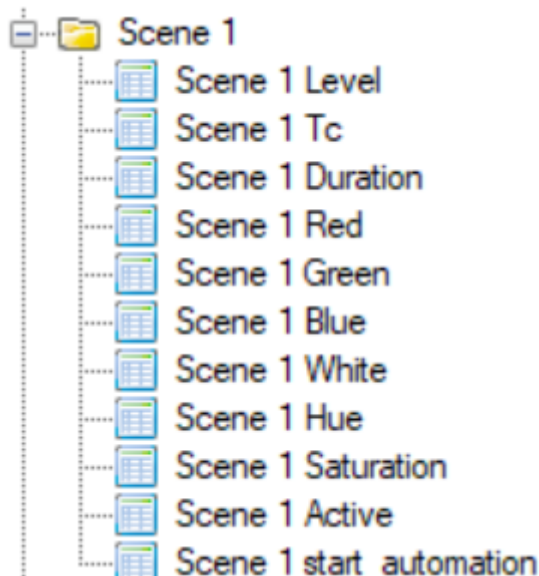

The fade time is set with Duration. The value is taken internally in Casambi * 10ms.

0 = default

1 = 0s

100 = 1s

The values to be called up are entered in Level, Tc, Red, Green, Blue, White, Hue and Sat.

Red, Green, Blue, White, Level are necessary for the RGBW control.

Hue, Sat, White, Level for the Hue/Sat control.

For Hue applies:

0x0000 - 0xFFFF = Color

The following applies to Tc:

Tc	Kommentar
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

If a value is specified in the two variables, it is called with the fade time set under Duration.

Scene Active stores whether the scene is called or not.

start_automation starts automation for all participants in the scene as soon as the value is greater than or equal to 1.

5.2.3. Polling

In this operating mode, certain values are queried and the variables are automatically adjusted.

Polled are:

- The level of the scenes and whether they are active. If not active then the level is 0
- The level of a group
- The level of the broadcast entry
- If the device is reachable (online) and how its state is
- Red, Green, Blue, White, Hue, Sat of a device
- Red, Green, Blue, White, Hue, Sat of a group
- Red, Green, Blue, White, Hue, Sat of Broadcast
- Red, Green, Blue, White, Hue, Sat of ungrouped fixtures
- Sensor_pir of a device
- Sensor_lux of a device

The method of polling the data can be customized under the [system](#) settings.

5.3. Free commands over TCP

In this operating mode, the gateway can connect to a TCP server and exchange ASCII-based texts with it.

5.3.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.25

Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Memory Slot			
<input type="text" value="10"/> <input type="button" value="Load..."/>			
Trigger			
Trigger <input type="text"/> <input type="button" value="Wizard"/>			
Action			
Command none			
<input type="button" value="Wizard"/>			
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			

© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.3.1.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

Memory Slot

0	▼	Load...
---	---	---------

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.3.1.2. Trigger

Trigger

Trigger

The command to which the gateway should react is entered in the text field.

5.3.1.3. Action

Action

Command none

Wizard

With the button wizard, the dialog for setting the action is called. A new page will then open:

Action Builder

Command none

next step

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Descriptions of the commands in the wizard are available here: ["Protokoll/Casambi"](#)

Action Builder

Command none

step back Test

Apply

After setting the action-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.3.2. From Casambi

Here you can set what the gateway should send on the network as soon as e.g. Scene calls from the Casambi world are available.

Casambi Ethernet Gateway v1.10

Generell Settings	To Casambi	From Casambi	Console
Communication from Casambi Network			
Memory Slot			
<input type="text" value="0"/>		<input type="button" value="Load..."/>	
Trigger			
Bit_1	<input type="checkbox"/>	OFF	
Bit_2	<input type="checkbox"/>	OFF	
Bit_3	<input type="checkbox"/>	OFF	
Bit_4	<input type="checkbox"/>	OFF	
Bit_5	<input type="checkbox"/>	OFF	
Bit_6	<input type="checkbox"/>	OFF	
Bit_7	<input type="checkbox"/>	OFF	
Bit_8	<input type="checkbox"/>	OFF	
Action			
<input type="text"/>			<input type="button" value="Wizard"/>
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			


© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.3.2.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

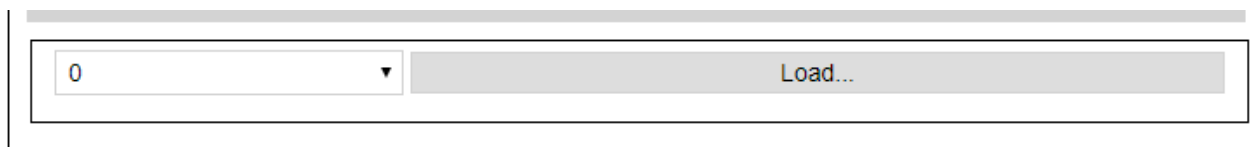

The image shows a horizontal control bar with a light gray background. On the left side, there is a white drop-down menu containing the number '0' and a small downward-pointing triangle. To the right of the drop-down menu is a gray button with the text 'Load...' in white.

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.


5.3.2.2. Trigger

The trigger specifies when an action should be triggered.



The triggers are used to set at which scene recall in the Casambi the command stored under "Action" is to be sent on the network.

In the Casambi system you can choose which bits are active in the trigger for a scene. (Picture below)

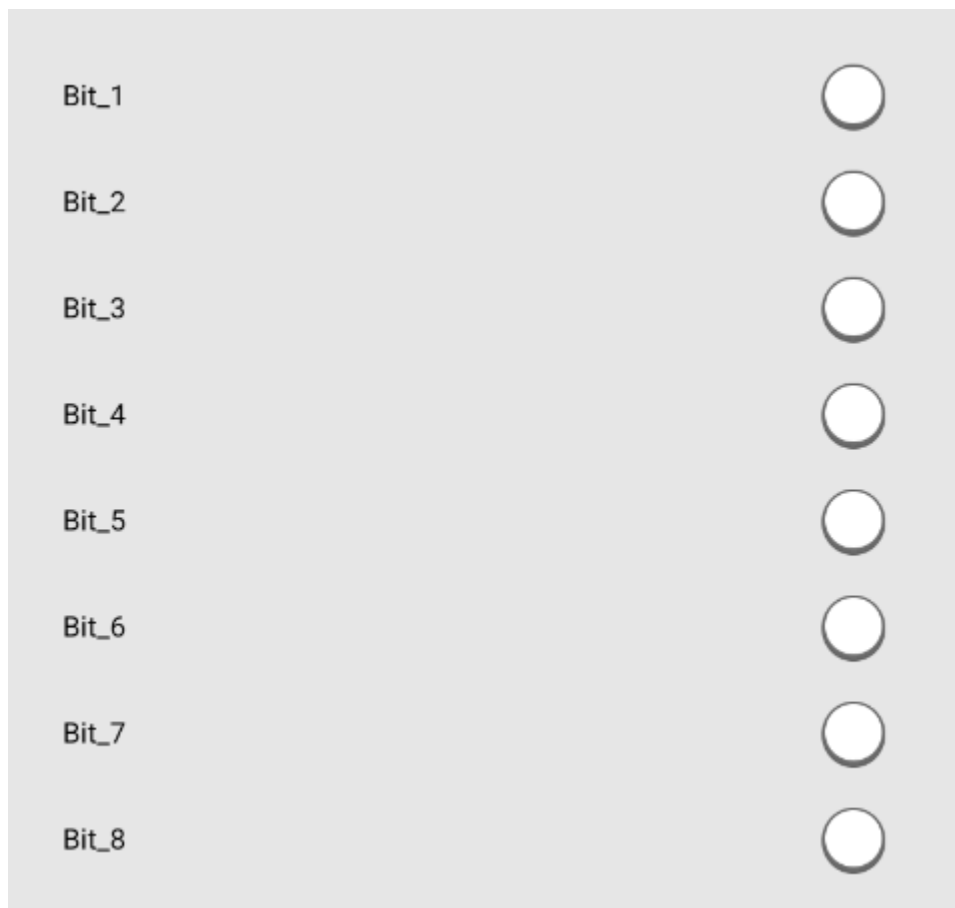

With the Submit button the entered is saved.

With the test button you can check whether the entered action is the right one.

5.3.2.3. Action

Action

The command that the gateway should send is entered in the text field.

5.4. Free commands over UDP

In this operating mode, the gateway sends out defined ASCII strings via UDP broadcast or reacts to them and triggers corresponding actions in the Casambi system.

5.4.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.25

Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Memory Slot			
<div style="border: 1px solid black; padding: 5px;">10 ▼ Load...</div>			
Trigger			
<div style="border: 1px solid black; padding: 5px;">Trigger Wizard</div>			
Action			
<div style="border: 1px solid black; padding: 5px;">Command none</div>			
<div style="border: 1px solid black; padding: 5px; background-color: #cccccc; width: 100%;">Wizard</div>			
<div style="border: 1px solid black; padding: 5px; background-color: #cccccc; width: 100%;">Save</div>			
<div style="border: 1px solid black; padding: 5px; background-color: #cccccc; width: 100%;">Test</div>			

© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.4.1.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

Memory Slot

0	▼	Load...
---	---	---------

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.4.1.2. Trigger

Trigger

Trigger

The command to which the gateway should react is entered in the text field.

5.4.1.3. Action

Action

Command none

Wizard

With the button wizard, the dialog for setting the action is called. A new page will then open:

Action Builder

Command none

next step

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Descriptions of the commands in the wizard are available here: ["Protokoll/Casambi"](#)

Action Builder

Command none

step back Test

Apply

After setting the action-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.4.2. From Casambi

Here you can set what the gateway should send on the network as soon as e.g. Scene calls from the Casambi world are available.

Casambi Ethernet Gateway v1.10

Generell Settings	To Casambi	From Casambi	Console
Communication from Casambi Network			
Memory Slot			
<input type="text" value="0"/>		<input type="button" value="Load..."/>	
Trigger			
Bit_1	<input type="checkbox"/>	OFF	
Bit_2	<input type="checkbox"/>	OFF	
Bit_3	<input type="checkbox"/>	OFF	
Bit_4	<input type="checkbox"/>	OFF	
Bit_5	<input type="checkbox"/>	OFF	
Bit_6	<input type="checkbox"/>	OFF	
Bit_7	<input type="checkbox"/>	OFF	
Bit_8	<input type="checkbox"/>	OFF	
Action			
<input type="text"/>			<input type="button" value="Wizard"/>
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			


© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.4.2.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

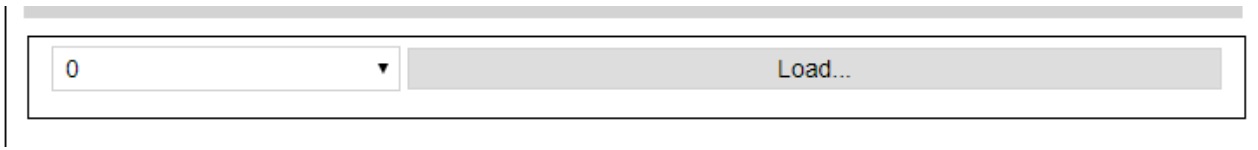


The image shows a horizontal control bar with a light gray background. On the left side, there is a white drop-down menu containing the number '0' and a small downward-pointing triangle. To the right of the drop-down menu is a gray button with the text 'Load...' in white.

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.


5.4.2.2. Trigger

The trigger specifies when an action should be triggered.

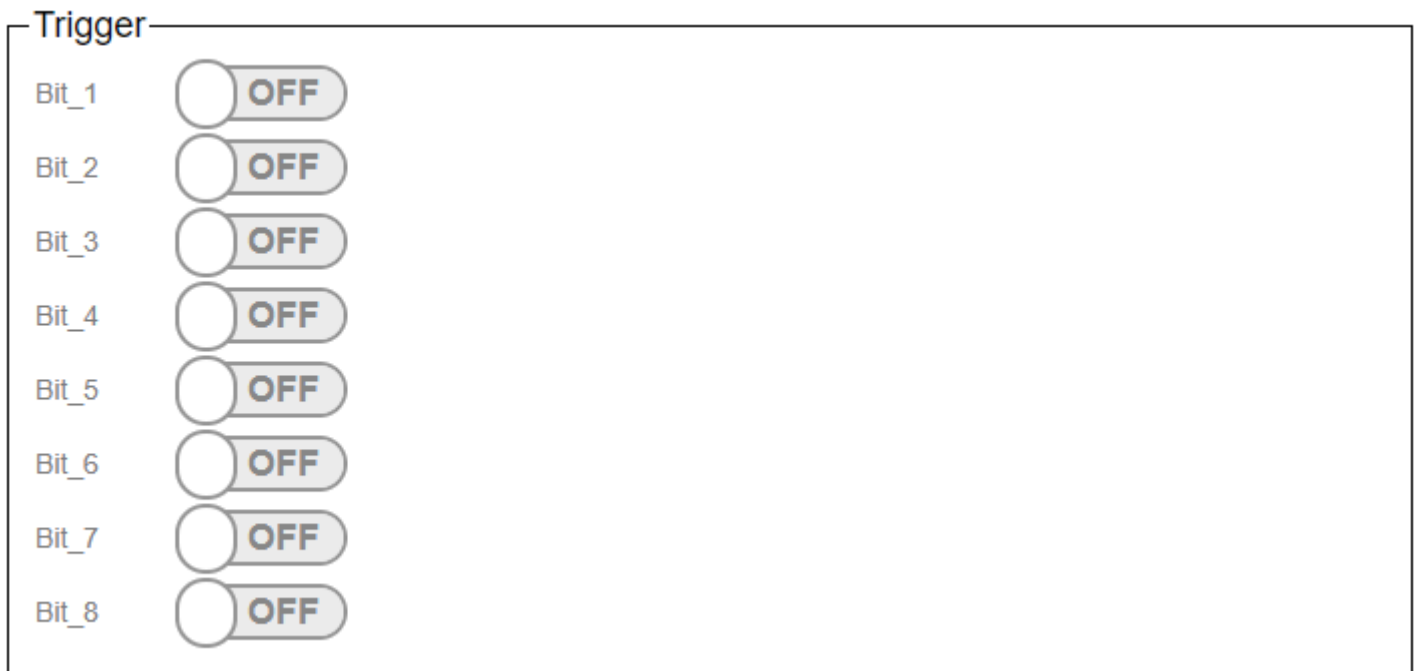

The triggers are used to set at which scene recall in the Casambi the command stored under "Action" is to be sent on the network.

In the Casambi system you can choose which bits are active in the trigger for a scene. (Picture below)

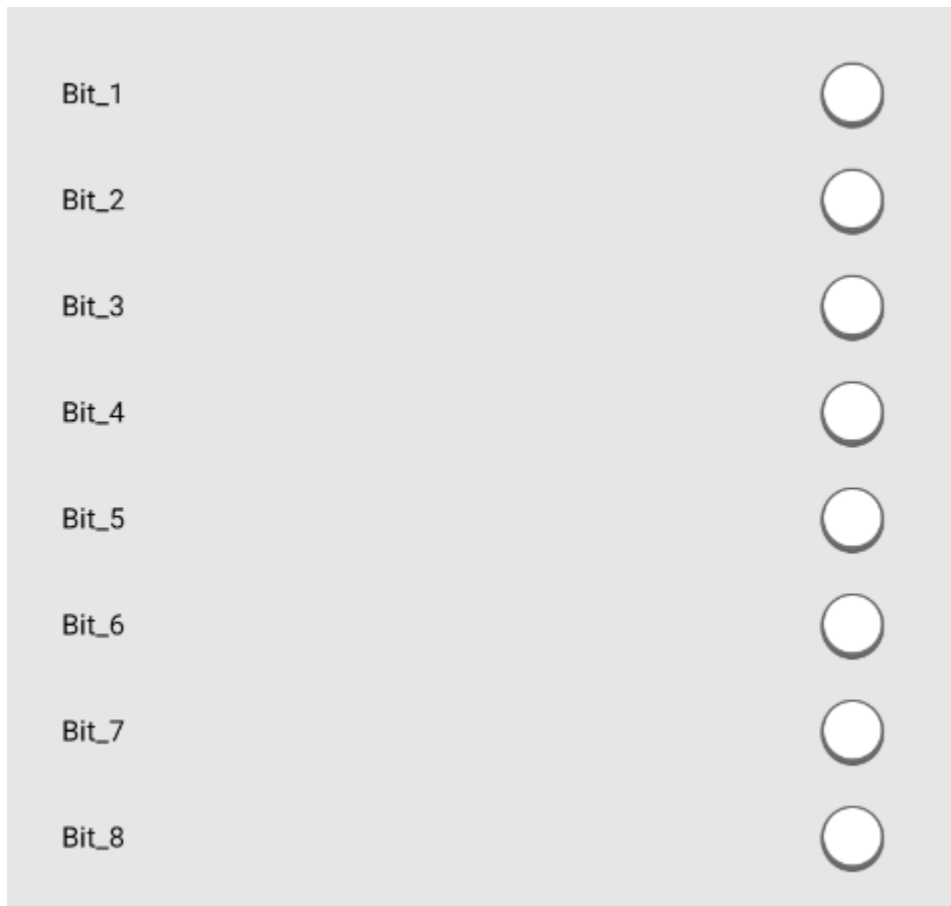

With the Submit button the entered is saved.

With the test button you can check whether the entered action is the right one.

5.4.2.3. Action

Action

The command that the gateway should send is entered in the text field.


5.5. HelvarNet (TCP)

Bei dieser Betriebsart, sendet das Gateway definierte HelvarNet Befehle an ein Imagine Router System der Firma Helver. Ebenso kann es auf Befehle aus diesem reagieren.

5.5.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Depending on the system, you can either go directly to the "[Commands](#)" page.

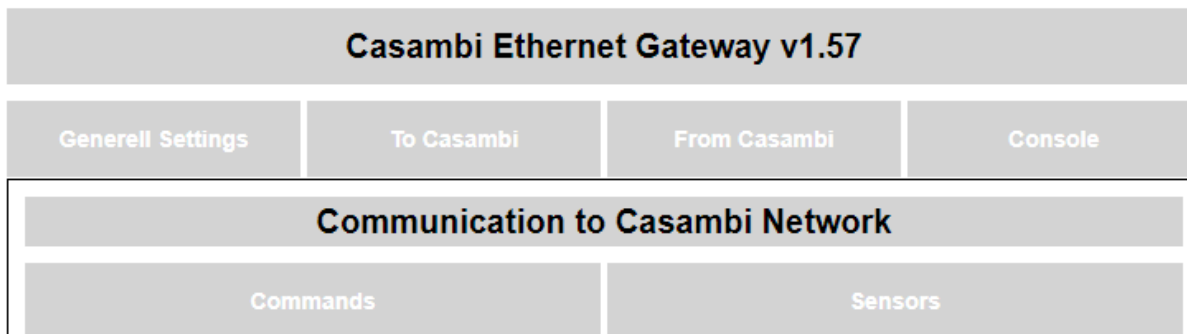

In the case of the HelvarNet control system, the "[Sensors](#)" page can also be selected from a submenu that is then visible.

5.5.1.1. Commands

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.25

Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Memory Slot			
<div style="border: 1px solid black; padding: 5px;">10 ▼ Load...</div>			
Trigger			
<div style="border: 1px solid black; padding: 5px;">Trigger Wizard</div>			
Action			
<div style="border: 1px solid black; padding: 5px;">Command none Wizard</div>			
Save			
Test			

© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.5.1.1.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

Memory Slot

0	▼	Load...
---	---	---------

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.5.1.1.2. Trigger

The command to which the gateway should react is entered in the text field.

Descriptions of the commands in the wizard are available here: ["Wizard/HelvarNet"](#)

Trigger

Trigger

Wizard

5.5.1.1.3. Action

Action

Command none

Wizard

With the button wizard, the dialog for setting the action is called. A new page will then open:

Action Builder

Command none

next step

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Descriptions of the commands in the wizard are available here: ["Protokoll/Casambi"](#)

Action Builder

Command none

step back Test

Apply

After setting the action-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.5.1.2. Sensors

Casambi Ethernet Gateway v1.57

Generell Settings	To Casambi	From Casambi	Console
-------------------	------------	--------------	---------

Communication to Casambi Network

Commands	Sensors
----------	---------

Lightsensor

Lightsensor	<input type="text" value="active"/>
Address	<input type="text" value="20.75.2.63.4"/>
Raw Value	38
Factor	<input type="text" value="1,00"/>
Value	38

© [Lichtmanufaktur Berlin GmbH 2020](#)

A sensor can be specified on this page, which is then queried cyclically every 30s for its current measured value. If a new value is received from the sensor, it is processed and then transferred to the Casambi system.

This function can be activated and deactivated with the Lightsensor drop-down menu. The sensor is only queried if HelvarNet has been selected as the system and the function is activated.

In the case of address, the address is given in the HelvarNet.

[Cluster]. [Router]. [Subnet]. [Device]. [Subdevice]

The cluster and the router ID can be determined from the IP address of the router 192.168.Cluster.Router. The subnet is the Dali line and the device is the device address. The 4 can be used as a sub-device for the multi-sensors.

With "Raw Value" the measured value of the sensor is displayed. This goes from 0 - 200.

This value can then be scaled using a factor. The factor can be set from 0 in steps of 0.01.

The value that is transmitted to the Casambi system is then in Value. This then takes the entered factor into account.

5.5.2. From Casambi

Here you can set what the gateway should send on the network as soon as e.g. Scene calls from the Casambi world are available.

Casambi Ethernet Gateway v1.10

Generell Settings	To Casambi	From Casambi	Console
Communication from Casambi Network			
Memory Slot			
<input type="text" value="0"/>		<input type="button" value="Load..."/>	
Trigger			
Bit_1	<input type="checkbox"/>	OFF	
Bit_2	<input type="checkbox"/>	OFF	
Bit_3	<input type="checkbox"/>	OFF	
Bit_4	<input type="checkbox"/>	OFF	
Bit_5	<input type="checkbox"/>	OFF	
Bit_6	<input type="checkbox"/>	OFF	
Bit_7	<input type="checkbox"/>	OFF	
Bit_8	<input type="checkbox"/>	OFF	
Action			
<input type="text"/>			<input type="button" value="Wizard"/>
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			

© Lichtmanufaktur Berlin GmbH 2020


The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

With certain operating modes (UDP Casambi Command, Art-Net) it is not possible to set anything on this page.

5.5.2.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

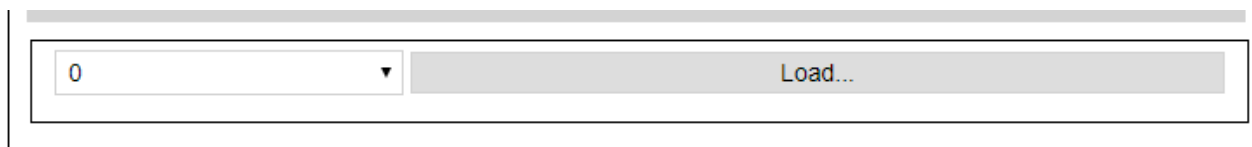


The image shows a horizontal control element within a light gray border. On the left is a white drop-down menu box containing the number '0' and a small downward-pointing triangle. To the right of this box is a gray rectangular button with the text 'Load...' in white.

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.


5.5.2.2. Trigger

The trigger specifies when an action should be triggered.

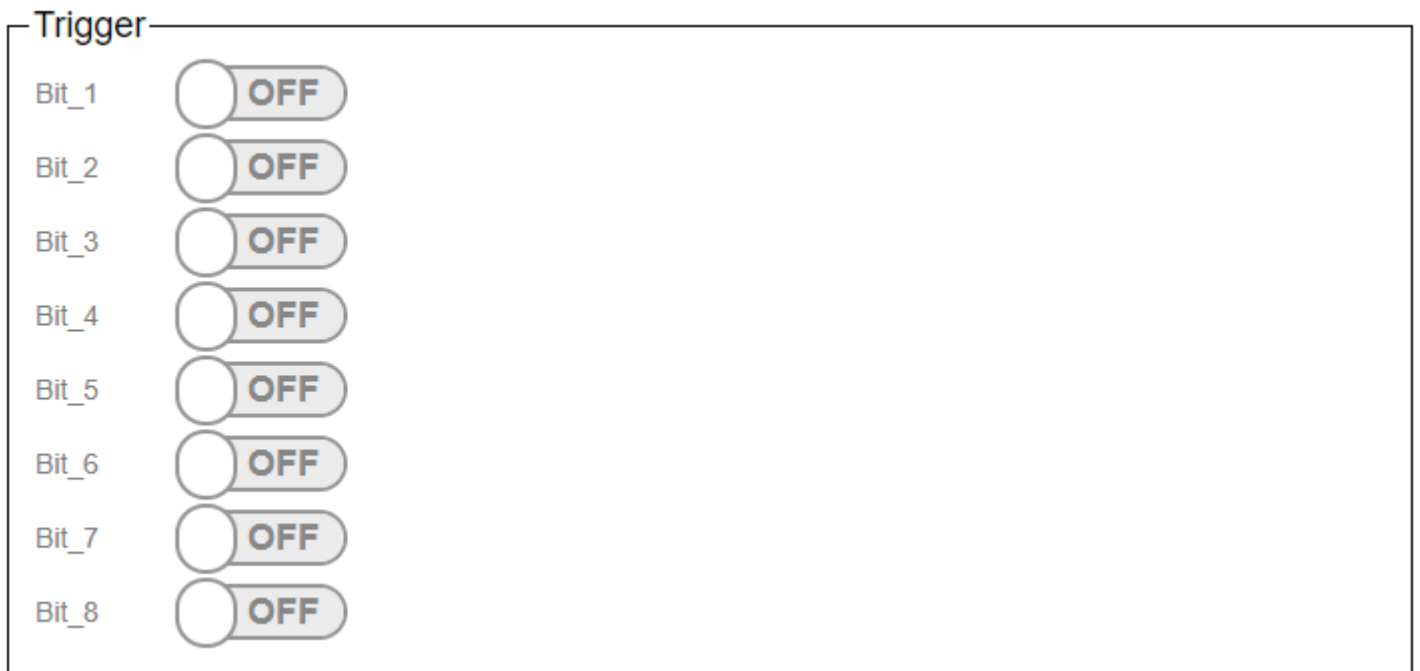

The triggers are used to set at which scene recall in the Casambi the command stored under "Action" is to be sent on the network.

In the Casambi system you can choose which bits are active in the trigger for a scene. (Picture below)

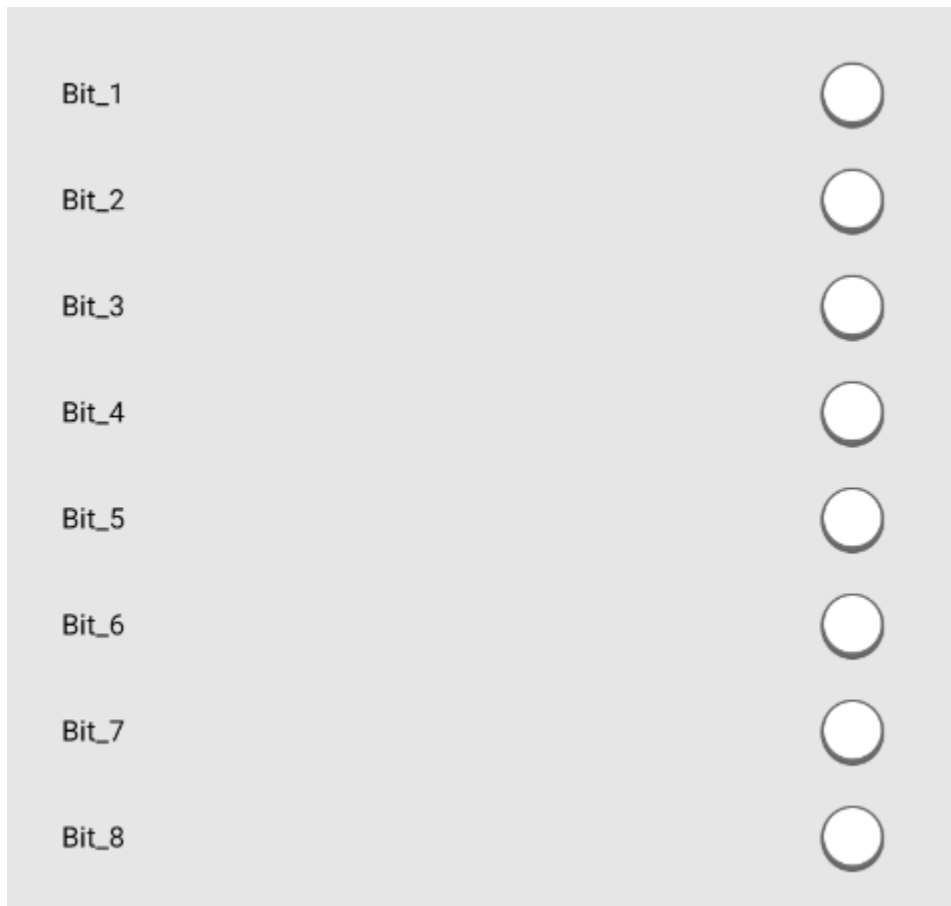

With the Submit button the entered is saved.

With the test button you can check whether the entered action is the right one.

5.5.2.3. Action

The command that the gateway should send is entered in the text field.

Action

5.5.3. HelvarNet Command Builder



Command Builder

Command


next step

The wizard supports you in creating the commands to which the Casambi system should react.

With "Command, various commands are available that can be reacted to.

- [Recall Scene \(Group\)](#)
- [Recall Scene \(Device\)](#)
- [Direct Level \(Group\)](#)
- [Direct Level \(Device\)](#)
- [Dimm \(Group\)](#)
- [Dimm \(Device\)](#)

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

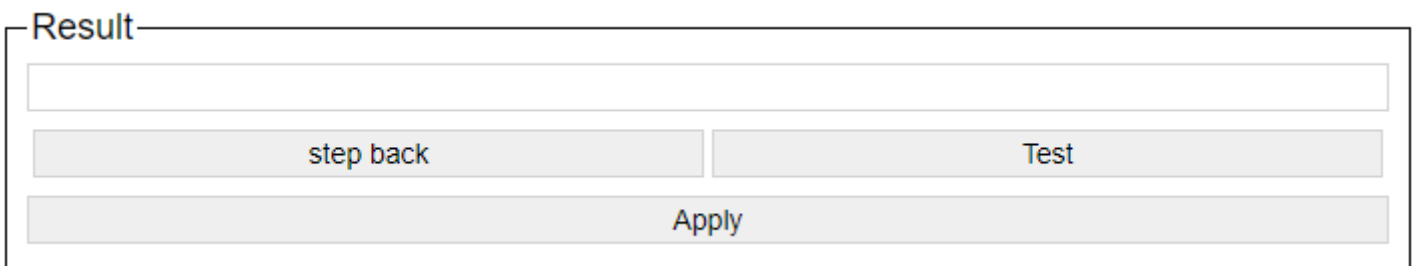

Result

step back Test

Apply

After setting the command-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

After accepting with "Apply", the command is automatically saved in the corresponding slot.



Addresses must be determined with the designer software!

5.5.3.1. Recall Scene (Group)

Command Builder

Command	Recall Scene (Group)
Address	<input type="text"/>
Block	<input type="text" value="1"/>
Scene	<input type="text" value="1"/>
Constant Light	<input type="checkbox"/> OFF
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The group number from the Designer software is entered in the "Address" field

"Block" and "Scene" indicate which scenes are called.

When the "Constant Light" slide switch is set to On, the scene is called up in the constant light control of the Helvar system.

"FadeTime" indicates the fade time to be used. Specification in seconds.

Ignore Fading indicates that the fade time sent with the call should be ignored.

5.5.3.2. Recall Scene (Device)

Command Builder

Command	Recall Scene (Device)
Address	<input type="text"/>
Block	<input type="text" value="1"/>
Scene	<input type="text" value="1"/>
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The device number from the Designer software is entered in the "Address" field

"Block" and "Scene" indicate which scenes are called.

"FadeTime" indicates the fade time to be used. Specification in seconds.

Ignore Fading indicates that the fade time sent with the call should be ignored.

5.5.3.3. Direct Level (Group)

Command Builder

Command	Direct Level (Group)
Address	<input type="text"/>
Level	<input type="range"/>
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The group number from the Designer software is entered in the "Address" field

Level indicates the brightness in (0-254).

"FadeTime" indicates the fade time to be used. Specification in seconds.

Ignore Fading indicates that the fade time sent with the call should be ignored.

5.5.3.4. Direct Level (Device)

Command Builder

Command	Direct Level (Device)
Address	<input type="text"/>
Level	<input type="range"/>
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The device number from the Designer software is entered in the "Address" field

Level indicates the brightness in (0-254).

"FadeTime" indicates the fade time to be used. Specification in seconds.

Ignore Fading indicates that the fade time sent with the call should be ignored.

5.5.3.5. Dimm (Group)

Command Builder

Command	Dimm (Group)
Group	<input type="text" value="1"/>
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The group number from the Designer software is entered in the "Address" field.

"FadeTime" specifies the fade time to be used. Specified in seconds.

Ignore Fading specifies that the fade time sent with the call is to be ignored.

For dimming it is best to set Ignore Fading to On.

5.5.3.6. Dimm (Device)

Command Builder

Command	Dimm (Device)
Device	<input type="text" value="1"/>
Fade Time	<input type="text" value="0,0"/>
Ignore Fading	<input type="checkbox"/> OFF

The device number from the Designer software is entered in the "Address" field.

"FadeTime" specifies the fade time to be used. Specified in seconds.

Ignore Fading specifies that the fade time sent with the call is to be ignored.

For dimming it is best to set Ignore Fading to On.

5.6. MQTT

In this operating mode, the gateway can be addressed via MQTT and also accepts control commands.

5.6.1. View in the gateway

Settings of the gateway via the internal website.

5.6.1.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.57			
Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Commands		Sensors	

5.6.1.1.1. Commands

Warning!

This "Command" settings are not used in "MQTT" mode.

These settings are not used in the MQTT operating mode.

5.6.1.1.2. Sensors MQTT

Communication to Casambi Network	
Commands	Sensors
Lightsensor	
Lightsensor	<input type="text" value="inactive"/>
Raw Value	0
Factor	<input type="text" value="1,00"/>
Value	0
<input type="button" value="Save"/>	
Presence	
Presence Detection	<input type="text" value="inactive"/>
State	inactive
<input type="button" value="Save"/>	

The parameters for setting sensor messages can be set here.

5.6.1.1.2.1. Lightsensor

Lightsensor

Lightsensor	<input type="text" value="inactive"/>
Raw Value	0
Factor	<input type="text" value="1,00"/>
Value	0

With the drop-down list "Lightsensor" the transfer of the light sensor data into the Casambi system can be started.

With "Raw Value" the value that is transmitted via BacNet / IP is displayed.

The value factor can be used to adjust the value that is delivered via BacNet / IP.

With Value, the value that is transferred to the Casambi system is displayed. It is calculated using the formula:
 $Value = Raw\ Value * Factor$.

Every changed value via BacNet is passed on to the Casambi system if "Lightsensor" is active.

5.6.1.1.2.2. Presence

Presence

Presence Detection

State inactive

Save

The transfer of a value as presence detection can be started with the drop-down list "Presence Detection".

In the case of State, an inactive or active is displayed. Depending on the parameters that are transmitted via BacNet / IP.

0 = inactive

1 = active

5.6.1.2. From Casambi

Warning!

This settings are not used in "MQTT" mode.

This page is not used under MQTT.

5.6.2. View in MQTT

Description of the commands and options in MQTT.

All values are transferred as a JSON structure.

[id] must be replaced by the ID of the number set as NET ID in the settings.

5.6.2.1. MQTT data received

5.6.2.1.1. Gateway

Return call of a scene

For this purpose, the gateway is added to the scene in the Casambi software. By means of the 8 sliders a unique number (binary) can now be generated, which is returned accordingly with a call of the scene over this value.

```
casambi/[id]/get/scene_call
{
  "scene":2
}
```

5.6.2.1.2. Broadcast

Return values that are retrieved internally for the whole network

level = average value of the luminaires

last_level = last level something was called with

cct_level = color temperature value

vertical = direct/indirect proportion

last_change = time in s at which the last change was made

```
casambi/[id]/get/poll_broadcast
{
  "level": 0,
  "last_level": 255,
  "cct_level": 127,
  "vertical": 130,
  "last_change": 79712
}
```


5.6.2.1.3. Device

Notification when a fixture has been removed

device = address of the device that was removed

```
casambi/[id]/get/node_deleted
{
  "device":1
}
```



The following commands require Casambi Evolution 37.90 or higher.

Return settings retrieved for a device.

A description of the parameters can be found [here](#).

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_device/[device_address]/properties
{
  "online": 1,
  "node_type": 0,
  "priority": 18,
  "scene_type": 0,
  "color_selector": 0,
  "color_balance": 0,
  "condition": 0,
  "ambient_temperatur": 0,
  "battery_level": 0,
  "overheating": 0,
  "general_failure": 0,
  "last_change": 75136
}
```

Return values retrieved for a device.

A description of the parameters can be found [here](#).

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_device/[device_address]/values
{
  "scene": 27,
  "level": 255,
  "last_level": 0,
  "cct_level": 0,
  "red": 0,
  "green": 0,
  "blue": 0,
  "white": 0,
  "hue": 0,
  "sat": 0,
  "x": 0,
}
```

```
"y": 0,  
"level_xy": 0,  
"vertical": 127,  
"last_change": 76808  
}
```

Return dimmers that have been changed for a device

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_devicet/[device_address]/element_dimmer  
{  
  "dimmer_1": 255,  
  "dimmer_2": 0,  
  "dimmer_3": 0,  
  "dimmer_4": 0,  
  "last_change": 76868  
}
```

Return sliders that have been changed for a device

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_devicet/[device_address]/element_slider  
{  
  "slider_1": 0,  
  "slider_2": 0,  
  "slider_3": 0,  
  "slider_4": 0,  
  "slider_5": 0,  
  "slider_6": 0,  
  "slider_7": 0,  
  "slider_8": 0,  
  "last_change": 76928  
}
```

Return On/Off toggles that have been changed for a device

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_devicet/[device_address]/element_onoff  
{  
  "onoff_1": 0,  
  "onoff_2": 1,  
  "onoff_3": 1,  
  "onoff_4": 0,  
  "onoff_5": 0,  
  "onoff_6": 0,  
  "onoff_7": 0,  
  "onoff_8": 0,  
  "last_change": 76988  
}
```

Return buttons that have been changed for a device

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

```
casambi/[id]/get/poll_devicet/[device_address]/element_button
{
  "button_1": 0,
  "button_2": 0,
  "button_3": 0,
  "button_4": 0,
  "button_5": 0,
  "button_6": 0,
  "button_7": 0,
  "button_8": 0,
  "last_change": 77048
}
```

Return sensor values that have been changed for a device

last_change = time in s at which the last change was made

[device_address] = address of the device (1 - 250)

sens_pir = 0 (no presence), 1 (presence)

```
casambi/[id]/get/poll_devicet/[device_address]/sensors
{
  "sens_pir": 0,
  "sens_lux": 1218,
  "last_change": 77124
}
```

5.6.2.1.4. ungrouped

Return values that were retrieved internally for ungrouped.

A description of the parameters can be found [here](#).

last_change = time in s at which the last change was made

```
casambi/[id]/get/poll_ungrouped
{
  "level": 0,
  "last_level": 255,
  "cct_level": 127,
  "vertical": 130,
  "last_change": 79872
}
```

5.6.2.1.5. Groups

Return values that were retrieved internally for a group.

A description of the parameters can be found [here](#).

last_change = time in s at which the last change was made

[group] = group (1 - 255)

```
casambi/[id]/get/poll_group/[group]
{
  "level": 0,
  "last_level": 255,
  "cct_level": 127,
  "vertical": 127,
  "last_change": 79925
}
```

5.6.2.1.6. Scenes

Return values that were retrieved internally for a scene.

A description of the parameters can be found [here](#).

last_change = time in s at which the last change was made

[scene] = scene (1 - 255)

```
casambi/[id]/get/poll_scene/[scene]
{
  "active": 0,
  "level": 255,
  "last_change": 79925
}
```

5.6.2.2. Send MQTT data



As of Casambi Evolution firmware 34.50 up to 8 buttons are prepared.

Set the light sensor value that the gateway can supply

```
casambi/[id]/set/light_sensor
{
  "lux_level":10
}
```

Set the PIR status that the gateway can provide

1 = Sensor presence detected

0 = Sensor no presence

```
casambi/[id]/set/pir_sensor
{
  "pir_sensor":1
}
```

Set the push button status that the gateway can deliver.

Button can be 0-3 or 0-7 depending on the version. 0-7 requires _EVO firmware.

```
casambi/[id]/set/push_button_pressed
{
  "button":1
}
```

```
casambi/[id]/set/push_button_released
{
  "button":1
}
```

Broadcast Level Set

```
casambi/[id]/set/level
{
  "level":171,
  "duration":1
}
```

Call scene with level

```
casambi/[id]/set/scene_level
{
  "level":165,
  "scene":2,
  "duration":2
}
```

Call group with level

```
casambi/[id]/set/groups_level
{
  "group":2,
  "duration":2,
  "level":254
}
```

PushButton Call target with level

```
casambi/[id]/set/push_button_level
{
  "level":185,
  "button":1
}
```



The following commands require Casambi Evolution 33.22 or higher.

Set target to level

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_level
{
  "level":171,
  "duration":1,
  "targetid":1,
  "targettype":1
}
```

Set target to Tc

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_tc
{
  "tc":171,
  "duration":1,
  "targetid":1,
  "targettype":1
}
```



The following commands require Casambi Evolution 34.50 or higher.

Set target to RGBW

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_rgbw
{
  "red":171,
  "green":1,
  "blue":1,
  "white":255,
  "targetid":1,
}
```



```
"targettype":1,  
"level":255  
}
```

Set target to Hue/Sat

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_huesat  
{  
  "hue":65000,  
  "sat":254,  
  "white":255,  
  "targetid":1,  
  "targettype":1,  
  "level":255  
}
```



The following commands require Casambi Evolution 37.00 or higher.

Set target to vertical

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_vertical  
{  
  "vertical":127,  
  "duration":1,  
  "targetid":1,  
  "targettype":1  
}
```



The following commands require Casambi Evolution 37.80 or higher.

Target start_automation

A description of the parameters can be found [here](#).

```
casambi/[id]/set/execute_automation  
{  
  "targetid":1,  
  "targettype":1  
}
```



The following commands require Casambi Evolution 37.90 or higher.

Set Target Dimmer

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_dimmers
{
  "dimmer_index":0,
  "dimmer_value":1,
  "duration":1,
  "targetid":1,
  "targettype":1
}
```

Set Target Elements

A description of the parameters can be found [here](#).

```
casambi/[id]/set/target_elements
{
  "element_index":0,
  "element_value":1,
  "duration":1,
  "targetid":1,
  "targettype":1
}
```

5.6.3. Poling

In this operating mode, certain values are queried cyclically and the variables are automatically adjusted.

Polled cyclically:

- The level of the scenes and whether they are active. If not active then the level is 0
- The level of a group
- The level of the broadcast entry
- Whether the device is reachable (online) and what its state is.
- Red, Green, Blue, White, Hue, Sat of a device
- Red, Green, Blue, White, Hue, Sat of a group
- Red, Green, Blue, White, Hue, Sat of Broadcast
- Red, Green, Blue, White, Hue, Sat of ungrouped fixtures
- Sensor values PIR
- Sensor values LUX

5.7. Netcomposer

In this operating mode, the gateway sends defined Netcomposer commands to a Netcomposer system from Eutrac. It can also react to commands from this.

5.7.1. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway v1.25

Generell Settings	To Casambi	From Casambi	Console
Communication to Casambi Network			
Memory Slot			
<div style="border: 1px solid black; padding: 5px;">10 ▼ Load...</div>			
Trigger			
<div style="border: 1px solid black; padding: 5px;">Trigger Wizard</div>			
Action			
<div style="border: 1px solid black; padding: 5px;">Command none</div>			
Wizard			
Save			
Test			

© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.7.1.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

Memory Slot

0	▼	Load...
---	---	---------

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.7.1.2. Trigger

The command to which the gateway should react is entered in the text field.

Trigger

Trigger

Wizard

5.7.1.3. Action

Action

Command none

Wizard

With the button wizard, the dialog for setting the action is called. A new page will then open:

Action Builder

Command none

next step

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Descriptions of the commands in the wizard are available here: ["Protokoll/Casambi"](#)

Action Builder

Command none

step back Test

Apply

After setting the action-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.7.2. From Casambi

Here you can set what the gateway should send on the network as soon as e.g. Scene calls from the Casambi world are available.

Casambi Ethernet Gateway v1.10

Generell Settings	To Casambi	From Casambi	Console
Communication from Casambi Network			
Memory Slot			
<input type="text" value="0"/>		<input type="button" value="Load..."/>	
Trigger			
Bit_1	<input type="checkbox"/>	OFF	
Bit_2	<input type="checkbox"/>	OFF	
Bit_3	<input type="checkbox"/>	OFF	
Bit_4	<input type="checkbox"/>	OFF	
Bit_5	<input type="checkbox"/>	OFF	
Bit_6	<input type="checkbox"/>	OFF	
Bit_7	<input type="checkbox"/>	OFF	
Bit_8	<input type="checkbox"/>	OFF	
Action			
<input type="text"/>			<input type="button" value="Wizard"/>
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			


© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.7.2.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

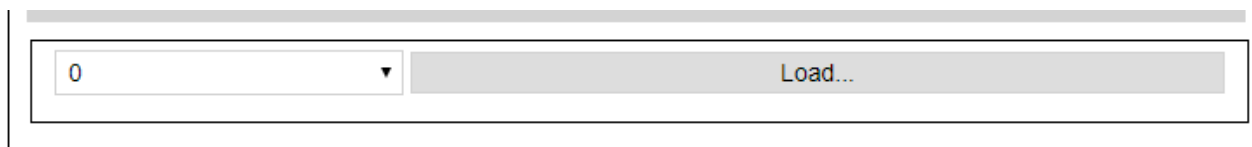


The image shows a horizontal control bar with a light gray background. On the left side, there is a white drop-down menu containing the number '0' and a small downward-pointing triangle. To the right of the drop-down menu is a gray button with the text 'Load...' in white.

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.


5.7.2.2. Trigger

The trigger specifies when an action should be triggered.

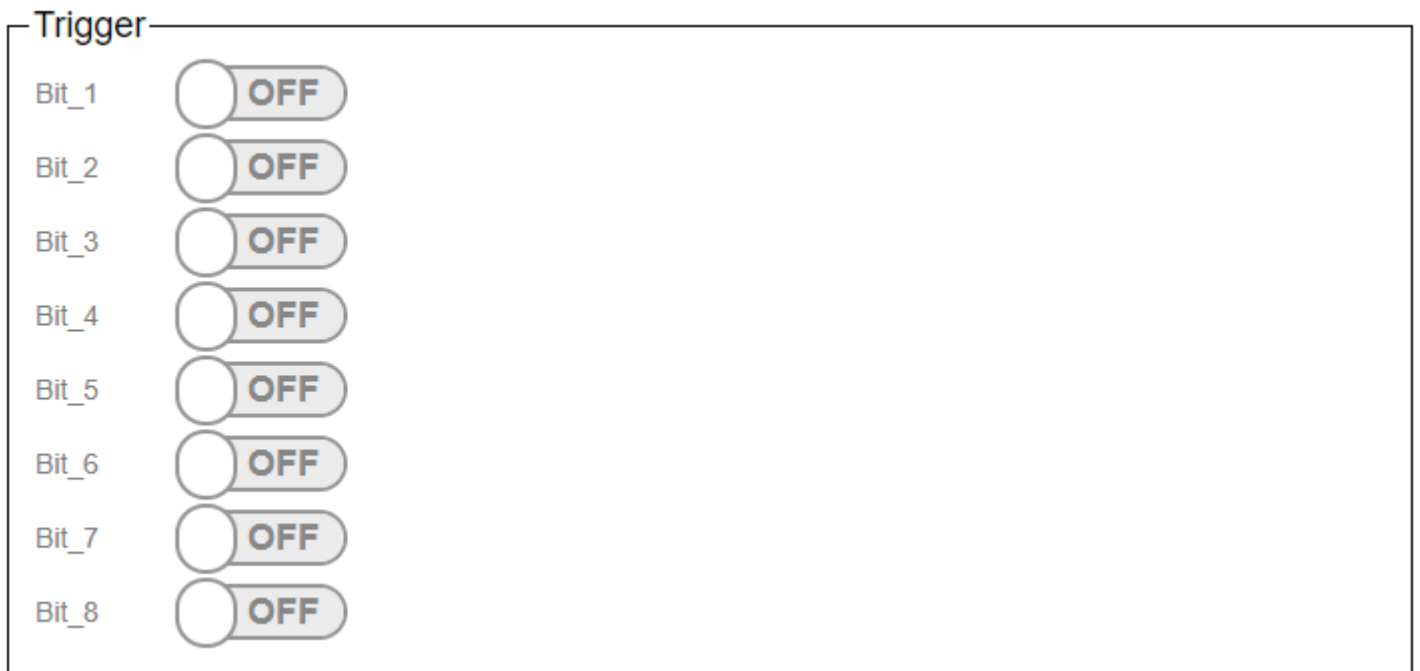

The triggers are used to set at which scene recall in the Casambi the command stored under "Action" is to be sent on the network.

In the Casambi system you can choose which bits are active in the trigger for a scene. (Picture below)

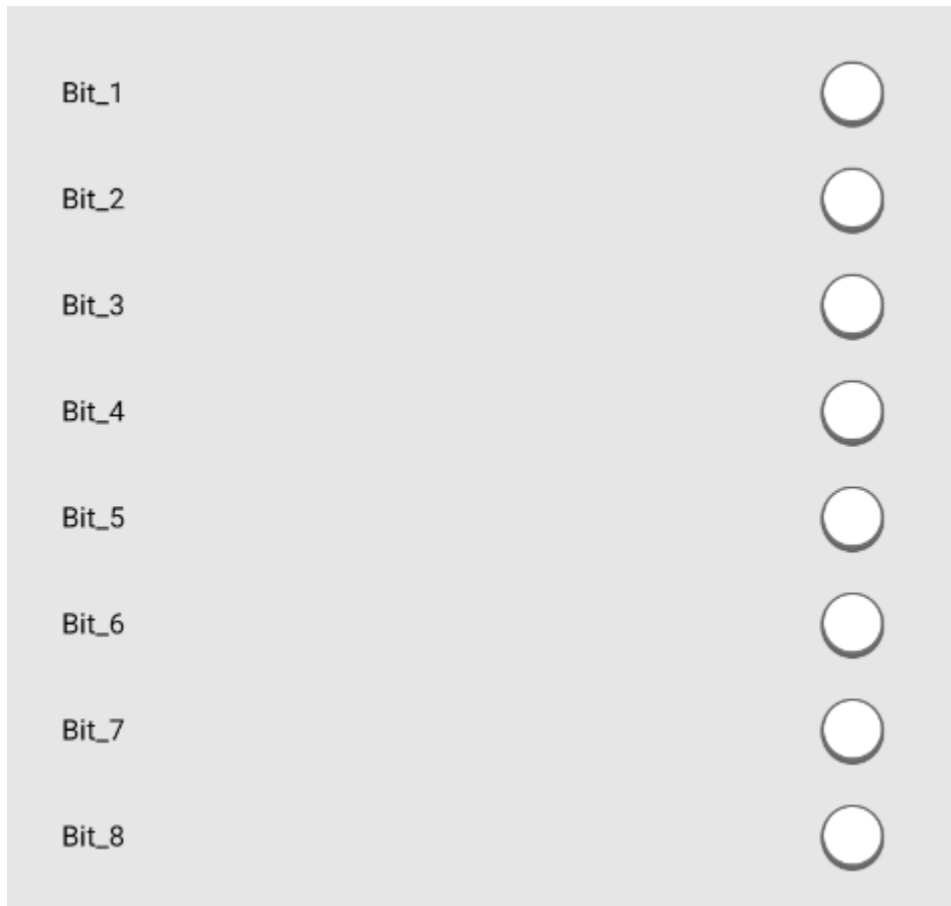

With the Submit button the entered is saved.

With the test button you can check whether the entered action is the right one.

5.7.2.3. Action

The command that the gateway should send is entered in the text field.

Action

5.7.3. Netcomposer Command Builder

Command Builder

NCR Address

Command

next step

The wizard supports you in creating the commands to which the Casambi system should react.

The "NCR Address" specifies which NCR address is to be responded to. 255 is "all".

With "Command" various commands are available which can be reacted to.

- [Device Level](#)
- [Scene](#)
- [Group with Scene](#)
- [Group with Level](#)
- [Sequence](#)

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Result

step back Test

Apply

After setting the command-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

After accepting with "Apply", the command is automatically saved in the corresponding slot.

5.7.3.1. Device Level

Command Builder

NCR Address	255
Command	Device Level
Device	<input type="text" value="0"/>
Level	<input type="range" value="0"/> <input type="text" value="0"/>
Fading	<input type="text" value="0"/>
Ignore Fading	<input type="checkbox"/> OFF

The device address of the destination is specified for Device.

The desired brightness is specified under Level.

In the case of fading, the corresponding fade time.

"Ignore Fading" lets you ignore the fade time in the call.

5.7.3.2. Scene

Command Builder

NCR Address	255
Command	Scene
Scene	<input type="text" value="0"/>
Fading	<input type="text" value="0"/>
Ignore Fading	<input type="checkbox"/> OFF

The desired scene is specified for Scene.

In the case of fading, the corresponding fade time.

"Ignore Fading" lets you ignore the fade time in the call.

5.7.3.3. Group with Scene

Command Builder

NCR Address	255
Command	Group with Scene
Group	<input type="text" value="0"/>
Scene	<input type="text" value="0"/>
Fading	<input type="text" value="0"/>
Ignore Fading	<input type="checkbox"/> OFF

For Group, the group number of the destination is specified.

The desired scene is specified for Scene.

In the case of fading, the corresponding fade time.

"Ignore Fading" lets you ignore the fade time in the call.

5.7.3.4. Group with Level

Command Builder

NCR Address	255
Command	Group with Level
Group	<input type="text" value="0"/>
Level	<input type="range" value="0"/> <input type="text" value="0"/>
Fading	<input type="text" value="0"/>
Ignore Fading	<input type="checkbox"/> OFF

The device address of the destination is specified for Device.

The desired brightness is specified under Level.

In the case of fading, the corresponding fade time.

"Ignore Fading" lets you ignore the fade time in the call.

5.7.3.5. Sequence

Command Builder

NCR Address	255
Command	Sequence
Sequence	<input type="text" value="0"/>
State	<input style="border-bottom: 1px solid black;" type="text" value="stoped"/>

"Sequence" is the sequence number.

"State" indicates whether the sequence is started or stopped.

5.8. UDP Casambi Command

In this operating mode, an external control, for example a visualization or a central control device, can connect to the gateway and carry out actions there or react to scene calls / status changes.

5.8.1. View in the gateway

Settings of the gateway via the internal website.

5.8.1.1. To Casambi

Communication to Casambi Network

Warning!

This settings are not used in "UDP Casambi Command" mode.

This page is not used in this mode.

5.8.1.2. From Casambi

Communication to Casambi Network

Warning!

This settings are not used in "UDP Casambi Command" mode.

This page is not used in this mode.

5.8.2. Control in the network

The structure of the telegrams is fixed. The transmission is byte by byte.

The first byte is the previously assigned "Net ID" in the General Setting dialog.

The second byte indicates whether it is a command from the Casambi system (0x70) or one to this (0x72).

Now comes the part of the command that is to be sent to the Casambi network.

A command is always terminated with /r (0x0D) and /n (0x0A).

Data transmission 1 "hex with dot":

If you want to send Commando 1.40 to the Casambi Bridge with Net ID 1, this would be:

1.72.1.28/r/n

So overall

0x_Net_ID.0x_Command_Direction.0x_Casambi_Data[1...X]/r/n

Data transfer 2 "dec with hash":

If you want to send Commando 1.40 to the Casambi Bridge with Net ID 1, this would be:

1#114#1#40/r/n

So overall

Net_ID#Command_Direction#0x_Casambi_Data[1...X]/r/n

Let's take a closer look at the Casambi_Data[1..X]:

Such a data package always consists of the same parts:

```
struct packet {
uint8_t length; //length (opcode + arguments)
uint8_t opcode;
uint8_t arguments[length-1];
}
```

The lengths given for the commands in the manual are the maximum length. The length can change if e.g. optional components such as the fade time should not be specified.

It can also change if the operating mode "dec with hash" is used and commands larger than one byte are combined.

Color temperature or lux values for the brightness sensor could be mentioned here as examples.

Packets with a length of 0 are ignored by the Casambi system.

The length is currently limited to a maximum of 17 bytes and cannot be increased. However, Casambi reserves the right to extend the maximum length in the future.

Packets with an unknown opcode specified should simply be ignored.

A list of the opcodes is given in [5.8.2.1](#) and [5.8.2.2](#).

If "Send Ack" has been activated, then a confirmation is sent on the network that the command has been sent. For this the arrived command is sent back with the addition "Ack".

Data transmission 1 "hex with dot": 0x_Net_ID.0x70.0x_Casambi_Data[1...X].ACK/r/n

Data transmission 2 "dec with hash": Net_ID#112#0x_Casambi_Data[1...X]#ACK/r/n

To make a request to all gateways, the ID 255 / 0xFF can be used.

5.8.2.1. Commands from the Casambi system

If a packet comes from the Casambi system, the part `0x_Command_Direction` is 0x70 or 112.

We only consider the part `Casambi_Data [1 ... X]` from the general data frame from 5.1

5.8.2.1.1. 0x0D - scene called

The gateway must be added to the corresponding scene. Via the slide switches Bit_1 to Bit_8 up to 255 different scenes can be encoded.

Each time the scene is called up, the corresponding command is sent to the network.

Length: 9

Opcode: 0x0D or 13

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Bit_1.0x_Bit_2.0x_Bit_3.0x_Bit_4.0x_Bit_5.0x_Bit_6.0x_Bit_7.0x_Bit_8

Example: 0.70.9.d.ff.0.0.0.0.0d/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Bit_1#Bit_2#Bit_3#Bit_4#Bit_5#Bit_6#Bit_7#Bit_8

Example: 000#112#009#013#255#000#000#000#000#000#000#000d/r/n

5.8.2.1.2. 0x1A - SetParameterValue

Transfer of a parameter from the Casambi system. Response to [GetParameterValue](#).

Length: 0x03

Opcode: 0x1B or 26

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Paramter_Number.0x_Paramter_Value

Data transmission 2 "dec with hash":

Casambi_Data[1...X]: Paramter_Number#Paramter_Value

5.8.2.1.3. 0x1B - ParametersComplete

Indication that the parameter transfer is completely finished. Response to [GetParameterValue](#).

Length: 0x01

Opcode: 0x1B or 27

No further data.

5.8.2.1.4. 0x28 - time received from the Casambi network

Response of the Casambi system to the request to send the current time.

Length: 8

Opcode: 0x28 or 40

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_year_high.0x_year_low.0x_month.0x_day.0x_hour.0x_minute.0x_second

Example: 0.70.8.28.7.e4.3.5.e.13.1d/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: year_high#year_low#month#day#hour#minute#second

Example: 000#112#008#040#007#228#003#005#014#019#029/r/n

5.8.2.1.5. 0x39 - node status

Details about the current status of a node are transmitted. Responses may come in a burst.

Length: 6

Opcode: 0x39 or 57

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Unit_ID.0x_Scene.0x_Priority_Node_Type.0x_Condition.0x_Online

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Unit_ID#Scene#Priority_Node_Type#Condition#Online

0x_Scene

the currently active scene ID

0x_Priority_Node_Type => Priority

(0..15, the 6 low-order bits)

1 = emergency

2 = BMS override

3 = manual control

4..14 = Automation priorities

4 [Classic FW] = any automation

8 = Presence

11 = Date timer

12 = clock timer (daily / weekly)

15 = startup

0x_Priority_Node_Type => Node Type

(0..3, the 2 most significant bits)

0 and 1 = Active nodes (lights, sensors, push buttons)

2 = switch (passive)

3 = sensor (passive)

0x_Condition

0x00, 0x80, 0xA0: ok

0x01: "overheated"

0x09: "overload" (current limit)

0x81: "thermal_overload"

0x82: "lamp_failure"

0x83: "driver_failure"

0x85: "incompatible_hw"

0x86: "hw_not_found"

0x87: "configuration_failed"

0x_Online

monitored online status

5.8.2.1.6. 0x3A - notify node removed

Notification that a device has been removed from the network. This response can also come when a status of a Nodes was queried that does not exist.

Length: 0x2

Opcode: 0x3A or 58

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Unit_ID

Example: 2.3a.1/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Unit_ID

Example: 002#058#001/r/n

5.8.2.1.7. 0x45 - scene status

Details about the current status of a scene are transmitted.

Length: 4

Opcode: 0x45 or 69

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Scene.0x_Active.0x_Level

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Scene#Active#Level

0x_Scene

the currently active scene ID

0x_Active

(bit 0 all other bits are ignored)

0 = scene inactive

1 = scene active

0x_Level

The last known level of the scene.

5.8.2.1.8. 0x46 - target status



VerticalRatio was added from Evolution firmware greater than 36.70.

Details about the current status of a target are transmitted.

Length: 0x6

Opcode: 0x46 or 70

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Target_ID.0x_level.0x_last_level.0x_cct_level.0x_Target_Type

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Target_ID#level#last_level#cct_level#Target_Type

0x_Level

average level of the lights in the group.

0x_last_Level

The last "one" level of lights.

0x_cct_Level

The last "Tc" level of the lights.

5.8.2.1.9. 0x49 - Target Color



Only works with Evolution firmware greater than 36.70.

Details about the current color of a target are transmitted.

Length: 0x15 or as requested in the query.

Opcode: 0x49 or 73

Data transmission 1 "hex with dot":

Casambi_Data[1...X]:

0x_Target_Type.0x_Target_ID.0x_level.0x_R.0x_G.0x_B.0x_W.

0x_Hue_h.0x_Hue_l.0x_Sat.0x_X_h.0x_X_l.0x_Y_h.0x_Y_l.0x_level_xy

Data transmission 2 "dec with hash":

Casambi_Data[1...X]: Target_Type#Target_ID#level#R#G#B#W#Hue#Sat#X#Y#level_xy

5.8.2.1.10. 0x4B - NotifyControlValues Responses



Attention only works with Evolution firmware greater than 37.90

Länge: variable

Opcode: 0x4B or 75

Response messages contain Unit ID and list of controls values as (Type, Value), where value can be 1 byte for Presence, 2 bytes (u16 value, little-endian) for Lux (Daylight) sensor, etc. (see the Control types IDs table).

Size of Value is type-dependent if not specified explicitly with (ID, TAG, LEN) header. “Long” variable-size form of value report is indicated with the 0x80 bit in TYPE ID; e.g. LEN=0 can be used for 0 value or 1 byte for [0..255]

Client must be able to consume at least 64 bytes of single message if requesting data updates and ignore any unsupported contents within notifications.

Longer sets of updates can be split into parts, multiple messages for the same target ID.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]:

0x_Target_ID.0x_type_A.0x_Value_A[1..4]

...

.0x_type_B.0x_Value_B[1..4]

...

.0x_type_C.0x_element_C.0x_length_C.0x_Value_C[1..4]

Data transmission 2 "dec with hash":

Casambi_Data[1...X]:

Target_ID#TYP_A#Value_A[1..4]

...

#Type_B#Value_B[1..4]

...

#Type_C#Element_C#Length_C#Value_C[1..4]

Typen:

Type	Size bytes / Layout	Description
1 / 129	1	Dimmer channel; single channels are reported in the short form (TYPE=0x01:VALUE), and indexed controls are reported the the long form with explicit length, see also “Slider” type (15) TYPE=0x81 : {0..7} : LEN={0..2} : VALUE — length 0/1/2 must be supported
2	1	Color Temperature
3	3[2:1]	Color Hue/Sat as 16-bits (Hue) and 8-bit (Saturation) levels
4	4[2:2]	XY colour: pair of (X:Y) 16-bit values representing [0.; 1.0] range
5	1	Color Source Selector - for fixtures with a mix of TW / Color fields sets TW vs. Color option TW=0, RGB=1, XY=2. In some fixture modes the fields are not mutually exclusive (no effect)

6	1	Device Temperature [C°], low-resolution value [1..255] of measured reading (0 ~ undefined)
7	1	Battery level [1..100%]; 0 ~ undefined
8	1	Overheating indicator [bool]
9	1	General failure indicator
10	1	“Vertical” control; depending on fixture type it can be either mixer of dimmers, or TW and colours, or direct/indirect light parts of the device.
11	1	“White” channel control: typically additional output for RGB colours or extra/secondary/ exclusive dimmer level in other modes.
12	-	not used / reserved
13	-	not used / reserved
14 / 142	1-4	Sensor field: generic sensor field (requires INDEX detail for interpretation)
15 / 143	2	Slider (custom element); indexed dimmers are reported in the long form (3/4/5 bytes) TYPE=0x8F: INDEX={0..7} : LEN={0..2} : VALUE[length] Note that 0 and 1 length is possible in the long form: for 00 (empty) or 1-byte (00..FF) values
16 / 144	1	On/Off toggle (custom element)
17 / 145	1	Button (custom element)
18 / 146	1	PushButton (custom element)
19	1	White / Color Balance
20	2	Light sensor value in lux units (or whatever the sensor can report)
21	1	Presence sensor state: values 0 / 1 / 2 correspond to Inactive / Active / Hold(linger)-time states

5.8.2.2. Commands to the Casambi system

If a packet comes from the Casambi system, the part `0x_Command_Direction` is 0x72 or 114.

We only consider the part `Casambi_Data [1 ... X]` from the general data frame.

5.8.2.2.1. 0x10 - Push Button Pressed

Set the state of a Button[0..3] to pressed.

Length: 2

Opcode: 0x10 or 16

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Button_Number

Example: 0.72.2.10.0/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Button_Number

Example: 0#114#2#16#0/r/n

5.8.2.2.2. 0x11 - Push Button Released

Set the state of a Button[0..3] to released.

Length: 2

Opcode: 0x11 or 17

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Button_Number

Example: 0.72.2.11.0/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Button_Number

Example: 0#114#2#17#0/r/n

5.8.2.2.3. 0x1D - GetParameterValue

Read out scenes + group parameters currently stored in the Casambi app for the gateway.

Length: 0x01

Opcode: 0x1D or 29

Is called without further parameters.

The [individual parameters](#) and a [parameter complete](#) package are then sent in response.

5.8.2.2.4. 0x1E - Set the level of a scene

Set all Casambi lights in a scene to a value.

Length: 5

Opcode: 0x1E or 30

Fadetime = Value* 10ms

Data transmission 1 "hex with dot":

The fade time value is optional and does not need to be sent. However, the length must then be reduced accordingly to 3.

Casambi_Data[1...X]: 0x_Scene.0x_Level.0x_Duration_low.0x_Duration_high

Example: 0.72.5.1e.1.ff.10.0/r/n

Data transfer 2 "dec with hash":

In this variant, the fade time is transmitted as a value. Therefore, the length here is reduced to 4. Here, too, the fade time is optional and can be omitted entirely. However, it can also be transmitted as 2 values (high/low byte). Then the length would also be 5.

Casambi_Data[1...X]: Scene#Level#Duration

Example: 0#114#4#30#1#255#1000/r/n

5.8.2.2.5. 0x1F - Set level of a group

Set all Casambi lights in a group to a value.

Length: 5

Opcode: 0x1F or 31

Fadetime = Value* 10ms

Data transmission 1 "hex with dot":

The fade time value is optional and does not need to be sent. However, the length must then be reduced accordingly to 3.

Casambi_Data[1...X]: 0x_Group.0x_Level.0x_Duration_high.0x_Duration_low

Example: 0.72.5.1f.1.ff.10.0/r/n

Data transfer 2 "dec with hash":

In this variant, the fade time is transmitted as a value. Therefore, the length here is reduced to 4.

Here, too, the fade time is optional and can be omitted entirely.

However, it can also be transmitted as 2 values (high/low byte). Then the length would also be 5.

Casambi_Data[1...X]: Group#Level#Duration_low#Duration_high

Example: 0#114#4#31#1#255#1000/r/n

5.8.2.2.6. 0x20 - Set the level of a target

Set all Casambi lights in a network to one value.

Length: 6

Opcode: 0x20 or 32

Fadetime = Value* 10ms

Data transmission 1 "hex with dot":

The fade time value is optional and does not need to be sent. However, the length must then be reduced accordingly to 4.

Casambi_Data[1...X]: 0x_Level.0x_Duration_low.0x_Duration_high.0x_Target_Type.0x_Target_ID

Example: 0.72.6.20.ff.10.0.0.0/r/n

Data transfer 2 "dec with hash":

In this variant, the fade time is transmitted as a value. Therefore, the length here is reduced to 5. Here, too, the fade time is optional and can be omitted entirely. However, it can also be transmitted as 2 values (high/low byte). Then the length would also be 6.

Casambi_Data[1...X]: Level#Duration#Target_Type#Target_ID

Example: 0#114#6#32#255#1000#0#0/r/n

Target_Type and Target_ID:

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group
3	1-255	scene (only currently active lights)
4	1-255	Scenes (all lights)
5	0-255	all lights with the same manufacturer ID

5.8.2.2.7. 0x21 - Set the level of a button's target

Set the target of a Button[0..3] to an absolute level.

Length: 3

Opcode: 0x21or 33

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Button_Number.0x_Level

Example: 0.72.3.21.0.ff/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Button_Number#Level

Example: 0#114#3#33#0#255/r/n

5.8.2.2.8. 0x28 - Request time from the Casambi network

Requests the Casambi network to send its current time.

Length: 1

Opcode: 0x28 or 50

Data transmission 1 "hex with dot":

Example: 0.72.1.28/r/n

Data transfer 2 "dec with hash":

Example: 0#114#1#50/r/n

Answer:

[0x28 - time received from the Casambi network](#)

5.8.2.2.9. 0x28 - Set time in the Casambi network

Sets the time in the Casambi network to the specified values.

Length: 8

Opcode: 0x28 or 50

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_year_high.0x_year_low.0x_month.0x_day.0x_hour.0x_minute.0x_second

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: year_high#year_low#month#day#hour#minute#second

5.8.2.2.10. 0x2B - Set presence sensor

Sets the device's presence sensor to 0 = no presence or 1 = presence.

Length: 2

Opcode: 0x2B or 43

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_sensor_state

Example: 0.72.2.2B.0/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: sensor_state

Example: 0#114#2#43#0/r/n

5.8.2.2.11. 0x2C - Set light sensor

Sets the device's light sensor to a value.

Length: 3

Opcode: 0x2C or 44

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Sensor_Value_low.0x_Sensor_Value_high

```
Example: 0.72.3.2C.ff.0/r/n
```

Data transfer 2 "dec with hash":

Casambi_Data: Sensor_Value

```
Example: 0#114#3#44#2000/r/n
```

5.8.2.2.12. 0x2F - Set color via RGBW

Set the color of different targets.

Length: 7

Opcode: 0x2F or 47

The values for R,G,B go from 0-254 respectively.

The value for W goes from 0-254, 255 means ignore.

The value for Level goes from 0-254, 255 means ignore.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_R.0x_G.0x_B.0x_W.0x_Target_Type.0x_Target_ID.0x_Level

Example: 0.72.7.2f.ff.0.0.ff.1.1.ff/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: R#G#B#W#Target_Type#Target_ID#Level

Beispiel: 0#114#7#47#255#0#0#255#1#1#255/r/n

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.13. 0x31 - SetTargetVerticalRatio

Set the vertical ratio of a target.

Length: 6

Opcode: 0x31 or 49

Fade time = value * 10ms

Data transmission 1 "hex with dot":

The value for the fadetime is optional and does not have to be sent. However, the length must then also be reduced to 4 accordingly.

Casambi_Data[1...X]: 0x_Ratio.0x_Duration_low.0x_Duration_high.0x_TargetType.0x_TargetID

Data transmission 2 "dec with hash":

In this variant the fade time is transmitted as one value. Therefore the length here is reduced to 5. The fade time is also optional here, however, and can be omitted completely. However, it can also be transmitted as 2 values (high/lowbyte). Then the length would also be 6.

Casambi_Data[1...X]: Ratio#Duration#TargetType#TargetID

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.14. 0x38 - SetColor X/Y

Set the color of different targets.

Length: 8

Opcode: 0x38 or 56

The value for X goes from 0-65,535.

The value for Y goes from 0-65.535.

The value for Level goes from 0-254, 255 means ignore.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_X_h.0x_X_l.0x_Y_h.0x_Y_l.0x_Target_Type.0x_Target_ID.0x_Level

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: X#Y#Target_Type#Target_ID#Level

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.15. 0x39 - Node state

Queries the state of a node. Attention only works with Evolution firmware.

The request can be:

0x00: Disable automatic state change notification

0x01 - 0xFB: Query a unit using its ID

0xFE: activate automatic notification when all nodes change status

0xFF: automatic notification when the status of your own node changes

Do not send the query command too quickly and always send a single unit, otherwise the system may be overloaded.

If there is no device on the queried ID, a 0x3A is returned. In this way, even without knowing the device IDs
Check which devices are available.

Length: 2

Opcode: 0x39 or 57

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Request

Example: 0.72.2.39.1/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: 0x_Request

Example: 0#114#2#57#1/r/n

Answer:

[0x39 - Node Status](#)

[0x3A - Notify Node removed](#)

5.8.2.2.16. 0x3D - Set Color via Hue / Sat

Set the color of different targets.

Length: 7

Opcode: 0x3D or 61

The value for Hue goes from 0-65,535.

The value for Sat goes from 0-255.

The value for W goes from 0-254, 255 means ignore.

The value for Level goes from 0-254, 255 means ignore.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Hue_h.0x_Hue_l.0x_Sat.0x_W.0x_Target_Type.0x_Target_ID.0x_Level

Example: 0.72.7.3D.ff.fe.ff.1.1.ff/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Hue#Sat#W#Target_Type#Target_ID#Level

Beispiel: 0#114#7#61#65000#254#255#1#1#255/r/n

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.17. 0x3E - SetTargetDimmers

Set dimmer of a target. There is a maximum of 4 dimmers per device (0-3).

Length: varies according to the number of dimmers - minimum 7

Opcode: 0x3E or 62

Fade time = value * 10ms

Fade time = 0 => Default value from the app is used

Index and value can be specified for one dimmer, but also several can be transferred at once.

To do this, the first pair of values is followed by the next. Maximum 4 dimmers per device.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_TargetType.0x_TargetID.0x_Duration_low.0x_Duration_high.
[0x_Index(0-3).0x_Value(0-3)]

Data transfer 2 "dec with hash":

In this variant the fade time is transmitted as one value. The length is then reduced by 1.

However, it can also be transmitted as 2 values (high/lowbyte). Then the length would be as above with "hex with dot".

Casambi_Data[1...X]: TargetType#TargetID#Duration#[Index(0-3)#0x_Value(0-3)]

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.18. 0x3F - SetTargetElements

Set custom elements of a target. There is a maximum of 8 elements per device (0-7).

Length: varies according to the number of elements - minimum 7.

Opcode: 0x3E or 62

Fade time = value * 10ms

Fade time = 0 => Default value from the app is used

Index and value can be specified for one dimmer, but also several can be transferred at once.

To do this, the first pair of values is followed by the next. Maximum 4 dimmers per device.

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_TargetType.0x_TargetID.0x_Duration_low.0x_Duration_high.
[0x_Index(0-3).0x_Value(0-3)]

Data transfer 2 "dec with hash":

In this variant the fade time is transmitted as one value. The length is then reduced by 1.

However, it can also be transmitted as 2 values (high/lowbyte). Then the length would be as above with "hex with dot".

Casambi_Data[1...X]: TargetType#TargetID#Duration#[Index(0-3)#0x_Value(0-3)]

Target_Type und Target_ID:

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.8.2.2.19. 0x45 - Scene state

Queries the state of a scene. Attention only works with Evolution firmware higher than 33.22.

Length: 2

Opcode: 0x45 or 69

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Scene_ID

Example: 0.72.2.45.1/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Scene_ID

Example: 0#114#2#69#1/r/n

Answer:

[0x45 - Scene Status](#)

5.8.2.2.20. 0x46 - Target Status

Queries the status of a target. Attention only works with Evolution firmware higher than 34.50.

Length: 3

Opcode: 0x46 or 70

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Target_ID.0x_Target_Type

Example: 0.72.2.46.1.0/r/n

Data transfer 2 "dec with hash":

Casambi_Data[1...X]: Target_ID#Target_Type

Example: 0#114#2#70#1#0/r/n

Answer:

[0x46 - Target Status](#)

5.8.2.2.21. 0x48 - Set color temperature

Set the color temperature of different targets.

Length: 7

Opcode: 0x48 or 72

Data transmission 1 "hex with dot":

The value for the fade time is not optional and must be sent.

Casambi_Data[1...X]: 0x_Tc_high.0x_Tc_low.0x_Duration_low.0x_Duration_high.0x_Target_Type.0x_Target_ID

```
Example: 0.72.7.48.0.ff.0.10.0.0/r/n
```

Data transfer 2 "dec with hash":

In this variant, the fade time is transmitted as a value. Therefore the length here is reduced to 5. The fade time value is not optional and must be sent.

Casambi_Data[1...X]: Tc#Duration#Target_Type#Target_ID

```
Example: 0#114#7#72#16000#1000#0#0/r/n
```

Target_Type and Target_ID:

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group
3	1-255	scene (only currently active lights)
4	1-255	Scenes (all lights)
5	0-255	all lights with the same manufacturer ID

Colourtemperatur (Tc):

Tc	comment
0x400 - 0x4000	Value in Kelvin (1000K - 16000K)
0x00-0xFF	normalized value for min Tc and max Tc, respectively
0x00	warmest possible value

5.8.2.2.22. 0x49 - Target Color



Only works with Evolution firmware greater than 36.70.

Queries the color of a target.

Length: 4

Opcode: 0x49 or 73

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Target_Type.0x_Target_ID.0x_ResponseSize

Example: 0.72.4.49.0.15/r/n

Data transmission 2 "dec with hash":

Casambi_Data[1...X]: Scene_ID

Example: 0#114#2#69#1/r/n

Target_Type and Target_ID:

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group

Response Size:

Number of bytes to be returned in the response. For all data this is 15.

Response:

[0x49 - Target Color](#)

5.8.2.2.23. 0x4A - Resume Automation



Attention only works with Evolution firmware greater than 37.80

Resume automatic sequence.

Length: 0x3

Opcode: 0x4A or 74

Data transmission 1 "hex with dot":

Casambi_Data[1...X]: 0x_Target_Type.0x_Target_ID

Example: 3.4A.1.1/r/n

Data transmission 2 "dec with hash":

Casambi_Data[1...X]: Target_Type#Target_ID

Example: 003#074#001#001/r/n

Target_Type and Target_ID:

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group

5.8.2.2.24. 0x4B - NotifyControlValues



Attention only works with Evolution firmware greater than 37.80

Details of the current control values can be retrieved or subscribed.

Length: 4 or 8 for SetDefaultMask.

Opcode: 0x4B or 75

Basically SetDefaultMask should be set first.

Then either values are requested automatically via Subscribe or read via Read.

Data transmission 1 "hex with dot":

Casambi_Data[1...X] - SetDefaultMask:

3.0.0.FF.FF.FF.FF

Casambi_Data[1...X] - Unsubscribe, Subscribe:

0x_Request.0x_Target_ID_min.0x_Target_ID_max

Data transmission 2 "dec with hash":

Casambi_Data[1...X] - SetDefaultMask:

3#0#0#255#255#255#255

Casambi_Data[1...X] - Unsubscribe, Subscribe, Read:

Request#Target_ID_min#Target_ID_max

Request

0 = Unsubscribe

1 = Subscrib

2 = Read

3 = SetDefaultMask

Target_ID

0 = All devices

1-250 = Devices

Response:

Targeted queries (ID > 0) always have response, which may be empty, having no data, just the Target ID, if there is no such unit or it has no matching data to provide.

[0x4B - Notify Control Response](#)

5.8.2.3. Demo programs

At the following URL we offer 2 test programs (including source code) that show how you can talk to the gateway in the operating mode "UDP Casambi Command" using UDP.

https://github.com/KLKG/Casambi_Gateway_API_Test

There is a program (UDP_Test) that cyclically queries all Casambi participants in a command line. Source code in C ++.

The other program (UDP_WPF) is a C # application with a graphical user interface. Other commands can also be sent here than just the cyclical query.

Both are demonstration programs and only show what is possible.

5.9. TCP Casambi Command

In this operating mode, an external control, for example a visualization or a central control device, can connect to the gateway and carry out actions there or react to scene calls / status changes.

5.9.1. View in the gateway

Settings of the gateway via the internal website.

5.9.1.1. To Casambi

Communication to Casambi Network

Warning!

This settings are not used in "TCP Casambi Command" mode.

This page is not used in this mode.

5.9.1.2. From Casambi

Communication to Casambi Network

Warning!

This settings are not used in "TCP Casambi Command" mode.

This page is not used in this mode.

5.9.2. Control in the network

The structure of the telegrams is the same as in the "UDP Casambi Command" mode.

The description is in [chapter 5.8.2](#).

5.10. UDP Casambi Bridge

In this operating mode, several gateways can exchange information and actions directly with one another.

5.10.1. Bridge Mode Command Builder

Command Builder

NCR Address	<input type="text" value="15"/>
Slot-ID	<input type="text" value="10"/>

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Result

<input type="text" value="f.a"/>	
<input type="button" value="step back"/>	<input type="button" value="Test"/>
<input type="button" value="Apply"/>	

After setting the command-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.10.2. To Casambi

Here you can set which actions the device should carry out in the Casambi system when a command comes to the gateway via the network.

Casambi Ethernet Gateway - 2.00.beta Debug - REV1

Generell SettingsTo CasambiFrom CasambiConsole

Communication to Casambi Network

Memory Slot

▼

Load...

Trigger

"Trigger" is not used in "UDP Casambi Bridge" Mode. The Memory Slot is called with the "From Casambi Command" of an other Bridge.

Action

Command	none
<div style="border: 1px solid #ccc; padding: 5px; background-color: #eee; width: 100%;">Wizard</div>	

Save

Test

© [Lichtmanufaktur Berlin GmbH](#) 2021

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.10.2.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

Memory Slot

0	▼	Load...
---	---	---------

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.10.2.2. Action

Action

Command none

Wizard

With the button wizard, the dialog for setting the action is called. A new page will then open:

Action Builder

Command none

next step

The "next step" button switches to the next step in the wizard. The button "step Back" allows you to take a step back.

Descriptions of the commands in the wizard are available here: ["Protokoll/Casambi"](#)

Action Builder

Command none

step back Test

Apply

After setting the action-specific settings, the generated command is displayed. You can try it out with a test and apply it with Apply.

5.10.3. From Casambi

Here you can set what the gateway should send on the network as soon as e.g. Scene calls from the Casambi world are available.

Casambi Ethernet Gateway v1.10

Generell Settings	To Casambi	From Casambi	Console
Communication from Casambi Network			
Memory Slot			
<input type="text" value="0"/>		<input type="button" value="Load..."/>	
Trigger			
Bit_1	<input type="checkbox"/>	OFF	
Bit_2	<input type="checkbox"/>	OFF	
Bit_3	<input type="checkbox"/>	OFF	
Bit_4	<input type="checkbox"/>	OFF	
Bit_5	<input type="checkbox"/>	OFF	
Bit_6	<input type="checkbox"/>	OFF	
Bit_7	<input type="checkbox"/>	OFF	
Bit_8	<input type="checkbox"/>	OFF	
Action			
<input type="text"/>			<input type="button" value="Wizard"/>
<input type="button" value="Save"/>			
<input type="button" value="Test"/>			


© Lichtmanufaktur Berlin GmbH 2020

The "Save" button saves the entry in the selected slot.

The "Test" button carries out the action in order to be able to check whether the correct action has been selected.

5.10.3.1. Select storage location

As a first step, a memory location must be selected on which the action is to be saved:

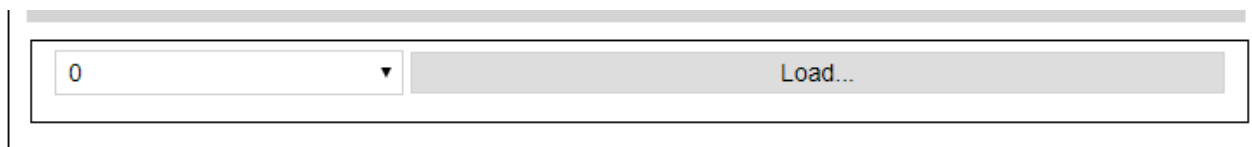

The image shows a horizontal control bar with a light gray background. On the left side, there is a white rectangular area containing a drop-down menu. The menu is currently open, showing the number '0' and a small downward-pointing triangle icon. To the right of the drop-down menu is a gray rectangular button with the text 'Load...' in white. The entire control bar is enclosed in a thin black border.

The storage location can be selected using the drop-down list and the content can be displayed on the website with the "Load ..." button.

5.10.3.2. Trigger

The trigger specifies when an action should be triggered.

Trigger

Bit_1	<input type="checkbox"/>	OFF
Bit_2	<input type="checkbox"/>	OFF
Bit_3	<input type="checkbox"/>	OFF
Bit_4	<input type="checkbox"/>	OFF
Bit_5	<input type="checkbox"/>	OFF
Bit_6	<input type="checkbox"/>	OFF
Bit_7	<input type="checkbox"/>	OFF
Bit_8	<input type="checkbox"/>	OFF

The triggers are used to set at which scene recall in the Casambi the command stored under "Action" is to be sent on the network.

In the Casambi system you can choose which bits are active in the trigger for a scene. (Picture below)

Bit_1	<input type="checkbox"/>
Bit_2	<input type="checkbox"/>
Bit_3	<input type="checkbox"/>
Bit_4	<input type="checkbox"/>
Bit_5	<input type="checkbox"/>
Bit_6	<input type="checkbox"/>
Bit_7	<input type="checkbox"/>
Bit_8	<input type="checkbox"/>

With the Submit button the entered is saved.

With the test button you can check whether the entered action is the right one.

5.10.3.3. Action

The command that the gateway should send is entered in the text field.

Action

5.11. Casambi

Description of the commands possible via the Casambi Wizard.

5.11.1. Ping



Sends a "ping" signal to the Casambi system.

In the Art-Net operating mode, the command is triggered. If the DMX level is above 128, the command is triggered.

5.11.2. Set Level

Action Builder

Command: SetLevel

Level: 0

Duration:

Target Type: ▼

Target Address:

Sets the device that is defined via the target type and the target address to the set value.

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group
3	1-255	scene (only currently active lights)
4	1-255	Scenes (all lights)
5	0-255	all lights with the same manufacturer ID

In the case of a connection via HelvarNet or to a Netcomposer system, the window looks like this:

Action Builder

Command: SetLevel

Level: 0

Level from Network: OFF

Duration:

Target Type: ▼

Target Address:

Here, "Level from Network" can be used to switch on the level signal that it receives from the other system. To do this, of course, a command with a level must also be set as a trigger.

If Dimm Group or Dimm Device is selected in HelvarNet, then dimming is automatically applied to the Mode SetLevel, SetSceneLevel, SetGroupLevel, SetRGBW and SetHue/Sat to the level.

5.11.3. Push Button Pressed



From Casambi Evolution firmware 34.50 up to 8 buttons are prepared.

Action Builder

Command PushButtonPressed

Button

Transmits the status "button pressed" to the Casambi system, which then carries out the corresponding stored action.

5.11.4. Push Button Released



From Casambi Evolution firmware 34.50 up to 8 buttons are prepared.

Action Builder

Command PushButtonReleased

Button

Transmits the status "Button released" to the Casambi system, which then carries out the corresponding stored action.

5.11.5. Set Presence

Action Builder

Command SetPrecense

Presence ▼

Transmits to the Casambi system whether a movement has been detected or not.

5.11.6. Set Scene Level

Action Builder

Command SetSceneLevel

Scene

Level

Duration

Calls up a scene in the Casambi system.

A scene number must be entered for the scene. The level indicates at which dimming level the scene should be called up. Duration determines the fade time.

In the case of a connection via HelvarNet or to a Netcomposer system, the window looks like this:

Action Builder

Command SetSceneLevel

Scene

Level

Level from Network OFF

Duration

Here, "Level from Network" can be used to switch on the level signal that it receives from the other system. To do this, of course, a command with a level must also be set as a trigger.

If Dimm Group or Dimm Device is selected in HelvarNet, then dimming is automatically applied to the Mode SetLevel, SetSceneLevel, SetGroupLevel, SetRGBW and SetHue/Sat to the level.

5.11.7. Set Group Level

Action Builder

Command SetGroupLevel

Group

Level 0

Duration

With this action a group can be set to a certain level. Duration defines the fade time again.

In the case of a connection via HelvarNet or to a Netcomposer system, the window looks like this:

Action Builder

Command SetGroupLevel

Group

Level 0

Level from Network OFF

Duration

Here, "Level from Network" can be used to switch on the level signal that it receives from the other system. To do this, of course, a command with a level must also be set as a trigger.

If Dimm Group or Dimm Device is selected in HelvarNet, then dimming is automatically applied to the Mode SetLevel, SetSceneLevel, SetGroupLevel, SetRGBW and SetHue/Sat to the level.

5.11.8. Set Push Button Level



Achtung!

From Casambi Evolution firmware 34.50 up to 8 buttons are prepared.

Action Builder

Command SetPushButtonLevel

Button

0

Level

0

step back

next step

Sets the level of the device that is specified as the target of the button in the Casambi app.

In the case of a connection via HelvarNet or to a Netcomposer system, the window looks like this:

Action Builder

Command

SetPushButtonLevel

Button

0

Level

0

Level from Network

OFF

step back

next step

Here, "Level from Network" can be used to switch on the level signal that it receives from the other system. To do this, of course, a command with a level must also be set as a trigger.

5.11.9. Set Lux Sensor

Action Builder

Command SetLuxSensor

Lux Level

Displays the lux value to be sent.

5.11.10. Set Tc

Action Builder

Command: SetTargetColorTemperature

Tc: 0

Duration:

Target Type: ▼

Target Address:

Sets the device that is defined via the target type and the target address to the set value. In the time entered under Duration.

Target_Type	Target_ID	comment
0	0	broadcast
1	1-250	device
2	0	ungrouped
2	1-255	group
3	1-255	scene (only currently active lights)
4	1-255	Scenes (all lights)
5	0-255	all lights with the same manufacturer ID

5.11.11. Set RGBW

Action Builder

Command: SetTargetColorRGBW

Red: 54

Green: 137

Blue: 49

White: 255

Level: 255

Target Type: Broadcast

Target Address: 0

step back next step

Set the target to the set color values. White and Level to 255 means that the values are ignored.

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

If Dimm Group or Dimm Device is selected in HelvarNet, then dimming is automatically applied to the Mode SetLevel, SetSceneLevel, SetGroupLevel, SetRGBW and SetHue/Sat to the level.

5.11.12. Set Hue / Sat

Action Builder

Command: SetTargetColorHueSat

Hue: 255

Saturation: 255

White: 255

Level: 244

Target Type: ▾

Target Address:

Set the target to the set color values. White and Level to 255 means that the values are ignored.

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

If Dimm Group or Dimm Device is selected in HelvarNet, then dimming is automatically applied to the Mode SetLevel, SetSceneLevel, SetGroupLevel, SetRGBW and SetHue/Sat to the level.

5.11.13. Set Vertical

Action Builder

Command: SetTargetVertical

Vertical: 127

Target Type: none

Target Address: 0

Set the target to the set vertical.

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.11.14. Start Automation

5.11.14. Start Automation

Action Builder

Command	ResumeAutomation
Target Type	<input type="text" value="none"/>
Target Address	<input type="text" value="0"/>

The automatic mode is activated for the target.

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.11.15. SetTargetDimmers

With dimmer the dimming channel of the luminaire is selected. Up to 4 channels per device are possible. These are defined by the manufacturer of the profile.

Duration = Value * 10ms

Action Builder

Command	SetTargetDimmers
Dimmer	<input type="text" value="0"/>
Value	<input type="range" value="0"/> <input type="text" value="0"/>
Duration	<input type="text" value="0"/>
Target Type	<input type="text" value="none"/> ▼
Target Address	<input type="text" value="0"/>

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

5.11.16. SetTargetElements

With Custom Elements the control element of the luminaire is selected. Up to 8 elements per device are possible. These are defined by the manufacturer of the profile.

Duration = Value * 10ms

Action Builder

Command	SetTargetElements
Custom Elements	<input type="text" value="0"/>
Value	<input type="range" value="0"/>
Duration	<input type="text" value="0"/>
Target Type	<input type="text" value="none"/> ▼
Target Address	<input type="text" value="0"/>

Target_Type	Target_ID	Kommentar
0	0	Broadcast
1	1-250	Device
2	0	ungrouped
2	1-255	group
3	1-255	scene(nur aktuell aktive Leuchten)
4	1-255	scene(alle Leuchten)
5	0-255	all devices with same manufacturer id

6. Console

Casambi Ethernet Gateway v1.10

Generell Settings


To Casambi

From Casambi

Console

Console

Console



Submit

Refresh

Parameter

Scene_0	0	Group_0	0
Scene_1	0	Group_1	0
Scene_2	0	Group_2	0
Scene_3	0	Group_3	0
Scene_4	0	Group_4	0
Scene_5	0	Group_5	0
Scene_6	0	Group_6	0
Scene_7	0	Group_7	0
Scene_8	0	Group_8	0
Scene_9	0	Group_9	0
Scene_10	0	Group_10	0
Scene_11	0	Group_11	0
Scene_12	0	Group_12	0
Scene_13	0	Group_13	0
Scene_14	0	Group_14	0
Scene_15	0	Group_15	0

Warning: 0 = no value set in Casambi Software

Get Parameter

Refresh

6.1. console

A display of the last commands that were exchanged between the Casambi system and the network.

Console

```
Casambi Input: 1.40
Casambi Output: 8.28.7.e4.6.13.e.1.28
Network Input: 255.62.F2.1.16
Casambi Input: 5.30.1.0.0.0
Network Input: 255.62.F2.0.16
Casambi Input: 5.30.1.254.0.0
```


A command can be sent directly to the Casambi system in the text line. The submit button transmits the command.

The Refresh button updates the display.

"Casambi Input" = commands that are sent to the Casambi system

"Casambi Output" = commands / responses received from the Casambi system

"Network Input" = commands received from the network

"Network Output" = commands that are sent to the network

6.2. Parameter

The Parameter area can be used to display values for a parameter that were previously specified in the Casambi app.

Parameter			
Scene_0	0	Group_0	0
Scene_1	0	Group_1	0
Scene_2	0	Group_2	0
Scene_3	0	Group_3	0
Scene_4	0	Group_4	0
Scene_5	0	Group_5	0
Scene_6	0	Group_6	0
Scene_7	0	Group_7	0
Scene_8	0	Group_8	0
Scene_9	0	Group_9	0
Scene_10	0	Group_10	0
Scene_11	0	Group_11	0
Scene_12	0	Group_12	0
Scene_13	0	Group_13	0
Scene_14	0	Group_14	0
Scene_15	0	Group_15	0

Warning: 0 = no value set in Casambi Software

Get Parameter

Refresh

With the button "Get Parameter" the query is sent to the Casambi module. With "Refresh" this page must then be updated once afterwards.

This information is important for scenes or group calls. Here you can assign the scenes and groups to the corresponding parameters within the Casambi app and then find out which ID is hidden behind this in order to use it in the calls.

7. Settings in the Casambi app


On the part of the Casambi network, the system behaves like a normal lamp / button / sensor.

You can find it in the Casambi software as a Bluetooth device and add it.

It then appears on the one hand in the luminaire overview, but also as a sensor and switch.


7.1. Profile selection

In the selection list for devices in the vicinity, the profiles can be changed for unpaired devices

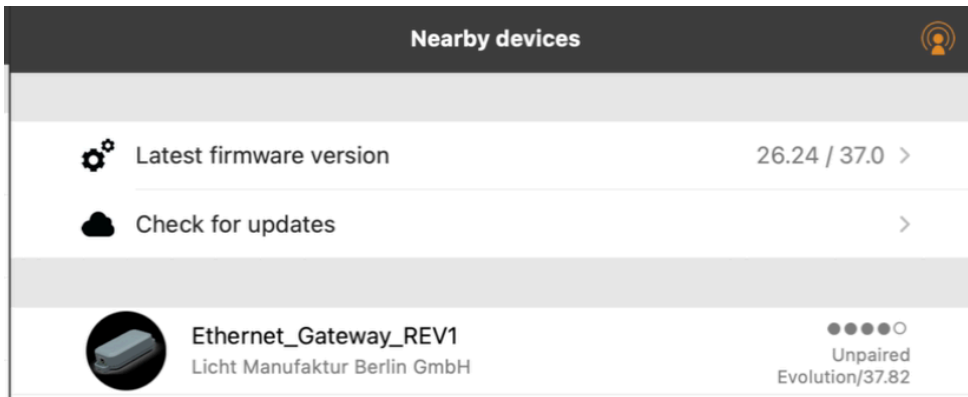

The profile without "_EVO" can also be used in Classic networks.

=> 4 buttons, 16 groups and 16 scenes as parameters

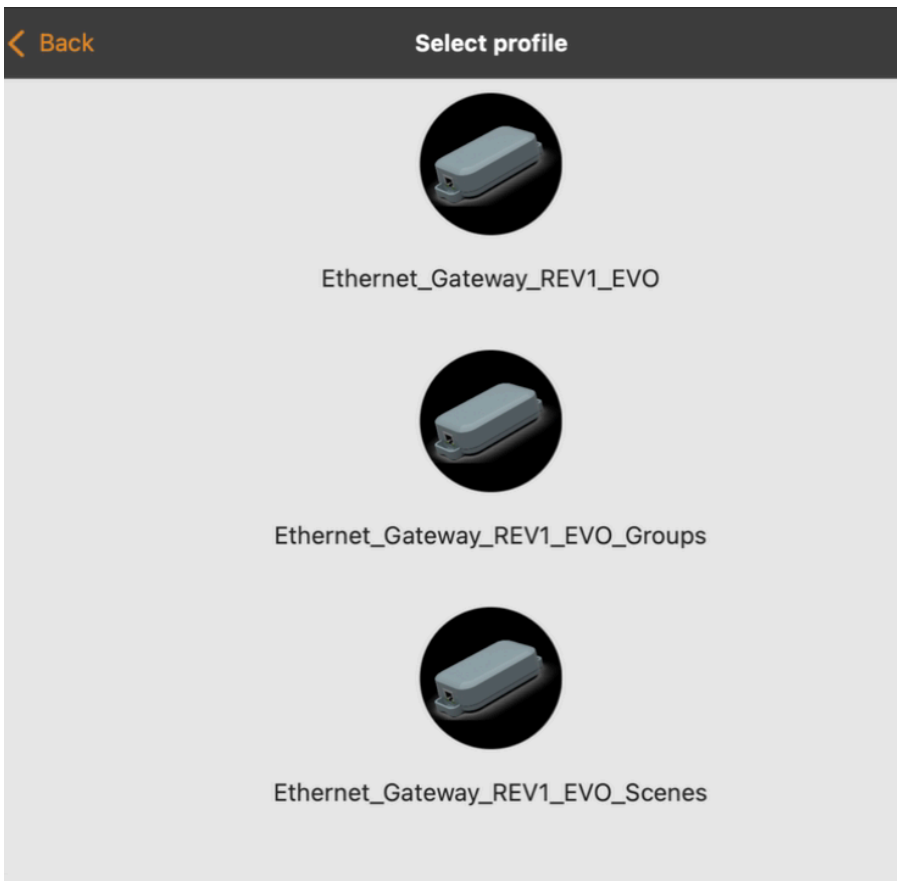

The programs that include "_EVO" are intended for Evolution mode.

_EVO = 32 groups + 32 scenes as parameters, 8 keys possible

_EVO_Groups = 64 groups, 8 keys

_EVO_Scenes = 64 scenes, 8 keys

With devices of the second hardware generation there is REV2 instead of REV1.

7.2. Behave as a lamp

You can pack the gateway into scenes or groups in the normal way.

Instead of one level, it has 8 switches. These can be used to carry out the actions within the gateway.

Depending on the state of the switches, a stored trigger can be executed.




7.3. Settings as a lamp

On the settings page of the luminaire, the parameters can then also be set, e.g. to have group addresses or scene addresses output.

Depending on the profile either

- 16 groups + 16 scenes
 - 32 groups + 32 scenes
 - 64 groups
 - 64 scenes
- are displayed.

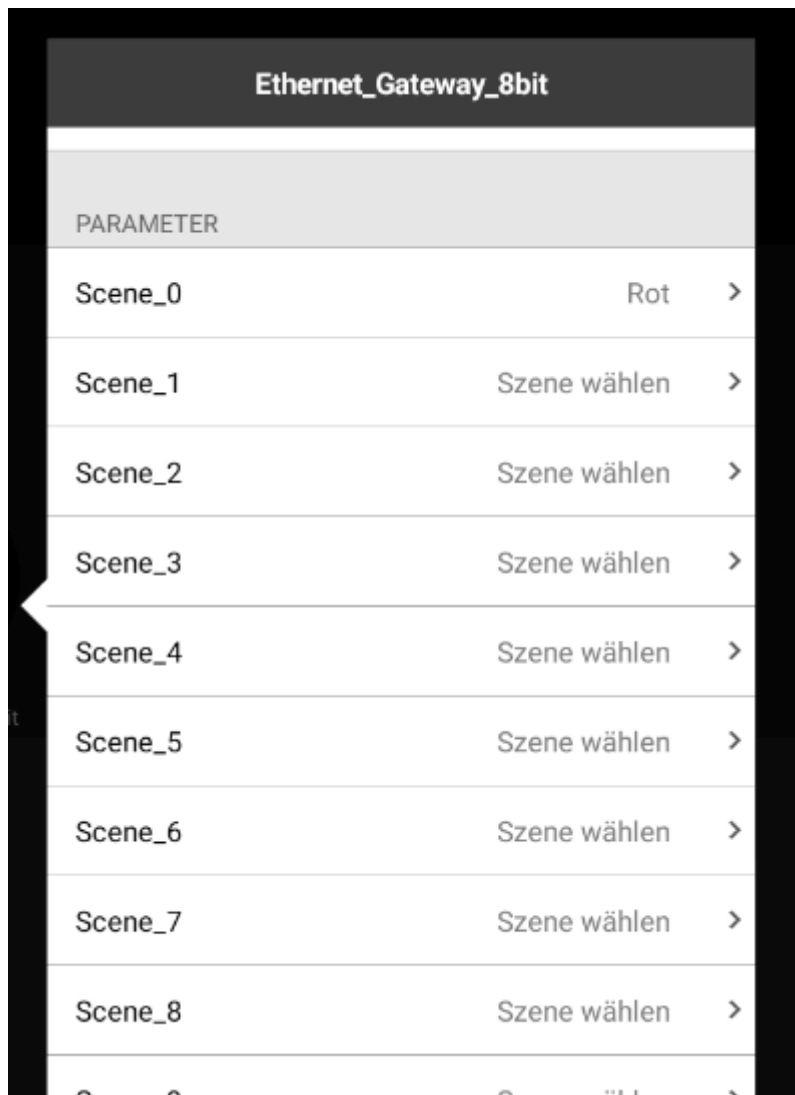

The screenshot shows a mobile application interface for 'Ethernet_Gateway_8bit'. It features a table with a header 'PARAMETER' and several rows representing scene settings. The first row, 'Scene_0', has the value 'Rot' and a right-pointing chevron. The subsequent rows, 'Scene_1' through 'Scene_8', all have the value 'Szene wählen' and a right-pointing chevron. A white callout bubble points to the 'Scene_3' row.

Ethernet_Gateway_8bit		
PARAMETER		
Scene_0	Rot	>
Scene_1	Szene wählen	>
Scene_2	Szene wählen	>
Scene_3	Szene wählen	>
Scene_4	Szene wählen	>
Scene_5	Szene wählen	>
Scene_6	Szene wählen	>
Scene_7	Szene wählen	>
Scene_8	Szene wählen	>



Ethernet_Gateway_8bit

Group_0	Gruppe wählen	>
Group_1	Gruppe wählen	>
Group_2	Gruppe wählen	>
Group_3	Gruppe wählen	>
Group_4	Gruppe wählen	>
Group_5	Gruppe wählen	>
Group_6	Gruppe wählen	>
Group_7	Gruppe wählen	>
Group_8	Gruppe wählen	>
Group_9	Gruppe wählen	>
Group_10	Gruppe wählen	>

7.4. Settings as a button

In the Casambi software, the gateway can be selected in the button area on the settings page.

Here, depending on the profile, 4 or, for profiles with "_EVO", 8 buttons can now be defined.

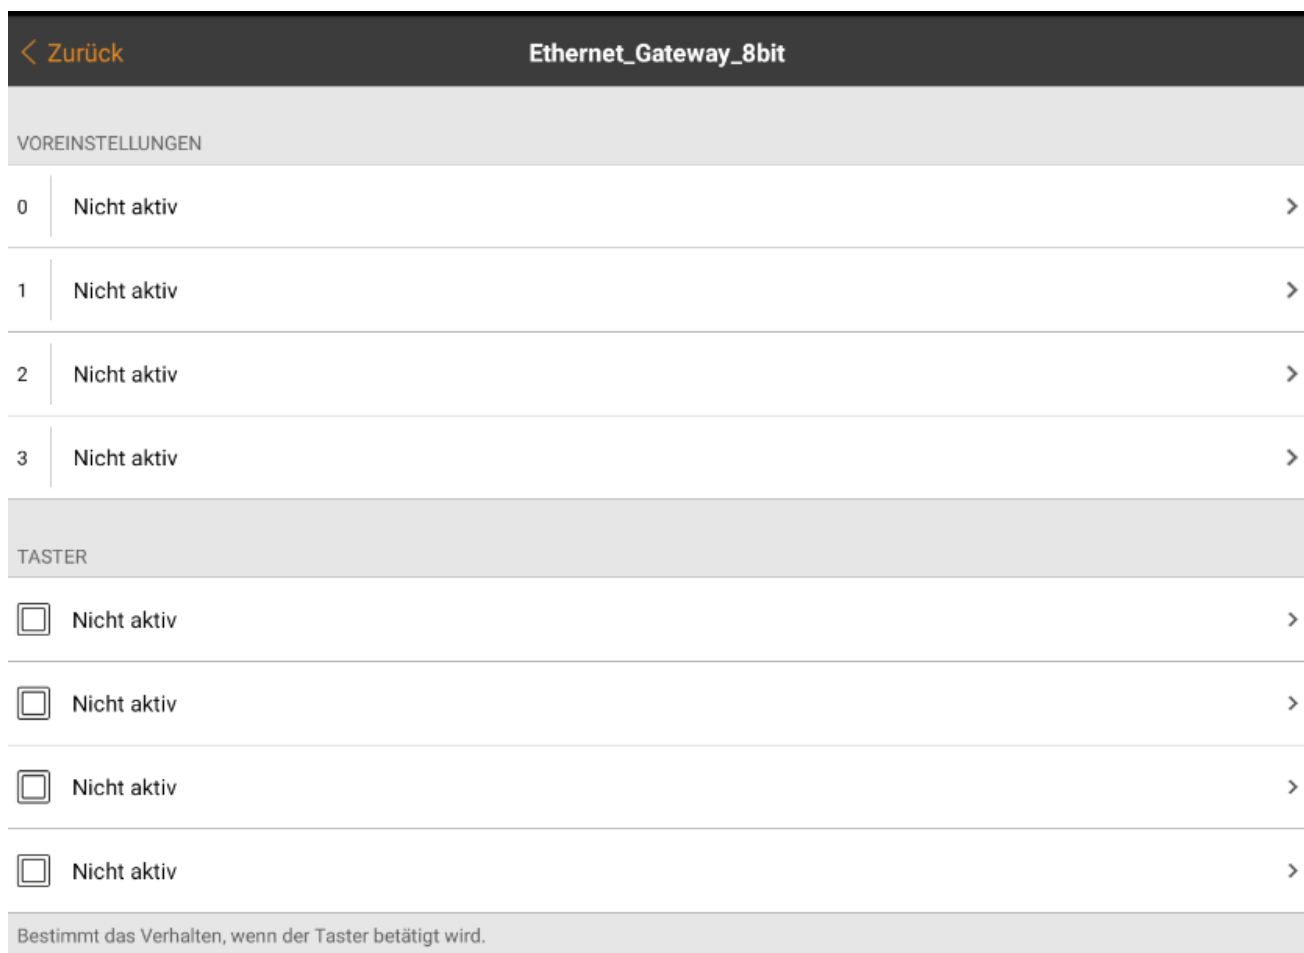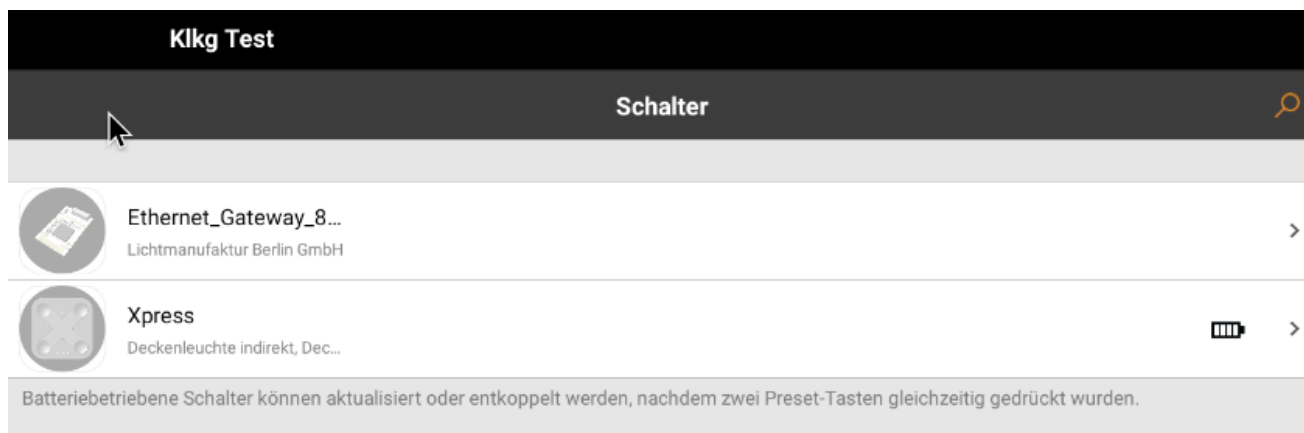


7.5. Settings as a PIR sensor

In the Casambi software, the gateway can be selected in the Sensor area on the settings page. This can now be set in the motion detector area.



7.6. Settings as a lux sensor

In the Casambi software, the gateway can be selected in the Sensor area on the settings page. This can now be set in the task light sensor area.

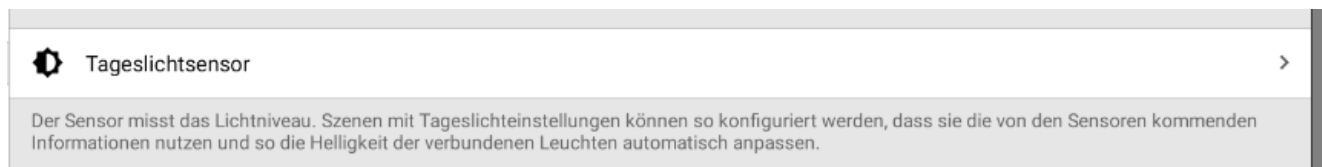

7.7. Identify

It is now possible to identify the gateway when inserting the device into the wireless network.

As long as the identification via the app is activated, the device behaves as if you press the identify button on the website.

8. Changelog Firmware



The backup files of version 2 are not compatible with those of version 3. In case of an update, the device must be set up again.



The hardware button is currently still without function due to a hardware error and will be fixed from devices with manufacturing date > 03/2022.

Overview of the changes to the firmware in the individual versions.

The changelog can be found online at: <https://changelog.lithernet.de/>

9. Support

We offer support via e-mail. Simply send an e-mail to support@lithernet.de. We will get back to you as soon as possible.

A ticket can also be created online on the website <https://support.lithernet.de/>. For this purpose, however, an account must be registered.

With this account you can also access previously written support requests.

A knowledgebase is under construction and can be reached at <https://support.lithernet.de/help/en-gb>.