

THIS DOCUMENT IS SUPPLIED IN STRICT CONFIDENCE AND MUST NOT BE LENT, REPRODUCED OR DISCLOSED TO ANY THIRD PARTY WITHOUT THE WRITTEN CONSENT OF GRAF UK LIMITED




**DO NOT SCALE - IF IN DOUBT ASK**

Notice: This drawing is issued only as a guideline and is an estimate of the materials required to construct the drainage system, it should not be used for construction purposes.

Graf UK Ltd makes no warranty or guarantee in relation to the suitability of any of the layout details shown on this drawing in relation to a particular scheme.


**NOTES:-**

1. All dimensions in mm, unless otherwise stated.
2. All dimensions are nominal and may vary within manufacturing tolerances.
3. All site temporary enabling works by others.
4. Graf products to be installed in strict accordance with Graf recommendations.
5. This drawing is intended for guidance only. Confirmation of the suitability for a particular project should be sought from the consulting engineers prior to final design or commencement of any construction works.

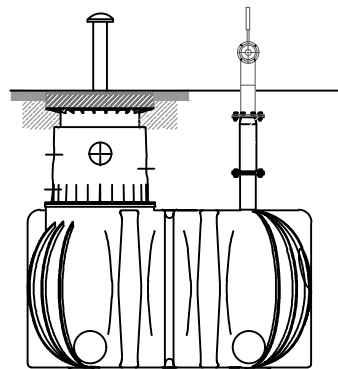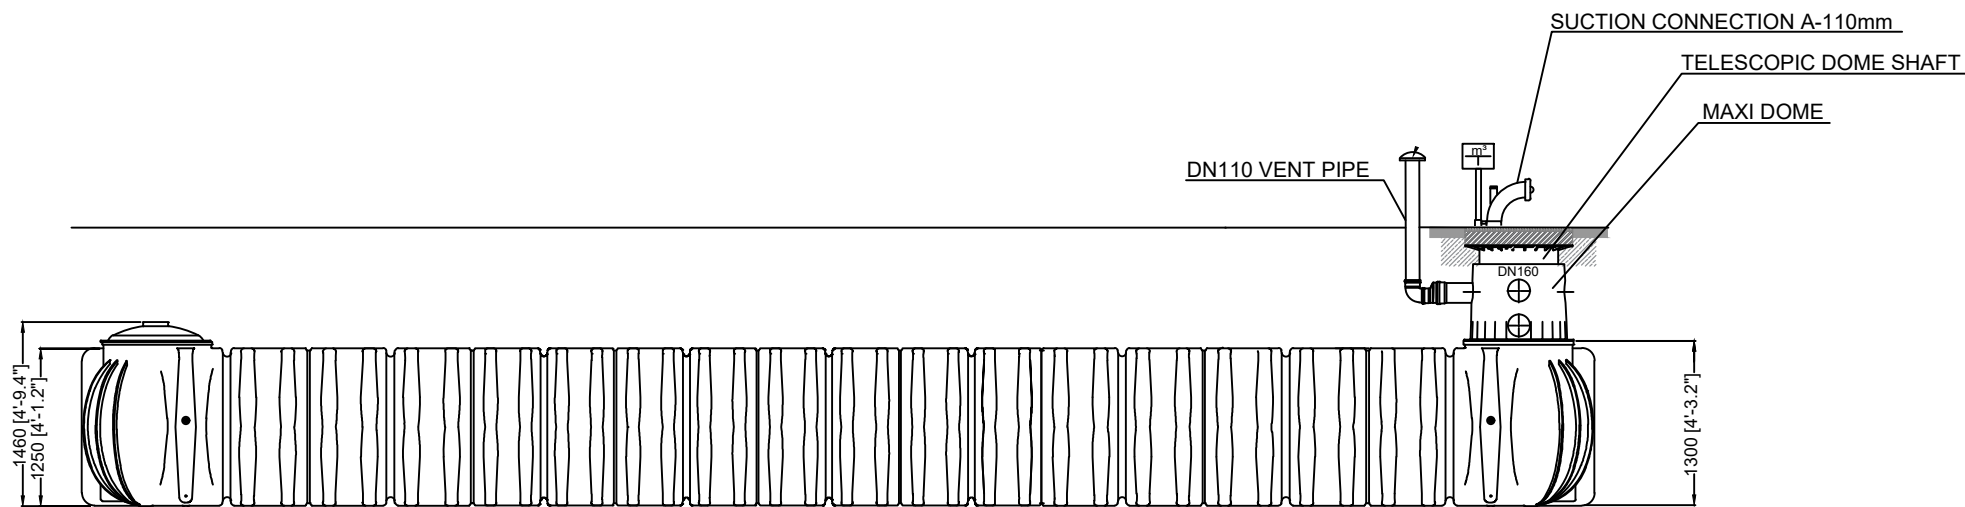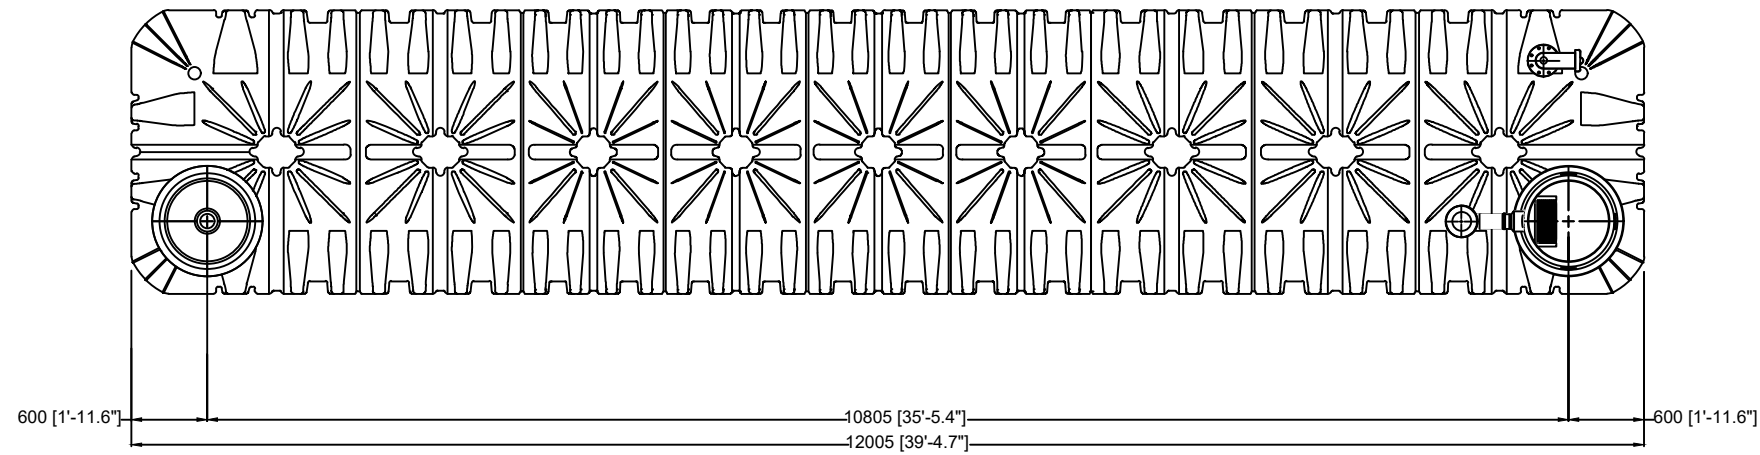

**PLATINI XXL FIREFIGHTING TANK VOLUMES**

RATED VOLUME (LITRES)	USABLE VOLUME (LITRES)
20,000	14,000
25,000	17,500

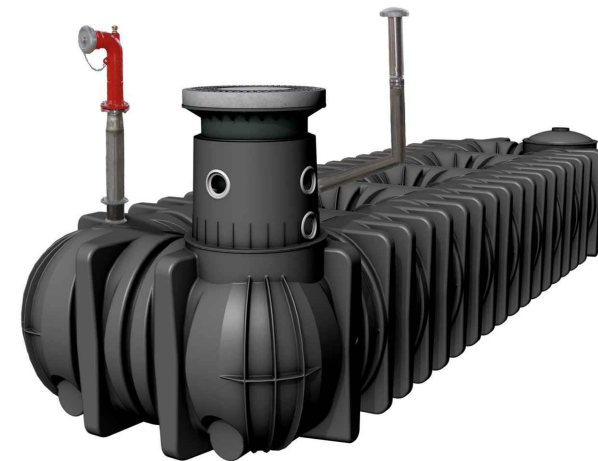

**NOTE:-** Tank accessory suitability may vary depending on project. Please contact Graf UK for sizing, support and design.

P0	LATEST REVISION	FC	19.12.22
REV.	DESCRIPTION	BY	DATE

**GRAF** GRAF UK Limited  
 GRAF UK Limited, Regen House, Beaumont Road, Banbury, Oxfordshire, OX16 1RH  
 T: 01608 661500 F: 01295 211333  
 E: info@grafuk.co.uk www.grafuk.co.uk

DRAWN : FC	DATE : 19.12.2022
CHECKED : DS	SCALE : VARIOUS@A3

PROJECT  
**GRAF STANDARD DETAILS**

DESCRIPTION  
**GRAF PLATINI XXL  
 25,000L  
 FIREFIGHTING TANK**

DRAWING No.	REV.
FF STANDARD DETAIL_PLATINI XXL_25,000L	P0