

**Beckham I Light Vanity****TV1001 1.0**

## GENERATION LIGHTING

**Vanity****GENERAL PRODUCT INFORMATION:**

These fixtures are intended to be installed utilizing NEC compliant junction boxes.


This product is safety listed for damp locations.

Incandescent lamps may be dimmed with a standard incandescent dimmer. LED lamps may be dimmed with a LED dimmer. Consult lamp manufacturer for additional information.

**CAUTION - RISK OF FIRE**

This product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.

Use minimum 90°C supply conductors.

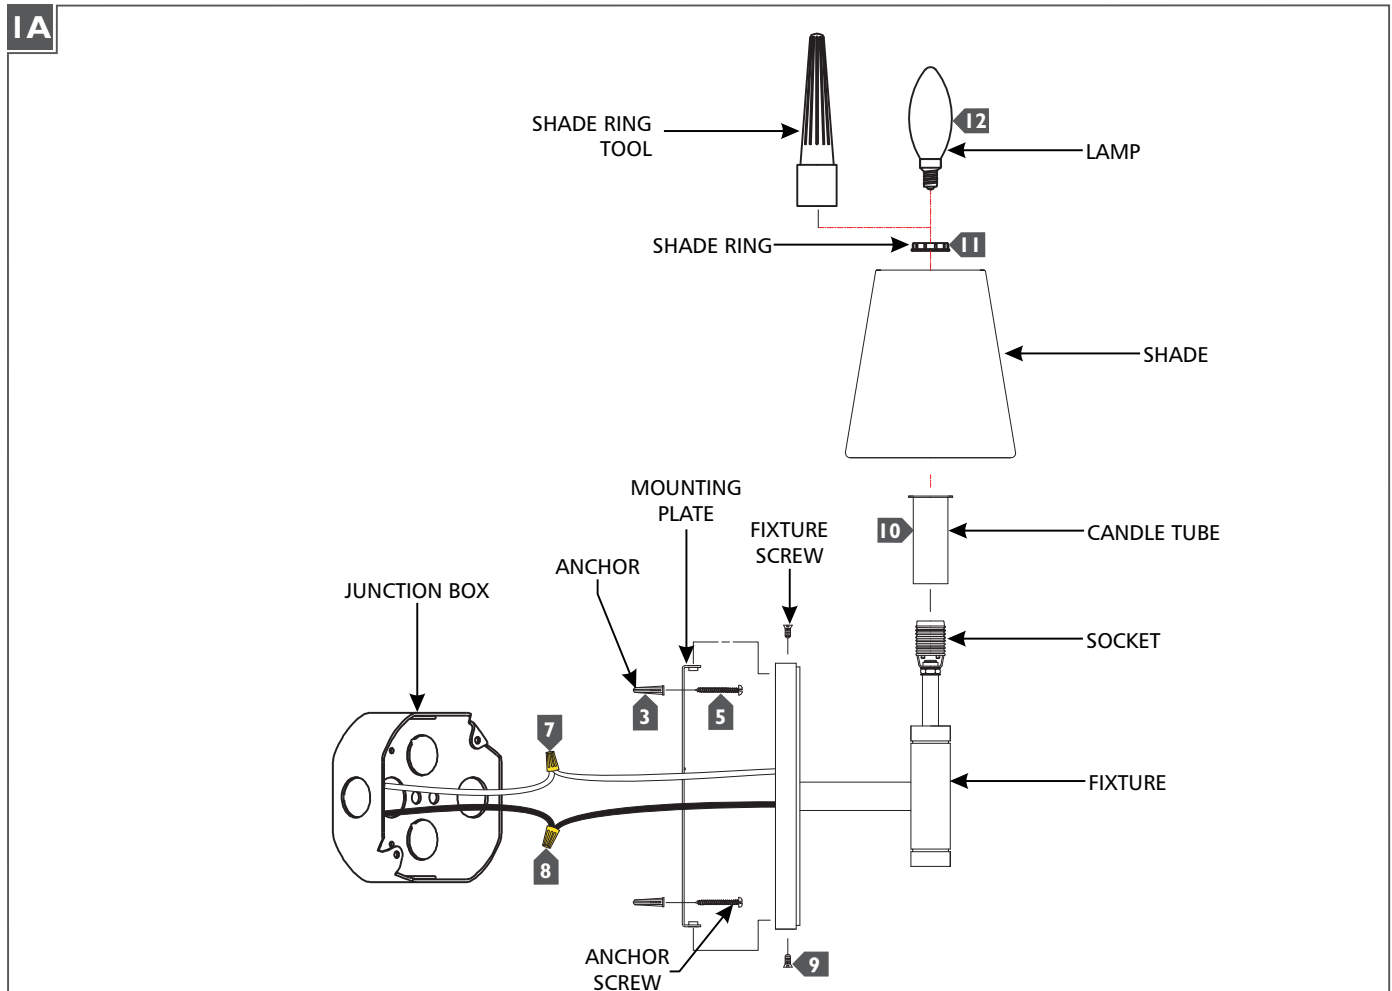

- 1** Temporarily install the mounting plate to the junction box.
- 2** Mark the anchor hole locations through the mounting plate, then remove the mounting plate.
- 3** Drill appropriate sized holes and install the anchors.
- 4** Secure the mounting plate to the junction box.
- 5** Screw the anchor screws into the anchors.
- 6** Connect the fixture ground wire to a suitable ground in accordance to local electrical codes.
- 7** Connect the white fixture wire to the neutral power line wire with a wire nut.
- 8** Connect the black fixture wire to the hot power line wire with a wire nut.
- 9** Mount the fixture onto the mounting plate and secure it in place with the fixture screws.
- 10** Install the candle tube by placing it over the socket.
- 11** Install the shade by placing it over the socket then use the shade ring tool to tighten the shade ring onto the socket.
- 12** Screw the lamp into the socket. Refer to the label on the socket for Max Wattage Information.

**SAVE THESE INSTRUCTIONS!**

GENERATION LIGHTING

7400 Linder Ave, Skokie, IL 160077

800.969.3347

**[www.generationlighting.com](http://www.generationlighting.com)**

© 2019 Generation Lighting. All rights reserved.

The "Generation Lighting" graphic is a registered trademark of Generation Lighting. Generation Lighting reserves the right to change specifications for product improvements without notification.