



TEST REPORT

For

Beyond LED Technology

1939 Parker Court, Stone Mountain, GA 30087

Model Number:	MRS8-40/60/80/D10/U/35-40-50	
Report Type:	Electrical, Photometric and ISTMT tests according to the following standards and show the compliance to DLC Program SSL Technical Requirements V5.1	
Standards:	IES LM-79-08: Approved Method: Electrical & Photometric Measurement of Solid-state Lighting Products ANSI C82.77-10-2014: Harmonic Emission Limits – Related Power Quality Requirements for Lighting ANSI/UL 1598-2008: Standard for Safety of Luminaires CIE 190:2010 Calculation and presentation of unified glare rating tables for indoor lighting luminaires IES TM-30-18: IES Method for Evaluating Light Source Color Rendition	
Project Engineer:	George Yang	
Report Number:	RKS210506003-10	
Sample Size:	One sample was received on 2021-05-06 and used for testing.	
Test Date:	2021-05-12 to 2021-05-15	
Report Date:	2021-05-25	
Reviewed By:	Seven Xia/ EE Engineer	
Prepared By:	Bay Area Compliance Laboratories Corp. (Kunshan). No.248 Chenghu Road, Kunshan, Jiangsu province, China. Tel: +86-0512-86175000 Fax: +86-0512-88934268	

1. Product Information and Description[#]

Product Primary Use:	Direct Linear Ambient Luminaires
Voltage and Frequency:	120-277VAC, 50/60Hz
LED Source Manufacturer:	Lumileds Holding B.V.
LED Source Model:	L128-xx80RA35000Q1
Luminaire length:	8ft
Auxiliary Ballast Model:	NA
Auxiliary Housing Model:	NA
White Tunable:	Yes
Field-Adjustable Light Output:	Yes



2. Product Rated Values[#]

Test Model	CCT(K)	Light Output (lm)	Power(W)	Luminous Efficacy (lm/W)
MRS8-40/60/80/D10/U/35-40-50	3500	9376	80	117.2
		7200	60	120
		4880	40	122
	4000	10240	80	128
		7860	60	131
		5320	40	133
	5000	9520	80	119
		7320	60	122
		4960	40	124

3. Test List

Test Model	CCT(K)	Power(W)	Test Item			
			Goniophotometer Test	Integrating Sphere Test	THDi and PF Test	In-Situ Temperature Measurement Test
MRS8-40/60/80/D10/U/35-40-50	3500	80	NA	Yes	Yes	Yes

4. Product Photo

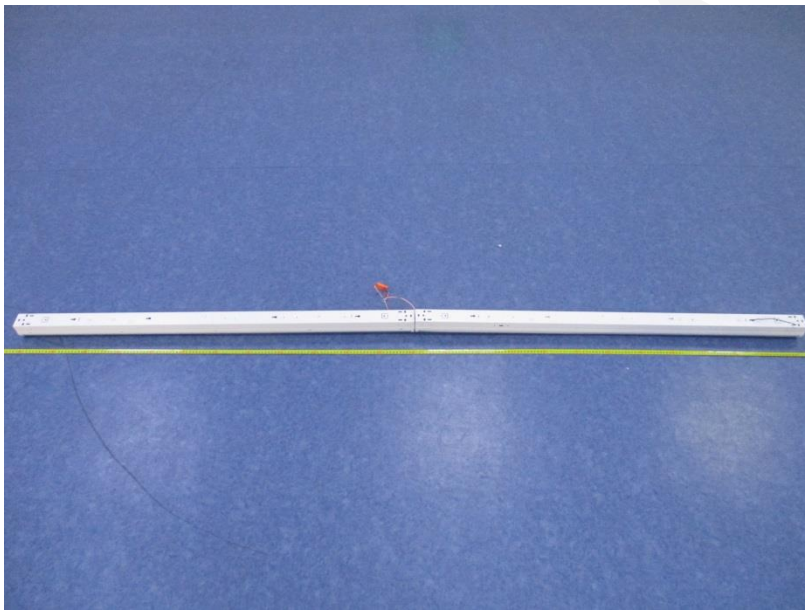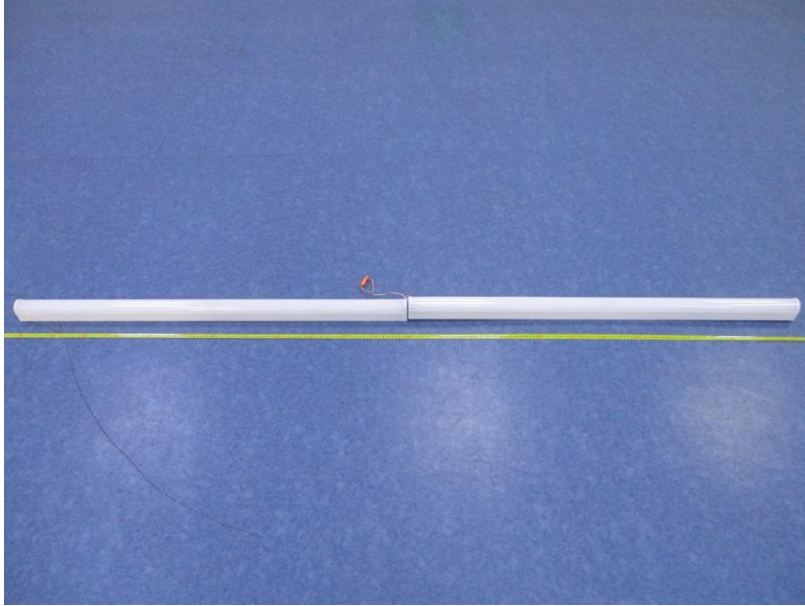

5. Test Result

Control Setting: 3500K/80W

Integrating Sphere Test; Orientation: Downward; Test Voltage: 120V 60Hz:				
Test Item	Test Result	DLC Requirements	DLC Requirements(With tolerances only)	Conclusion
Light Output(lm)	9380.15	≥3000	≥2700	Pass
Power(W)	78.5	None.	None.	N/A
Total Efficacy(lm/W)	119.49	≥115	≥111.55	Pass
CCT(K)	3368	3220~3710	No tolerances	Pass
Duv	-0.00042	-0.0055~0.0065	No tolerances	Pass
IES R _f	84	70	69	Pass
IES R _g	96	89	88	
IES Rcs,h1	-12%	-12%~23%	-13%~24%	
R _a	82.9	≥80	≥79	
R ₉	12	≥0	≥-1	


Integrating Sphere THDi, PF Test; Orientation: Downward:					
Test Voltage	Test Item	Test Result	DLC Requirements	DLC Requirements(With tolerances and/or allowances)	Conclusion
120	Power Factor	0.9922	≥0.9	≥0.87	Pass
120	THDi	3.60%	≤20%	≤25%	Pass
277	Power Factor	0.9116	≥0.9	≥0.87	Pass
277	THDi	4.82%	≤20%	≤25%	Pass

In-Situ Temperature Measurement Test: Test Voltage: 120V 60Hz;

Test Item	Test Result	DLC Requirements	DLC Requirements(With tolerances and/or allowances)	Conclusion
TMP _{LED} (°C)	48.6	≤115	With tolerance of ≤ 1.1°C or 0.4%, whichever is greater due to thermocouple tolerance	Pass
Drive Current/Individual LED source(mA)	88.3	≤150	With +5% tolerance	Pass
L ₇₀ Lumen Maintenance Life (Hours)	>54000	≥50000	None.	Pass
Color Maintenance	0.002	≤0.004	≤0.0044	Pass

Note:

1. The test results were measured directly from the test equipment.
2. The DLC requirements were listed according to DLC Technical Requirements V5.1.
3. The conclusion is for reference only. Test report that indicate product performance meets DLC Technical Requirements do not represent official DLC product qualification. All decisions regarding product qualification are made by the DLC.

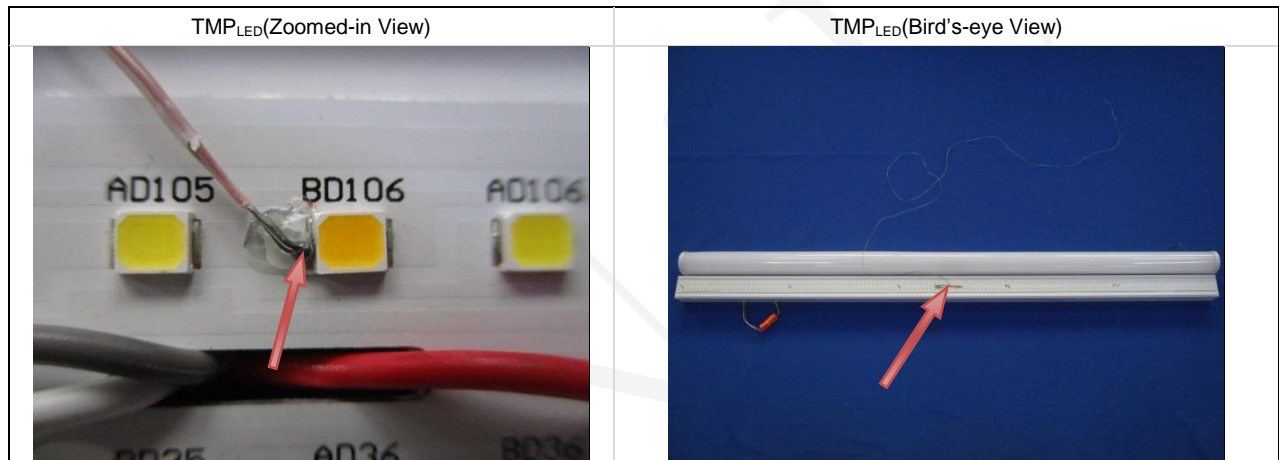

Test Data

[Integrating Sphere System]


Photometric and Electrical Measurement Result

Voltage (V)	Frequency (Hz)	Current (A)	Power (W)	Power Factor	Luminous Flux(lm)	Efficacy (lm/W)
120.0	60	0.6595	78.5	0.9922	9380.15	119.49

Radiant Flux (W)	CCT (K)	Duv	x	y	u'	v'
28.254	3368	-0.00042	0.4125	0.3932	0.2393	0.5134

Color Rendering Index







Ra			
82.9			
R1	R2	R3	R4
82	90	95	81
R5	R6	R7	R8
81	86	84	63
R9	R10	R11	R12
12	75	79	62
R13	R14	R15	
84	97	76	

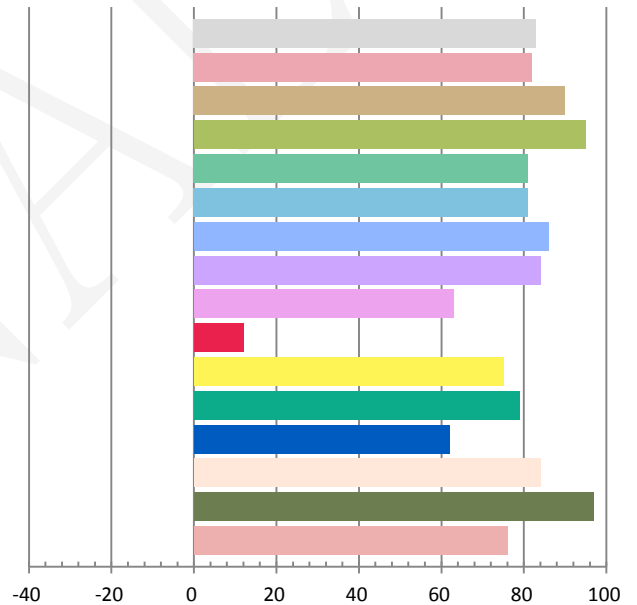

ANSI/IES TM-30-18 Color Rendition Report

Source: User SPD
Date: 2021/5/12

Manufacturer: SHANGHAI HONGBAO LIGHTING CO LTD
Model: MRS8-40/60/80/D10/U/35-40-50

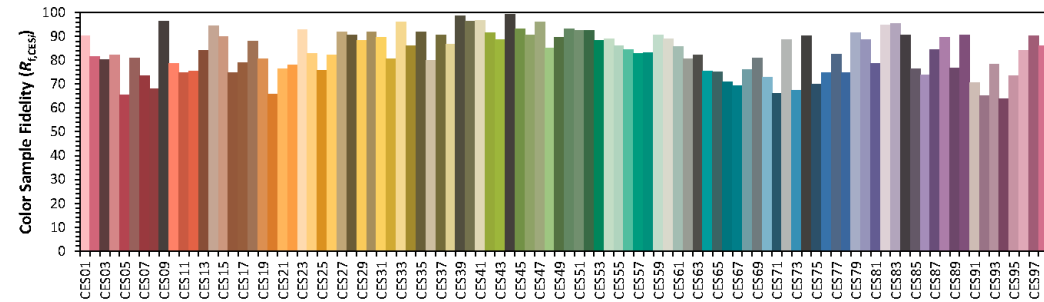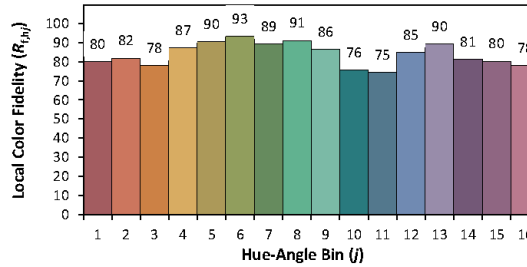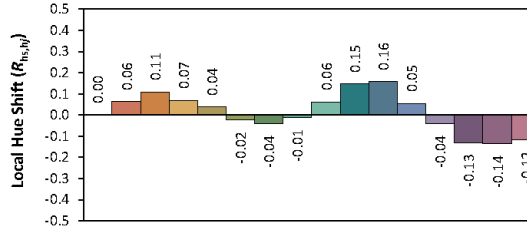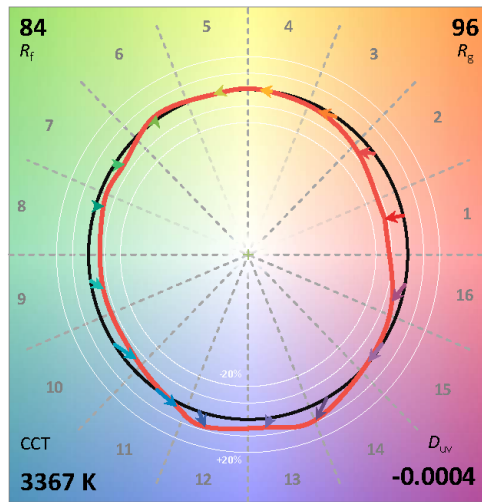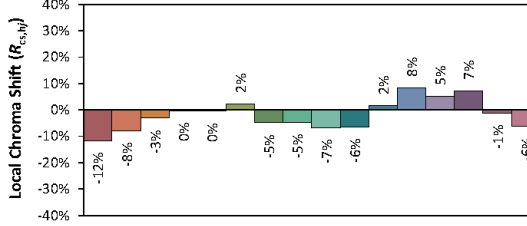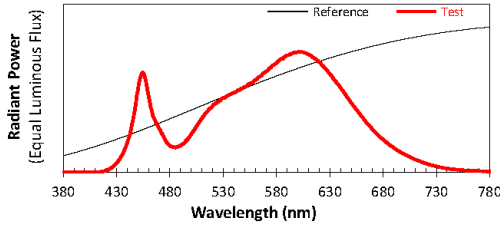


Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

x 0.4125
 y 0.3932
 u' 0.2393
 v' 0.5134


CIE 13.3-1995
(CRI)
 R_a 83
 R_0 12

Colors are for visual orientation purposes only. Created with the ANSI/IES TM-30-18 Calculator Version 2.00.


Relative Spectral Power Distribution

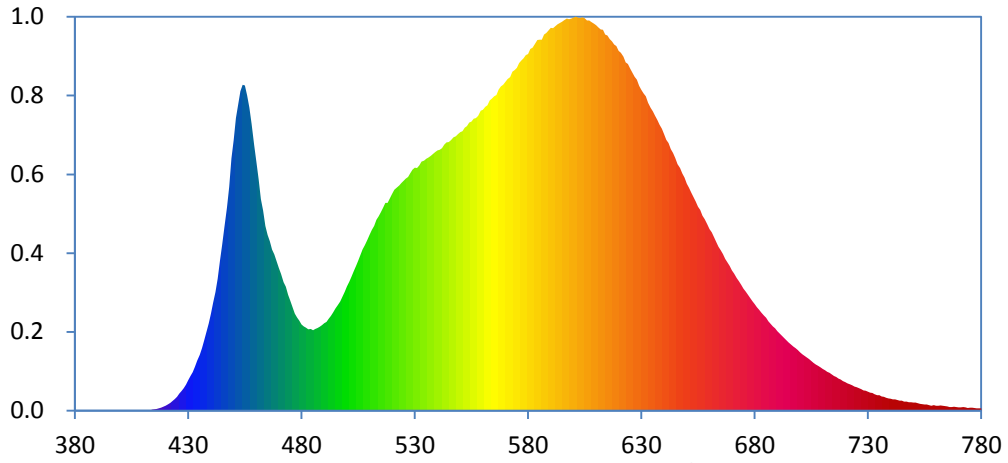

CIE 1931 x y Chromaticity Diagram

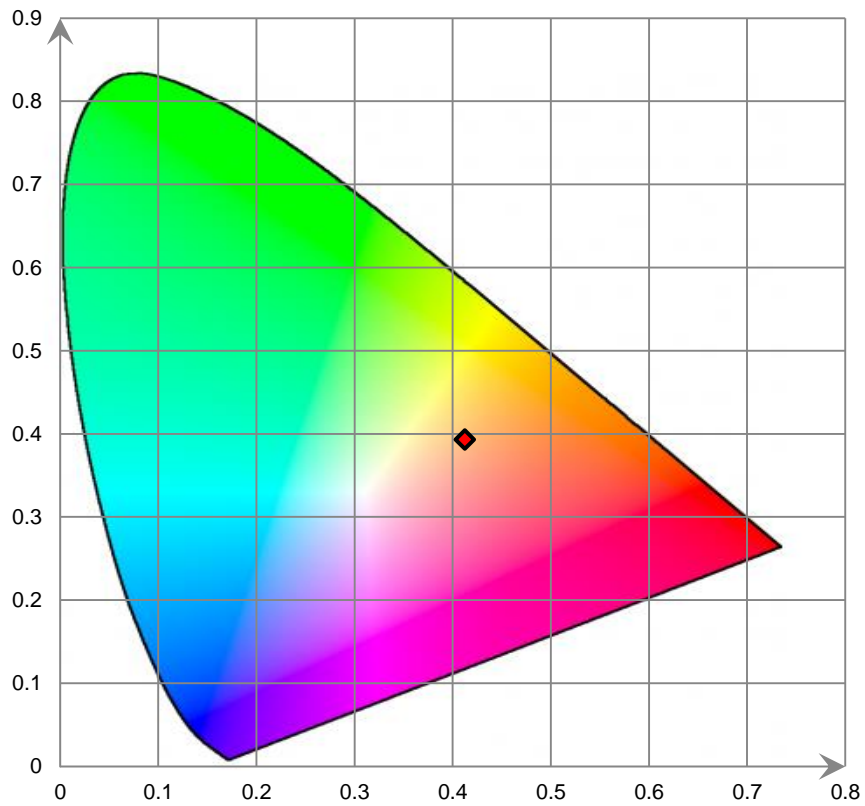

ANSI C78.377-2017 Chromaticity Quadrangles

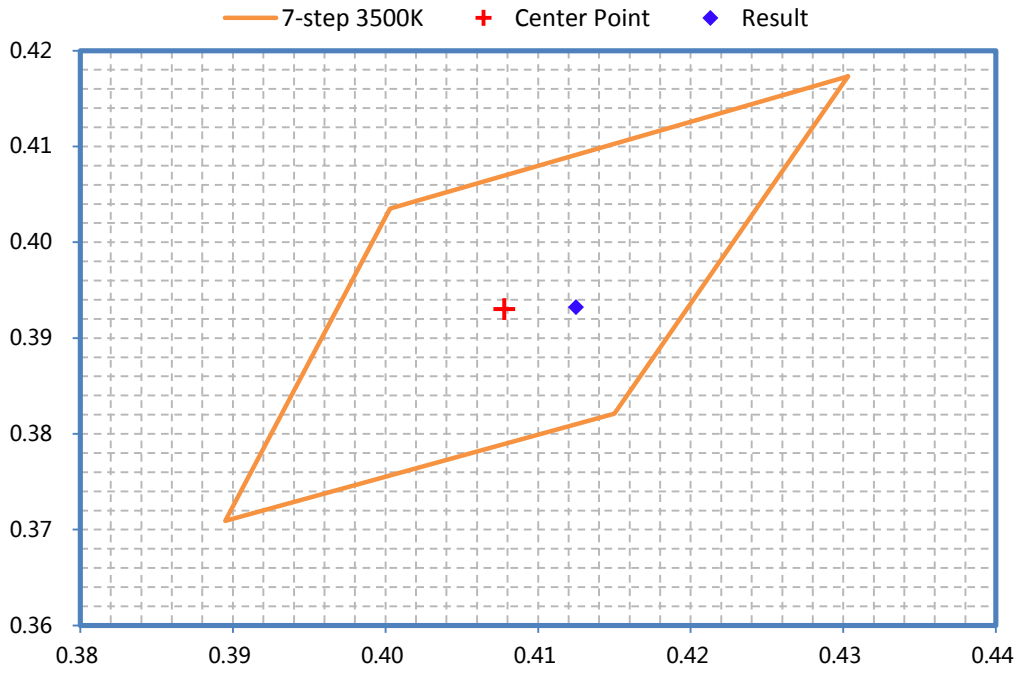

6. Description of Test Equipment

Device	Manufacture	Model No	Serial No	Calibration date	Calibration due date
Integrating Sphere	INVENTFINE	Dia 1.5m	JWWCV090112	2020-12-23	2021-12-22
Power Meter	INVENTFINE	WT500	GSJWQ20009	2021-03-16	2022-03-15
Spectral photometer	INVENTFINE	CMS-3S	GSGSE100017	2020-12-23	2021-12-22
AC Power Supply	INVENTFINE	CHP500	JWJSD010071	2020-11-25	2021-11-24
Standard Light Source	INVENTFINE	N/A	JWWCR020105	2020-10-20	2021-10-19
Thermal Meter	ANYMETRE	TH-20E	N/A	2020-11-30	2021-11-29
DC Power Supply	INVENTFINE	WL3005	JWWCP020069	2020-11-25	2021-11-24
Digital Multimeter	FLUKE	115C	37840512WS	2020-10-08	2021-10-07
Hybrid Recorder	YOKOGAWA	DR230	47JH0903	2020-11-25	2021-11-24
Power Supply	SC	SC/BP-11003	1608110030553	2020-11-25	2021-11-24

Statement of Traceability: Bay Area Compliance Laboratories Corp. (Kunshan) attested that all calibration has been performed using suitable standards traceable to National Primary Standards and International System of Units (SI).

7. Test Method

Product was tested with no seasoning. All stabilization and measurements were made in compliance with IES LM-79-08. The ambient temperature of the sample was maintained at $25^{\circ}\text{C} \pm 1^{\circ}\text{C}$ during measurement. And relative humidity is less than 65%. The product was operated in its intended orientation in application during all testing.

Integrating Sphere System

The system includes AC power source, digital power meter, DC power supply, Spectroradiometer, and integrating sphere. The integrating sphere system is calibrated by standard spectrum light source before measurement. 4π geometry was used during measurement.

ISTMT Test

The LED which has the highest temperature was measured at the location of LED case which is specified by LED source manufacturer and detailed by LM-80 report. The drive current of LED package/module/array was calculated as the total output current of the driver measured by multimeter, divided by the number of branches in parallel of LEDs.

Directions

1. The information marked "superscript #" is provided by the applicant, the laboratory is not responsible for its authenticity and this information can affect the validity of the result in the test report.
2. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested.
3. Otherwise required by the applicant or Product Regulations, Decision Rule in this report did not consider the uncertainty.
4. The extended uncertainty given in this report is obtained by combining the standard uncertainty times the coverage factor K with the 95% confidence interval.
5. This report cannot be reproduced except in full, without prior written approval of the Company.
6. This report is valid only with a valid digital signature. The digital signature may be available only under the Adobe software above version 7.0.

*****END OF REPORT*****