


BASE 200P SYSTEM - LOAD CLASS A15-C250

EXPOSED ASPHALT PAVEMENT INSTALLATION

8" (200mm) BASE PLASTIC TRENCH DRAIN

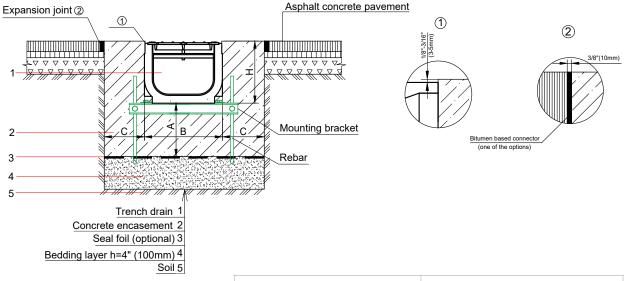

PARAMETER	LOAD CLASS		
	CLASS A	CLASS B	CLASS C
CONRETE ENCASEMENT DEPTH (A), in	4" (100mm)	4" (100mm)	6" (150mm)
CONRETE ENCASEMENT WIDTH (B), in	4" (100mm)	4" (100mm)	6" (150mm)

NOTES:

- SPECIFIER IS RESPONSIBLE FOR CONCRETE ENCASEMENT AND REINFORCING BASED UPON APPLICATION AND LOCAL CODES.
- 2. EXPANSION AND CONTRACTION CONTROL JOINTS AND REINFORCEMENT ARE RECOMMENDED TO PROTECT CHANNEL AND CONCRETE SURROUND. ENGINEERING ADVICE MAY BE REQUIRED.
- 3. THIS INSTALLATION SCHEME IS A RECOMMENDATION. CONSULT WITH THE MANUFACTURER FOR INSTALLATION INSTRUCTIONS.
- 4. THE FINISHED LEVEL OF CONCRETE SURROUND SHOULD BE 1/8" 3/16" (3-5mm) ABOVE THE TOP OF THE CHANNEL EDGE.
- 5. USE CASCADE INSTALLATION METHOD IF SLOPE IS REQUIRED (REFER TO RESOURCES ON THE WEBSITE).

GENERAL: THE TRENCH DRAIN SHALL BE VODALAND CANADA BASE 200P AS MANUFACTURED BY VODALAND OR APPROVED EQUAL.

SPECIFICATION: BASE 200P TRENCH DRAIN SHALL BE 39.4" (1000mm) LONG AND THE NOMINAL CLEAR OPENING SHALL BE 8" (200mm) WITH 10.2" (260mm) OVERALL WIDTH. CHANNELS SHALL BE MANUFACTURED FROM UV STABILIZED 100% RECYCLED POLYPROPYLENE. UNITS SHALL HAVE MALE-TO-FEMALE INTERLOCKING JOINTS THAT WILL NOT SEPARATE DURING THE INSTALLATION. CHANNELS SHALL HAVE A RADIUSED SELF CLEANING BOTTOM WITH A MANNING'S COEFFICIENT OF 0.009 AND NEUTRAL 0% BUILT IN SLOPE. GRATINGS SHALL MEET THE SYSTEM LOAD CLASS SPECIFIED. CHANNELS AND GRATE SHALL WITHSTAND A REQUIRED EN1433 LOAD CLASS.

THE COMPLETE DRAINAGE SYSTEM SHALL BE BY VODALAND CANADA INC. ANY DEVIATION OR PARTIAL SYSTEM DESIGN AND/OR IMPROPER INSTALLATION WILL VOID ANY AND ALL WARRANTIES PROVIDED BY VODALAND CANADA INC.

REVISED: 2022





BASE 200P SYSTEM - LOAD CLASS A15-C250

EXPOSED ASPHALT PAVEMENT INSTALLATION

8" (200mm) BASE PLASTIC TRENCH DRAIN

CHECK AND SPECIFY APPROPRIATE OPTIONS: