

CLASSE 5 ONE GROUP S Tank models

Pre-Install Checklist

ELECTRICAL REQUIREMENTS:

Espresso Machine



Voltage Range: 110-120 VAC Single Phase

Watts: 1600

Circuit Size: 20 amps

SUGGESTED RECEPTACLE FOR ESPRESSO MACHINE:

5-20R

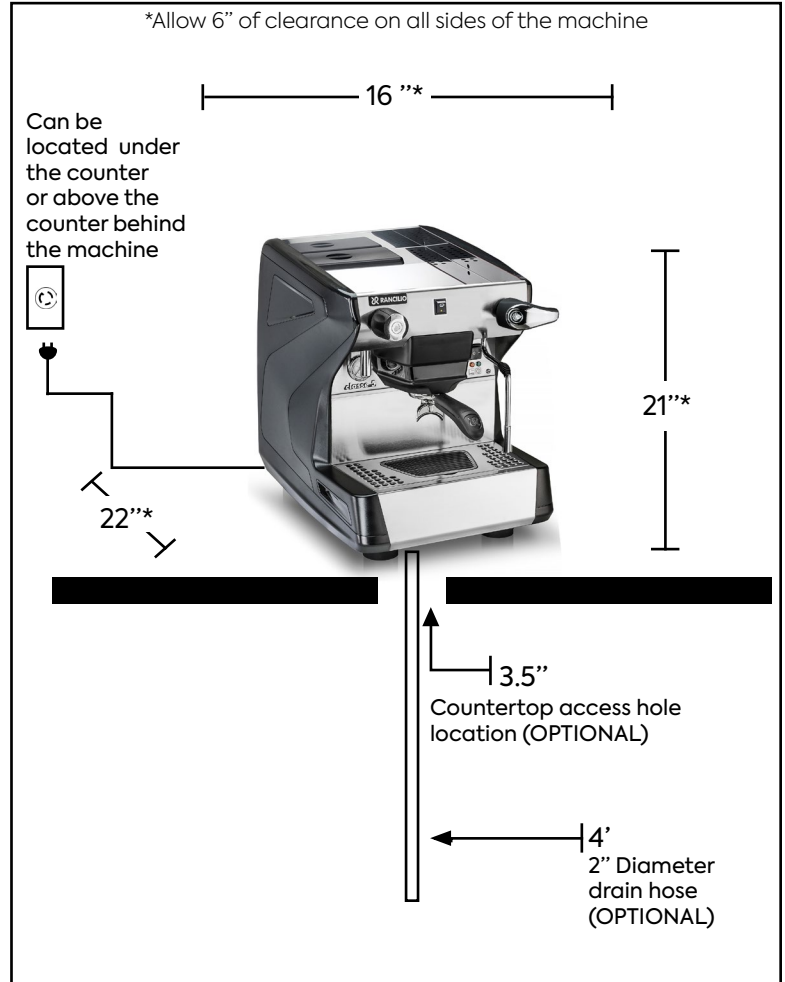

CLASSE 5 ONE GROUP S Tank models

Pre-Install Checklist

DRAIN REQUIREMENTS:

Open gravity drain with minimum 2" I.D., within 4' of the machine. (OPTIONAL)

SPACE REQUIREMENTS:

Allow at least 6" of clearance on all sides of the machine.

COFFEE REQUIREMENTS:

On installation day, you must have 2 lbs of each type of coffee you are serving (i.e. 2 lbs of regular and 2 lbs of decaf coffee beans).

Sign and return via fax to Rancilio Group North America at **630-914-7901** or print, sign, scan and email to **servicecoordinator@ranciliogroupna.com**.

By signing, you agree to the following:

- If the installer arrives and the site is not ready, pre-payment of \$500 must be issued to Rancilio before a second installation attempt will be made.
- Installation must be completed by a certified technician with written permission from Rancilio.
- You have read and understood this Pre-install Checklist.
- You are aware of the requirements needed for the installation.

Failure to comply will void all warranty and maintenance packages.

Full Name*

Company Name*

Email*

Phone*

Address/Site Location*

Signature*

Date*

**Required information*