

Certificate No. 38681/DBBPAL  
Date: December 17, 2018



Issuing Office:  
Jl. Arteri Tol Cibitung No. 1, Cibitung Bekasi 17520, Indonesia  
Phone/Facs: +62 21 88321176/88321166  
Email: jum.cbt@sucofindo.co.id

## REPORT OF ANALYSIS

The following sample (s) was submitted and identified by the client as :

CLIENT : ANUGERAH SELLIN DISTRINDO, PT  
Jl. Kakap 3/IA Rawamangun  
Jakarta

TYPE OF SAMPLE : DRINKING WATER

DATE RECEIVED : December 3, 2018

DATE OF ANALYSIS : December 4, 2018 to December 17, 2018

TESTED FOR : Microbiological, Inorganic Chemical, Physical and Chemical  
(Republic of Indonesia Health Minister Decree  
No.492/MENKES/PER/IV/2010)

DESCRIPTION OF SAMPLE : Packing : Unsealed plastic bottle

SAMPLE IDENTIFICATION : Tap Water Drink Pure Filter

YOUR REFERENCE : -

### Conclusion


Based on parameter analysis it is concluded that the sample is conform with Republic of Indonesia Health Minister Decree No.492/MENKES/PER/IV/2010

The attachment available is an integral part of this certificate

This Certificate/report is issued under our General Terms and Conditions, copy of which is available upon request or may be accessed at [www.sucofindo.co.id](http://www.sucofindo.co.id)

This test result (s) related to the sample (s) submitted only and the report/certificate cannot be reproduced in any way, except in full context and with the prior approval in writing from Sucofindo Laboratory

CBT101386218.1010

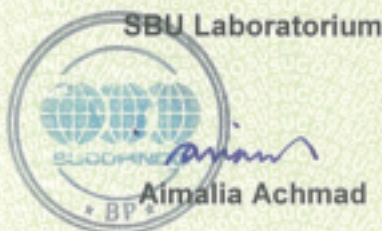

084563



**SUCOFINDO**

Issuing Office:

Phone/Facs: +62 21 88321176/88321166

Jl. Arteri Tol Cibitung No. 1, Cibitung Bekasi 17520, Indonesia

Email: jum.cbt@sucofindo.co.id

## REPORT OF ANALYSIS

Parameter	Unit	Test Results	Threshold Limit Value	Methods *) Part Number
<i>Parameter I</i>				
<i>a). Microbiological</i>				
Total Coliform	colony / 100 mL	0	0	9222 B
Escherichia Coli	colony / 100 mL	0	0	9222 G
<i>b). Inorganic Chemical</i>				
Arsenic	mg/L	< 0.001	0.01	3114 C
Fluoride	mg/L	< 0.06	1.5	4500-F-D
Chromium Total	mg/L	< 0.01	0.05	3120 B, 3030 E
Cadmium	mg/L	< 0.001	0.003	3113 B
Nitrite as NO <sub>2</sub> <sup>-</sup>	mg/L	0.18	3	4500-NO <sub>2</sub> -B
Nitrate as NO <sub>3</sub> <sup>-</sup>	mg/L	4.30	50	4500-NO <sub>3</sub> -B
Cyanide	mg/L	< 0.01	0.07	4500-CN-E
Selenium	mg/L	< 0.001	0.01	3114 C
<i>Parameter II</i>				
<i>a). Physical</i>				
Odor	-	Odorless	Odorless	2150 B
Color	TCU	< 1.09	15	2120 C
Total Dissolved Solid	mg/L	255	500	PO/LK/40
Turbidity	NTU	< 0.22	5	2130 B
Taste	-	Tasteless	Tasteless	2160 C
Temperature **	C	20	Ambient Temp. ± 3 °C	2550 B
<i>b). Chemical</i>				
Aluminum	mg/L	< 0.01	0.2	3120 B, 3030 E
Iron	mg/L	< 0.02	0.3	3120 B, 3030 E
Total Hardness as CaCO <sub>3</sub>	mg/L	92.0	500	2340 B
Chloride	mg/L	18.7	250	4500-Cl-D
Manganese	mg/L	< 0.01	0.4	3120 B, 3030 E
pH	-	7.4	6.5 – 8.5	4500-H <sup>+</sup> -B
Zinc	mg/L	< 0.01	3	3120 B, 3030 E
Sulfate	mg/L	54.3	250	4500-SO <sub>4</sub> <sup>2-</sup> E
Copper	mg/L	< 0.01	2	3120 B, 3030 E
Ammonia	mg/L	< 0.01	1.5	4500-NH <sub>3</sub> -F

Parameter I is the parameter which have direct connection with human healthy

Parameter II is the parameter which have indirect connection with human healthy

\*) Standard Methods, 22<sup>nd</sup> Edition 2012, APHA-AWWA-WEF

\*\*) Excluded the scope of accreditation KAN

< = Less than the detection limit indicated

**Note :**

Based on attachment II of the regulation Health Minister Decree No. : 492/MENKES/PER/IV/2010, all parameter above must be tested and reported according to requirements for Drinking Water Quality and ongoing quality monitoring.

For another parameter of drinking water quality which are not mentioned in this test result, it should be tested especially if there is any suspected or indication of pollution substance i.e. : Microbiological, Inorganic chemical, Organic Chemical, Pesticides Compound and Radioactivity, as per attached in appendix I of the regulation

