

# Calibration Columns



CC Series Calibration Columns have been developed for the accurate calibration of metering pumps.



Tube



Ends

SERIES: CCA-X

CAPACITIES: Up to 20,000 ml<sup>1</sup>

CONNECTIONS: 1/2", 1" and 2"²

MATERIALS: Clear PVC tube, PVC ends³



<sup>1</sup> ml and GPH (water) scale is supplied as standard

<sup>2</sup> Other clear tube materials and configurations are available upon request

## Features

### Clear Visual Indication

### Easy Installation and Maintenance

### Ideal for All Types of Plastic Piping

- All types of end connections for rigid plastic pipe or PFA tubing
- **Maximum Temperature:** 60C (140°F)
- **Maximum Pressure:** 16 psig

### X-Style:

- 1 = Bottom threaded connection only
- 2 = Top/Bottom threaded connections
- 3 = Bottom threaded connection complete with removeable vented dust cap
- 4 = Top/bottom threaded connection complete with removable o-ring seal top and float ring indicator

### Optional Features

- End cap connections of BSP Thread, ASTM or DIN Socket and ANSI, DIN or JIS Flange
- Highly visible float for CC1 and CC3 products

### Top Connection Styles



CCA1


CCA2

CCA3

CCA4


**DIMENSIONS** INCHES

Size	Item No.	Capacity		øB	A			øC	
		ml	USGPH		Style 1	Style 2,4	Style 3	Style 1	Style 2,3,4
1/2"	CCA2-100-005T	100	1.6	1.4	10.2	10.50	10.7	1.1	1.4
	CCA2-250-005T	250	4.0	1.9	11.0	11.25	11.5	1.6	1.9
	CCA2-500-005T	500	8.0	2.4	12.2	12.50	12.7	2.1	2.4
	CCA2-1000-005T	1,000	16.0	2.8	16.2	16.50	16.8	2.5	2.8
1"	CCA2-2000-010T	2,000	32.0	3.5	20.2	20.50	20.7	3.1	3.5
	CCA2-4000-010T	4,000	64.0	4.5	22.2	22.50	22.7	4.1	4.5
2"	CCA2-10000-020T	10,000	160.0	6.9	22.6	23.00	23.2	6.5	6.9
	CCA2-15000-020T	15,000	240.0	6.9	33.0	32.50	33.0	6.5	6.9
	CCA2-20000-020T	20,000	321.0	6.9	42.2	43.00	42.3	6.5	6.9

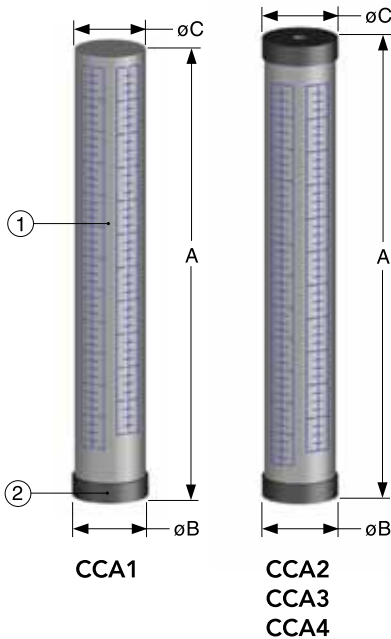

No.	Part	Pcs.	Materials
1	Tube	1	Clear PVC
2	Ends	2	PVC

**Typical dosing system schematic**

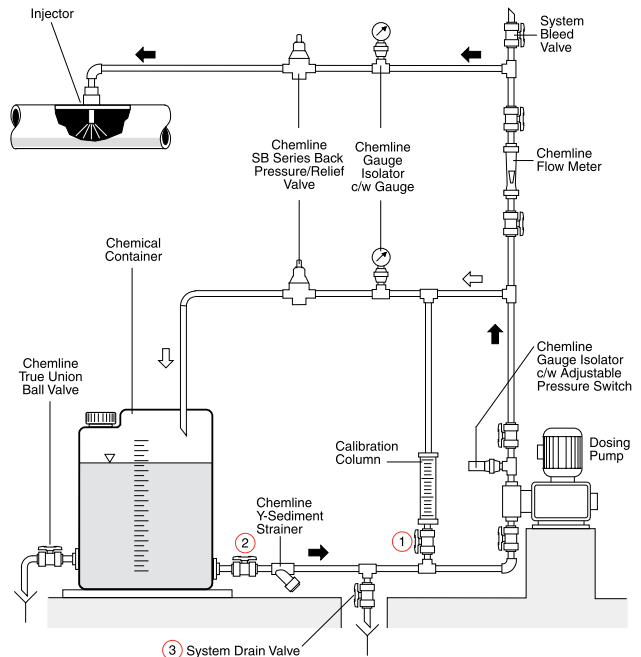

**Calibration instructions**

**NOTE:** Before starting either of the calibration procedures below, ensure that the pump is primed and void of any trapped air.

**Using the USGPM scale:** (scale based on **time**, in one (1) minute volume discharge)

1. Fill the calibration column to the top "0" mark on the USGPH scale.
2. Close isolation valve (#2) from the supply tank and drain valve (#3). Open isolation valve (#1) below column and start the pump.
3. Use a stopwatch to measure the time of one (1) minute (60) seconds and record the volume dispensed by the metering pump using the draw down scale.
4. Adjust the pump volume control higher or lower to meet with your desired output.
5. Repeat above sets 1 through 4, until the desired output is met.
6. Divide the measured USGPH number by 60 to determine the **USGPM volume**, if required.

If you wish to shorten the time of dispensing for calibration by one half (1/2) or one quarter (1/4), you must multiply the measured volume by the same number used to divide the time by.

- e.g. 10 USGPH in 1 minute equals
- 5 USGPH x 2 in 30 seconds or
- 2.5 USGPH x 4 in 15 seconds

**Using the ml scale:** (scale based on **volume** pumped, over any given time)

1. Fill the calibration column to the top "0" mark on the ml scale.
2. Close isolation valve (#2) from the supply tank and drain valve (#3). Open isolation valve (#1) below column and start the pump.
3. Use a stopwatch to measure the time it takes to pump down a given volume (ml) in 60 seconds.
4. Multiply the volume by 60 to determine the **ml per hour** volume, if required.
5. Adjust the pump volume control higher or lower to meet with your desired output.
6. Repeat above sets 1 through 5, until the desired output is met.

If you wish to shorten the time of dispensing for calibration by one half (1/2) or one quarter (1/4), you must multiply the volume by the same number used to divide the time by to determine ml per minute or hour.

- e.g. 100 ml in 60 seconds equals
- 50 ml x 2 in 30 seconds or
- 25 ml x 4 in 15 seconds

# CC Series Calibration Columns

## SAMPLE SPECIFICATION

1. The Calibration Columns shall be manufactured from highly-translucent polyvinyl chloride (PVC) material.
2. Graduations shall be easy-to-read imprinted white lettering with PP coating to ensure chemical resistance.
3. Graduations shall have dual-scale USGPH and mL, with ascending and descending increments.
4. The Calibration Columns shall be available with end cap connections of NPT (Female), but optional connection types are listed below.
5. All connections will be CNC machined or injection moulded from PVC material.
6. All bottom connections will come with NPT (Female) threading.
7. The top connection will be either open, NPT threaded end cap, removeable vented dust cap or removeable NPT threaded end cap that is CNC machined or injection moulded from PVC material.
8. Calibration Columns with the removeable top end cap (CC4) are convenient for cleaning the cylinder and will include a highly -visible float to improve graduation measurement.

## Styles



## ORDERING EXAMPLE

<b>Chemline Calibration Columns</b>	<b>CC</b>	<b>A</b>	<b>2</b>	<b>-100</b>	<b>005</b>	<b>T</b>	<b>-</b>
Body Material	<b>A – PVC</b> <b>B – PP</b>						
Style	<b>1 – Bottom threaded connection only</b> <b>2 – Top/Bottom threaded connections</b> <b>3 – Bottom threaded connection complete with removeable vented dust cap</b> <b>4 – Bottom threaded connection complete with removeable o-ring seal top and float ring indicator</b>						
Capacity	<b>100</b>	<b>250</b>	<b>500</b>	<b>1,000</b>	<b>2,000</b>	<b>4,000</b>	<b>10,000</b> <b>15,000</b> <b>20,000</b>
Size	<b>005 – 1/2"</b>		<b>010 – 1"</b>		<b>020 – 2"</b>		
Connections	<b>T – FNPT Threaded</b>			<b>S – Socket</b>		<b>F – Flanged</b>	
Seals <sup>1</sup>	<b>E – EPDM</b>		<b>V – FKM (Viton®)</b>				

**Example:** Chemline CC Series Calibration Column, PVC, Style 2, 100 mL flow capacity, 1/2", FNPT threaded ends.

<sup>1</sup> For Style 4 only





**JJ DOWNS INDUSTRIAL PLASTICS INC.**

416.236.1884    Toronto, ON    JJDOWNS.COM