



OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Accolade Plus/Infinity sheet vinyl

Prepared for: Armstrong Flooring Pty Ltd
Deep Shah
29-39 Mills Road
BRAESIDE VIC 3195

Specimen Description: Accolade Plus/Infinity sheet vinyl, 500x1000 mm.

No. of Specimens: 1 off

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Unfixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A

Air Temperature: 22°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

Test Date: 18 October 2021

Test Personnel: Dale Siegle and Marcus Braché

Displacement Space (rounded to the nearest 0.5cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 - 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	13°
Classification:	R10

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Reviewed By:



Dale Siegle
Compliance and Test Technician
Approved Signatory



Daniel King BSc/BEng (mat) Hons., MIEAust
General Manager - Compliance Services
Approved Signatory

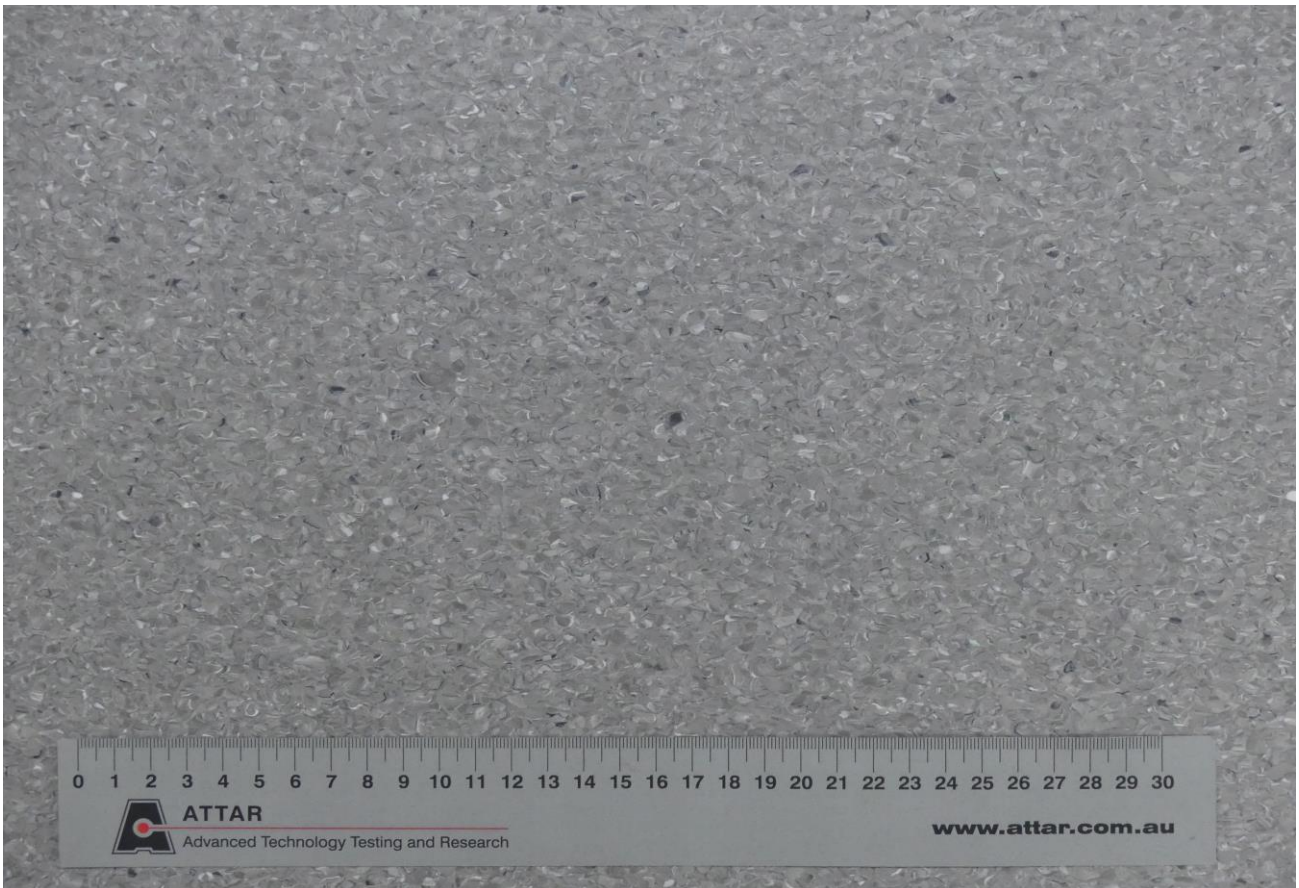


Figure 1: Accolade Plus/Infinity sheet vinyl



CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

Classification	Angle, degrees
No Classification	<6
R9	$\geq 6 < 10$
R10	$\geq 10 < 19$
R11	$\geq 19 < 27$
R12	$\geq 27 < 35$
R13	≥ 35