





2x 750 Series Heater Connection Guidance

Date: 10.24.22

Purpose:

This document shows quick guidance on connecting two 750 Series solar air heaters in series to achieve the same heating rating of a single 1500 Series heater using an external wood framing.

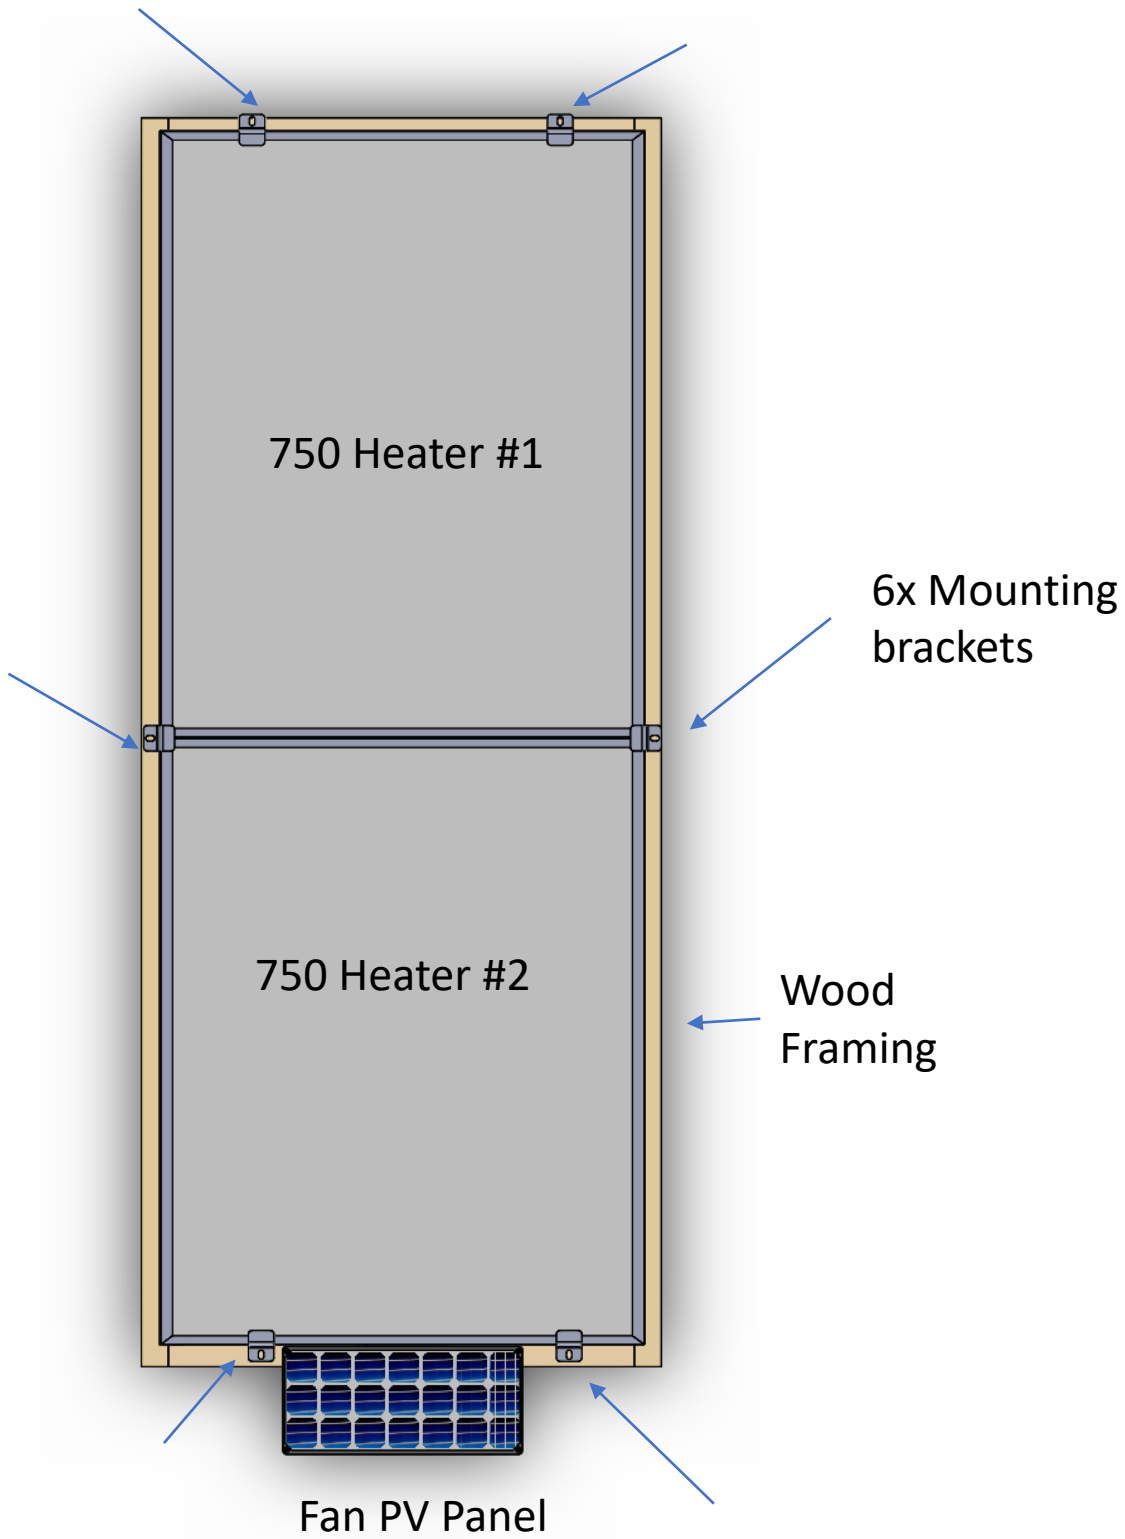

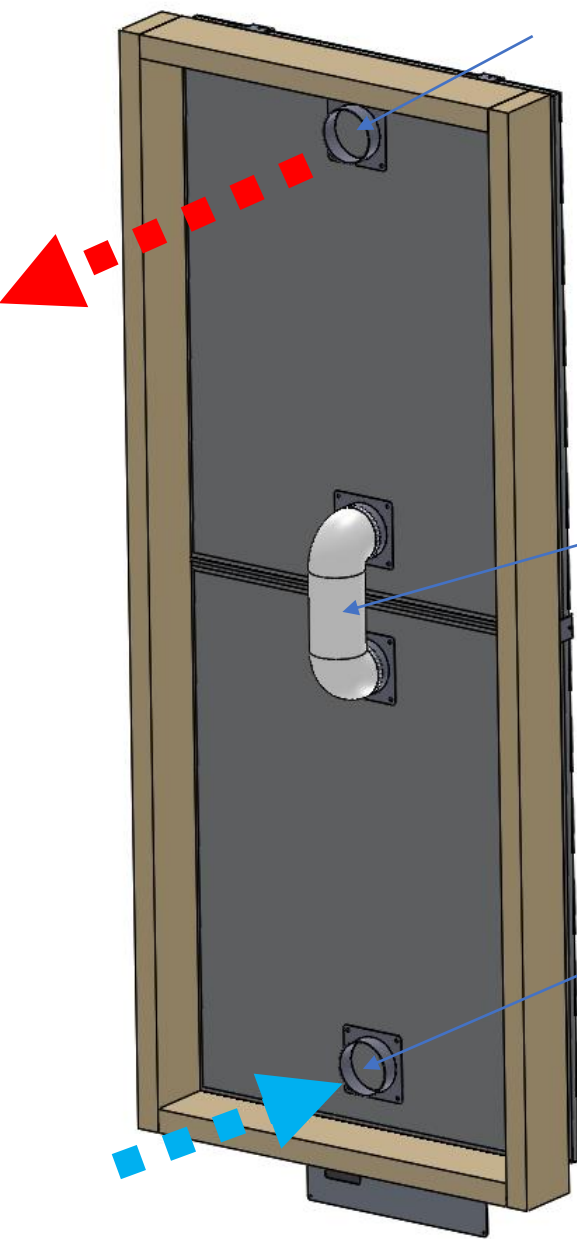

Exhaust collar with gravity damper + thermal switch insert location – hot air out

Heater exhaust to heater intake connection – 4" flexible duct or box duct connection

Intake Collar Assembly (fan) – cool air in

5-6" deep wood framing off the mounting wall