
# How to Build a Partial Home Backup System (EU Standard)

#### Declaration

- · It is crucial to have a licensed electrician perform the installation. Improper installation could result in property damage or serious injury, including death.
- · This document is solely for reference purposes and is not legal advice. For further information, please consult with a local licensed electrician.
- · BLUETTI cannot be held liable for any damage or injury resulting from an incorrectly installed backup system.
- 1. How to Build a Partial Home Backup System with **BLUETTI** EP500Pro/AC300+B300/EP500/AC200MAX Power Station. (3000Watt system and lower)



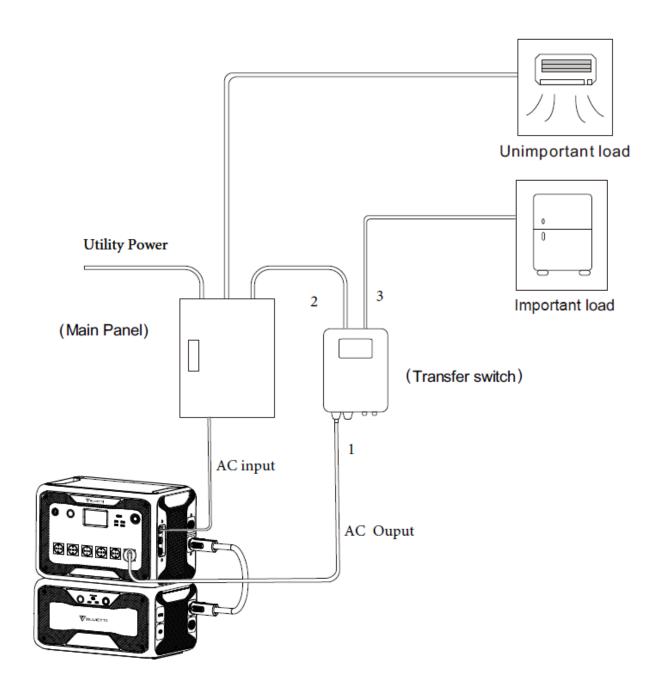

#### Purchase link:

(BLUETTI does not have any commercial relationship with this particular brand. You are free to choose other brands with the same functionality.):


https://www.amazon.de/Hager-sft225-Switch-Modular-2-polig/dp/B00F8OWF38

We will make a plan as follows:

- 1) Switch to I is using the EP500 Pro /AC300+B300 supply. We have UPS mode, so owners can switch to I all the time until EP500 Pro /AC300+B300 has something wrong.
- 2) When something is faulty on the EP500 Pro /AC300+B300, we need to switch to **II** and use the public grid supply.
- 3) If the public power grid is always out of service, please Switch to I to use EP600 UPS mode. If not, switch to II

\_\_\_\_\_

2. How to build a partial home backup system with BLUETTI AC500+B300S (5000Watt, 3072Wh~18432Wh)

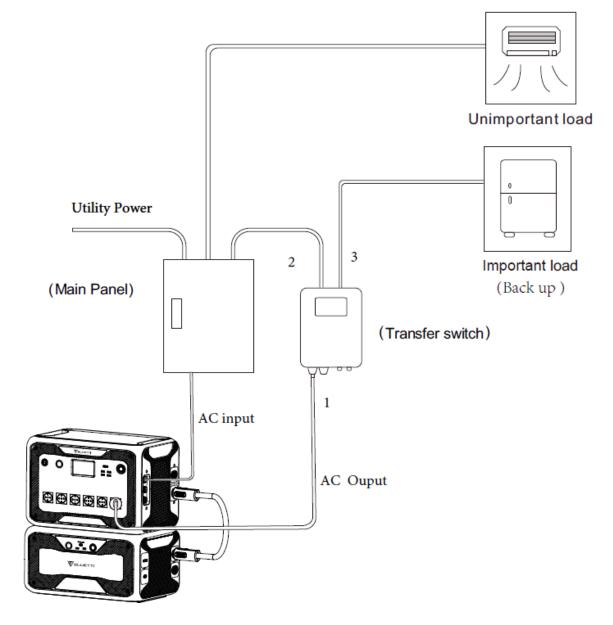


You need to purchase a transfer switch as follows:



### Purchase link


(BLUETTI does not have any commercial relationship with this particular brand. You are free to choose other brands with the same functionality.):

https://www.amazon.de/HAGER-SFT440-Commutatore-tetrapolare-moduli/dp/B00SCD72NA

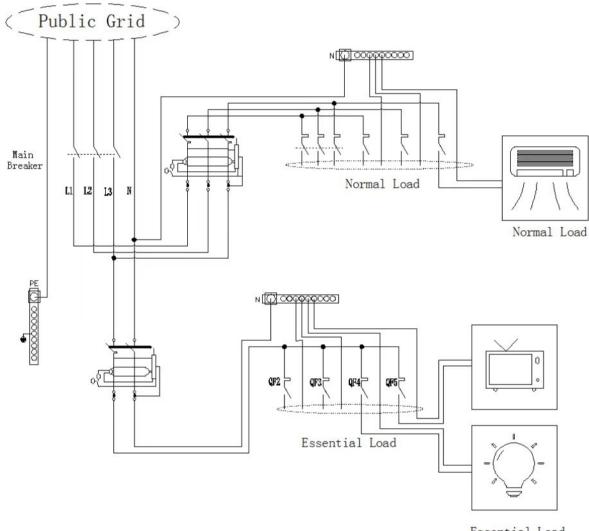

Essential Load

Then, connect the AC500+B300S and transfer the switch to the home circuit as follows:

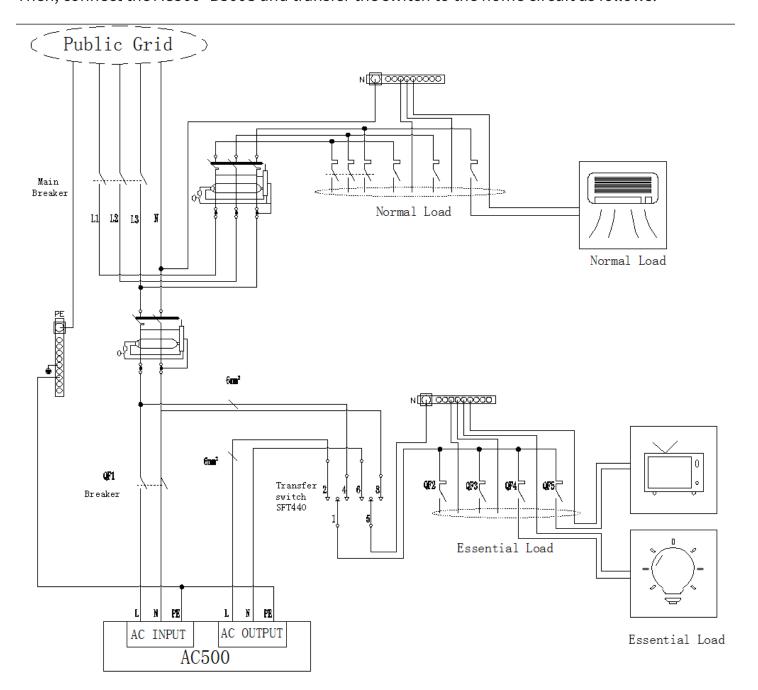

**Steps for Connecting the transfer switch to the AC500+B300S:** 

- 1. Connect the L/N wires from AC500 AC output to the SFT440' s pin 2(L), pin 6(N)
- 2. Connect the L/N wires from public Grid to the SFT440's pin 4(L), pin 8(N),
- 3. Move away the wires from the pubic grid on the essential appliances' breakers, then connect pin1(L), and pin 5(N) of SFT440 to the essential appliances' breakers.
- 4. All the essential load power must be lower than 5000VA

## For further information:

Website: www.bluettipower.eu

Email: sale-eu@bluettipower.com / sale-uk@bluettipower.com