


4

3

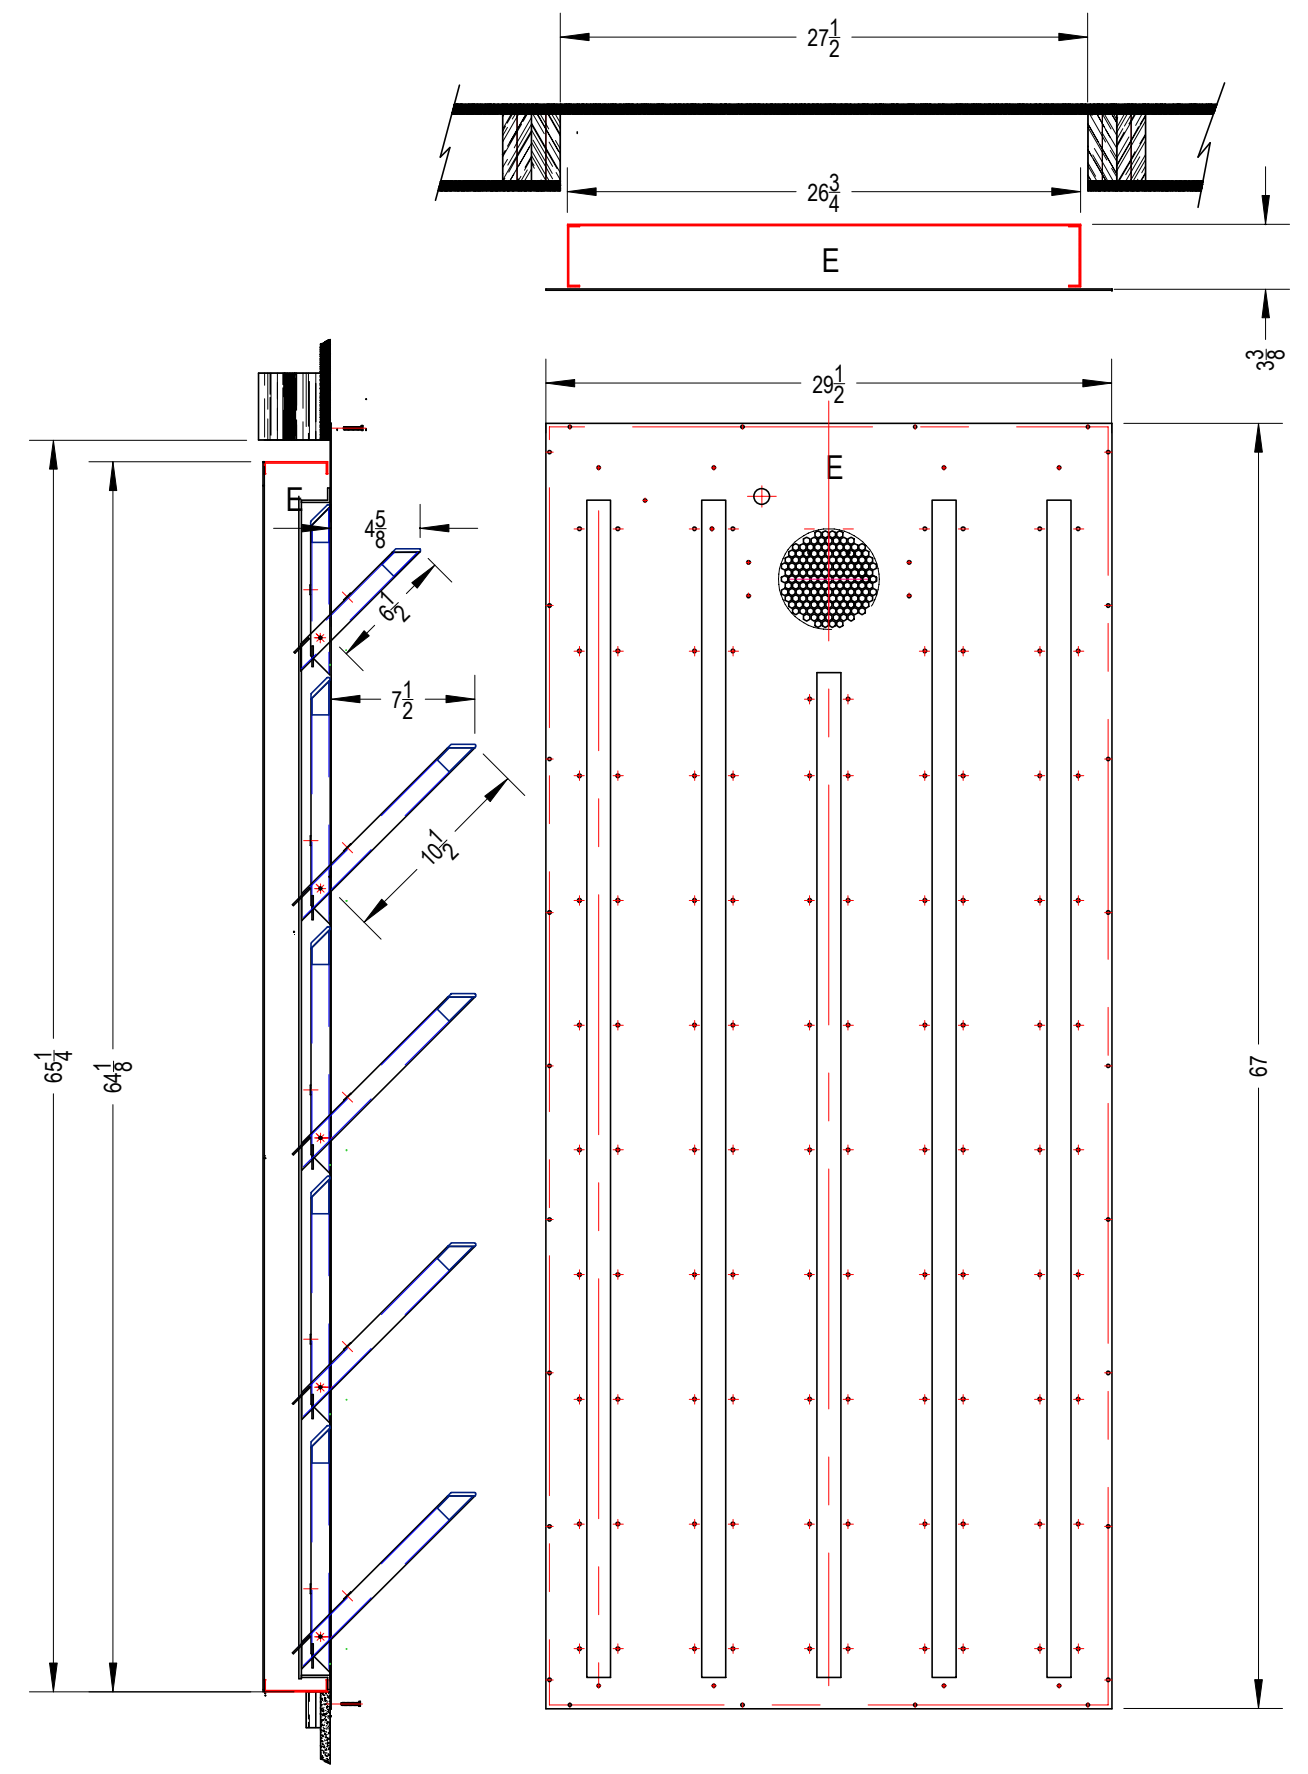

FOR INSTALLATION ON 16" CENTER STUDS
 ROUGH OPENING 27 1/2" X 65 1/4"

ELECTRICAL CONNECTION AT CENTER OF TOP
 AS NOTED "E"

TIMER TO BE LOCATED REMOTELY BY INSTALLER
 TIMER SUPPLIED: INTERMATIC EI230 OR EI220

110 V AC
 1300 W

INSTALL PER APPLICABLE ELECTRICAL CODE
 BY LICENCED ELECTRICIAN



PROJECT		PUELICHE DRYER F10+	
TITLE		INSTALL DETAILS	
DWG NO	74108	SCALE	MAR 2022
REV	1	SHEET	

4

3



2

1