



PNOZ m EF 16DI




pilz

Configurable Control System PNOZmulti

This document is a translation of the original document.

All rights to this documentation are reserved by Pilz GmbH & Co. KG. Copies may be made for internal purposes. Suggestions and comments for improving this documentation will be gratefully received.

Pilz®, PIT®, PMI®, PNOZ®, Primo®, PSEN®, PSS®, PVIS®, SafetyBUS p®, SafetyEYE®, SafetyNET p®, the spirit of safety® are registered and protected trademarks of Pilz GmbH & Co. KG in some countries.



Section 1	Introduction	4
	1.1 Validity of documentation	4
	1.2 Retaining the documentation	4
	1.3 Definition of symbols	4
Section 2	Overview	6
	2.1 Scope of supply	6
	2.2 Unit features	6
	2.3 Front view	7
Section 3	Safety	8
	3.1 Intended use	8
	3.2 System requirements	8
	3.3 Safety regulations	8
	3.3.1 Use of qualified personnel	8
	3.3.2 Warranty and liability	8
	3.3.3 Disposal	9
	3.3.4 For your safety	9
Section 4	Function description	10
	4.1 Integrated protection mechanisms	10
	4.2 Functions	10
	4.3 System reaction time	10
	4.4 Block diagram	10
Section 5	Installation	11
	5.1 General installation guidelines	11
	5.2 Dimensions	11
	5.3 Connecting the base unit and expansion modules	11
Section 6	Commissioning	12
	6.1 Wiring	12
	6.2 Download modified project to the PNOZmulti safety system	12
	6.3 Connection	12
Section 7	Operation	13
	7.1 Messages	13
Section 8	Technical details	14
	8.1 Safety characteristic data	16
Section 9	Order reference	17

1 Introduction

1.1 Validity of documentation

This documentation is valid for the product PNOZ m EF 16DI. It is valid until new documentation is published.

This operating manual explains the function and operation, describes the installation and provides guidelines on how to connect the product.

1.2 Retaining the documentation

This documentation is intended for instruction and should be retained for future reference.

1.3 Definition of symbols

Information that is particularly important is identified as follows:



DANGER!

This warning must be heeded! It warns of a hazardous situation that poses an immediate threat of serious injury and death and indicates preventive measures that can be taken.



WARNING!

This warning must be heeded! It warns of a hazardous situation that could lead to serious injury and death and indicates preventive measures that can be taken.



CAUTION!

This refers to a hazard that can lead to a less serious or minor injury plus material damage, and also provides information on preventive measures that can be taken.



NOTICE

This describes a situation in which the product or devices could be damaged and also provides information on preventive measures that can be taken. It also highlights areas within the text that are of particular importance.



INFORMATION

This gives advice on applications and provides information on special features.

2 Overview

2.1 Scope of supply

- ▶ Expansion module PNOZ m EF 16DI
- ▶ Jumper 779 260

2.2 Unit features


Using the product PNOZ m EF 16DI:

Expansion module for connection to a base unit from the configurable control system .

The product has the following features:

- ▶ Can be configured in the PNOZmulti Configurator
- ▶ 16 inputs for connecting, for example:
 - E-STOP pushbutton
 - Two-hand button
 - Safety gate limit switch
 - Start button
 - Light beam devices
 - Scanner
 - Enabling switch
 - PSEN
 - Operating mode selector switch
- ▶ LED for:
 - Error messages
 - Diagnostics
- ▶ Test pulse outputs used to monitor shorts across the inputs
- ▶ Plug-in connection terminals:
Either spring-loaded terminal or screw terminal available as an accessory (see order reference)
- ▶ Please refer to the document "PNOZmulti System Expansion" for the PNOZmulti base units that can be connected

2.3 Front view

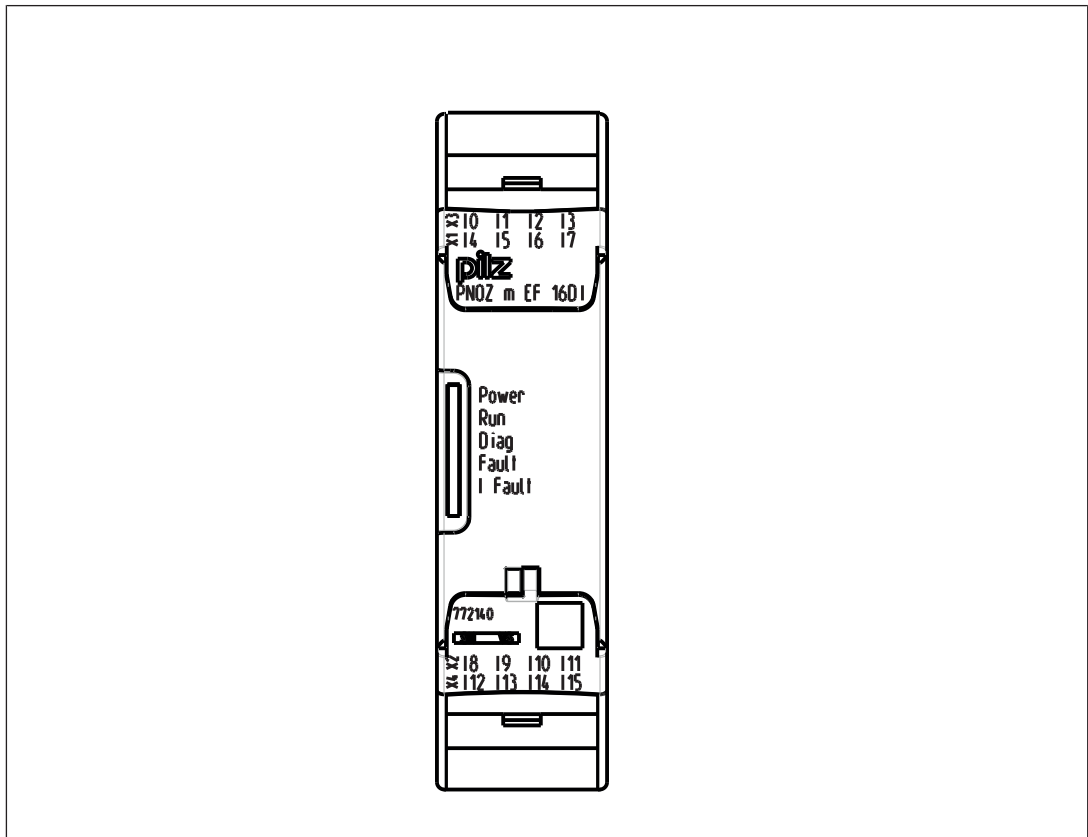

Legend:

- ▶ Inputs I0 – I15
- ▶ LEDs:
 - POWER
 - Run
 - Diag
 - Fault
 - I Fault

3 Safety

3.1 Intended use

The expansion module may only be connected to a base unit from the configurable control system (please refer to the document "PNOZmulti System Expansion" for details of the base units that can be connected).

The configurable control system is used for the safety-related interruption of safety circuits and is designed for use in:

- ▶ E-STOP equipment
- ▶ Safety circuits in accordance with VDE 0113 Part 1 and EN 60204-1

3.2 System requirements

Please refer to the "Product Modifications" document in the "Version overview" section for details of which versions of the base unit and PNOZmulti Configurator can be used for this product.

3.3 Safety regulations

3.3.1 Use of qualified personnel

The products may only be assembled, installed, programmed, commissioned, operated, maintained and decommissioned by competent persons.

A competent person is someone who, because of their training, experience and current professional activity, has the specialist knowledge required to test, assess and operate the work equipment, devices, systems, plant and machinery in accordance with the general standards and guidelines for safety technology.

It is the company's responsibility only to employ personnel who:

- ▶ Are familiar with the basic regulations concerning health and safety / accident prevention
- ▶ Have read and understood the information provided in this description under "Safety"
- ▶ And have a good knowledge of the generic and specialist standards applicable to the specific application.

3.3.2 Warranty and liability

All claims to warranty and liability will be rendered invalid if

- ▶ The product was used contrary to the purpose for which it is intended
- ▶ Damage can be attributed to not having followed the guidelines in the manual
- ▶ Operating personnel are not suitably qualified
- ▶ Any type of modification has been made (e.g. exchanging components on the PCB boards, soldering work etc.).

3.3.3 Disposal

- ▶ In safety-related applications, please comply with the mission time t_M in the safety-related characteristic data.
- ▶ When decommissioning, please comply with local regulations regarding the disposal of electronic devices (e.g. Electrical and Electronic Equipment Act).

3.3.4 For your safety

The unit meets all necessary conditions for safe operation. However, you should always ensure that the following safety requirements are met:

- ▶ This operating manual only describes the basic functions of the unit. Information on the advanced functions can be found in the online help for the PNOZmulti Configurator and in the PNOZmulti technical catalogue. Only use these functions after you have read and understood the documentation. All necessary documentation can be found on the PNOZmulti Configurator CD.
- ▶ Do not open the housing or make any unauthorised modifications.
- ▶ Please make sure you shut down the supply voltage when performing maintenance work (e.g. exchanging contactors).

4 Function description

4.1 Integrated protection mechanisms

The relay conforms to the following safety criteria:

- ▶ The circuit is redundant with built-in self-monitoring.
- ▶ The safety function remains effective in the case of a component failure.

4.2 Functions

The expansion module provides additional inputs.


The function of the inputs on the safety system depends on the safety circuit created using the PNOZmulti Configurator. A chip card is used to download the safety circuit to the base unit. The base unit has 2 microcontrollers that monitor each other. They evaluate the input circuits on the base unit and expansion modules and switch the outputs on the base unit and expansion modules accordingly.

The online help on the PNOZmulti Configurator contains descriptions of the operating modes and all the functions of the PNOZmulti safety system, plus connection examples.

4.3 System reaction time

Calculation of the maximum reaction time between an input switching off and a linked output in the system switching off is described in the document "System Expansion".

4.4 Block diagram

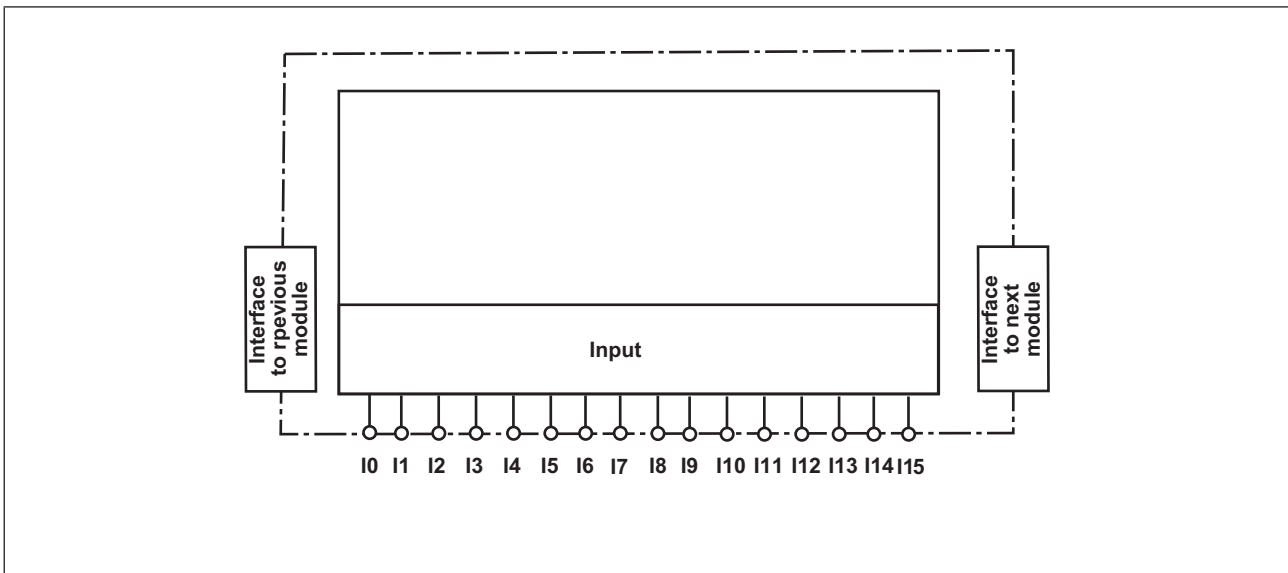

5 Installation

5.1 General installation guidelines

- ▶ The unit should be installed in a control cabinet with a protection type of at least IP54.
- ▶ Fit the safety system to a horizontal mounting rail. The venting slots must face upward and downward. Other mounting positions could damage the safety system.
- ▶ Use the locking elements on the rear of the unit to attach it to a mounting rail.
- ▶ In environments exposed to heavy vibration, the unit should be secured using a fixing element (e.g. retaining bracket or end angle).
- ▶ Open the locking slide before lifting the unit from the mounting rail.
- ▶ To comply with EMC requirements, the mounting rail must have a low impedance connection to the control cabinet housing.
- ▶ The ambient temperature of the PNOZmulti units in the control cabinet must not exceed the figure stated in the technical details, otherwise air conditioning will be required.




CAUTION!

Damage due to electrostatic discharge!

Electrostatic discharge can damage components. Ensure against discharge before touching the product, e.g. by touching an earthed, conductive surface or by wearing an earthed armband.

5.2 Dimensions

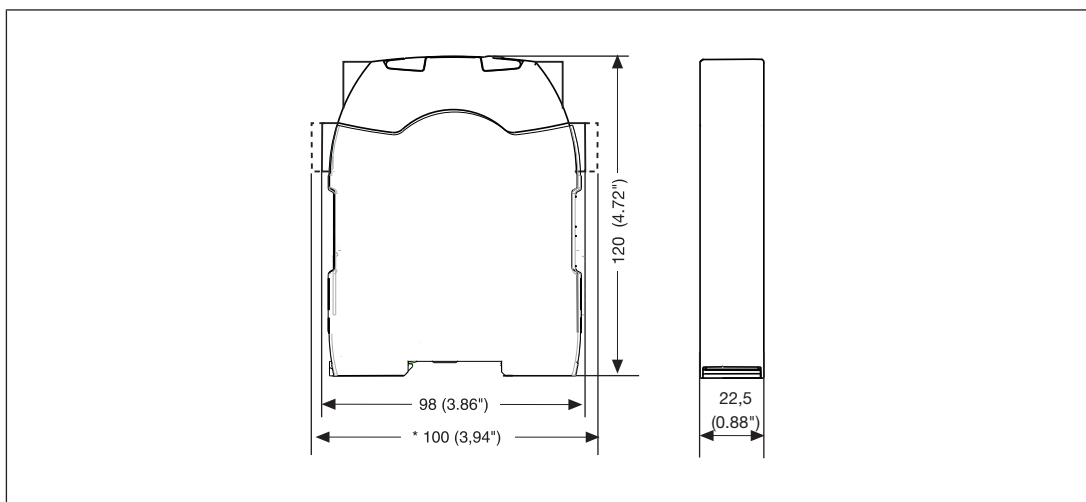

5.3 Connecting the base unit and expansion modules

Connect the base unit and the expansion modules as described in the operating manuals for the base modules.

- ▶ The terminator must be fitted to the last expansion module
- ▶ Install the expansion module in the position configured in the PNOZmulti Configurator.

6 Commissioning

6.1 Wiring

The wiring is defined in the circuit diagram of the PNOZmulti Configurator.

Please note:

- ▶ Information given in the "Technical details" must be followed.
- ▶ Use copper wire that can withstand 75°C.

6.2 Download modified project to the PNOZmulti safety system

As soon as an additional expansion module has been connected to the system, the project must be amended using the PNOZmulti Configurator. Proceed as described in the operating instructions for the base unit.



NOTICE

For the commissioning and after every program change, you must check whether the safety devices are functioning correctly.

6.3 Connection

input circuit	Single-channel	Dual-channel
Example: Emergency stop without detection of shorts across contacts		
Example: Emergency stop with detection of shorts across contacts		

Connection examples for the input circuit

7 Operation

When the supply voltage is switched on, the PNOZmulti safety system copies the configuration from the chip card.

The LEDs "POWER", "DIAG", "FAULT", "IFAUULT" and "OFAULT" light up on the base unit.

The PNOZmulti control system is ready for operation when the "POWER" and "RUN" LEDs on the base unit are lit continuously.

7.1 Messages

Legend:

	LED on
	LED flashes
	LED off

Fault					
PO WE R	Run	Dia g	Fau lt	IFa ult	
					No supply voltage
✘	✘				Expansion module PNOZ m EF 16DI is running without error
✘					Expansion module PNOZ m EF 16DI is in a STOP condition
✘			◀		Internal error on the expansion module PNOZ m EF 16DI or on the overall system. Expansion module is in a safe condition.
✘			✘		External error on the expansion module PNOZ m EF 16DI or on the overall system. Expansion module is in a safe condition.
✘				◀	Internal error on the inputs of the expansion module PNOZ m EF 16DI. Expansion module is in a safe condition, e.g. pulse error.
✘				✘	External error on the inputs of the expansion module PNOZ m EF 16DI. Expansion module is in a safe condition.

8 Technical details

General	772140
Approvals	BG, CCC, CE, GOST, TÜV, cULus Listed
Application area	Failsafe
Module's device code	00E2h
Electrical data	772140
Supply voltage	
For	Module supply
Internal	Via base unit
Voltage	24,0 V
Type	DC
Current consumption	46 mA
Power consumption	1,1 W
Max. power dissipation of module	3,00 W
Status indicator	LED
Inputs	772140
Number	16
Input voltage in accordance with EN 61131-2 Type 1	24 V DC
Input current at rated voltage	5 mA
Input current range	2,5 - 5,3 mA
Pulse suppression	0,5 ms
Maximum input delay	8 ms
Potential isolation	No
Environmental data	772140
Ambient temperature	
In accordance with the standard	EN 60068-2-14
Temperature range	0 - 60 °C
Forced convection in control cabinet off	55 °C
Storage temperature	
In accordance with the standard	EN 60068-2-1/-2
Temperature range	-25 - 70 °C
Climatic suitability	
In accordance with the standard	EN 60068-2-30, EN 60068-2-78
Condensation during operation	Not permitted
EMC	EN 61131-2
Vibration	
In accordance with the standard	EN 60068-2-6
Frequency	5,0 - 150,0 Hz
Acceleration	1g
Shock stress	
In accordance with the standard	EN 60068-2-27
Acceleration	15g
Duration	11 ms
Max. operating height above sea level	2000 m

Environmental data		772140
Airgap creepage		
In accordance with the standard		EN 61131-2
Overvoltage category		II
Pollution degree		2
Rated insulation voltage		30 V
Protection type		
In accordance with the standard		EN 60529
Mounting (e.g. cabinet)		IP54
Housing		IP20
Terminals		IP20
Mechanical data		772140
Mounting position		Horizontal on top hat rail
DIN rail		
Top hat rail		35 x 7,5 EN 50022
Recess width		27 mm
Max. cable length		
Max. cable length per input		1,0 km
Material		
Bottom		PC
Front		PC
Top		PC
Conductor cross section with screw terminals		
1 core flexible		0,25 - 2,50 mm², 24 - 12 AWG
2 core with the same cross section, flexible without crimp connectors or with TWIN crimp connectors		0,20 - 1,50 mm², 24 - 16 AWG
Torque setting with screw terminals		0,50 Nm
Connection type		Spring-loaded terminal, screw terminal
Mounting type		plug in
Conductor cross section with spring-loaded terminals: flexible with/without crimp connector		0,20 - 2,50 mm², 24 - 12 AWG
Spring-loaded terminals: Terminal points per connection		2
Stripping length		9 mm
Dimensions		
Height		101,4 mm
Width		22,5 mm
Depth		120,0 mm
Weight		95 g

The standards current on 2012-08 apply.

8.1 Safety characteristic data

Unit	Operating mode	EN ISO 13849-1: 2008 PL	EN ISO 13849-1: 2008 Category	EN IEC 62061 SIL CL	EN IEC 62061 PFH _D [1/h]	EN ISO 13849-1: 2008 T _M [year]
Logic						
CPU	–	PL e	Cat. 4	SIL CL 3	2,84E-10	20
Input						
SC inputs	1-channel	PL d	Cat. 2	SIL CL 2	2,10E-09	20
SC inputs	2-channel	PL e	Cat. 4	SIL CL 3	4,27E-11	20
SC inputs	1-ch., pulsed light beam device	PL e	Cat. 4	SIL CL 3	2,10E-10	20

All the units used within a safety function must be considered when calculating the safety characteristic data.



INFORMATION

A safety function's SIL/PL values are **not** identical to the SIL/PL values of the units that are used and may be different. We recommend that you use the PAScal software tool to calculate the safety function's SIL/PL values.

9 Order reference

Order reference		
Product type	Features	Order no.
PNOZ m EF 16DI	Expansion module	772 140
Order reference: Accessories		
Product type	Features	Order no.
Set spring terminals	1 set of spring-loaded terminals	751 004
Set screw terminals	1 set of screw terminals	750 004
Order reference: Terminator, jumper		
Product type	Features	Order no.
PNOZ mm0.xp connector left	Jumper yellow/black to connect the modules, 1 piece	779 260



Pilz GmbH & Co. KG
Felix-Wankel-Straße 2
73760 Ostfildern, Germany
Telephone: +49 711 3409-0
Telefax: +49 711 3409-133
E-Mail: pilz.gmbh@pilz.de
Internet: www.pilz.com

► ...
In many countries we are represented by our subsidiaries and sales partners.

Please refer to our homepage for further details or contact our headquarters.

► Technical support

+49 711 3409-444
support@pilz.com

pilz