

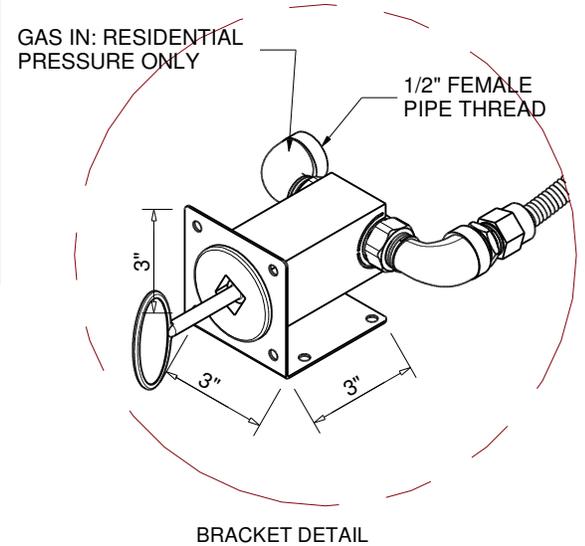
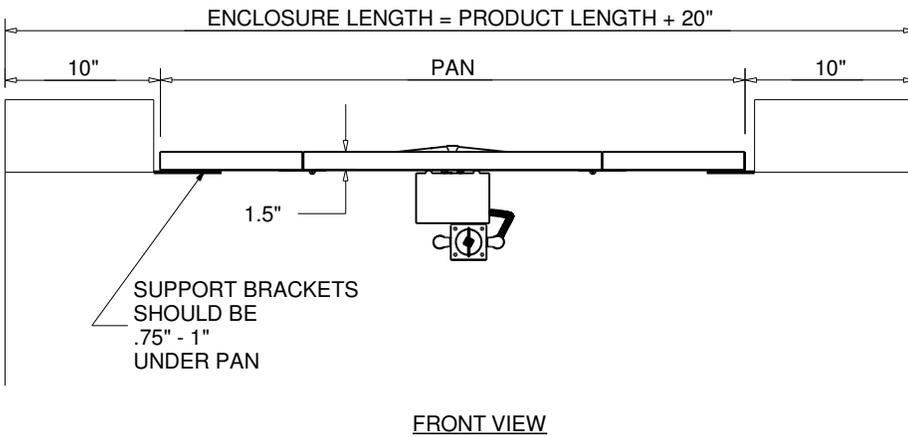


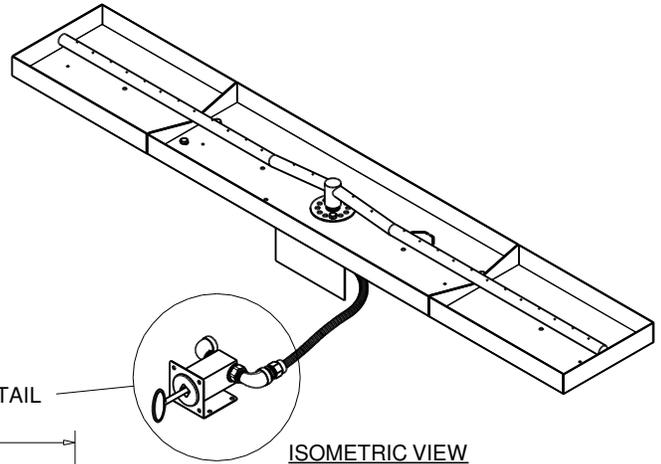

**Hearth Products Controls Co**  
**CSA CERTIFIED-OUTDOOR USE ONLY**  
**FOR COMMERCIAL AND RESIDENTIAL USE**

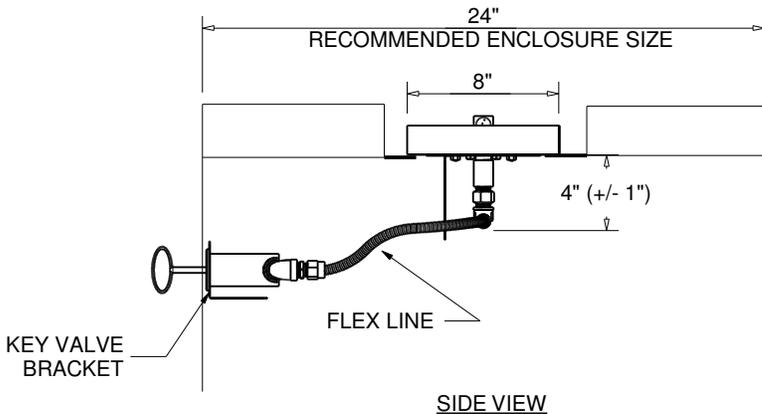

MATERIAL: 304 STAINLESS STEEL

PART NUMBERS	DIMENSION CHART			STND FLEX LINE LENGTH
	PAN	BURNER		
		SIZE	BTU	
MLFPK25X8-L-FLEX	25"	24"	50K	36"
MLFPK37X8-L-FLEX	37"	36"	65K	36"
MLFPK49X8-L-FLEX	49"	48"	65K	36"

**Notes:**

**1. PROPER VENTING**

- ENCLOSURES: Recommend 4 each 18 sq.in. vents on opposing sides (Minimum 2 each 18 sq.in. vents).

**2. GAS SUPPLY - FOR USE WITH FIXED PIPING SYSTEMS OR FOR USE WITH SMALL TANKS UP TO 90K.**

- Natural Gas: Operating Supply Pressure: Minimum: 6.0" W.C.; Maximum: 7.0" W.C.
- LP Gas: Operating Supply Pressure: Minimum: 10.0" W.C.; Maximum: 11.0" W.C.

**IMPORTANT:** Ensure any flex line that may be used from the permanent main fuel supply to the product is rated to the stated max btu of the product and certified to ANSI Z21.75\*CSA 6.27.

**5. MODIFICATION OF PRODUCT WILL VOID ANY CERTIFICATION AND WARRANTY.**


**6. FOLLOW ALL MANUFACTURER INSTALLATION INSTRUCTIONS AND LOCAL CODES.**

**7. ALL DIMENSIONS ARE CONSIDERED TRUE AND REFLECT MANUFACTURER'S SPECIFICATIONS AS OF THE REVISION DATE.**

**8. DO NOT SCALE DRAWING.**

**9. THESE DRAWINGS ARE FOR SIZING AND PLANNING PURPOSES. ALL INFORMATION CONTAINED HEREIN WAS CURRENT AT THE TIME OF DEVELOPMENT. THE MANUFACTURER'S RESPONSIBLE FOR THE ACCURACY OF THE DRAWING.**

**10. CONTRACTOR'S NOTE: FOR PRODUCT AND COMPANY INFORMATION VISIT [www.CADdetails.com/info](http://www.CADdetails.com/info) REFERENCE NUMBER 771-025.**



**MATCH LIT FIRE PIT INSERT - WITH FLEX LINE**

**LINEAR PAN - MLFPK**