



8165 E Kaiser Blvd. Anaheim, CA 92808  
www.lightlaboratory.com

Report No: L011706001



**Report No:** L011706001

**Issue Date:** 2/6/2017

**Prepared For:** SPJ Lighting Inc.  
2107 Chico Ave., South El Monte, CA, 91733

**Model Number:** SPJ 49-01

**Test:** Photometric/Electrical Test

**Standards Used:** Appropriate part or all test guidelines were used for test performed:  
*IESNA LM79: 2008* Approved Methods for Electrical and Photometric Measurements of Solid-State Lighting Products  
*ANSI NEMA ANSLG C78.377: 2008* Specification of the Chromaticity of Solid State Lighting Products  
*ANSI C82.77:2002:* Harmonic Emission Limits-Related Quality Requirements for Lighting Equipment

**Description of Sample:** Client submitted the sample. Catalog number is SPJ 49-01. Received in working and undamaged condition. No modifications were necessary.

**Testing Condition:** Fixture is tested with no special conditions.

**Sample Arrival Date:** 2/2/17

**Date of Tests:** 2/2/17 - 2/6/17

**Seasoning of Sample:** No seasoning was performed in accordance with IESNA LM-79.

**Equipment List**

Equipment Used	Model No	Stock No	Calibration Due Date
Chroma Programmable AC Source	61604	PS-AC02	--
Yokogawa Digital Power Meter	WT210	MT-EL06-S1	11/28/17
ITECH	IT6122	PS-DC03-S1	11/28/17
Fluke Digital Thermometer	52k/J	MT-TP02-GC	11/28/17
LLI Type C Goniophotometer System	RMG-C-MKII	CD-LL04-GC	--
LLI 2M Sphere	2MR97	CD-SN03-S2	--
LLI Spectroradiometer	SPR-3000	MT-SC01-S2	Before Use

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

**Test Summary**

<b>Manufacturer:</b>	SPJ Lighting Inc.
<b>Model Number:</b>	SPJ 49-01
<b>Driver Model Number:</b>	CUSTOM DRIVER
<b>Total Lumens:</b>	1522.60
<b>Input Voltage (VAC/60Hz):</b>	120.00
<b>Input Current (Amp):</b>	0.19
<b>Input Power (W):</b>	22.58
<b>Input Power Factor:</b>	0.97
<b>Current ATHD @ 120V(%):</b>	22%
<b>Current ATHD @ 277V(%):</b>	N/A
<b>Efficacy:</b>	67
<b>Ambient Temperature (°C):</b>	25.0
<b>Stabilization Time (Hours):</b>	0:50
<b>Total Operating Time (Hours):</b>	1:10
<b>Off State Power(W):</b>	0.00

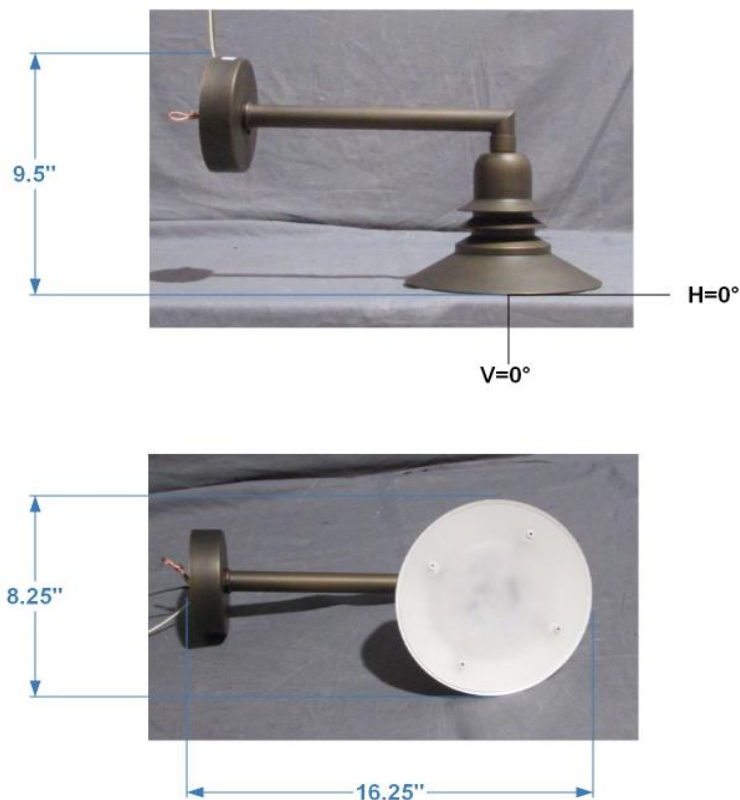


FIG.1 LUMINAIRE

\*All Results in accordance to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting.

## Test Methods

### Photometric Measurements - Goniophotometer

A Custom Light Laboratory Type C Rotating Mirror Goniophotometer was used to measure candelas(intensity) at each angle of distribution as defined by IESNA for the appropriate fixture type.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Spectral Measurements - Integrating Sphere

A Sensing Spectroradiometer SPR-3000, in conjunction with Light Laboratory 2 meter integrating sphere was used to measure chromaticity coordinates, correlated color temperature(CCT) and the color rendering index(CRI) for each sample.

Ambient temperature is set to 25°C and is measured from the center of the fixture, within 1ft from the outside of the fixture. Temperature is maintained at 25°C throughout the testing process and the sample is stabilized for at least 30mins and longer as necessary for the sample to achieve stabilization.

Electrical measurements are measured using the listed equipment.

### Disclaimers:

This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST or any agency of Federal Government.

Report Prepared by : Keyur Patel

Test Report Released by:



Jeff Ahn  
Engineering Manager

Test Report Reviewed by:



Steve Kang  
Quality Assurance

*\*Attached are photometric data reports. Total number of pages:10*



8165 E. Kaiser Blvd. Anaheim, CA 92808  
 www.lightlaboratory.com

# Photometric Test Report

**IES ROAD REPORT**  
**PHOTOMETRIC FILENAME : L011706001.IES**

## DESCRIPTIVE INFORMATION (From Photometric File)

IESNA:LM-63-2002  
 [TEST] L011706001  
 [TESTLAB] LIGHT LABORATORY, INC.  
 [ISSUEDATE] 2/6/2017  
 [MANUFAC] SPJ LIGHTING INC.  
 [LUMCAT] SPJ 49-01  
 [LUMINAIRE] WALL MOUNT LED FIXTURE  
 [BALLASTCAT] CUSTOM DRIVER  
 [LAMPPOSITION] 0,0  
 [LAMPCAT] N/A  
 [OTHER] INDICATING THE CANDELA VALUES ARE ABSOLUTE AND  
 [MORE] SHOULD NOT BE FACTORED FOR DIFFERENT LAMP RATINGS.  
 [POWER SUPPLY] 12VDC CONSTANT VOLTAGE SOURCE  
 [INPUT] 120VAC, 22.58W  
 [TEST PROCEDURE] IESNA:LM-79-08

## CHARACTERISTICS

IES Classification	Type V
Longitudinal Classification	Very Short
Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	1523
Downward Total Efficiency	N.A. (absolute)
Total Luminaire Efficiency	N.A. (absolute)
Luminaire Efficacy Rating (LER)	67
Total Luminaire Watts	22.58
Ballast Factor	1.00
Upward Waste Light Ratio	0.00
Maximum Candela	575.99
Maximum Candela Angle	0H 0V
Maximum Candela (<90 Degrees Vertical)	575.99
Maximum Candela Angle (<90 Degrees Vertical)	0H 0V
Maximum Candela At 90 Degrees Vertical	0 (0.0% Luminaire Lumens)
Maximum Candela from 80 to <90 Degrees Vertical	51.64 (3.4% Luminaire Lumens)
Cutoff Classification (deprecated)	N.A. (absolute)

**IES ROAD REPORT**  
**PHOTOMETRIC FILENAME : L011706001.IES**

**LUMINAIRE CLASSIFICATION SYSTEM (LCS)**


**ZONAL LUMEN SUMMARY**

	Lumens	% Lamp	% Luminaire	Zone	%
FL - Front-Low (0-30)	219.6	N.A.	14.4		
FM - Front-Medium (30-60)	393.2	N.A.	25.8	0-20	13.7
FH - Front-High (60-80)	135.8	N.A.	8.9	0-30	28.8
FVH - Front-Very High (80-90)	12.7	N.A.	0.8	0-40	46.7
BL - Back-Low (0-30)	219.6	N.A.	14.4	0-60	80.5
BM - Back-Medium (30-60)	393.2	N.A.	25.8	0-80	98.3
BH - Back-High (60-80)	135.8	N.A.	8.9	0-90	100
BVH - Back-Very High (80-90)	12.7	N.A.	0.8	10-90	96.4
UL - Uplight-Low (90-100)	0.0	N.A.	0.0	20-40	33
UH - Uplight-High (100-180)	0.0	N.A.	0.0	20-50	51
				40-70	45.4
Total	1522.6	N.A.	100.0	60-80	17.8
				70-80	6.3
BUG Rating	B1-U0-G1			80-90	1.7
				90-110	0
				90-120	0
				90-130	0
				90-150	0
				90-180	0
				110-180	0
				0-180	100

CANDELA TABULATION

Vert. Angles	Horizontal Angles
	<u>0</u>
0	575.99
5	572.62
10	563.32
15	547.39
20	526.58
25	500.46
30	469.58
35	435.16
40	396.65
45	355.40
50	313.37
55	268.15
60	223.03
65	177.84
70	132.85
75	88.69
80	51.64
85	20.72
90	0.00


**COEFFICIENTS OF UTILIZATION**

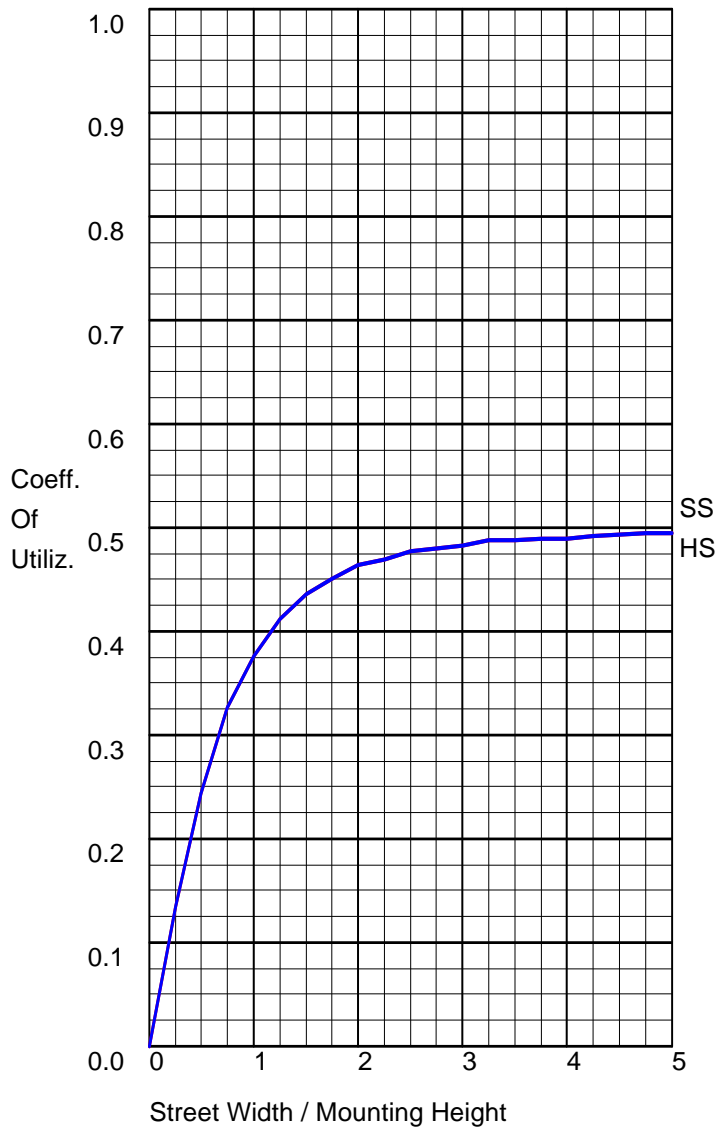

**FLUX DISTRIBUTION**

	Lumens	Percent Of Luminaire
Downward Street Side	761.3	50.0
Downward House Side	761.3	50.0
Downward Total	1522.6	100.0
Upward Street Side	0.0	0.0
Upward House Side	0.0	0.0
Upward Total	0.0	0.0
Total Flux	1522.6	100.0


POLAR GRAPH

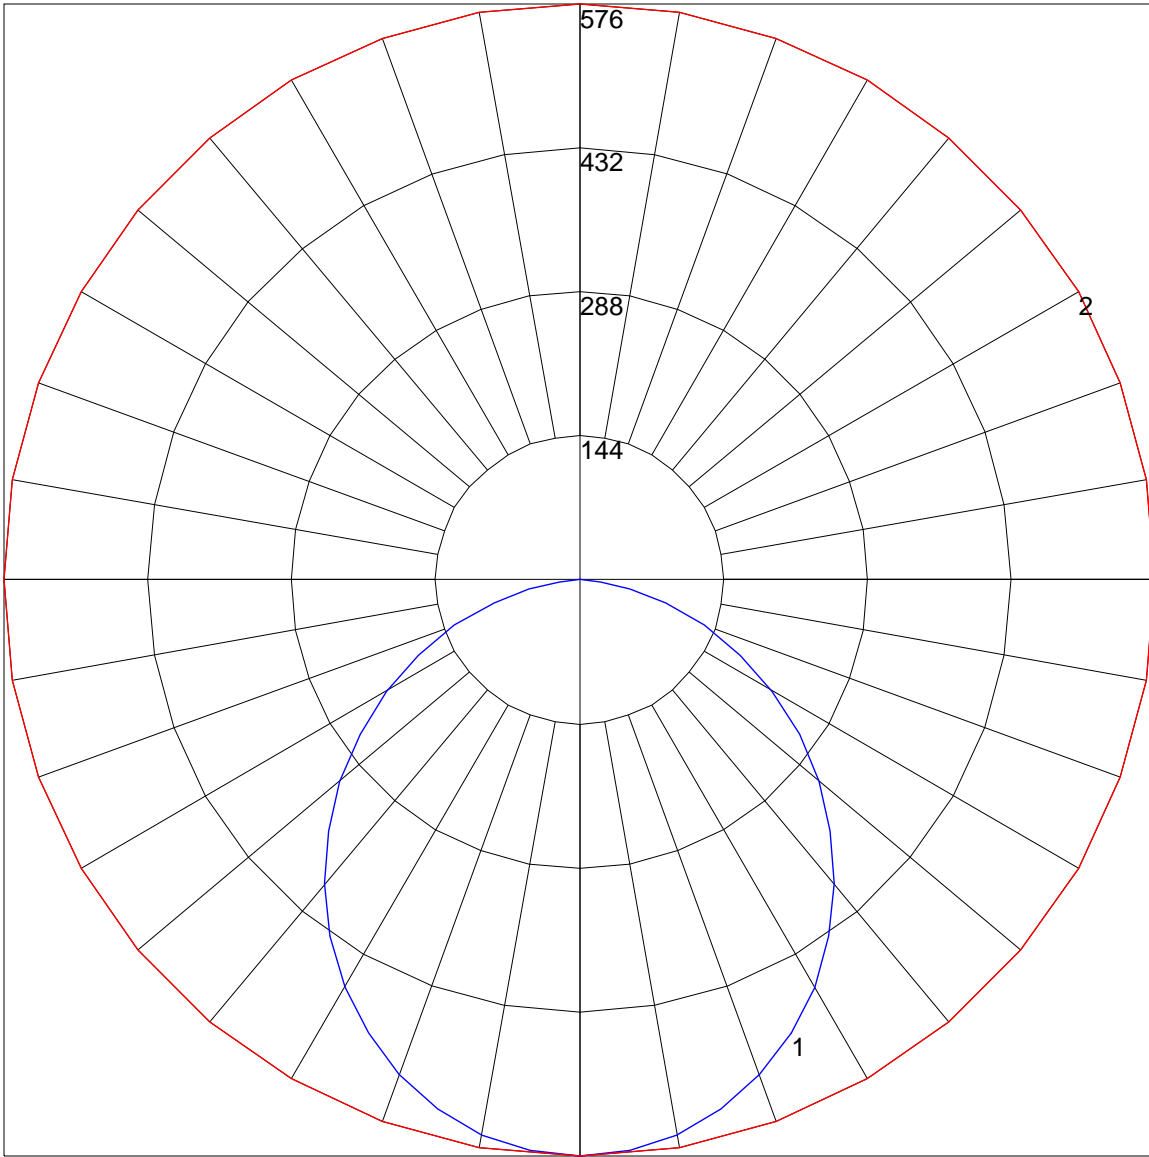

Maximum Candela = 575.99 Located At Horizontal Angle = 0, Vertical Angle = 0  
# 1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)  
# 2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)




ISOFOOTCANDLE LINES OF HORIZONTAL ILLUMINANCE

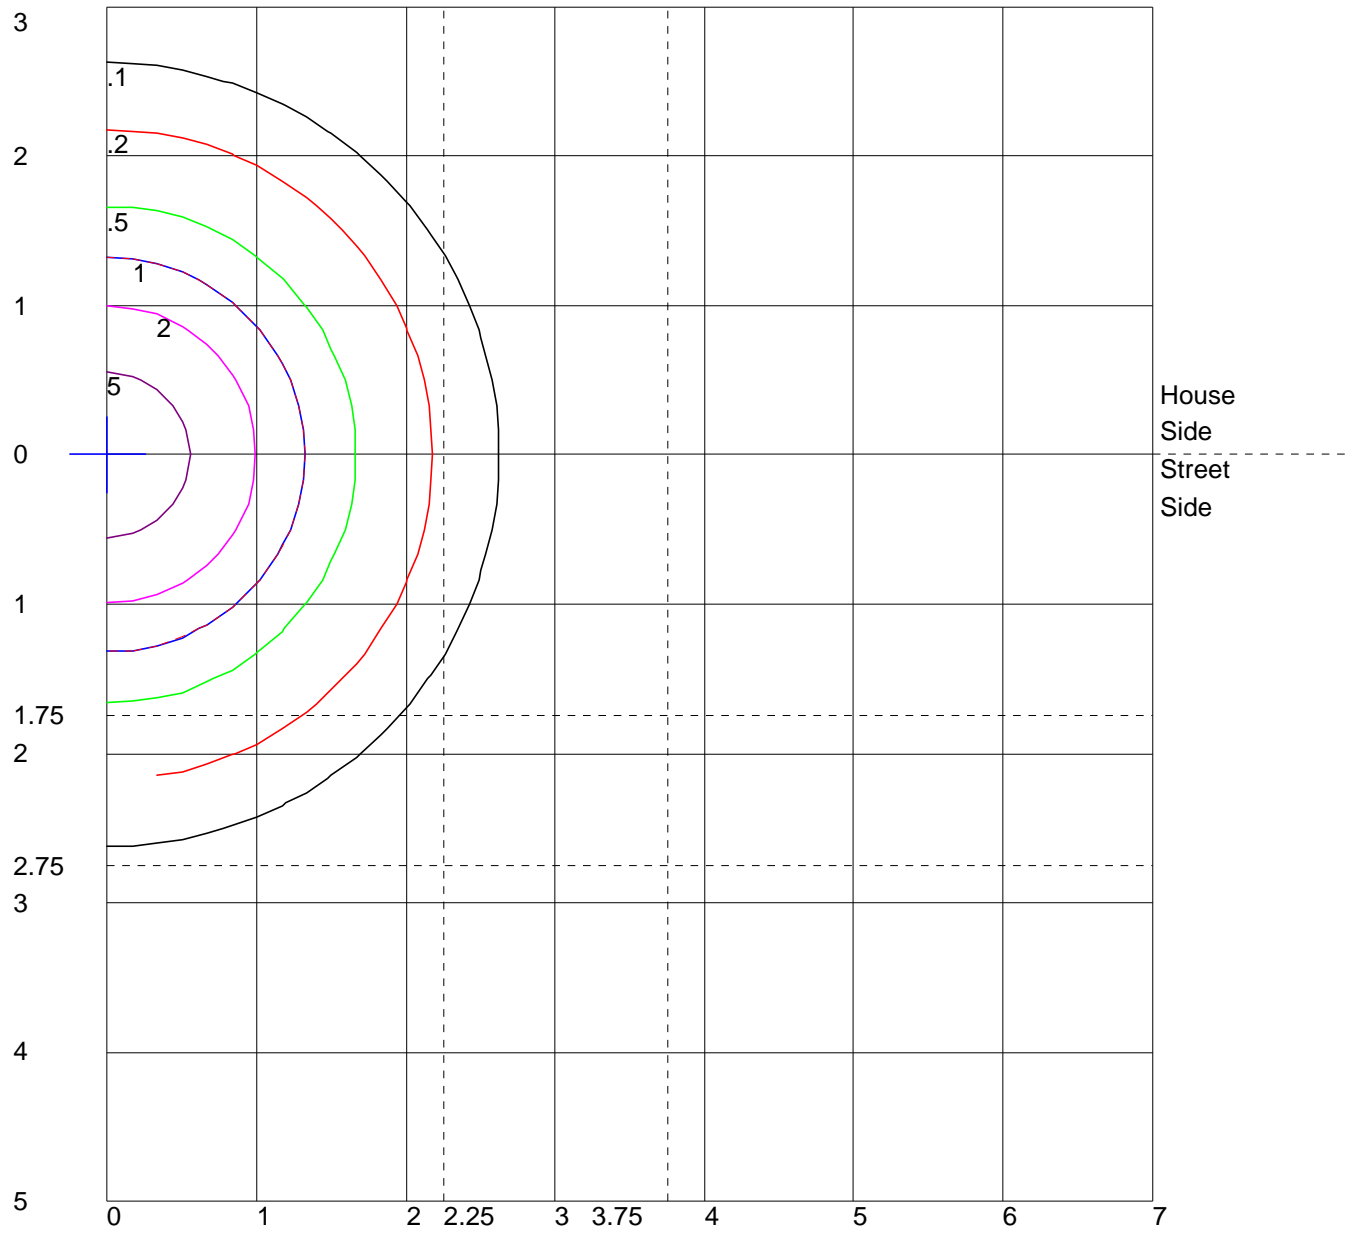

Distance In Units Of Mounting Height  
 Values Based On 8 Foot Mounting Height  
 1/2 Maximum Candela Trace Shown As Dashed Curve  
 (+) = Maximum Candela Point

LUMINAIRE CLASSIFICATION SYSTEM (LCS) GRAPH

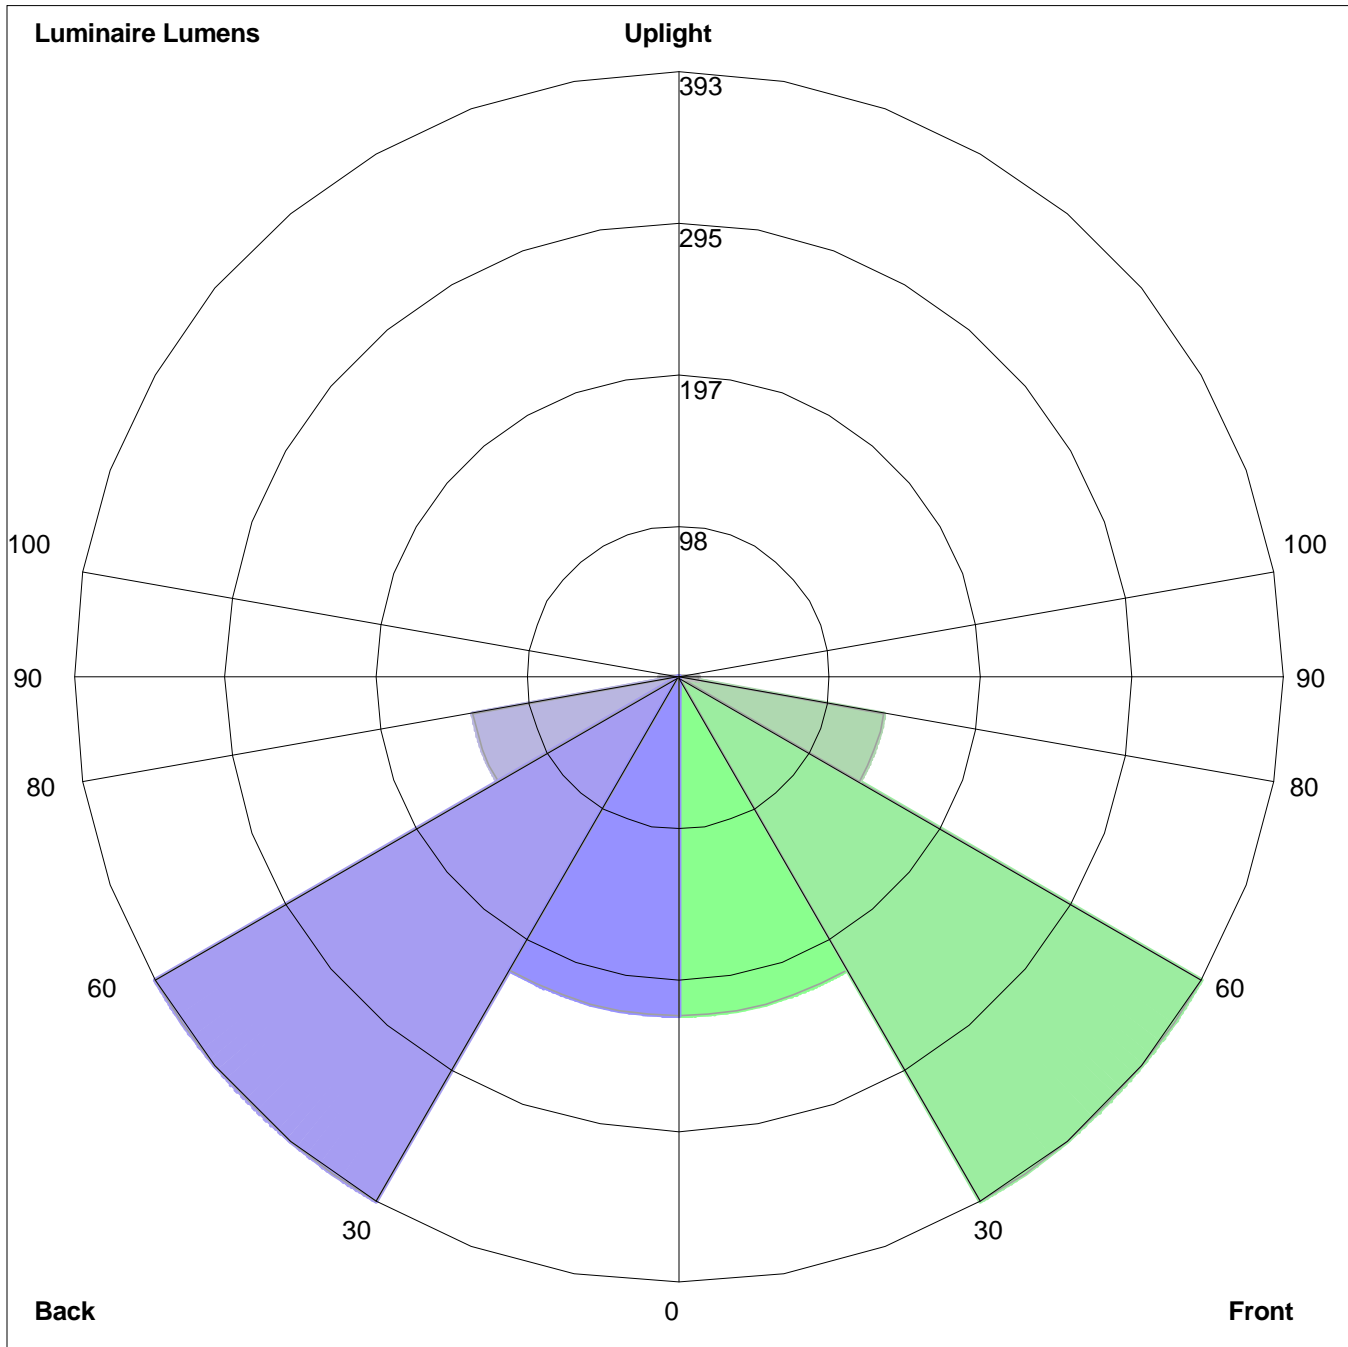

Luminaire Lumens:  
Front: Low=219.6, Medium=393.2, High=135.8, Very High=12.7  
Back: Low=219.6, Medium=393.2, High=135.8, Very High=12.7  
Uplight: Low=0.0, High=0.0

BUG Rating : B1-U0-G1