


VENOM® EBR-7C MRAD Reticle Subtensions for 3-15x44 FFP

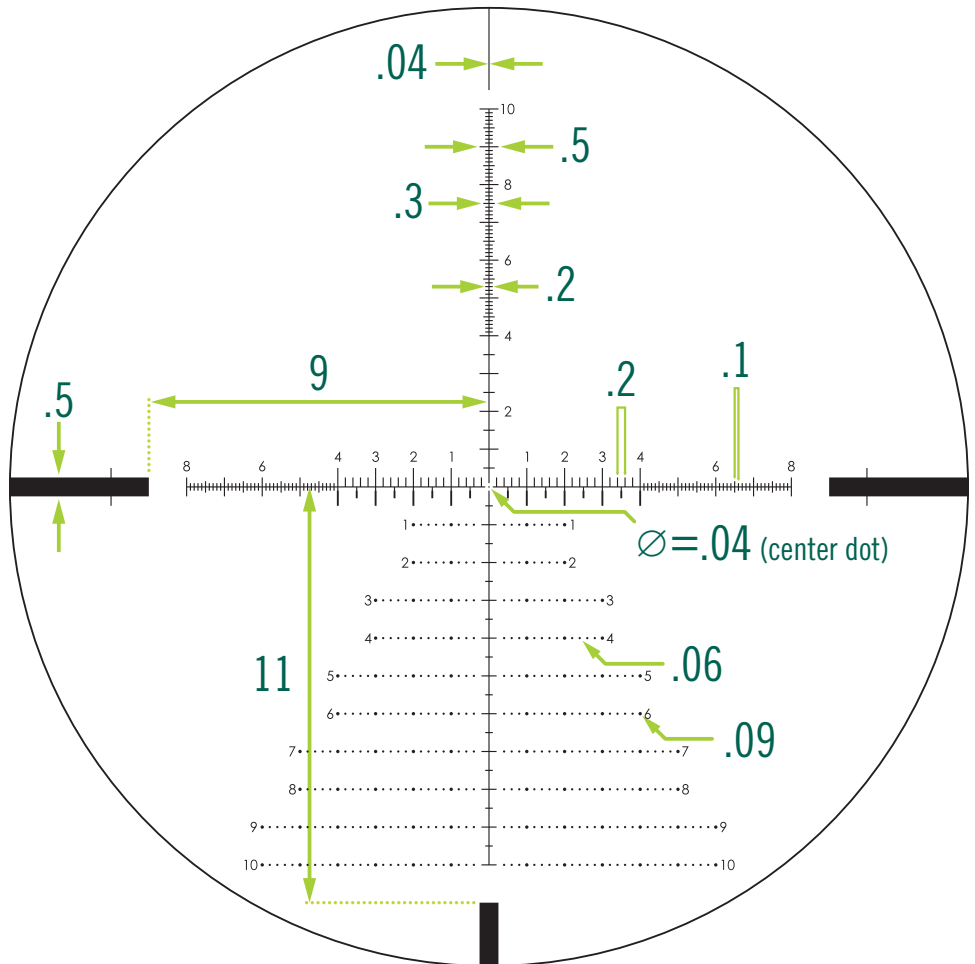

....[NOTES]....

Subtensions are measured in MRAD and remain constant at all magnifications.

Reticle image shown for representation only. The overall reticle image will vary with changes in the magnification.