


RAZOR® HD LHT™ XLR-2 MRAD Reticle Subtensions for 4.5-22x50

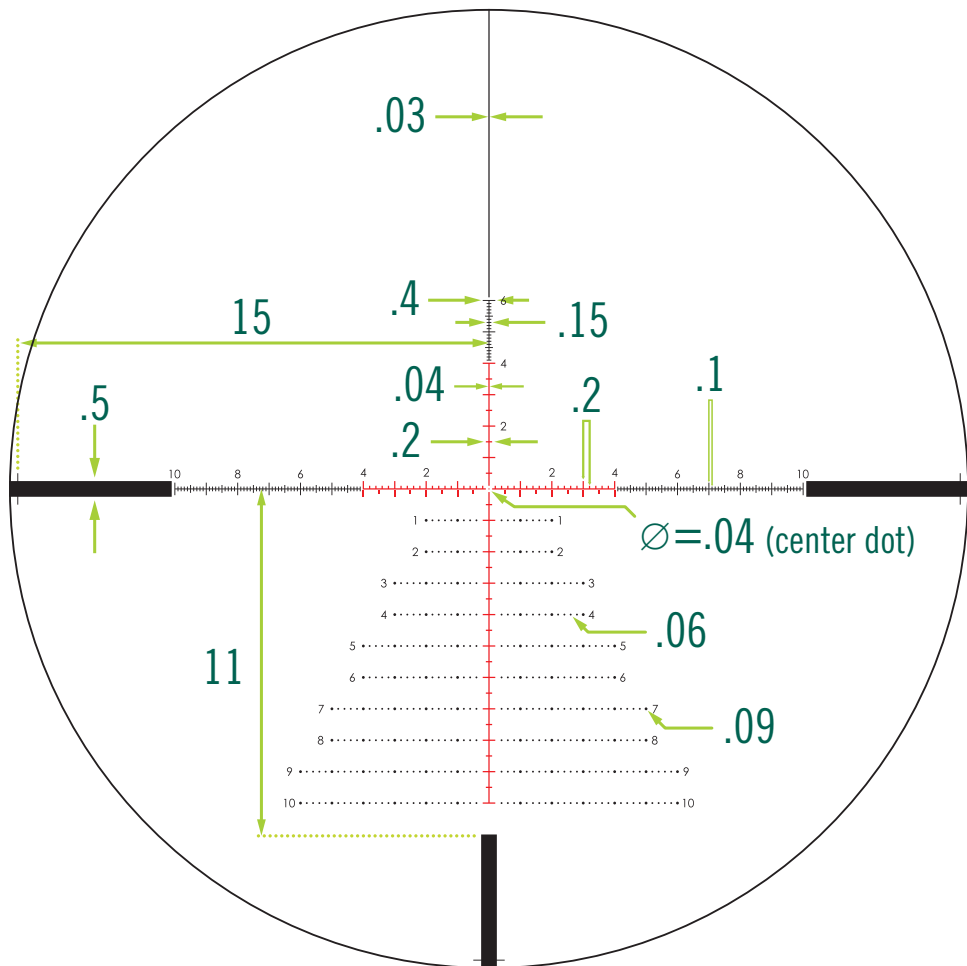

....[NOTES]....

Subtensions are measured in MRAD and remain constant at all magnifications.

Reticle image shown for representation only. Reticle image may vary between models, magnification, or reticle plane.