




PF - Hot water buffer store Pufferspeicher

Carbon steel hot water buffer store for the storage of primary water produced from continuous and discontinuous heat sources.
Available in the following options:
- only storage
- storage + one auxiliary coil
- storage + two auxiliary coils

The thermal fluid contained in the cylinder and in the primary heat exchangers must operate in closed circuit (without oxygen), in order to avoid corrosion phenomena. Cylinders are also prepared to host a backup immersion heater (not supplied).

HEAT SOURCE



APPLICATION



TECHNICAL FEATURES

Buffer vessel

| | |
|-------------------------------|---------------------------------------|
| Material | S 235 Jr Carbon steel |
| Internal protective treatment | None |
| External protective treatment | Anti rust protection + epoxy painting |
| Rating (P max. / T max.) | 4 or 6 bar / 95°C |

Heat exchanger

| | |
|-------------------------------|-----------------------|
| Material | S 235 Jr Carbon steel |
| Internal protective treatment | None |
| External protective treatment | None |
| Type | Fixed coil |
| Rating (P max. / T max.) | 10 bar / 95°C |

General features

| | |
|--------------------|---|
| Capacity | 300 - 5000 L |
| Warranty | 5 years |
| Insulation | - Soft insulation with polyester + PVC: Fire retardant class B2 (DIN 4102) - Hard insulation: - Polyurethane foam + PVC for 300/500/600/800/100/1500/2000 litres capacity: Fire retardant class B3 (DIN 4102) - Polyester (15mm) + polystyrene (85mm) + PVC for 1250/2500/3000/4000/5000 litres capacity: Fire retardant class B2 (DIN 4102) |
| In compliance with | - Pressure Equipment Directive (PED) 2014/68/UE Art. 4 Para 3 - Energy related Products (Erp) Directive 2009/125/CE |

ACCESSORIES (page 218)



Electronic control unit




Thermostat



Thermometer



1 1/2 electric immersion heater

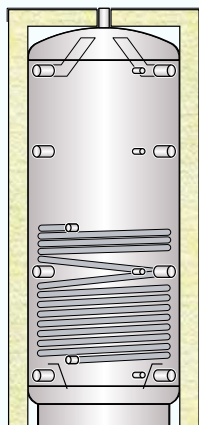


PFS - Hot water buffer store with one coil Hard insulation and PVC jacket

| WORKING PRESSURE 4 bar CODE | WORKING PRESSURE 6 bar CODE | INSULATION THICK. (mm) | ErP CLASS | HEAT LOSS S (W) | REAL CAPACITY (L) | HEAT EXCHANGER (m ²) / (L) * |
|-----------------------------|-----------------------------|------------------------|-----------|-----------------|-------------------|--|
| PFS 00300 R | PFS 00306 R | 50 | B | 57,3 | 289,8 | 1,40 / 13,7 |
| PFS 00500 R | PFS 00506 R | 50 | B | 69,7 | 499,8 | 2,00 / 19,6 |
| PFS 00600 R | PFS 00606 R | 50 | C | 94,7 | 585,2 | 2,50 / 24,5 |
| PFS 00800 R | PFS 00806 R | 100 | C | 109,9 | 749,3 | 2,50 / 24,5 |
| PFS 01000 R | PFS 01006 R | 100 | C | 113,8 | 931,0 | 3,50 / 34,3 |
| PFS 01250 R | PFS 01256 R | 100 | C | 140,0 | 1266,8 | 3,80 / 37,2 |
| PFS 01500 R | PFS 01506 R | 100 | C | 132,8 | 1472,4 | 4,00 / 39,2 |
| PFS 02000 R | PFS 02006 R | 100 | C | 143,5 | 1950,0 | 4,80 / 47,0 |
| PFS 02500 R | PFS 02506 R | 100 | - | - | 2493,5 | 4,80 / 47,0 |
| PFS 03000 R | PFS 03006 R | 100 | - | - | 2957,5 | 6,00 / 58,8 |
| PFS 04000 R | PFS 04006 R | 100 | - | - | 3894,4 | 7,00 / 68,6 |
| PFS 05000 R | PFS 05006 R | 100 | - | - | 5005,2 | 8,00 / 78,4 |

PFS - Hot water buffer store with one coil Soft insulation with polyester and PVC jacket

| WORKING PRESSURE 4 bar CODE | WORKING PRESSURE 6 bar CODE | INSULATION THICK. (mm) | ErP CLASS | HEAT LOSS S (W) | REAL CAPACITY (L) | HEAT EXCHANGER (m ²) / (L) * |
|-----------------------------|-----------------------------|------------------------|-----------|-----------------|-------------------|--|
| PFS 00800 F | PFS 00806 F | 130 | C | 129,4 | 749,3 | 2,50 / 24,5 |
| PFS 01000 F | PFS 01006 F | 130 | C | 141,2 | 931,0 | 3,50 / 34,3 |
| PFS 01250 F | PFS 01256 F | 130 | C | 159,6 | 1266,8 | 3,80 / 37,2 |
| PFS 01500 F | PFS 01506 F | 130 | C | 168,2 | 1472,4 | 4,00 / 39,2 |
| PFS 02000 F | PFS 02006 F | 130 | C | 184,0 | 1950,0 | 4,80 / 47,0 |
| PFS 02500 F | PFS 02506 F | 100 | - | - | 2493,5 | 4,80 / 47,0 |
| PFS 03000 F | PFS 03006 F | 100 | - | - | 2957,5 | 6,00 / 58,8 |
| PFS 04000 F | PFS 04006 F | 100 | - | - | 3894,4 | 7,00 / 68,6 |
| PFS 05000 F | PFS 05006 F | 100 | - | - | 5005,2 | 8,00 / 78,4 |

* Volume occupied by the heat exchanger and its support structure

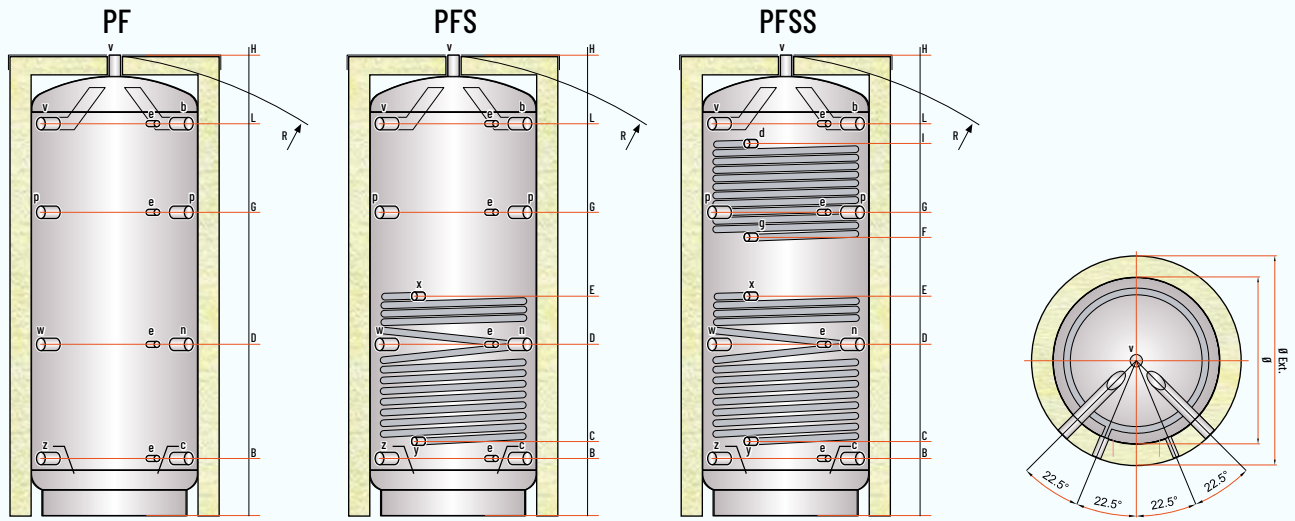

LEGEND

- b** . Biomass boiler flow
- c** . Biomass boiler return
- d** . Boiler flow
- e** . Thermometer - Sensor
- g** . Boiler return
- n** . Heating system return
- p** . Free connection
- x** . Solar system flow
- y** . Solar system return
- v** . Heating system flow
- w** . Opening for immersion heater
- z** . Low temperature heating system return

| WORKING PRESSURE 4 & 6 bar MODEL | DIMENSIONS (mm) | | Ø EXT (Hard/Soft ins.) ** | R * | LOWER HEAT EXCHANGER (m ²) | UPPER HEAT EXCHANGER (m ²) | WEIGHT PFSS (kg) |
|----------------------------------|-----------------|------|---------------------------|--------|--|--|------------------|
| | Ø | H | | | | | |
| PF_ 00300 R | 500 | 1595 | 600 | 1720 * | 1,40 | 1,10 | 70 |
| PF_ 00500 R | 650 | 1645 | 750 | 1820 * | 2,00 | 1,80 | 110 |
| PF_ 00600 R | 650 | 1895 | 750 | 2050 * | 2,50 | 1,80 | 120 |
| PF_ 00800_ | 790 | 1750 | 990/1050 | 1745 | 2,50 | 2,00 | 149 |
| PF_ 01000_ | 790 | 2110 | 990/1050 | 2095 | 3,50 | 2,50 | 183 |
| PF_ 01250_ | 950 | 2075 | 1150/1210 | 2090 | 3,80 | 2,60 | 215 |
| PF_ 01500_ | 1000 | 2115 | 1200/1260 | 2145 | 4,00 | 2,80 | 237 |
| PF_ 02000_ | 1100 | 2380 | 1300/1360 | 2385 | 4,80 | 3,80 | 301 |
| PF_ 02500_ | 1200 | 2495 | 1400 | 2550 | 4,80 | 3,80 | 354 |
| PF_ 03000_ | 1250 | 2710 | 1450 | 2760 | 6,00 | 3,80 | 423 |
| PF_ 04000_ | 1400 | 2820 | 1600 | 2905 | 7,00 | 4,50 | 492 |
| PF_ 05000_ | 1600 | 2850 | 1800 | 3005 | 8,00 | 5,00 | 572 |


* For capacities from 300 to 600 litres, the tilt height refers to the insulated cylinder
 ** The insulation is removable except for models from 300 to 600 litres

| WORKING PRESSURE 4 & 6 bar MODEL | HEIGHTS (mm) | | | | | | | | CONNECTIONS (GAS) | | | |
|----------------------------------|--------------|-----|------|------|------|------|------|------|-------------------|----|---------------|--|
| | B | C | D | E | F | G | I | L | d g x y | e | b c n p v w z | |
| PF_ 00300 R | 215 | 290 | 595 | 810 | 930 | 1080 | 1290 | 1350 | 1" | ½" | 1"½ | |
| PF_ 00500 R | 240 | 315 | 615 | 835 | 955 | 1105 | 1315 | 1375 | 1" | ½" | 1"½ | |
| PF_ 00600 R | 235 | 315 | 700 | 1000 | 1120 | 1270 | 1480 | 1630 | 1" | ½" | 1"½ | |
| PF_ 00800_ | 275 | 355 | 655 | 875 | 1015 | 1145 | 1345 | 1410 | 1" | ½" | 1"½ | |
| PF_ 01000_ | 275 | 350 | 810 | 1035 | 1195 | 1355 | 1675 | 1755 | 1" | ½" | 1"½ | |
| PF_ 01250_ | 320 | 400 | 745 | 1060 | 1200 | 1380 | 1600 | 1705 | 1" | ½" | 1"½ | |
| PF_ 01500_ | 340 | 420 | 765 | 1080 | 1220 | 1400 | 1620 | 1725 | 1" | ½" | 1"½ | |
| PF_ 02000_ | 370 | 450 | 930 | 1090 | 1230 | 1435 | 1710 | 1945 | 1" | ½" | 1"½ | |
| PF_ 02500_ | 385 | 480 | 940 | 1120 | 1300 | 1500 | 1700 | 2050 | 1" | ½" | 2" | |
| PF_ 03000_ | 400 | 490 | 1015 | 1210 | 1430 | 1645 | 1830 | 2255 | 1" | ½" | 2" | |
| PF_ 04000_ | 460 | 550 | 1085 | 1270 | 1490 | 1710 | 1930 | 2315 | 1" | ½" | 2" | |
| PF_ 05000_ | 465 | 555 | 1080 | 1275 | 1495 | 1710 | 1895 | 2320 | 1" | ½" | 2" | |

Disclaimer: this layout is purely indicative. It does not replace consultant's design

LEGEND

- 8 . Vent with valve
- 9 . Solar system control unit
- 10 . Solar system safety kit (6 bar)
- 11 . Solar system expansion vessel
- 12 . Heating system expansion vessel
- 13 . System drain
- 14 . Heating system safety valve
- 15 . 3-way valve low temperature heating system

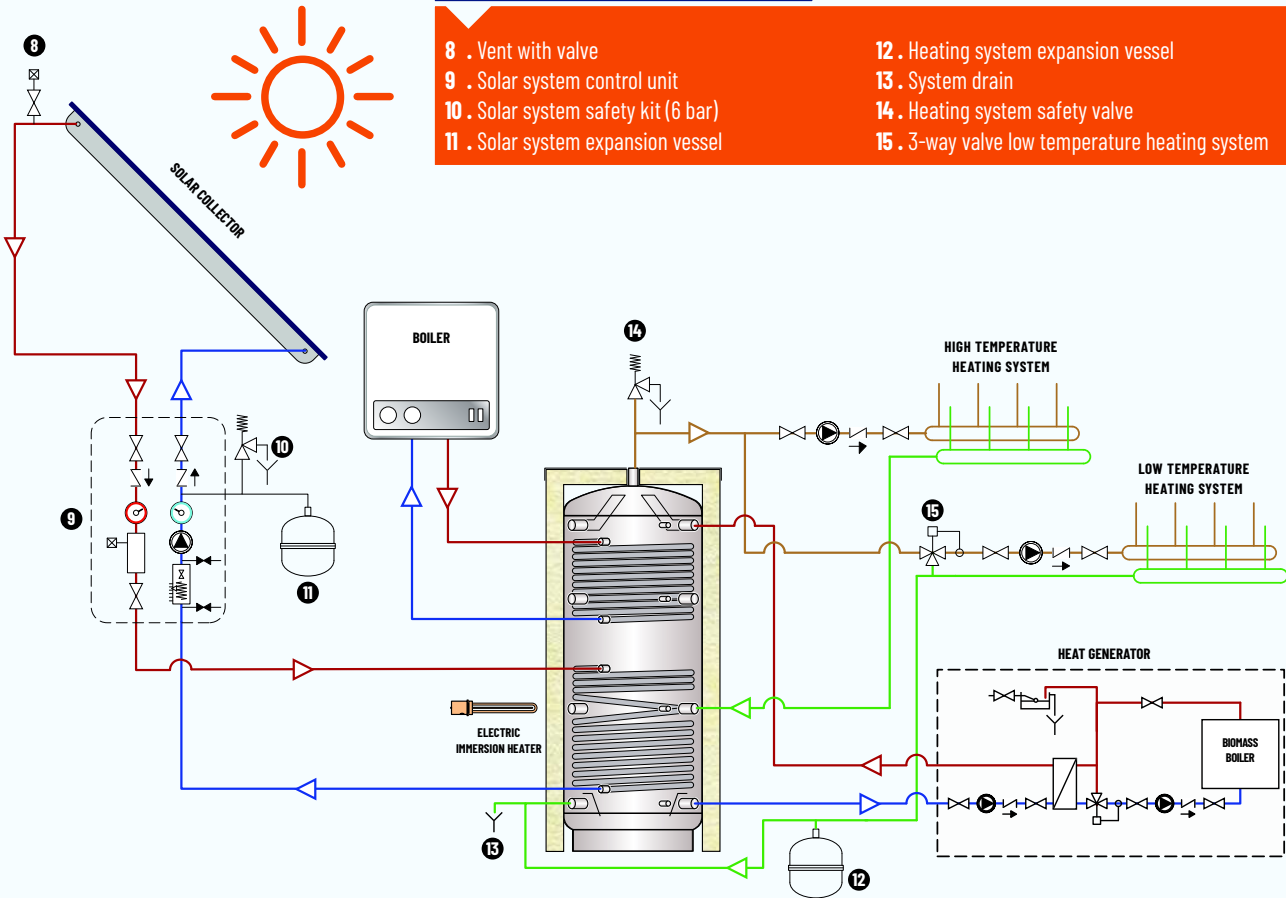

PRIMARY WATER THERMAL STORES

Lower heat exchanger performance

Upper heat exchanger performance

| CODE | m ² (L) | Power (kW) | | | | m ² (L) | Power (kW) | | | |
|-------------|--------------------|---------------------------------------|---------------------------------------|---------------------------------------|---------------------------------------|--------------------|---------------------------------------|---------------------------------------|---------------------------------------|---------------------------------------|
| | | $\Delta T^* 10\text{ }^\circ\text{C}$ | $\Delta T^* 15\text{ }^\circ\text{C}$ | $\Delta T^* 20\text{ }^\circ\text{C}$ | $\Delta T^* 25\text{ }^\circ\text{C}$ | | $\Delta T^* 10\text{ }^\circ\text{C}$ | $\Delta T^* 15\text{ }^\circ\text{C}$ | $\Delta T^* 20\text{ }^\circ\text{C}$ | $\Delta T^* 25\text{ }^\circ\text{C}$ |
| PF_ 00300 R | 1,4 (9,9) | 9,0 | 13,4 | 17,9 | 22,4 | 1,1 (7,8) | 7,0 | 10,6 | 14,1 | 17,6 |
| PF_ 00500 R | 2,0 (14,2) | 12,8 | 19,2 | 25,6 | 32,0 | 1,8 (12,8) | 11,5 | 17,3 | 23,0 | 28,8 |
| PF_ 00600 R | 2,5 (17,8) | 16,0 | 24,0 | 32,0 | 40,0 | 1,8 (12,8) | 11,5 | 17,3 | 23,0 | 28,8 |
| PF_ 00800_ | 2,5 (17,8) | 16,0 | 24,0 | 32,0 | 40,0 | 2,0 (14,2) | 12,8 | 19,2 | 25,6 | 32,0 |
| PF_ 01000_ | 3,5 (24,9) | 22,4 | 33,6 | 44,8 | 56,0 | 2,5 (17,8) | 16,0 | 24,0 | 32,0 | 40,0 |
| PF_ 01250_ | 3,8 (27,0) | 24,3 | 36,5 | 48,6 | 60,8 | 2,6 (18,5) | 16,6 | 24,9 | 33,3 | 41,6 |
| PF_ 01500_ | 4,0 (28,4) | 25,6 | 38,4 | 51,2 | 64,0 | 2,8 (19,9) | 17,9 | 26,9 | 35,8 | 44,8 |
| PF_ 02000_ | 4,8 (34,1) | 30,7 | 46,0 | 61,4 | 76,7 | 3,8 (27,0) | 24,3 | 36,5 | 48,6 | 60,8 |
| PF_ 02500_ | 4,8 (34,1) | 30,7 | 46,0 | 61,4 | 76,7 | 3,8 (27,0) | 24,3 | 36,5 | 48,6 | 60,8 |
| PF_ 03000_ | 6,0 (42,6) | 38,4 | 57,6 | 76,7 | 95,9 | 3,8 (27,0) | 24,3 | 36,5 | 48,6 | 60,8 |
| PF_ 04000_ | 7,0 (49,7) | 44,8 | 67,2 | 89,5 | 111,9 | 4,5 (32,0) | 28,8 | 43,2 | 57,6 | 71,9 |
| PF_ 05000_ | 8,0 (56,8) | 51,2 | 76,7 | 102,3 | 127,9 | 5,0 (35,5) | 32,0 | 48,0 | 64,0 | 79,9 |

* ΔT : difference between the average temperature of the heating fluid (inside the heat exchanger) and the average temperature of the heated fluid (internal to the buffer in the area affected by the coil).