


1 COMMERCIAL CONTROLS

A. CONTROLS ON APPLIANCE


4HRTC

4-HOUR TIMER CONTROL PANEL

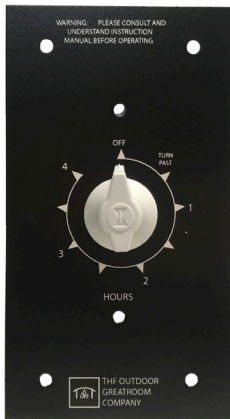


- Installed **on the appliance**.
- Includes 36 in. wire lead that connects directly to CF-DSI.
- Replaces the standard CF-DSI control switch.
- Eliminates remote (CF-DSI-R) functionality.
- Operates **low-voltage** circuit.

INSTALLATION DIAGRAM - (4HRTC)

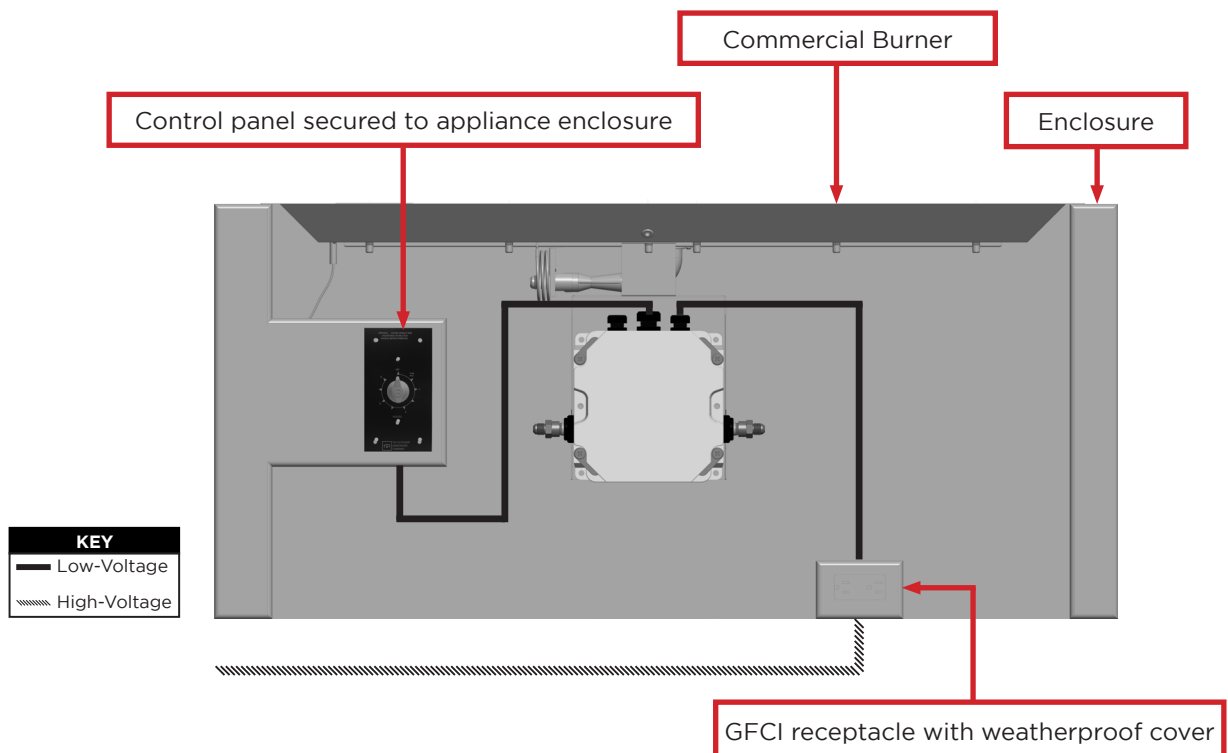



WIRING DIAGRAM - (4HRTC)

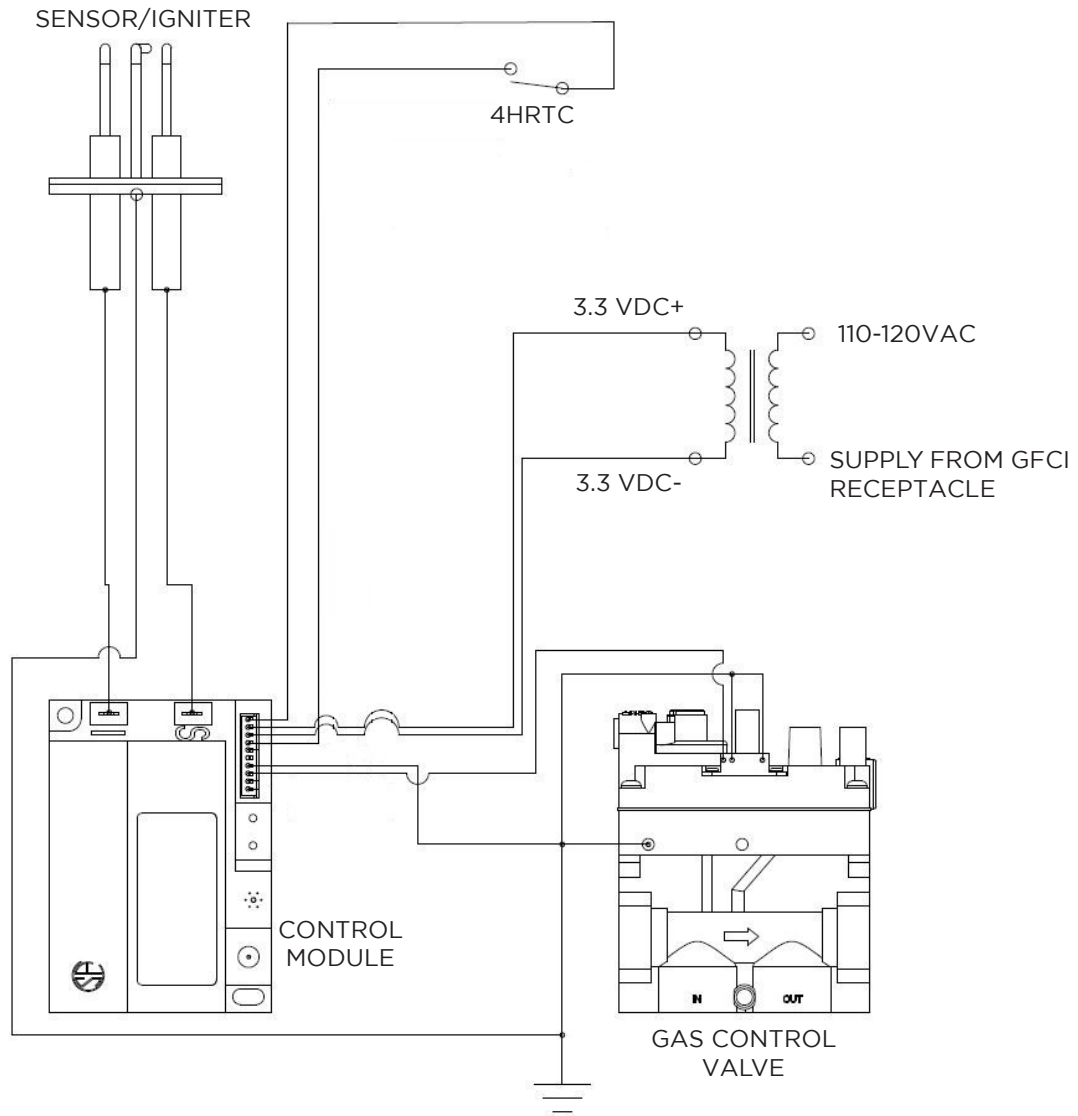

B. CONTROLS AWAY FROM APPLIANCE


CFP-ESO-CP

EMERGENCY STOP




- Installed **away from the appliance**.
- Install on a wall or pillar in accordance with local electrical code.
- Includes printed instruction cover plate.
- Mounts to single-gang junction box.
- Immediately cuts **high-voltage** to the appliance circuit.

INSTALLATION DIAGRAM - (CFP-ESO-CP)

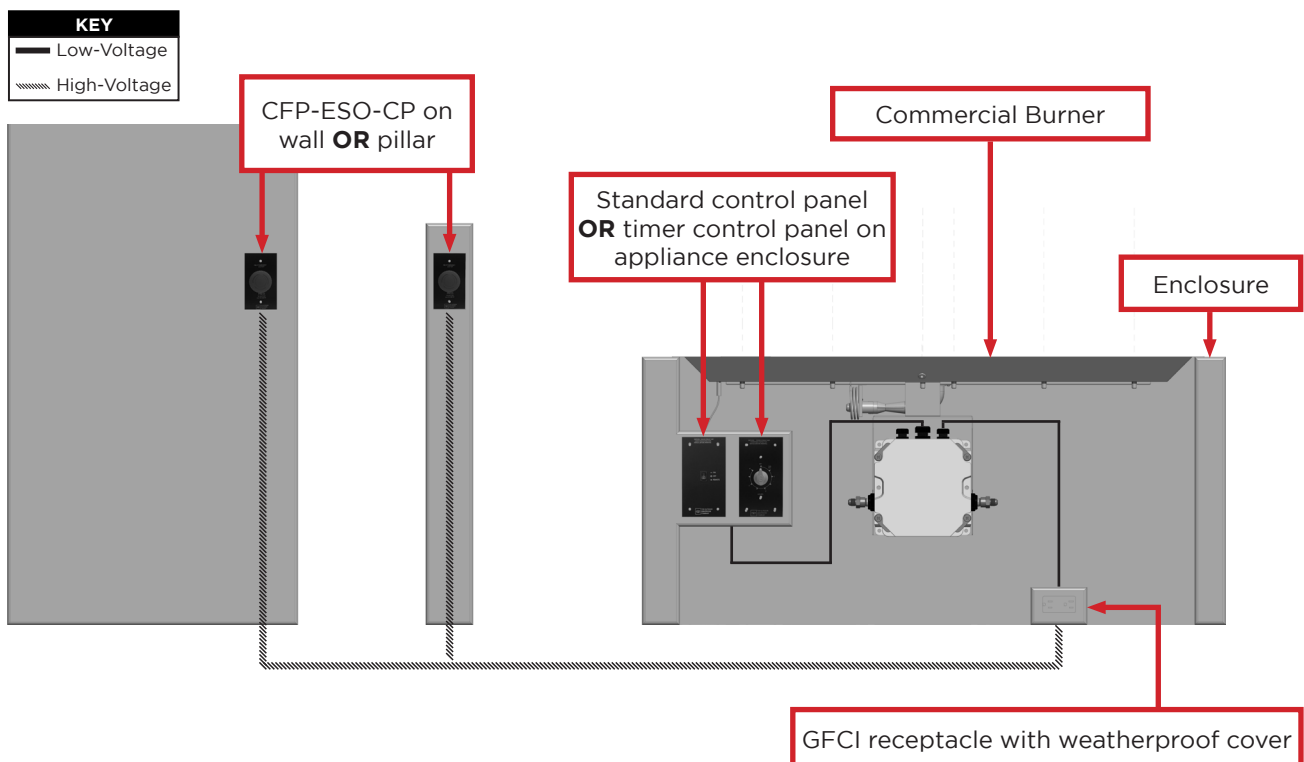



WIRING DIAGRAM - (CFP-ESO-CP)

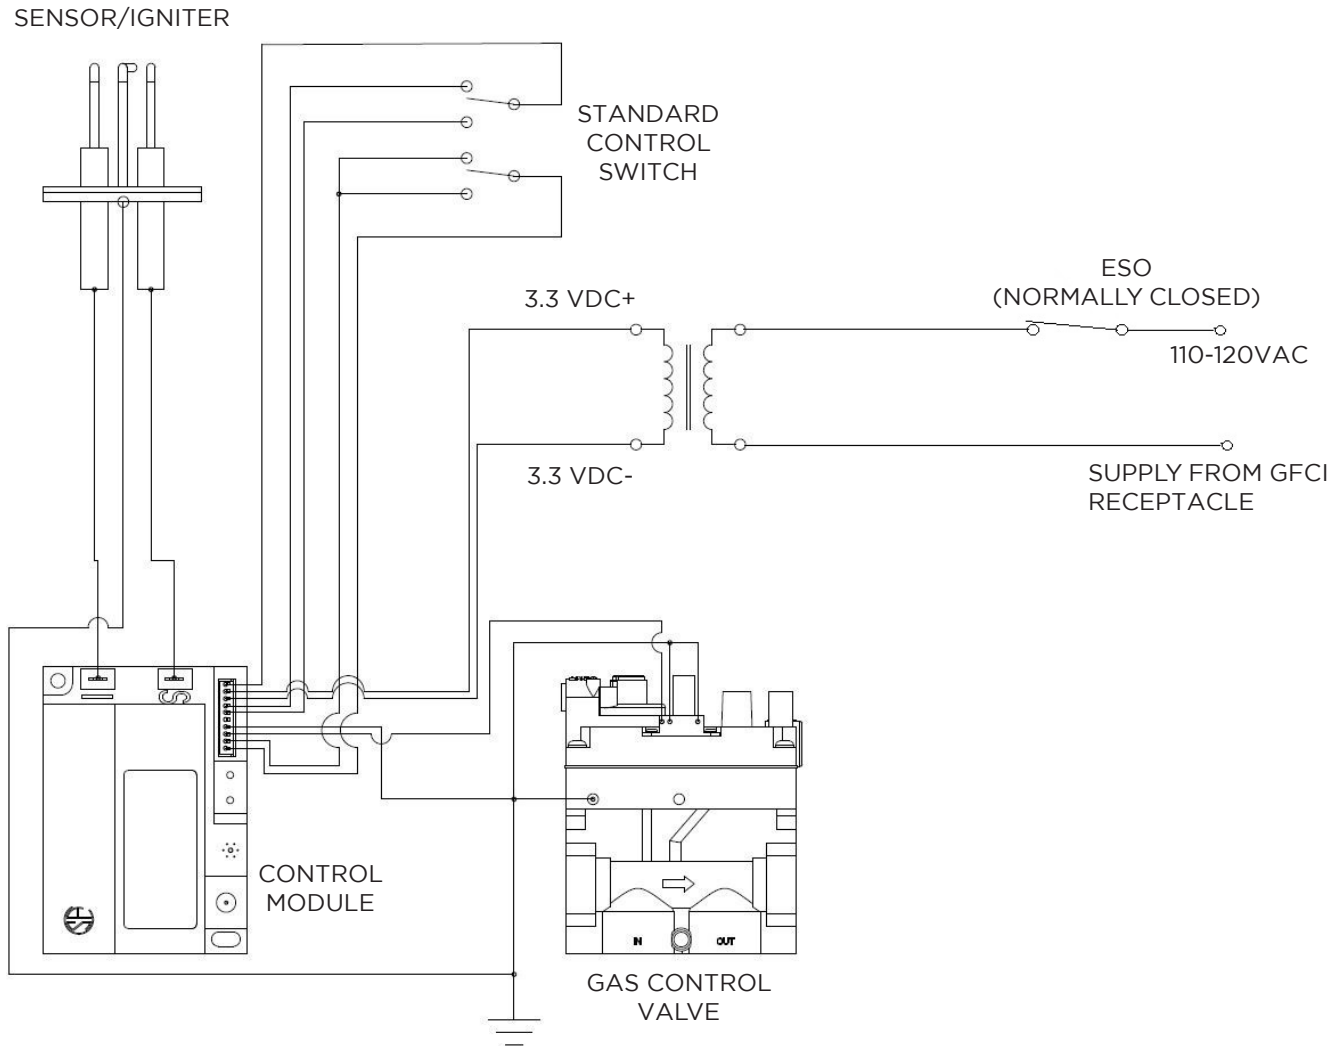

⚠ WARNING ⚠

If any components were damaged during the incident that prompted the use of the emergency stop button, they **must be replaced** before the appliance is operated again. In some instances, the entire appliance should be replaced.

After emergency stop is pressed and situation is resolved, **DO NOT** immediately reset the emergency stop button. Follow these steps to reset:


1. Turn all controls to the OFF position. This includes the CF-DSI switch, the 4-hour timer, and/or the wall switch.
2. Verify that appliance is not covered or obstructed.
3. Reset the emergency stop button by twisting clockwise.

WSES-CP ON/OFF WALL SWITCH AND EMERGENCY STOP




- Installed **away from the appliance**.
- Only install on a wall **within line-of-sight** of the appliance in accordance with local electrical code.
- Includes printed instruction cover plate.
- Mounts to double-gang junction box
- Operates **high-voltage**.
- Included DSI switch bypass (CF-DSI-SB) can be installed on DSI to remove control from appliance and give sole control to the WSES-CP.
- If CF-DSI-SB is installed, remote functionality is removed.

INSTALLATION DIAGRAM - (WSES-CP)

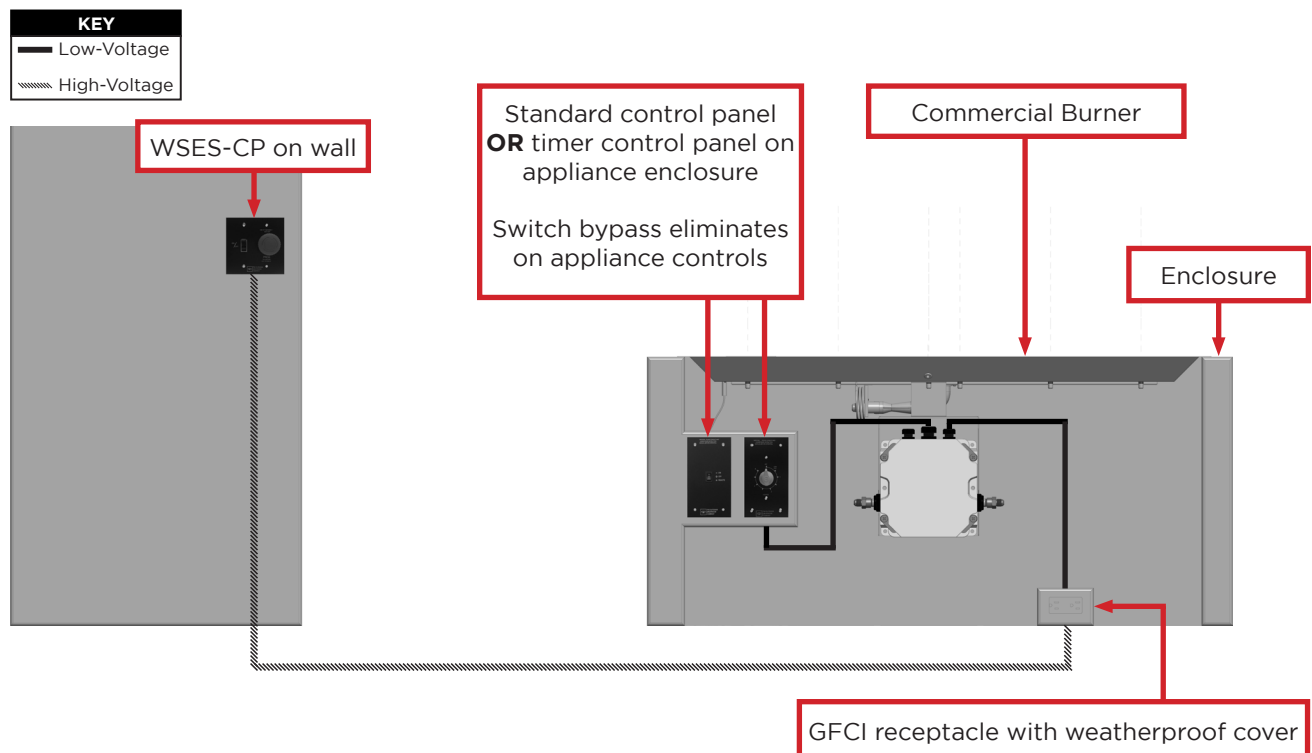




WIRING DIAGRAM - (CFP-ESO-CP)

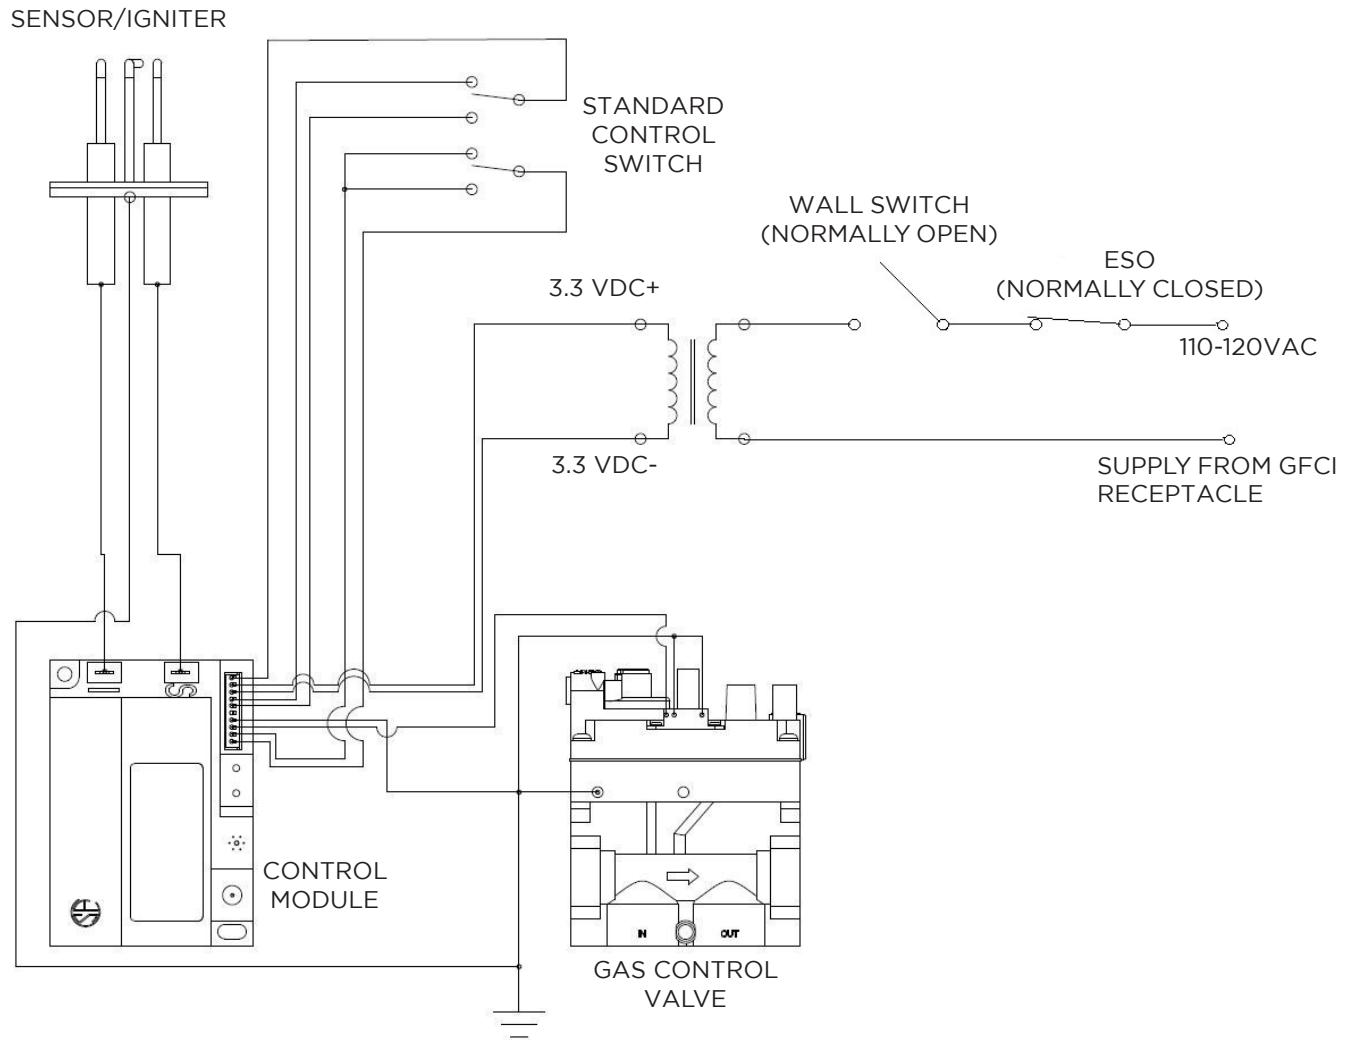


4HRTES-CP

4-HOUR TIMER AND EMERGENCY STOP

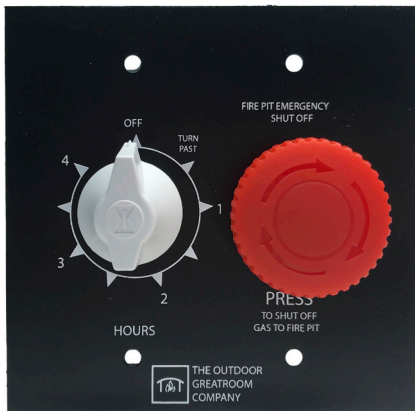

- Installed **away from the appliance**.
- Only install on a wall **within line-of-sight** of the appliance in accordance with local electrical code.
- Includes printed instruction cover plate.
- Mounts to double-gang junction box
- Operates **high-voltage**.
- Included DSI switch bypass (CF-DSI-SB) can be installed on DSI to remove control from appliance and give sole control to the WSES-CP.
- If CF-DSI-SB is installed, remote functionality is removed.

INSTALLATION DIAGRAM - (4HRTES-CP)

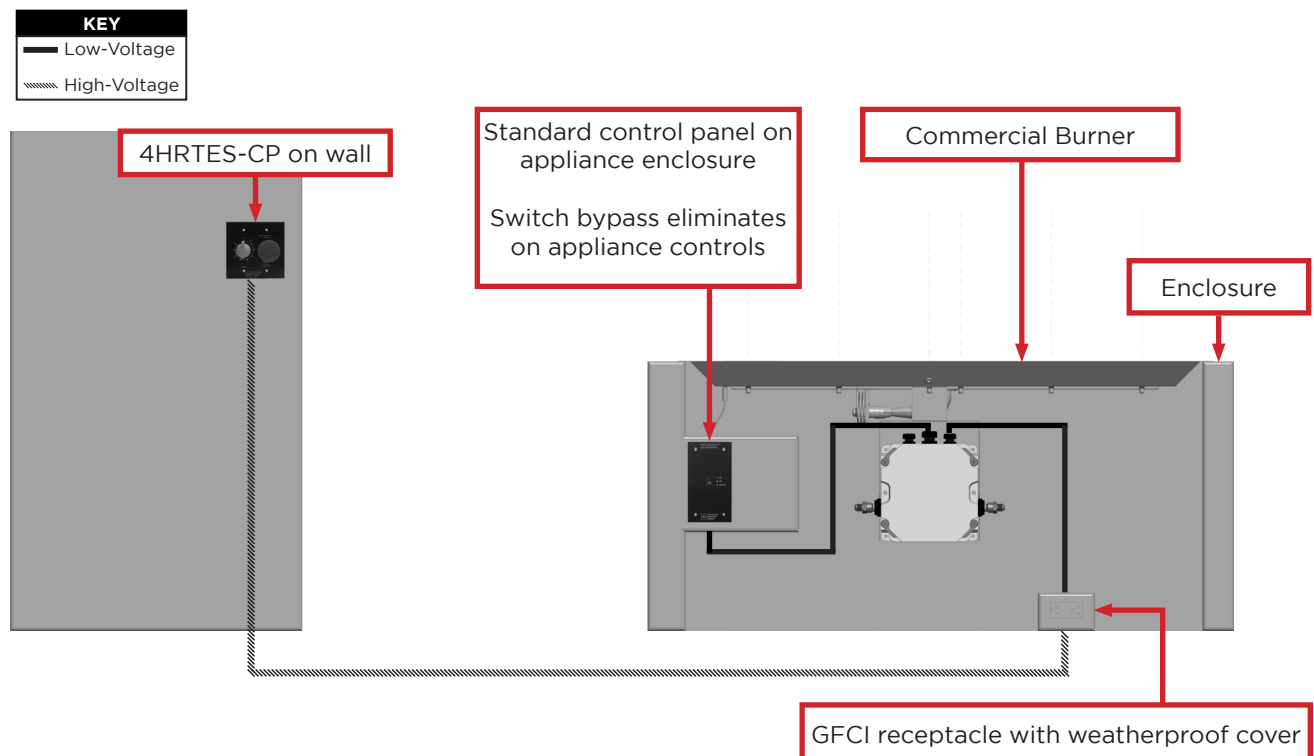



WIRING DIAGRAM - (4HRTES-CP)

