



Accredited for compliance with ISO/IEC 17025-  
Testing

NATA is a signatory to the ILAC Mutual Recognition  
Arrangement for the mutual recognition of the  
equivalence of testing, medical testing, calibration  
and inspection reports

Accreditation No. 2735

## OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

### Natralis Foothold

**Prepared for:** Armstrong Flooring Pty Ltd  
Deep Shah  
29-39 Mills Road  
BRAESIDE VIC 3195

**Specimen Description:** Natralis Foothold, 550x1000 mm.

**No. of Specimens:** 1 off

**Surface Structure:** Structured

**Specimen Preparation:** Washed with water and pH neutral detergent, rinsed then dried.

**Specimen Configuration:** Unfixed

**Test Direction:** Test direction not applicable.

**Joint Type & Width:** N/A

**Air Temperature:** 23°C

**Test Standard:** AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

**Test Shoe:** Leipzig V73-SP

**Test Location:** ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

**Test Date:** 13 July 2022

**Test Personnel:** Dale Siegle and Daniel King

<b>Displacement Space</b> (rounded to the nearest 0.5cm <sup>3</sup> /dm <sup>2</sup> ):	Not tested
<b>Displacement Space Assessment Group</b> (Appendix E, AS 4586 - 2013):	Not tested
<b>Corrected mean overall acceptance angle (<math>\alpha_{ave}</math>)</b> (rounded down to the nearest degree):	19°
<b>Classification:</b>	R11

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.


Reviewed By:



Daniel King BSc/BEng (mat) Hons., MIEAust  
General Manager - Compliance Services  
Approved Signatory



Dale Siegle  
Technical Consultant - Compliance Services  
Approved Signatory

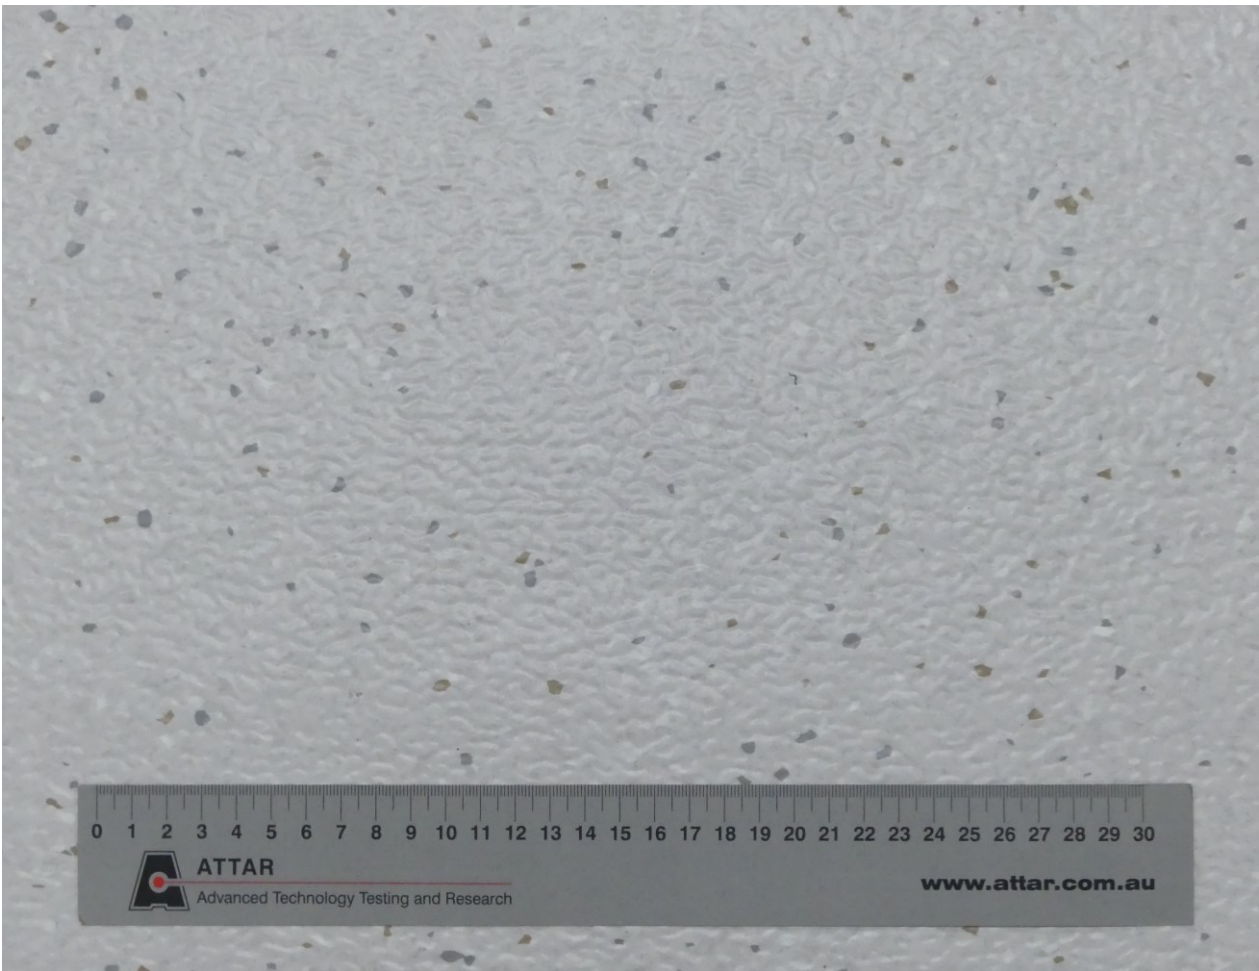

**Figure 1:** Natralis Foothold



**CLASSIFICATION CRITERIA – AS 4586 - 2013**  
**Oil Wet Inclining Platform Test – Appendix D**

**Compliance**

**TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST**

<b>Classification</b>	<b>Angle, degrees</b>
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35