


MINIMUM 37.00 2 X 8 STUDS 11.75 MINIMUM MINIMUM OPENING OPENING 5/8" DRYWALL 1 HOUR FIRE RATING LINE ENTIRE CAVITY (5 SIDES) FIXTURE WHIP w/ CONNECTORS CONNECTION MADE AT JUNCTION BOX 5/8" DRYWALL 1 HOUR FIRE RATING SUBFLOOR JUNCTION BOX ON TOP OR SIDE MIN. 2 x 8 ADJUSTABLE TABS SURFACE VIEW

INSTALLATION TYPES

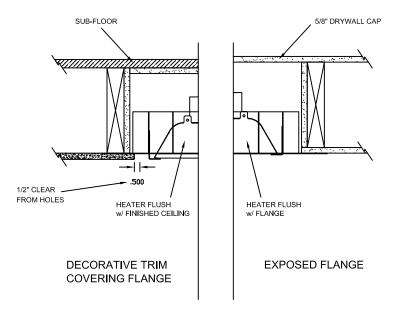



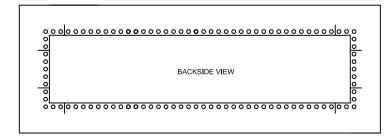

NOTES:

- Heater suspends (Gravity) by resting on adjustable tabs in flush mount fixture.
- Mounting holes on Surface Flange to be determined and drilled by Contractor/Installer.
- Supplied with Hi-Temp Fixture Whip and Hi-Temp Wire Nuts.
- Coil excess flex into heater cavity
- Use Licensed Electrician ONLY

INFRATECH. www.infratech-usa.com

15700 S. Figueroa St. Gardena, California 90248 Phone: (310) 354-1250 Fax: (310) 523-3674

ITEM #: X-18-2295 304 S.S. #4 FINISH

DESCRIPTION: W-33 FLUSH MOUNT PLASTER FRAME (FOR USE WITH 33" W-SERIES HEATERS)


NOTES:

SUPPLIED w/ ELECTRICAL FIXTURE WHIP

DATE: SCALE: Jun. 11, 2014

N/A


DRAWN BY: MD

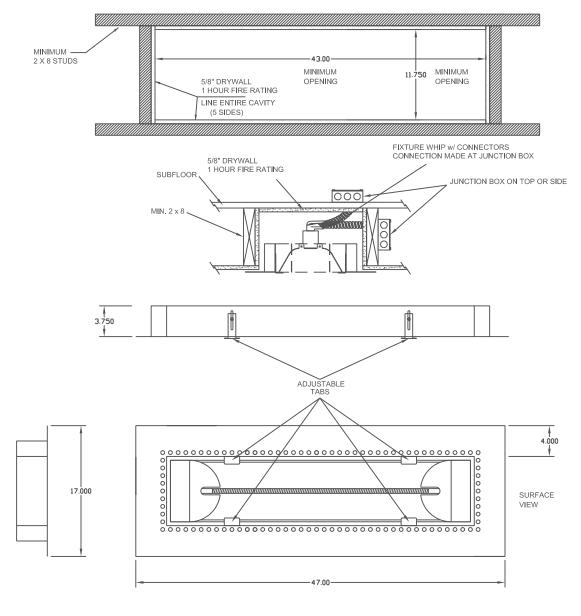

NOTES: - Heater suspends (Gravity) by resting on adjustable tabs in flush mount fixture.

- Mounting holes on Surface Flange to be determined and drilled by Contractor/Installer.
- Supplied with Hi-Temp Fixture Whip and 2 Hi-Temp Wire Nuts
- Coil excess flex into heater cavity
- Use Licensed Electrician ONLY

INSTALLATION TYPES

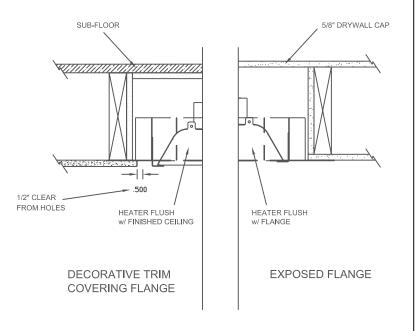




MATERIAL:

STAINLESS STEEL

DATE:


7/30/07

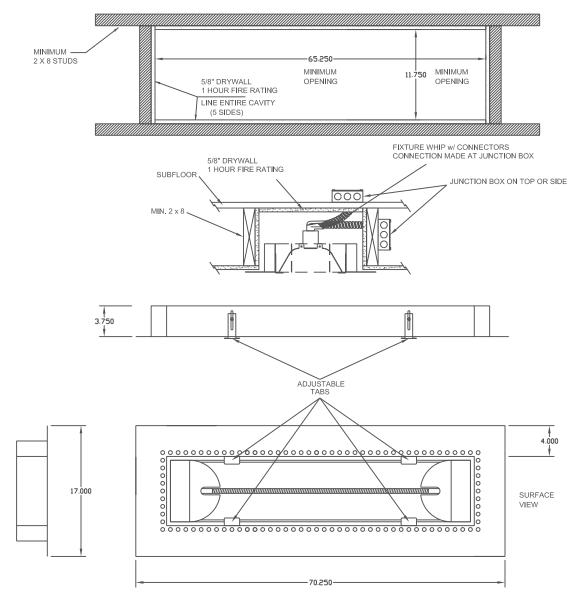

NOTES: - Heater suspends (Gravity) by resting on adjustable tabs in flush mount fixture.

- Mounting holes on Surface Flange to be determined and drilled by Contractor/Installer.
- Supplied with Hi-Temp Fixture Whip and 2 Hi-Temp Wire Nuts
- Coil excess flex into heater cavity
- Use Licensed Electrician ONLY

INSTALLATION TYPES

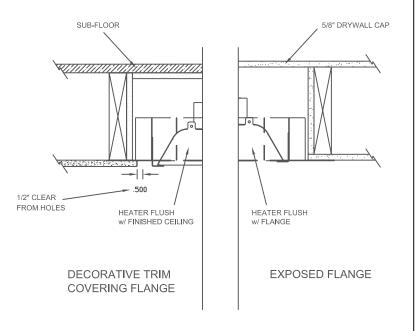



STAINLESS STEEL

7/30/07