



The new degree of comfort.™

## Indoor Cooling Coils For Dual Furnace Application

### RCCL- Series

featuring Industry Standard R-410A  
Refrigerant



**WARNING**  
RCCL COOLING COIL  
FOR USE IN  
UPFLOW APPLICATIONS ONLY

- The RCCL- series cooling coils are designed for use with two Upflow Gas Furnaces and a single 6.5 or 7.5 ton [22.9 or 26.4 kW] commercial condensing unit.
- For twinning furnaces, please refer to the appropriate Installation Instructions.
- RCCL coils are single circuit coils with a mounted expansion valve in a completely assembled and insulated plenum.
- Sheet metal transitions and block-offs for dual furnace applications are packaged with the RCCL coil assembly.

## TABLE OF CONTENTS

Coil Specifications .....	3
Coil Dimensions and Weights.....	4-6

## 6.5 & 7.5 Ton Single Circuit Evaporator Coils

### MODEL RCCL-D5013S

6.5 & 7.5 Ton [22.9 & 26.4 kW] high efficiency evaporator coil.

**NOTE:** Sheet metal transition and block-offs for dual furnace applications are packaged with the RCCL coil assembly.

### THE FOLLOWING FURNACES MAY BE USED IN 6.5 & 7.5 TON UPFLOW APPLICATIONS

<b>80% GAS UPFLOW</b>
R801TA125525MSA

<b>90 PLUS GAS UPFLOW</b>
R95TA1151524SA

**NOTE:** See gas furnace specification sheets to determine appropriate models and fan speeds for 6.5 & 7.5 ton [22.9 & 26.4 kW] applications.

## Pressure Drop (Inches, Water Column) [kPa]

RCCL-D5013S					
CFM [L/s]	DRY COIL	WET COIL	CFM [L/s]	DRY COIL	WET COIL
2400 [1133]	.15 [.04]	.18 [.04]	3800 [1793]	.25 [.06]	.32 [.08]
2600 [1227]	.16 [.04]	.20 [.05]	4000 [1888]	.26 [.06]	.34 [.08]
2800 [1321]	.18 [.04]	.22 [.05]	4200 [1982]	.28 [.07]	.36 [.09]
3000 [1416]	.19 [.05]	.24 [.06]	4400 [2077]	.30 [.07]	.38 [.09]
3200 [1510]	.20 [.05]	.26 [.06]	4600 [2171]	.31 [.08]	.40 [.10]
3400 [1605]	.22 [.05]	.28 [.07]	4800 [2265]	.32 [.08]	.42 [.10]
3600 [1699]	.23 [.06]	.30 [.07]			

[ ] Designates Metric Conversions

## Physical Data Table


<b>MODEL NO. RCCL-</b>	<b>D5013S</b>
Nominal Tons [kW]	6.5, 7.5 [22.9, 26.4]
Coil Face Area (Sq. Ft.) [m <sup>2</sup> ]	12.57 [1.17]
Coil Tube Diameter (In.) [mm]	3/8" [9.5]
Coil, Rows Deep—Fins Per Inch	4/12
<b>REFRIGERANT CONTROL:</b> Thermal Expansion Valve	BBIZE-8
<b>CABINET:</b> Finish	Galvanized
Sheet Metal	Galvanized
Gauge (Nominal)	20
<b>UNIT WEIGHTS:</b> Operating (lbs.) [kg]	130 [57.7]
Shipping (lbs.) [kg]	140 [63.5]
Packaging Dimensions (H x W x L) (In.) [mm]	26" x 26" x 52 1/4" [660.4] x [660.9] x [1327.2]

## A.R.I. Ratings

<b>INDOOR COOLING COIL WITH CONDENSING UNIT</b>				
<b>80°F. D.B. [27°C]/67°F. W.B. [19°C] INDOOR—95°F. D.B. [35°C] OUTDOOR</b>				
COOLING COIL	CONDENSING UNIT	NET BTUH [kW]	EVAP CFM [L/s]	EER
RCCL-D5013S	RAWL-079+R95T-12	77,000 [22.6]	2,600 [1227]	11.5
	RAWL-091+R801T-12	90,000 [26.4]	2,800 [1321]	11.5

## Coil Dimensional Data

RAWL-079  
RAWL-091

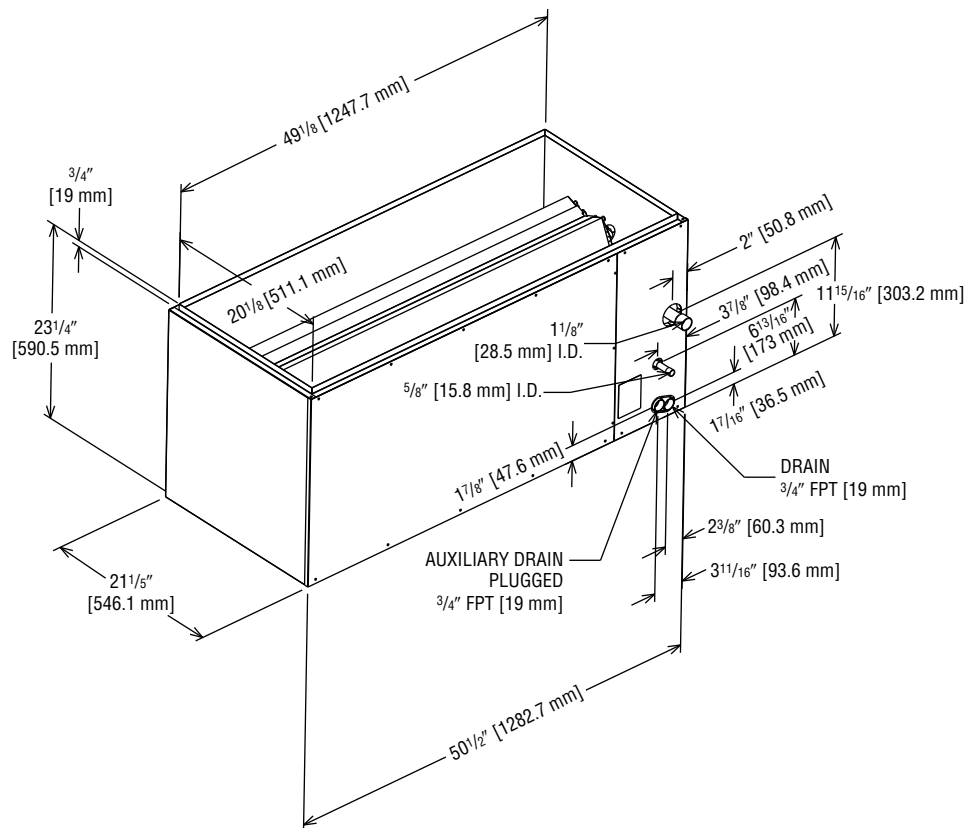

[ ] Designates Metric Conversions

## Airflow Correction Factors

RCCL-D5013S													
ACTUAL — CFM [L/s]	2400 [1133]	2600 [1227]	2800 [1321]	3000 [1416]	3200 [1510]	3400 [1605]	3600 [1699]	3800 [1793]	4000 [1888]	4200 [1982]	4400 [2077]	4600 [2171]	4800 [2265]
TOTAL MBH	0.80	0.84	0.87	0.90	0.92	0.95	0.97	1.00	1.03	1.05	1.07	1.09	1.11
SENSIBLE MBH	0.75	0.80	0.84	0.87	0.90	0.94	0.97	1.00	1.03	1.06	1.09	1.12	1.14



**NOTES:** 1. Multiply correction factor times gross performance data.  
2. Resulting sensible capacity cannot exceed total capacity.

[ ] Designates Metric Conversions

## Coil Piping And Expansion Valve Bulb Location

1. An oil trap in the suction line should be provided.
2. The expansion valve sensing bulb must be strapped securely to the top of the suction line on the outside of the coil cabinet. Both the bulb and suction line must be insulated. See figure 3.
3. The condensate drain connection is 3/4" [19 mm] NPT. A 3" [76.2 mm]: A trap with adequate pitch must be provided. See figure 3.

**FIGURE 1**  
BLOCKOFF CHANNEL INSTALLATION

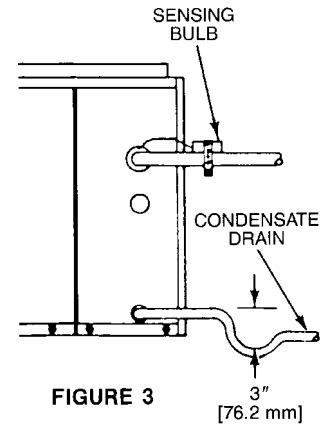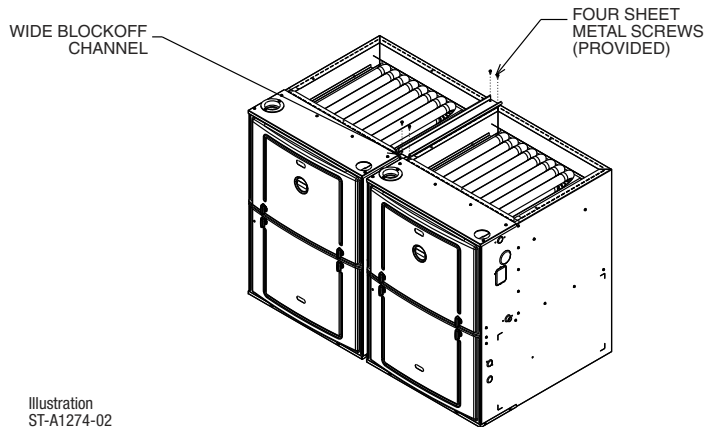

**FIGURE 3**

**(Field Supplied)**

[ ] Designates Metric Conversions





The new degree of comfort.™

*In keeping with its policy of continuous progress and product improvement, Rheem reserves the right to make changes without notice.*

Rheem Heating, Cooling & Water Heating • P.O. Box 17010  
Fort Smith, Arkansas 72917 • [www.rheem.com](http://www.rheem.com)

Rheem Canada Ltd./Ltée • 125 Edgeware Road, Unit 1  
Brampton, Ontario • L6Y 0P5



INTEGRATED HOME COMFORT

PRINTED IN U.S.A. 8/18 QG FORM NO. C11-225