



Lithium-Ion Phosphate Energy Storage System Force-H2 Operation Manual

Information Version:21P2FH0503 PM0MFORCE325

This manual introduces Force-H2 from Pylontech. Force-H2 is a high voltage Lithium-Ion Phosphate Battery storage system. Please read this manual before you install the battery and follow the instruction carefully during the installation process. Any confusion, please contact Pylontech immediately for advice and clarification.

Content

1.	SAFETY	1
	1.1 Symbol	1
	Symbol in label	
	1.2 Before Connecting	4
	1.3 In Using	
2.	SYSTEM INTRODUCE	5
۷.		
	2.1 Product Introduce	
	2.2 Specifications	
	2.2.1 The parameter of system	
	2.2.2 Battery Module (FH48074)	
	2.2.3 Control Module FC0500M-40 (internal power supply)	
	LED Indicators Instructions	
	Definition of RJ45 Port Pin	
	2.3 System Diagram	12
3.	INSTALLATION	13
	3.1 Tools	13
	3.2 Safety Gear	13
	3.3 System Working Environments Checking	14
	3.3.1 Cleaning	14
	3.3.2 Ventilation	14
	3.3.3 Fire-extinguisher System	14
	3.3.4 Grounding System	14
	3.3.5 Clearance	14
	3.4 Handling and placement	14
	3.4.1 Handling and placement of the battery module	14
	3.4.2 Handling and placement of the base	14
	3.4.3 Selection of installation sites	15
	3.4.4 Packing list	15
	3.4.5 Mounting and installation of the base	16
	3.4.6 Battery Modules and Control Module (BMS) pile up	17
	3.4.7 Installation of the metal bracket for the system	18
	3.4.8 Locking of the control Module's fix screw of left and right side	20
	3.5 Cables connection	20
	3.5.2 Cables	22
	3.5.3 System turns on	23

	3.5.4 System turns off	25
4 .	SYSTEM DEBUG	26
5.	MAINTENANCE	27
	5.1 Trouble Shooting:	27
	5.2 Replacement of main component	
	5.2.1 Replacement of Battery Module	29
	5.2.2 Replacement of Control Module (BMS)	31
	5.3 Battery Maintenance	31
6.	REMARKS	33
7.	SHIPMENT	33
8.	ANNEX 1: INSTALLATION AND SYSTEM TURN ON PROGRESS LIST	34
9.	ANNEX 2: SYSTEM TURN OFF PROGRESS LIST	35

1. Safety

The Force-H2 is a high voltage DC system, operated by skilled/qualified personnel only. Read all safety instructions carefully prior to any work and observe them at all times when working on with the system.

Incorrect operation or work may cause:

- injury or death to the operator or a third party;
- > damage to the system hardware and other properties belonging to the operator or a third party.

Skills of Qualified Personnel

Qualified personnel must have the following skills:

- training in the installation and commissioning of the electrical system, as well as the dealing with hazards;
- knowledge of this manual and other related documents;
- knowledge of the local regulations and directives.

1.1 Symbol

i.i Gyinbot		
	Danger	 Lethal voltage! Battery strings will produce HIGH DC power and can cause a lethal voltage and an electric shock. Only qualified person can perform the wiring of the battery strings.
	Warning	 Risk of battery system damage or personal injury DO not pull out the connectors while the system is working! De-energize from all multiple power sources and verify that there is no voltage
	Caution	Risk of battery system failure or life cycle reduces
	Symbol in label	Read the product and operation manual before operating the battery system!
	Symbol in label	Danger! Safety!

	Symbol in label	Warning electric shock!
	Symbol in label	Do not place near flammable material
	Symbol in label	Do not reverse connection the positive and negative
	Symbol in label	Do not place near open flame
	Symbol in label	Do not place at the children and pet touchable area
	Symbol in label	Recycle label
	Symbol in label	Label for Waste Electrical and Electronic Equipment (WEEE) Directive (2012/19/EU)
(6	Symbol in label	The certificate label for EMC

SUD EC 62619	Symbol in label	The certificate label for Safety by TÜV SÜD
Type Approved Safety Regular Production Surveillance www.tuv.com ID 0000000000	Symbol in label	The certificate label for Safety by TÜV Rheinland
TÜVRheinland C US	Symbol in label	The certificate label for Safety by TÜV Rheinland



Danger: Batteries deliver electric power, resulting in burns or a fire hazard when they are short circuited, or wrongly installed.

Danger: Lethal voltages are present in the battery terminals and cables. Severe injuries or death may occur if touch the cables and terminals.



Warning: DO NOT open or deform the battery module, otherwise the product will be out of warranty scope **Warning:** Whenever working on the battery, wear suitable personal protective equipment (PPE) such as rubber gloves, rubber boots and goggles.

Warning: Force-H2 system working temperature range: 0°C∼50°C; Optimum temperature: 18°C∼28°C.

Out of the working temperature range may cause the battery system over / low temperature alarm or protection which further lead to the cycle life reduction as well as. It will affect the warranty terms as well.



Warning: For battery installation, the installer shall refer to NFPA70 or similar local installation standard for operation.



Caution: Improper settings or maintenance can permanently damage the battery. **Caution:** Incorrect inverter parameters will lead to a further faulty/damage to battery.



Reminding

1) It is very important and necessary to read the user manual carefully (in the accessories) before installing or using battery. Failure to do so or to follow any of the instructions or warnings in this document can result in electrical shock, serious injury, or death, or can damage battery, potentially rendering it inoperable.

- 2) If the battery is stored for long time, it is required to charge them every six months, and the SOC should be no less than 90%;
- 3) Battery needs to be recharged within 12 hours, after fully discharged;
- 4) Do not expose cable outside;



1.2 Before Connecting

- 1) After unpacking, please check product and packing list first, if product is damaged or lack of parts, please contact with the local retailer;
- 2) Before installation, be sure to cut off the grid power and make sure the battery is in the switched-off mode:
- 3) Wiring must be correct, do not mistake the positive and negative cables, and ensure no short circuit with the external device;
- 4) It is prohibited to connect the battery and AC power directly;
- 5) Battery system must be well ground and the resistance must be less than 100mΩ;
- 6) Please ensured the electrical parameters of battery system are compatible to related equipment;
- 7) Keep the battery away from water and fire.



1.3 In Using

- 1) If the battery system needs to be moved or repaired, the power must be cut off and the battery is completely shut down;
- 2) It is prohibited to connect the battery with different type of battery.
- 3) It is prohibited to put the batteries working with faulty or incompatible inverter;
- 4) It is prohibited to disassemble the battery (QC tab removed or damaged);
- 5) In case of fire, only dry powder fire extinguisher can be used, liquid fire extinguishers are prohibited;

2. System Introduce

2.1 Product Introduce

Force-H2 is a high voltage battery storage system based on lithium iron phosphate battery, which is one of the new energy storage products developed and produced by Pylontech. It can be used to support reliable power for various types of equipment and systems. Force-H2 is especially suitable for those application scenes which required high power output, limited installation space, restricted load-bearing and long cycle life.

2.2 Specifications



2.2.1 The parameter of system

Product Type		Force-H2	
Cell Technology		Li-iron (LFP)	
Battery System Capacity(kWh)	7.10	10.65	14.20
Battery System Voltage(Vdc)	192	288	384
Battery System Capacity(AH)		37Ah	l
Battery Controller Name		FC0500M-40S	
Battery Module Name		FH9637M	
Battery Module Quantity(pcs)	2	3	4
Battery Module Capacity(kWh)		3.552	
Battery Module Voltage(Vdc)		96	
Battery Module Capacity(AH)		37	
Battery System Charge Upper Voltage(Vdc)	216	324	432
Battery System Charge Current(Amps, Standard)		7.4	
Battery System Charge Current(Amps, Normal)		18.5	
Battery System Charge Current(Amps, Max.@15s)		40	
Battery System Discharge Lower Voltage(Vdc)	174	261	348
Battery System Discharge Current(Amps, Standard)		7.4	
Battery System Discharge Current(Amps, Normal)	18.5		
Battery System Discharge Current(Amps, Max.@15s)	40		
Short circuit rating(Amps)	<4000		
Efficiency(%)	96		
Depth of Discharge(%)		95	
Dimension(W*D*H, mm)	450*296*822	450*296*1118	450*296*1414
Communication		CANBUS/Modbus RT	U
Protection Class		IP55	
Weight(kg)	82	117	152
Operation Life(Years)		15+	
Operation Temperature(°C)	0~50°C		
Storage Temperature(°C)	-20~60°C		
Altitude(m)	<2000		
Humidity	5~95%		
Product Certificate	VDE25	10-50, IEC62619, IEC	62477-1,
Floduct Certificate	IEC62040-1, CEC, CE		
Transfer Certificate		UN38.3	
1) Battery Controller Dimensions(W*D*H)		450×296×190 mm	
2) Battery Module Dimensions (W*D*H)		450×296×296mm	
3) Battery bottom base Dimensions(W*D*H)		450×296×40 mm	

2.2.2 Battery Module (FH48074)



Product Type	FH9637M
Cell Technology	Li-ion (LFP)
Battery Module Capacity (kWh)	3.552
Battery Module Voltage (Vdc)	96
Battery Module Capacity (Ah)	37
Battery Module Serial Cell Quantity (pcs)	30
Battery Cell Voltage (Vdc)	3.2
Battery Cell Capacity (AH)	37
Dimension (W*D*H, mm)	450*296*296
Weight (kg)	35
Operation Life	15+Years
Operation Cycle Life	5,000
Operation Temperature	0~50°C
Storage Temperature	-20~60°C
Transfer Certificate	UN38.3


2.2.3 Control Module FC0500M-40 (internal power supply)



Control Module (FC0500-40) Display Panel



LED Button

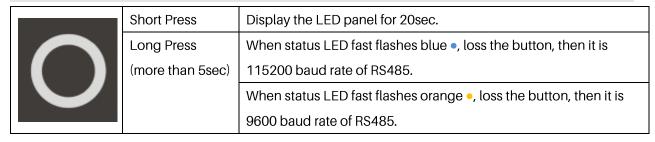

Status



2 colors, Blue and orange Refer to [LED Indicators Instructions]

Battery Module Status		
1	Blue solid	Normal
2		
3		
4	Orange solid	Individual module alarm or protection.
5		See trouble shooting steps in section
— 7		5.1

System Capacity



System SOC
Each LED indicate 25%SOC

Indicate the system SOC.


LED Indicators Instructions

Condition	STATUS	<u>[[]]</u>	Note
Self-checking	Blue, Flashing	All flashing	
Self-checking failure	Orange, Slow flashing	Off	Battery Module Status off. See trouble shooting steps in section 5.1
Black start success	Blue, fast flashing	Off	
Black start failure	Orange, Fast flashing	Off	See trouble shooting steps in section 5.1
Communication Lost or BMS error	Orange, solid	Indicate SOC, blue, solid	See trouble shooting steps in section 5.1
Idle	Blue, slow flashing	Indicate SOC, blue, solid	
Charge	Blue, solid	Indicate SOC, blue, solid	
Floating charge	Blue, solid	All flashing, horse race lamp	
Discharge	Blue, flashing	Indicate SOC, blue, solid	
System sleep	Blue, flashing	Off	Battery module status off

Remark: Slow flashing: 2.0s ON/1.0s OFF. Flashing 0.5s ON/0.5s OFF.

Fast flashing: 0.1s ON/0.1s OFF.

Control Module (FC0500M-40S) Cable Panel

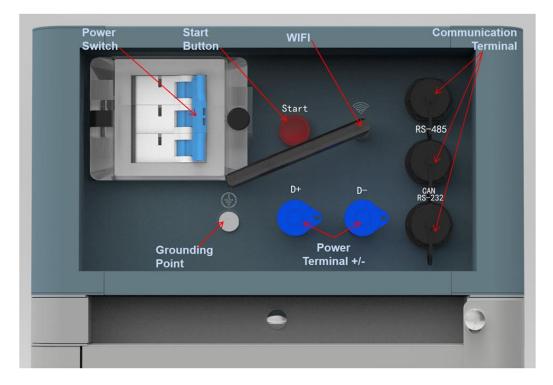

Power Switch

ON: main breaker ON, able to turn on battery system by start button.


OFF: system turn off completely, no power output.

Caution: When the breaker is tripped off because of over current or short circuit, must wait more than 30min then can turn on it again, otherwise may cause the breaker damage.





Start function: press more than 5sec until the buzzer rings, to turn on controller.



Black start function: when system turn on, and relay is OFF, press more than 10sec, and relay will turn on for 10 min without communication(depends on conditions).

Wi-Fi

Manufacturer: Pylon Technologies Co., Ltd.

Address: Plant 8, No.505 Kunkai Road, JinXi Town, 215324 Kunshan City, Jiangsu Province,

PEOPLE'S REPUBLIC OF CHINA

Importer: XXXX (Located in installed country)

Address: XXXX (Located in installed country)

Wireless maximum output power: 20dBm

Operating frequency: 2412-2472MHz

Gain of antenna: Max 3dBi

Modulation system:

DBPSK/DQPSK/CCK(DSSS)

BPSK/QPSK/16QAM/64QAM(OFDM)

Modulating Repetition:

1Mbps/2Mbps/5.5Mbps/11Mbps(DSSS)

6Mbps/9 Mbps/12 Mbps/18 Mbps/24 Mbps/36 Mbps/48 Mbps/54 Mbps(OFDM)

MCS0~MCS7(802.1 1n 20MHz)

Channel spacing:5MHZ

Type of antenna: 2.4G IPEX-SMA Antenna

Power Terminal (+/-)

Connect power cables of battery system with Inverter.

Communication Terminal (RS485 / CAN / RS232)


RS485 Communication Terminal: (RJ45 port) follow MODBUS 485 protocol, for communication between battery system and inverter.

CAN Communication Terminal: (RJ45 port) follow CAN protocol, for communication between battery system and inverter.

RS232 Communication Terminal: (RJ45 port) for manufacturer or professional engineer to debug or service.

Definition of RJ45 Port Pin


No.	CAN	RS485	RS232
1			
2	GND		
3			TX
4	CANH		
5	CANL		
6			RX
7		RS485A	
8		RS485B	



RJ45 Port



2.3 System Diagram

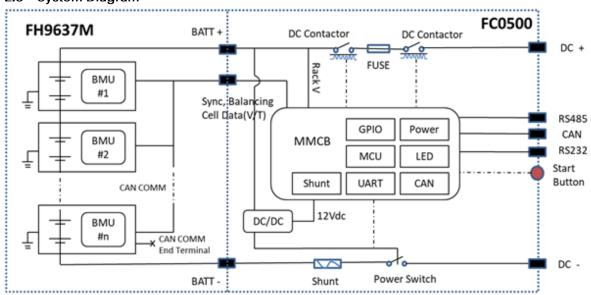

3. Installation

3.1 Tools

The following tools are required to install the battery pack:



NOTE

Use properly insulated tools to prevent accidental electric shock or short circuits.

If insulated tools are not available, cover the entire exposed metal surfaces with available insulated alternatives, except their tips, with electrical tape.

3.2 Safety Gear

It is recommended to wear the following safety gear when dealing with the battery pack



3.3 System Working Environments Checking

3.3.1 Cleaning



Before installation and system power on, the dust and iron scurf must be removed to keep a clean environment.

The system cannot be installed in desert area without an enclosure to prevent from sand.



Danger: Battery module has active DC power at terminal all the time), must be careful to handle the modules.

3.3.2 Ventilation



Force-H2 system working temperature range: $0^{\circ}\text{C} \sim 50^{\circ}\text{C}$; Optimum temperature: $18^{\circ}\text{C} \sim 28^{\circ}\text{C}$.

There is no mandatory ventilation requirements for battery module, but please avoid of installation in confined area. The aeration shall avoid of high salinity, humidity or temperature.

Caution: Force-H2 system is IP55 design. But please avoid frost or direct sunlight. Out of the working temperature range will cause the battery system over / low temperature alarm or protection which further lead to the cycle life reduction. According to the environment, the cooling system or heating system should be installed if it is necessary.

3.3.3 Fire-extinguisher System

It must be equipped with fire-extinguisher system for safety purpose.

The fire system needs to be regularly checked to be in normal condition. Refer to the using and maintenance requirements please follow local fire equipment guidance.



3.3.4 Grounding System

Before the battery installation must make sure the grounding point of the basement is stable and reliable. If the battery system is installed in an independent equipment cabin (e.g. container), must make sure the grounding of the cabin is stable and reliable.

The resistance of the grounding system must ≤100mΩ

3.3.5 Clearance

Minimum clearance to heat source is more than 2 meters.

Minimum clearance to battery module(rack) is more than 0.5 meters.



3.4 Handling and placement

Warning: The battery pile's power terminals are high voltage DC. It must be installed in a restricted access area:

Warning: Force-H2 is a high voltage DC system, operated by qualified and authorized personnel only.



3.4.1 Handling and placement of the battery module


Single battery module is 36kg. If without handling tools must have more than 2 men to handling with it.

3.4.2 Handling and placement of the base

The base is light, single person can handle with it.

3.4.3 Selection of installation sites

- A. Force-H2 system working temperature range: $0^{\circ}\text{C} \sim 50^{\circ}\text{C}$; Optimum temperature: $18^{\circ}\text{C} \sim 28^{\circ}\text{C}$. Do not place the battery system in direct sun light. It is suggested to build sunshade equipment. In cold area the heating system is required.
- B. Force-H2 system must not be immersed in water. Cannot be placed the battery base in rain or other water sources. As a suggestion, the base's height shall >300mm above the ground.
- C. The base's weight capacity should support the weight of whole battery system (130~300kg).
- D. Force-H2 system bust be installed on fixed ground.

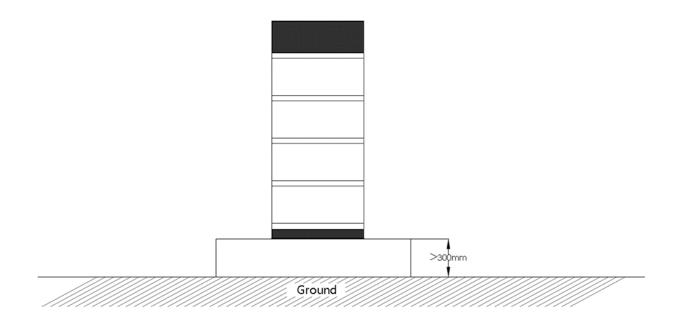

3.4.4 Packing list


FC0500	FC0500M-40S Battery Controller			
Item	Description	Set		
1	FC0500M-40S Battery Controller	1		
2	Force-H2 basement (450*296*40, mm)	1		
3	EPE foam	2		
4	3.5M black external communication cable (RJ45 - M19)	2		
5	3.5M DC+ red external power cable (10AWG)	1		
6	3.5M DC- black external power cable (10AWG)	1		
7	1M yellow-green grounding cable (10AWG)	1		
8	M4 screws for fixing brackets	14		
9	M8 bolts for fixing basement	4		
10	Product Manual	1		


11	Warranty card	1			
FH9637	FH9637M Battery Module				
1	FH9637M battery module				
2	EPE foam	2			
External	External Bracket Kit*				
1	660 mm bracket	2			
	For up to 2 battery modules installation				
2	622 mm bracket	2			
	In combine use with 660mm bracket for up to 4 modules installation;				
	see below installation picture;				

*The external bracket kit only needed when the product article number (can be checked on Battery controller carton box) is FM0500MA01V00102.


3.4.5 Mounting and installation of the base

The base must be fixed installed on the basement with 4pcs M8×80 foundation bolts. Battery rack basement holes bitmap (unit: mm):

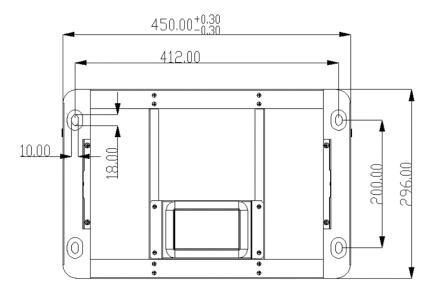

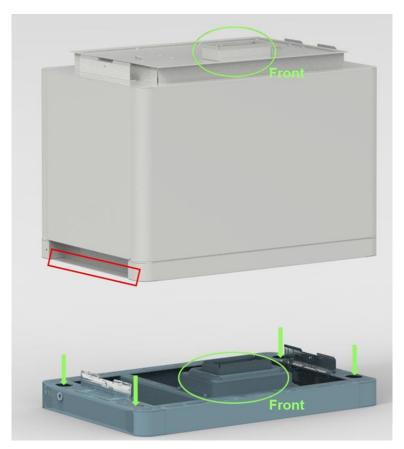


3.4.6 Battery Modules and Control Module (BMS) pile up

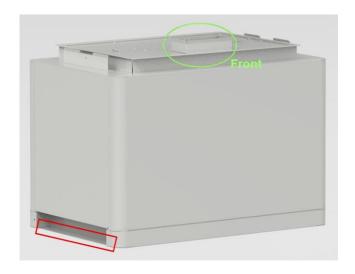

Handle above the red marked edgings of the both side of these battery modules and control module (BMS). **Caution:** If hands under this red marked side, hands will get hurt.



Danger: when battery is connected together with the base the internal socket still have high voltage DC power from serial connected battery modules (battery module can't be turned off).

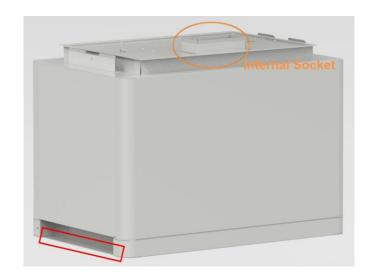


3.4.7 Installation of the metal bracket for the system

In control module's package has 2pcs short and 2pcs long metal bracket s.

Fix these metal brackets at the both back side corners.



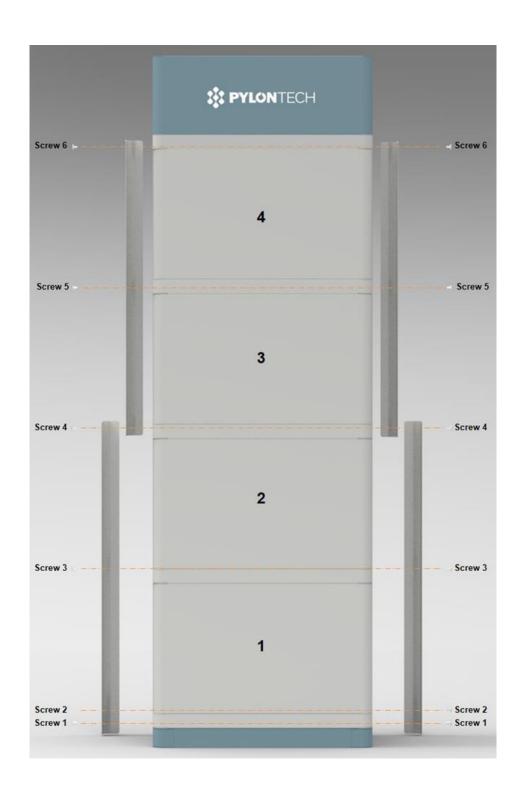



3.4.8 Locking of the control Module's fix screw of left and right side



3.5 Cables connection

Attention:

A

Danger: The battery system is high voltage DC system. Must make sure the grounding is fixed and reliable.

Danger: All the plugs and sockets of the power cables must be not reverse connection. Otherwise it will cause personal injury.

Danger: No short circuit or reserved connection of the battery system's positive and negative port.


Caution: Wrong communication cables connection will cause the battery system failure.








The Force-H2 modules has 3 grounding point

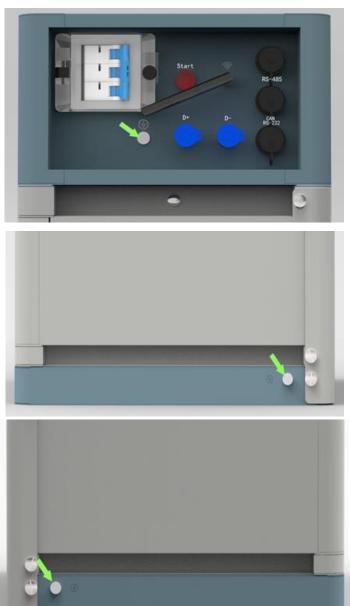

Grounding cable must \geq 10AWG. The cable shall be copper with yellow-green color.


3.5.2 Cables



To disconnect, a special tool is required. Do not pull out directly



Note: Communication cable uses RJ45 connector and water-proofed cover(M19-RJ45) matched with controller connection port.

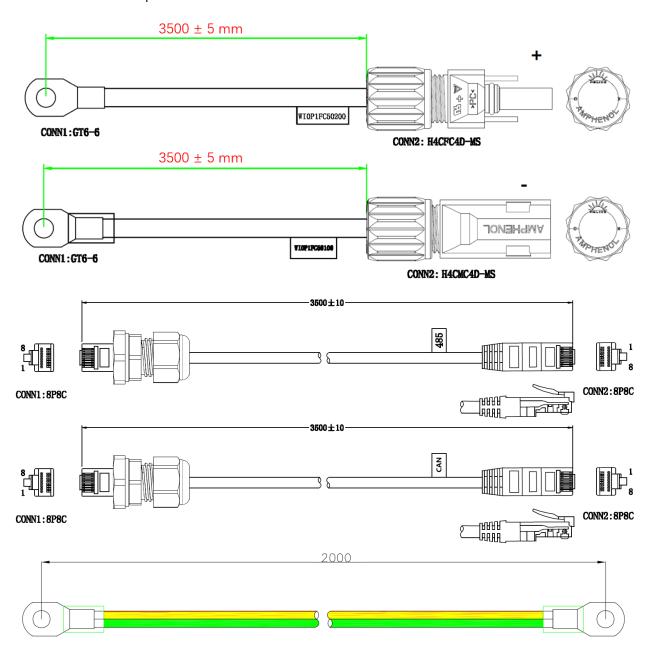



3.5.3 System turns on



Warning: Double check all the power cables and communication cables. Make sure the voltage of the inverter/PCS is same level with the battery system before connection. Check all the power switch are OFF. System turns on step:

- 1) Check all cables are connected correctly. Check grounding is connected.
- 2) If necessary, turn on the switch at inverter's battery side or between inverter and battery. If possible, turn on AC or PV power source to wake up inverter.
- 3) Open protect cover of Power switch. And turn on power switch.
- 4) Press start button for at least 5 seconds or until buzzer rings. Battery takes 10-30s for self-checking.

If inverter is turned on by AC or PV source, then most inverter can setup communication with BMS automatically, in this case, the BMS will close relay and system is ready for work.

If inverter needs battery power to turn on, then check the LED of battery shall be:



In this case, press the Start button for at least 10s, till the Status lighting Blue and fast flashing, then battery will black start to support inverter and after inverter turned on and set up communication, then BMS is ready for work.



Caution: When the breaker is tripped off because of over current or short circuit, must wait after 10min to turn on it again, otherwise may cause the breaker damage.





Warning: If has failure during the self-check, must debug the failure then can start next step.

If the "STATUS" lamp shows orange from beginning, it means there has some failure in the battery string, the Power Relays in BMS will open, must debug at first.

Note: The LED lamp will be off in 20sec without any operation.



Caution: During first time power on, the system will require to do fully charge progress for SOC calibration purpose.

Caution: it is suggested to fully charge the whole Battery Energy Storage System (BESS) first after installation or after long time storage without charging. Depending on the soc level, there will be a regularly (3 month) fully charge requesting during continuous operation as well, it will be handled automatically by the communication between BESS and external device.

3.5.4 System turns off

When failure or before service, must turn the battery storage system off:

- (1) Turn off inverter or power supply on DC side.
- (2) Turn off the switch between PCS and battery system.
- (3) Turn off the "Power Switch" of the BMS.





Caution: Before replace the battery module for service, must charge/discharge the existing battery module voltage similar to the replacement. Otherwise the system need long time to do the balance for this replaced battery module.

NOTE

After installation, DO NOT forget to register online for full warranty: www.pylontech.com.cn/service/support

4. System Debug

This system debug is for BESS system (Battery Energy Storage System). BESS system can't do the debug itself. It must operation with configured inverter, UPS, PCS and EMS system together.

Debug Step	Content			
Prepare of debug.	Turn on the BESS system, refer to chapter 3. Before turn on the whole BESS			
	system turn on the load is not allowed!			
	Remark: Except the BESS, if other equipment have its own system turn on step,			
	must follow the operation manual.			
Working together with	1) Check the communication cable connection and make sure the cable			
inverter	order on battery and inverter side are matched. All undefined pin are			
	suggested to be empty.			
	2) Check the baud rate of inverter. The default of battery CAN is 500kbps,			
	MODBUS 485 is 9600bps. If necessary, change the baud rate of RS485.			
	3) Check the terminal resistance CAN 120 Ω , 485 120 Ω			
	4) If necessary, check the setting on inverter or control box has right			
	parameter and brand of battery. And check the information of BESS shown on			
	inverter is correct.			

5. Maintenance

5.1 Trouble Shooting:



Danger: The Force-H2 is a high voltage DC system, operated by qualified and authorized person only.Danger: Before check the failure, must check all the cables connection and the BESS system can turn on normally or not.

Check the environment first

No	Problem	Possible Reason	Solution		
1	No power output, no led	Press start button too short.	To turn on, at least 5s		
	on.		To black start, at least 10s.		
		The button battery in controller is	Change the controller module.		
		missing or failure.			
		The power supply in controller is			
		failure			
		The battery voltage is too low.	Make sure at least 2 battery modules.		
		The connector of base is failure	The base is not connected or change the base		
2	After turned on, status	Self-checking failure.	Make sure no DC voltage or set		
	LED slow flashing orange.	DC side has a voltage, but voltage	correct DC voltage before		
	Others off.	difference with the battery system is	press start button.		
		higher than 20V.	Then follow turn on process.		
		BMS internal failure.	Use debug tool to further		
			analysis or change the		
			controller module.		
3	Status LED fast flashing	The time interval after last time black	Wait more than 5 minutes and		
	orange, others off.	start is too short.	try black start again.		
		The battery system under error	Make sure no other protection		
		condition such as: temperature or	factor. Or use debug tool to		
		current protection or other error, thus	further analysis.		
		do not response black start.			
4	Buzzer rings continue	Relay adhesion or failure.	Completely disconnect battery		
			system with any DC source		
			then make a restart. If problem		
			remain, then swap the		
			controller.		
5	Status LED solid orange.	Communication lost with inverter	Check the communication		
	Battery module LED blue		cable PIN and wiring whether		
	solid.		is correctly.		
		Over current protection.	Check DC side. And wait until		
			BMS release protection.		
		Controller failure.	Use debug tool to further		

			analysis or change the controller module. Or use debug tool.
6	Status LED solid orange. Battery module exists LED in orange solid	Over/ under temperature protection.	Check environment temperature. And wait BMS release.
		Over voltage protection.	Check DC charge voltage setting or wait BMS release.
		Under voltage protection.	Use black start function, and then charge the system.
		Battery module BMS failure	Use debug tool to further analysis or change the battery module.
7	All LED blue but no output.	Fuse fusing	Change the controller module
8	Other failure	Cell failure or electrical board failure. Or failure need debug tool for further debug.	Can't find out failure point or can't check. Please contact with distributor or Pylontech.

Once a certain failure detected following the trouble shooting steps, shut down the battery string first before replacement to avoid further over discharge to the system due to the self-consumption.

5.2 Replacement of main component



Danger: The Force-H2 is a high voltage DC system, operated by qualified and authorized person only.

Danger: Before replace the main component must shut off the maintenance

battery string's power. Must confirm the D+ and D- terminal are without

power. The turn off progress refer to chapter 3.6.5.

5.2.1 Replacement of Battery Module

5.2.1.1 Charge existing module to full (SOC 100%). Make sure new battery module is 100% as well.

5.2.1.2 Turn off the whole battery string's power. Must confirm the D+ and D-terminal are without power. The turn off progress refer to chapter 3.5.4.

5.2.1.3 Dismantle **D+** and **D-** Power Cable, Communication Cable and Grounding Cable.

5.2.1.4 Dismantle the control Module's fix screw of left and right side. And dismantle the fix metal brackets.




5.2.1.5 Move the control module and each battery module one by one.



Danger: when battery is connected together with the base the internal socket still have high voltage DC power from serial connected battery modules (battery module can't be turned off).



Handle above the red marked edgings of the both side of these battery modules and control module (BMS). **Caution:** If hands under this red marked side, hands will get hurt.





Warning: Single battery module is 35kg. If without handling tools must more than 2 men to handling with it.

5.2.1.6 Pile up the new battery module. And pile up the battery modules and control module up again. 5.2.1.7 Install back the control Module's fix screw of left and right side. And Install back the fix metal brackets.

5.2.1.8 Install back Grounding Cable, Communication Cable and the D+ and D- Power Cable. 5.2.1.9 Turn on this battery string. Refer to chapter 3.5.4.





5.2.2 Replacement of Control Module (BMS)

5.2.2.1 Turn off the whole battery string's power. Must confirm the D+ and D- terminal are without power. The turn off progress refer to chapter 3.5.4.

5.2.2.2 Dismantle D+ and D- Power Cable, Communication Cable and Grounding Cable.

5.2.2.3 Dismantle the control Module's fix screw of left and right side. And dismantle the fix metal brackets.

5.2.2.4 Remove the control module.





Danger: when battery is connected together with the base the internal socket still have high voltage DC power from serial connected battery modules

(battery module can't be turned off).

5.2.2.5 Pile up the new control module.

5.2.2.6 Install back the control Module's fix screw of left and right side. And Install back the fix metal brackets.

5.2.2.7 Install back Grounding Cable, Communication Cable and the D+ and D- Power Cable.

5.2.2.8 Turn on this battery string. Refer to chapter 3.5.4.



5.3 Battery Maintenance

Danger: The maintenance of battery must be done by qualified and authorized personnel only.

Danger: Some maintenance items must turn off at first.

5.3.1 Voltage Inspection:

[Periodical Maintenance] Check the voltage of battery system through the monitor system. Check the system whether exist abnormal voltage or not. For example: Single cell's voltage is abnormal high or low.

5.3.2 SOC Inspection:

[Periodical Maintenance] Check the SOC of battery system through the monitor system. Check the battery string whether exist abnormal SOC or not.

5.3.3 Cables Inspection:

[Periodical Maintenance] Visual inspect all the cables of battery system. Check the cables has broken, aging, getting loose or not.

5.3.4 Balancing:

[Periodical Maintenance] The battery strings will become unbalance if long time not be full charged. Solution: every 3 month should do the balancing maintenance (charge to full), normally it will been done automatically by the communication between system and external device.

5.3.5 Output Relay Inspection:

[Periodical Maintenance] Under low load condition (low current), control the output relay OFF and ON to hear the relay has click voice, that's mean this relay can off and on normally.

5.3.6 History Inspection:

[Periodical Maintenance] Analysis the history record to check has accident (alarm and protection) or not, and analysis its reason.

5.3.7 Shutdown and Maintenance:

[Periodical Maintenance]

Some system function must be maintenance during the EMS restart, it is recommended to maintenance the system every 6 months.

5.3.8 Recycle

NOTE

Damaged batteries may leak electrolyte or produce flammable gas.

In case a damaged battery needs recycling, it shall follow the local recycling regulation (ie. Regulation (EC) N 1013/2006 among European Union) to process, and using the best available techniques to achieve a relevant recycling efficiency.

6. Remarks

Storage

For long-term storage (more than 3 months), the battery cells should be stored in the temperature range of 5~45°C, relative humidity <65% and contains no corrosive gas environment.

The battery module should shelfed in range of 5~45°C, dry, clean and well ventilated environment.

Before storage the battery should be charged to 50~55% SoC;

It is recommended to active the chemical (discharge and charge) of the battery every 3 months, and the longest discharge and charge interval shall not exceed 6 months.



Caution: If not follow the above instructions for long term store the battery, The cycle life will have relative heavily reduction.

Capacity expansion

A new battery module can be add onto an existing system at any time. Please make sure the existing system is being fully charged before add on a new module. In a serial connection system, the new module, even has a higher SOH, will follow the system worst SOH condition module to perform.

7. Shipment

Battery module will pre-charged to 100%SOC or according to customer requirement before shipment. The remaining capacity of battery cell, after shipment and before charge, is determined by the storage time and condition.

- 1. The battery modules meet the UN38.3 certificate standard.
- 2. In particular, special rules for the carriage of goods on the road and the current dangerous goods law, specifically ADR (European Convention on the International Carriage of Dangerous Goods by Road), as amended, must be observed.

Any further questions, please contact Pylontech: service@pylontech.com.cn

8. Annex 1: Installation and System Turn ON Progress List

Tick after completion	No.	Item	Remark
		The environment is meeting all technical requirements.	
	1	3.3.1 Cleaning	
		3.3.2 Temperature	Refer to chapter
	'	3.3.3 Fire-extinguisher System	3.3
		3.3.4 Grounding System	
		3.3.5 Clearance	
	2	Selection of installation sites.	Refer to chapter
Ш		Coloure in included in these.	3.4.3.
	3	Battery base is installed follow the technical requirements.	Refer to chapter
Ш		Buttery base is installed reflew the teermout requirements.	3.4.4.
	4	Battery modules installation.	Refer to chapter
Ш		Battery modules motulation.	3.4.5.
	5	Battery system are fixed.	Refer to chapter
Ш		Battery dysterm are mod.	3.4.6.
	6	Control Module (BMS) and Battery Module are installed well.	Refer to chapter
Ш	Ů	Control Module (BMC) and Battery Mediate are installed Wett	3.4.7.
	7	Connect D+ and D- between BMS to the inverter/PCS or	Refer to chapter
Ш		confluence cabinet.	3.5.2.
	8	Connect the grounding cable.	Refer to chapter
Ш		oormoot the grounding oubte.	3.5.1.
	9	Double check every power cables , communication cables ,	Refer to chapter
	J	grounding cable installed well.	3.5.2 and 3.5.1.
	10	Switch the external power or inverter/PCS on, ensure all the	Refer to chapter
	10	power equipment can work normally.	3.6.4.

	The first installation should do full charging progress automatically.	
11	If the status LED of BMS turns to blue, it means this battery string is operation.	

9. Annex 2: System Turn OFF Progress List

Tick after completion	No.	ltem	Remark		ark
	1	Soft-off the inverter through inverter's control panel.	Refer	to	chapter
	ļ	3011-011 the inverter through inverter 3 control panet.	3.5.4.		
	2	Turn off the switch between inverter and this battery string (Force-H2), or turn off the power switch of inverter, to make sure no current through this battery string.	Refer 3.5.4.	to	chapter
	3	Turn off the "Power Switch" of the BMS.	Refer 3.5.4.	to	chapter



Pylon Technologies Co., Ltd.

No. 73, Lane 887, ZuChongzhi Road, Zhangjiang Hi-Tech Park Pudong, Shanghai 201203, China T+86-21-51317699 | F+86-21-51317698

E service@pylontech.com.cn

W www.pylontech.com.cn