


DUCKBILL CHECK VALVE

Replacement Instructions


⚠ WARNING TO BE INSTALLED AND MAINTAINED BY PROPERLY TRAINED PROFESSIONAL INSTALLER ONLY. READ MANUAL & LABELS FOR ALL SAFETY INFORMATION & INSTRUCTIONS.

⚠ CAUTION Turn off water system, disable all pumps and depressurize the system before performing installation. Always wear proper protective safety equipment when working with metering pumps.

These instructions are for replacements. For initial installations, refer to the manual for the specific pump series.



Trim injection fitting quill

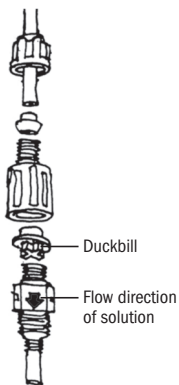

Injection Check Valve
Exploded View

- 1 A 1/4" or 1/2" Female NPT (FNPT) connection is required for installing the injection fitting. If there is no FNPT fitting available, provide one by either tapping the pipe or installing FNPT pipe tee fitting.
- 2 Wrap the Male NPT (MNPT) end of injection fitting with 2 to 3 turns of threading tape. If necessary, trim the injection fitting quill as required to inject product directly into flow of water.
- 3 Hand tighten the injection fitting into the FNPT fitting.
- 4 Prior to connection, test injection check valve and NPT threads for leaks by pressurizing system. If necessary, tighten an additional 1/4 turn.
- 5 Install connecting nut and ferrule to the pump discharge line. Insert discharge line into check valve body until it reaches base of body.
- 6 Finger tighten connecting nut to fitting. If using 3/8" connections, firmly hold the check valve body and wrench tighten the 3/8" connecting nut one additional half turn. If a leak occurs, gradually tighten the 3/8" connecting nut as required.
- 7 Turn pump on and re-pressurize system. Observe chemical flow as actuated by system and check all connections for leaks.
- 8 After suitable amount of dosing time, perform tests for desired chemical readings (e.g., pH or ppm). If necessary, adjust the pump output or solution strength.

This information is not intended for specific application purposes. Stenner Pump Company reserves the right to make changes to prices, products, and specifications at any time without prior notice.

INSCV 020922