

# Greater Victoria Drinking Water Quality 2016 Annual Report

Parks & Environmental Services Department

Environmental Protection



Prepared By  
Water Quality Program

**Capital Regional District**

479 Island Highway, Victoria, BC, V9B 1H7

T: 250-474-9680 F: 250-474-9691

[www.crd.bc.ca](http://www.crd.bc.ca)

April 2017



## Greater Victoria Drinking Water Quality 2016 Annual Report

### EXECUTIVE SUMMARY

This report provides the annual overview of CRD Water Quality Monitoring Program and its results on water quality in 2016 within the Greater Victoria Drinking Water System (GVDWS) and its individual system components (Map 1). The results indicate that Greater Victoria's drinking water continues to be of good quality and is safe to drink.


The monitoring program is designed to meet the requirements of the provincial regulatory framework which is defined by the *BC Drinking Water Protection Act* and *Drinking Water Protection Regulation*, as well as follow the federal Guidelines for Drinking Water Quality.

The approximately 11,000 hectares of the Sooke and Goldstream watersheds comprise the source of our regional drinking water supply area. Water flows from the reservoirs to the Sooke and Japan Gulch disinfection facilities and then through large diameter transmission mains and a number of storage reservoirs into 8 different distribution systems which in turn deliver the drinking water to the consumers. The monitoring program covers the entire system to anticipate any issues (i.e., source water monitoring), ensure treatment is effective (i.e., transmission and distribution system monitoring) and address any concerns or questions by the general public. The program adopts a multiple lines of evidence approach (biological, chemical and physical) to ensure all aspects of water quality are considered. The program is comprehensive, collecting approximately 6,500 samples and conducting approximately 28,000 individual analyses annually. The results are discussed with the Island Health Authority, who oversee compliance with drinking water standards, and with our Capital Regional District (CRD) operations and municipal staff, who rely on the information to properly operate and maintain the system components.

Our source water is unfiltered and the source reservoirs are large systems that operate as functioning ecosystems. Water quality monitoring in the watersheds serves several purposes: 1) to verify that we continue to comply with the criteria for an unfiltered surface water source; 2) to understand the quality of the water flowing into the reservoirs; 3) to ensure that we are aware of the presence and absence of water quality-relevant organisms in the lakes, as well as specific pathogens, prior to any treatment; 4) to confirm that the water quality parameters remain within the effectivity range of our disinfection treatment; and 5) to detect any taste and odour concerns that could then pass through the system.

This is the first annual water quality report by the CRD that separates the water system components that are CRD responsibility from system components that are the responsibility of the municipalities. Each water distribution system was assessed for compliance with the regulatory requirements. It was found that a number of water purveyors are currently not complying with the regulations and recommendations are made for addressing the shortcomings.

# MAP 1. Greater Victoria Drinking Water System

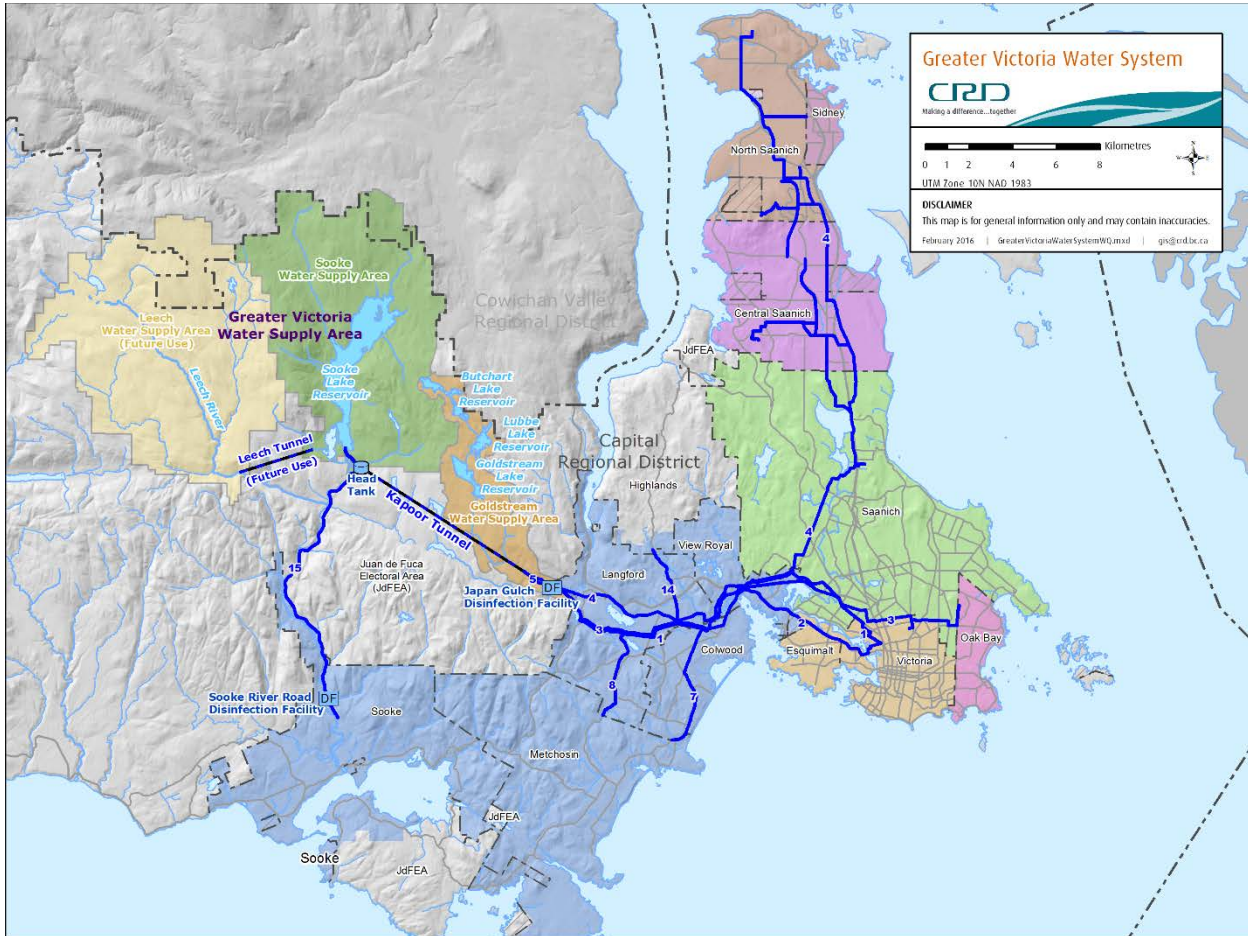

**Greater Victoria Drinking Water Quality  
2016 Annual Report**

**Table of Contents**

<b>EXECUTIVE SUMMARY .....</b>	<b>I</b>
<b>1.0 INTRODUCTION .....</b>	<b>1</b>
<b>2.0 WATER SYSTEM DESCRIPTION .....</b>	<b>1</b>
2.1 SOURCE WATER SYSTEMS .....	1
2.2 WATER DISINFECTION .....	2
2.3 CRD TRANSMISSION SYSTEM.....	3
2.4 DISTRIBUTION SYSTEMS .....	5
<b>3.0 MULTIPLE BARRIER APPROACH TO WATER QUALITY.....</b>	<b>9</b>
<b>4.0 WATER QUALITY REGULATIONS.....</b>	<b>11</b>
<b>5.0 OPERATIONAL CHANGES AND EVENTS – CRD SYSTEMS.....</b>	<b>13</b>
5.1 USE OF GOLDSTREAM WATER .....	13
5.2 SOOKE LAKE RESERVOIR .....	13
5.3 CHLORINE DOSAGE.....	14
5.4 CRD RESERVOIR MAINTENANCE .....	14
<b>6.0 WATER QUALITY MONITORING .....</b>	<b>15</b>
6.1 CRD WATER QUALITY MONITORING PROGRAM.....	15
6.2 SAMPLING PLANS.....	16
6.3 BACTERIOLOGICAL ANALYSES.....	17
6.4 CERTIFICATION AND AUDITS.....	18
<b>7.0 WATER QUALITY RESULTS .....</b>	<b>19</b>
7.1 SOURCE WATER QUALITY RESULTS.....	19
7.2 TREATMENT MONITORING RESULTS .....	33
7.3 CRD TRANSMISSION SYSTEM RESULTS .....	36
7.4 DISTRIBUTION SYSTEM RESULTS .....	40
7.5 WATER QUALITY COMPLAINTS .....	55
<b>8.0 CONCLUSIONS .....</b>	<b>56</b>

**List of Figures**

Figure 1	Water Level Elevation in Sooke Lake Reservoir, 2012–2016 .....	13
Figure 2	Raw Water Entering Japan Gulch Plant Total Coliforms 2007–2016 .....	20
Figure 3	<i>E.coli</i> in Raw Water Entering Japan Gulch Plant in 2016 .....	20
Figure 4A	Total Algal Concentration (Natural Units/mL) Over Time, Sooke Lake Reservoir, South Basin, 1 m Depth (SOL-01-01) .....	21
Figure 4B	Total Algal Concentration (Natural Units/mL) Over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01).....	22
Figure 5A	2016 Sooke Lake Reservoir Monthly Sample Composition (%) by Major Algal Group, South Basin, 1 m Depth (SOL-01-01).....	25
Figure 5B	2016 Sooke Lake Reservoir Monthly Sample Composition (%) by Major Algal Group, North Basin, 1 m Depth (SOL-04-01).....	25
Figure 6A	Total Numbers Rotifer Species over Time, Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01).....	27
Figure 6B	Total Numbers Rotifer Species over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01).....	27
Figure 7A	Total Numbers Copepod Species over Time, Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01).....	28

Figure 7B	Total Numbers Copepod Species over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01).....	28
Figure 8	2016 Turbidity of Raw Water Entering Japan Gulch Treatment Plant .....	29
Figure 9	2016 Temperature of Raw Water Entering Japan Gulch Plant (Weekly Average) .....	30
Figure 10	Total Nitrogen in Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01) .....	31
Figure 11	Total Nitrogen in Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01) .....	31
Figure 12	Total Phosphorus in Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01) .....	32
Figure 13	Total Phosphorus in Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01).....	32
Figure 14	2016 UV Treated Water at Japan Gulch Plant Total Coliforms Before and After UV Treatment .....	33
Figure 15	Treated Water at First Customer below Japan Gulch Plant Monthly Total Coliforms and Chlorine Residual in 2016 .....	34
Figure 16	2016 UV Treated Water at Sooke River Road Disinfection Facility Total Coliforms Before and After UV Treatment.....	35
Figure 17	Treated Water at First Customer below Sooke River Road Disinfection Facility, Monthly Total Coliforms and Chlorine Residual in 2016 .....	36
Figure 18	2016 Transmission Mains Total Coliforms and Chlorine Residual.....	38
Figure 19	2016 Storage Reservoirs Total Coliforms and Chlorine Residual.....	40
Figure 20	JDF – West Shore Distribution System Total Coliforms and Chlorine Residual .....	42
Figure 21	Sooke/East Sooke Distribution System Total Coliforms and Chlorine Residual.....	44
Figure 22	Central Saanich Distribution System Total Coliforms and Chlorine Residual .....	46
Figure 23	North Saanich Distribution System Total Coliforms and Chlorine Residual.....	48
Figure 24	Oak Bay Distribution System Total Coliforms and Chlorine Residual.....	50
Figure 25	Saanich Distribution System Total Coliforms and Chlorine Residuals in 2016.....	52
Figure 26	Sidney Distribution System Total Coliforms and Chlorine Residuals in 2016.....	53
Figure 27	Victoria/Esquimalt Distribution System Total Coliforms and Chlorine Residuals in 2016.....	55

### List of Tables

Table 1	2016 Bacteriological Quality of the CRD Transmission Mains.....	37
Table 2	2016 Bacteriological Quality of Storage Reservoirs.....	39
Table 3	2016 Bacteriological Quality of the Juan de Fuca Distribution System – West Shore Municipalities (CRD).....	41
Table 4	2016 Bacteriological Quality of the Sooke/East Sooke Distribution System (CRD).....	43
Table 5	2016 Bacteriological Quality of the Central Saanich Distribution System.....	45
Table 6	2016 Bacteriological Quality of North Saanich Distribution System.....	47
Table 7	2016 Bacteriological Quality of Oak Bay Distribution System.....	49
Table 8	2016 Bacteriological Quality of Saanich Distribution System.....	51
Table 9	2016 Bacteriological Quality of Sidney Distribution System.....	53
Table 10	2016 Bacteriological Quality of Victoria Distribution System.....	54

Appendix A Tables 1, 2 and 3

# Greater Victoria Drinking Water Quality 2016 Annual Report

## 1.0 INTRODUCTION

This report is the annual overview of the results from water quality samples collected in 2016 from the Greater Victoria Drinking Water System (GVDWS) (Map 1). The report summarizes data from the Capital Regional District (CRD) owned and operated water infrastructure that includes the source reservoirs, the Regional Transmission System and the Juan De Fuca Water Distribution System, as well as data from the municipal distribution systems. Monthly and weekly summary reports on water quality data are posted on CRD's website at: [www.crd.bc.ca/about/data/drinking-water-quality-reports/greater-victoria-water-quality-reports](http://www.crd.bc.ca/about/data/drinking-water-quality-reports/greater-victoria-water-quality-reports)

## 2.0 WATER SYSTEM DESCRIPTION

In 2016, the GVDWS supplied drinking water to approximately 367,000 people and is the third largest drinking water system operating in British Columbia. It comprises 2 separate service areas:

1. The **Japan Gulch Service Area** that supplies water to approximately 355,000 people in Victoria, Saanich, Oak Bay, Esquimalt, the Saanich Peninsula municipalities and the West Shore municipalities via the Japan Gulch Disinfection Facility.
2. The **Sooke Drinking Water Service Area** that supplies water to approximately 12,000 people in Sooke and East Sooke via the Sooke River Road Disinfection Facility.

### 2.1 Source Water Systems

Drinking water for the GVDWS comes from protected watersheds called the Greater Victoria Water Supply Area (see Map 1). This CRD-owned and managed area, which is approximately 11,000 hectares in size, is located about 30 km northwest of the city and encompasses about 98% of the Sooke Lake, 98% of the Goldstream Lake and 92% of the Leech River catchment areas.

#### Japan Gulch Service Area

The 5 reservoirs in the supply area have been used as a source of drinking water since the early 1900s. The Sooke Lake Reservoir, the largest of the reservoirs, is the primary water source for this system, supplying approximately 98% of Greater Victoria's drinking water. The 4 reservoirs in the Goldstream system (Butchart, Lubbe, Goldstream and Japan Gulch reservoirs) are typically offline and are used only as a backup water supply. Controlled releases from the Goldstream Watershed provide water for salmon enhancement in the lower Goldstream River. The Leech River watershed does not yet contribute to the water supply for the GVDWS.

Water at the southern end of Sooke Lake Reservoir enters one of the variable depth gates in the intake tower and is screened through a stainless steel travelling screen (openings of 0.5 mm). From the intake tower, the water passes through two 1,200 mm-diameter pipelines to the Head Tank and then through the 8.8 km-long, 2,300 mm-diameter Kapoor Tunnel and then into 1,525 mm- and 1,220 mm-diameter pipes connecting the Kapoor Tunnel to the Japan Gulch Disinfection Facility where it is disinfected.

During the brief period of its use [typically used only during the winter when the Kapoor Tunnel is out of service for inspection by CRD Integrated Water Services (IWS) staff], water in the Goldstream River Watershed is released from Goldstream Reservoir and flows down the upper reaches of Goldstream River into Japan Gulch Reservoir. Water from Japan Gulch Reservoir enters the Japan Gulch Intake Tower through a low-level intake gate and enters the Japan Gulch Intake Tower, passing through a 14-mesh, stainless steel screen and is then carried in a 1,320 mm-diameter pipe into the Japan Gulch Disinfection Facility.

## Sooke Drinking Water Service Area

Drinking water for the Sooke Drinking Water Service Area is only supplied from Sooke Lake Reservoir, but travels a different route. This water is passed through a 14.5 km-long (9 miles), 600 mm-diameter PVC pipe and ductile iron from a point just above the Head Tank through to the Sooke River Road Disinfection Plant. The Sooke Drinking Water Service Area has no backup water source.

### 2.2 Water Disinfection

The disinfection process in the GVDWS is both simple and effective and uses 2 disinfection facilities to provide disinfected drinking water to 2 large service areas:

- Japan Gulch Disinfection Facility supplies the Japan Gulch Service Area; a small portion of the Highlands is provided water for fire suppression)
- Sooke River Road Disinfection Facility supplies the Sooke Drinking Water Service Area.

Both disinfection facilities utilize the same disinfection concepts but different process methods. The current Japan Gulch facility uses chlorine and ammonia gases for the disinfection process while the Sooke River Road facility generates sodium hypochlorite on site and injects liquid ammonia to achieve the disinfection effect.

At both disinfection facilities, the water passes through a 3-part disinfection process in sequential order—2 primary disinfectant steps that provide disinfection of the water entering the system, followed by a secondary disinfectant step that provides continuing disinfection throughout the transmission system and the distribution systems:

1. **UV Disinfection.** Ultraviolet (UV) disinfection provides the first step in the primary disinfection process (disinfection of the raw source water entering the plants) and inactivates parasites such as *Giardia* and *Cryptosporidium* (3-log [99.9%] inactivation), as well as reducing the level of bacteria in the water.
2. **Free Chlorine Disinfection.** Free chlorine disinfection provides the second step in the primary disinfection process using a free chlorine dosage of approximately 1.6–2.0 mg/L and a minimum of 10-minute (depending upon flow) contact time between the free chlorine and the water. The free chlorine disinfection step inactivates bacteria and provides a 4-log (99.99%) reduction of viruses.
3. **Ammonia Addition.** The secondary disinfection process consists of the addition of ammonia to form chloramines at a point downstream where the water has been in contact with the free chlorine for approximately 10 minutes or more. The ammonia is added at a ratio of approximately 1 part ammonia to 4–5 parts chlorine. In the water, these chemicals combine to produce a chloramine residual (measured as total chlorine). This residual remains in the water and continues to protect the water from bacterial contamination (secondary disinfection) as it travels throughout the pipelines of the distribution system.

In Metchosin at Rocky Point Reservoir, and in East Sooke at the Iron Mine Reservoir, CRD IWS re-chloraminates the water to boost the chlorine residual provided to the extremities of that system. Currently, there are no provisions to re-chloramine the water at the far reaches of the distribution system on the Saanich Peninsula; however, re-chlorination stations are operational at the Upper Dawson Reservoir, Upper Dean Park Reservoir and Deep Cove Pump Station supplying Cloake Hill Reservoir. These re-chlorination stations are able to add free chlorine to the system if the total chlorine residuals have dropped to inadequate levels.

The Japan Gulch Disinfection Facility is currently undergoing a substantial update to replace the aging chlorine and ammonia gas facilities with new liquid chemical storage and injection facilities. This will improve safety and treatment efficiency aspects at this plant.



## 2.3 CRD Transmission System

Using a series of large diameter transmission mains, the CRD supplies treated water in the Japan Gulch Service Area to its downstream customers. These large diameter transmission mains are sorted into 3 sections:

1. Regional Transmission System, that supplies the core area and West Shore municipalities and up to the Saanich Peninsula boundary;
2. The Saanich Peninsula Trunk Water Distribution System that receives water at 2 points on the Saanich Peninsula from the Regional Transmission System and supplies it to the 3 municipalities on the Saanich Peninsula; and
3. The Sooke Supply Main.

### 2.3.1 Regional Transmission System

CRD currently uses 7 large diameter transmission mains to supply drinking water to the municipal distribution systems in the Japan Gulch Service Area. These transmission mains range in diameter from 1,525 mm (60") down to 460 mm (18") and transfer water from the Japan Gulch Disinfection Facility to the distribution systems listed in Section 2.4.

- Main #1 is a 1,067 mm-diameter (42"), cement mortar-lined, welded steel pipe that starts at the Humpback pressure regulating valve (PRV) below the Humpback Reservoir Dam and ends at the David Street vault. This transmission main provides water primarily to the City of Victoria but also services portions of Saanich and the West Shore communities.
- Main #2 is a 780 mm-diameter (31") steel and ductile iron pipe which starts at the Colwood overpass and runs primarily through View Royal, Esquimalt and Vic West along the Old Island Highway and Craigflower Road. Main #2 joins Main #1 at the David Street vault after crossing the Bay Street Bridge. This supply main is 7.6 km in length and provides water to View Royal, Victoria and Esquimalt.
- Main #3 is primarily a 990 mm-diameter (39") steel pipe that supplies water from the Humpback PRV and terminates at the CRD's Mt. Tolmie Reservoir. There are several sections in this line that include 1,220 mm-diameter (48") and 810 mm-diameter (32") pipes. The 810 mm-diameter pipe terminates at the Oak Bay meter vault. This supply main is 21.3 km in length and provides water to the West Shore communities, Saanich, Victoria and Oak Bay.
- Main #4, a high pressure transmission main, is primarily a 1,220 mm-diameter (48"), welded steel pipe that supplies water from the Japan Gulch Disinfection Facility primarily to Saanich and the Saanich Peninsula. There are 2 small sections of 1,320 mm (52") and 1,372 mm (54") reinforced concrete pipe. This transmission main is 26.2 km in length and terminates near the Saanich-Central Saanich boundary where it transfers water to the 762 mm (30") trunk main which extends to McTavish Reservoir. It supplies the municipalities on the Saanich Peninsula and to Bear Hill Reservoir and Hamsterly Pump Station near Elk Lake.
- Main #5 is a 1,524 mm-diameter (60") pipe that connects the Kapoor Tunnel via the Japan Gulch Disinfection Facility to the Humpback PRV just below the old Humpback Reservoir dam. It is approximately 1.6 km in length and provides water to Mains #1 and #3.
- Main #7 is a 610 mm-diameter (24") steel pipe that runs from Goldstream and Whitehead to Metchosin and Duke. It is 4 km in length and provides water to portions of Colwood, Langford and Metchosin.
- Main #8 is a 457 mm-diameter (18") steel and asbestos cement (AC) pipe that runs from Glen Lake School, primarily along Happy Valley Road to Happy Valley and Glenforest. It is 3.6 km in length and provides water to Langford, Colwood and Metchosin.

There are 3 active inter-connections between the high pressure Main #4 and the low pressure Mains #1 and #3 where water can be transferred from Main #4 to the other 2 mains via PRV stations. These stations are located at Watkiss Way, Millstream at Atkins, at Goldstream/Veteran's Memorial Parkway, and Burnside at Wilkinson Road. There is also a series of inter-connections between Main #1 and Main #3 with the major inter-connections, Price Road, Station Road, Tillicum and Dupplin Road.

### 2.3.2 Saanich Peninsula Trunk Water Distribution System

The Saanich Peninsula Trunk Water Distribution System receives water at several points on the Saanich Peninsula from the Regional Transmission System and supplies it to 4 customers on the Saanich Peninsula: the municipalities of Central Saanich, North Saanich, Sidney and the Agricultural Research Station.

The Saanich Peninsula Trunk Water Distribution System is comprised of 46 km of transmission mains including the 750 mm (30") Bear Hill Main, the 400 mm (16") Keating Main, the 400 mm (16") Dean Park Main and the 250–500 mm (10–20") Saanich Peninsula mains.

At McTavish Reservoir (the terminus of the Regional Transmission System), the Saanich Peninsula Trunk Water Distribution System continues further along the peninsula via a 610 mm-diameter (24") concrete cylinder pipe. In the vicinity of the airport, this main reduces to a 406 mm-diameter (16") asbestos cement pipe that terminates at the Deep Cove Pump house. A dedicated 250 mm-diameter (10") perm/PVC pipe connects Deep Cove Pump Station with Cloake Hill Reservoir. A 457 mm-diameter (18") pipe along Mills Road connects the trunk main to the northwest end of the Sidney Distribution System.

The CRD also operates 6 major pumping stations located at Hamsterly, Martindale, Lowe Road, Dean Park Lower, Dean Park Middle and Deep Cove along with 2 minor pumping stations located at Mt. Newton and Dawson Upper Reservoir that are all considered part of the transmission system.

### 2.3.3 Sooke Supply Main

The Sooke Drinking Water Service Area is supplied by Main #15, a 600 mm pipe (upper section PVC, lower high pressure section - ductile iron) that conveys raw water from Sooke Lake Reservoir to the Sooke River Road Disinfection Facility. Main #15 feeds directly into the Sooke distribution system downstream of the disinfection facility.

### 2.3.4 Storage Reservoirs

A number of storage reservoirs are considered part of the transmission system even though most of them technically operate as a distribution reservoir with all its typical functions: balancing, fire and emergency storage.

The CRD-owned and operated transmission system storage reservoirs in the Regional Transmission System are:

- Mt. Tolmie Reservoir, a 2-cell concrete in-ground reservoir, 27,300 m<sup>3</sup>, located on Mt. Tolmie at the terminus of Main #3 near the Oak Bay-Saanich boundary.
- Haliburton Reservoir, a 1-cell concrete in-ground reservoir, 22,700 m<sup>3</sup>, located off Haliburton Road in Saanich; disconnected from the system (off Main #4) and only provides emergency storage.

The CRD-owned and operated transmission system storage reservoirs in the Saanich Peninsula Trunk Water Distribution System are:

- Bear Hill Reservoir, a 2-cell concrete above-ground reservoir, 4,546 m<sup>3</sup> (1,000,000 gallon), located on Bear Hill in Saanich.
- Cloake Hill Reservoir, a 1-cell, 4,546 m<sup>3</sup> (1,000,000 gallon) reservoir located on Cloake Hill in North Saanich.
- Dawson Upper Reservoir, a 1-cell, 455 m<sup>3</sup> (100,000 gallon) reservoir located off Benvenuto Avenue in Central Saanich.
- Dean Park Lower Reservoir, a 2-cell concrete above-ground reservoir, 4,546 m<sup>3</sup> (1,000,000 gallon), located beside Dean Park Road in North Saanich.
- Dean Park Middle Reservoir, 2 cylindrical concrete above-ground tanks, 2,730 m<sup>3</sup> (600,000 gallon), located near the bottom of Dean Park in North Saanich.

- Dean Park Upper Reservoir, a 2-cell concrete partly in-ground reservoir, 4,546 m<sup>3</sup> (1,000,000 gallon), located near the top end of Dean Park in North Saanich.
- McTavish Reservoir, a 2-cell concrete in-ground reservoir, 6,820 m<sup>3</sup> (1,500,000 gallon), located on the south side of McTavish Road in North Saanich.

## 2.4 Distribution Systems

The GVDWS contains 8 individual distribution systems. Six distribution systems are separately owned and operated by the municipalities of Central Saanich, North Saanich, Oak Bay, Saanich, Sidney and Victoria. Victoria owns and operates the distribution system in Esquimalt. Two distribution systems are owned by the CRD and operated by CRD IWS. These latter two systems include the combined distribution system in the West Shore communities of Langford, Colwood, Metchosin and View Royal, and a separate system supplying water to Sooke and parts of East Sooke. Each distribution system owner/operator is called a water supplier and is responsible for providing safe water to their individual customers and meeting all the requirements under the *Drinking Water Protection Act and Regulation*.

### 2.4.1 Juan de Fuca Water Distribution System – CRD

In 2016, water was supplied to the Juan de Fuca Water Distribution System (in this report, not including Sooke – see Sooke/East Sooke Distribution System below) primarily from Main #1 and Main #3. Parts of Langford and View Royal were supplied from Main #4. The development at Bear Mountain in Langford was supplied by Main #4. In the Juan de Fuca Water Distribution System, water flowed generally in a northerly and southerly direction away from the supply mains. The William Head Institution and the Beecher Bay meter vault are located at the southern extremities of this system.

The Juan de Fuca Water Distribution System includes the following distribution reservoirs:

- Bear Mountain Reservoir #1, a 2-cell, 1,250 m<sup>3</sup> (275,000 gallon) reservoir located on the lower slopes of the Bear Mountain development in Langford.
- Deer Park Reservoir, a 1-cell, 182 m<sup>3</sup> (40,000 gallon) reservoir located downstream of Rocky Point Reservoir re-chloramination station near the extremity of the water system off of Deer Park Trail in Metchosin.
- Fulton Reservoir, a 2-cell, 4,580 m<sup>3</sup> (1,007,459 gallon) reservoir located at the end of Fulton Road in Colwood.
- Peacock Reservoir, a 2-cell, 583.8 m<sup>3</sup> (128,420 gallon) reservoir located north of the Trans-Canada Highway off of Peacock Place in Langford.
- Rocky Point Reservoir, a 3-cell, 546 m<sup>3</sup> (120,000 gallon) reservoir located near the end of Rocky Point Road in Metchosin.
- Skirt Mountain Reservoir, a 3-cell, 6,525 m<sup>3</sup> (1,435,300 gallon) reservoir located near the top of Skirt Mountain in the Bear Mountain development in Langford.
- Stirrup Place Reservoir, a 2-cell, 242 m<sup>3</sup> (53,300 gallon) reservoir located off of Stirrup Place Road in Metchosin.
- Walfred Reservoir, a 3-cell, 560 m<sup>3</sup> (123,180 gallon) reservoir located on Triangle Mountain in Colwood.

### 2.4.2 Sooke/East Sooke Distribution System – CRD

The Sooke/East Sooke Distribution System begins downstream of the Sooke River Road Disinfection Facility at the end of Main #15 on Sooke River Road where the Ammonia Storage and Metering Building is located. The primary water supply main to the community follows Sooke River Road downstream and splits at Milne's Landing going east toward Sassenos and west toward the central area of Sooke. Two underwater pipelines across Sooke Basin supply East Sooke. Sun River Estates came on-line in 2006 and is serviced by a 300 mm (12") pipeline on Phillips Road and the 2-cell concrete Sunriver Reservoir.

The Sooke/East Sooke Distribution System includes the following distribution reservoirs:

- Coppermine Reservoir, a 1-cell concrete partly in-ground reservoir, 455 m<sup>3</sup> (100,000 gallon), located off of Coppermine Road in East Sooke.
- Helgesen Reservoir, a 4-cell concrete partly in-ground reservoir, 6,973 m<sup>3</sup> (153,385 gallon), located at the west end of Helgesen Road in Sooke.
- Henlyn Reservoir, a 1-cell steel tank tower, 224 m<sup>3</sup> (49,270 gallon), located off of Henlyn Drive in Sooke.
- Silver Spray Reservoir, a 2-cell cylindrical concrete tank, 841 m<sup>3</sup> (185,000 gallon), located off of Silver Spray Drive in East Sooke.
- Sunriver Reservoir, a 2-cell concrete above-ground reservoir, 1,800 m<sup>3</sup> (395,944 gallon), located off of Sunriver Way in Sooke.

#### **2.4.3 Central Saanich Distribution System – District of Central Saanich**

In 2016, drinking water was supplied to the Central Saanich Distribution System via 10 pressure zones (7 off the Bear Hill main and 3 off the Martindale Valley main). The Bear Hill main supplied the Tanner Ridge area by direct feed, the central area in 1 pressure zone through 3 PRVs, the Saanichton area in 2 pressure zones through 2 PRVs, the Brentwood Bay area, and the Tsartlip First Nation through a PRV. Five smaller pressure zones served the rest of Central Saanich. Dawson Upper Reservoir (CRD) supplied a small area of higher elevation residences in Brentwood Bay. Martindale Pump Station supplied an agricultural area in the southeast corner of the municipality. The Island View Road area was supplied by the Stelly's Pump Station. The Mount Newton pump station provided water to the northeast corner and to the Tsawout First Nation lands. A municipally-owned pump station on Oldfield Road serviced a small area in the southwest corner.

Bear Hill Reservoir (CRD) had the largest service population in Central Saanich providing approximately 80% of the Central Saanich's water. It was the primary supply to most of Central Saanich (south of Haldon Road) including Brentwood Bay.

The Central Saanich Distribution System has technically no balancing, fire or emergency storage but relies on CRD infrastructure to provide this. Several CRD-owned reservoirs in Central Saanich, that are considered part of the transmission system, function as distribution reservoirs for the Central Saanich Distribution System.

#### **2.4.4 North Saanich Distribution System – District of North Saanich**

In 2016, drinking water was supplied to the North Saanich Distribution System from a number of points along the Saanich Peninsula Trunk Water Distribution System. This included Dean Park via the Lowe Road Pump Station, Dean Park Pump Stations and Dean Park Reservoirs (all CRD-owned and operated), Deep Cove/Lands End area via connections upstream of the Deep Cove Pump Station, Cloake Hill Reservoir via Deep Cove Pump Station (all CRD-owned and operated), and Swartz Bay. In the North Saanich Distribution System, Cloake Hill Reservoir (CRD) was the largest pressure zone. Water flowed generally in an easterly direction through the Dean Park pressure zone, northwest into the Deep Cove/Lands End area and northeast to the Swartz Bay area. Dean Park Upper Reservoir (CRD) supplied a small portion of the Dean Park Estates.

The North Saanich Distribution System has technically no balancing fire or emergency storage but relies on CRD infrastructure to provide this. Several CRD-owned reservoirs in North Saanich that are considered part of the transmission system function as distribution reservoirs for the North Saanich Distribution System.

North Saanich provides water to the Greater Victoria Airport Authority via the water main on the south side and the east side of the airport. As water quality in the airport distribution system falls under federal jurisdiction, it was not monitored by CRD in 2016 and is, therefore, not included in this report.

#### **2.4.5 Oak Bay Distribution System – District of Oak Bay**

In 2016, drinking water was supplied to the Oak Bay Distribution System at Lansdowne and Foul Bay Road from Main #3. The water flowed in a west to east direction across Lansdowne with north and south branches. Oak Bay conveys water via a 406 mm main which crosses Oak Bay diagonally from northwest to southeast. Water was distributed from the north end to the south end via the 406 mm main. Oak Bay has an outer loop flow on Beach Drive to the Victoria boundary. The Oak Bay Distribution System has no balancing, fire or emergency storage but rather relies on the CRD infrastructure to provide this.

Oak Bay used 4 local pressure areas supplied by booster pumps. Sylvan Lane Pump Station supplied the Barkley-Sylvan area; Plymouth supplied the North Henderson area; Foul Bay supplied the south Henderson area; and Uplands Pump Station (seasonal) supplied the Uplands area. There are 2 inter-connections with the Victoria/Esquimalt Distribution System which are normally closed, but which can be used in emergencies.

#### **2.4.6 Saanich Distribution System – District of Saanich**

In 2016, drinking water was supplied to the Saanich Distribution System at a number of points from CRD's transmission mains. Water was supplied from Main #1 at Dupplin, Wilkinson and Marigold, Holland/Burnside, and Admirals/Burnside; from Main #3 at Douglas, Tillicum, Admirals, Shelbourne, Richmond, Foul Bay, Mt. Tolmie and Maplewood Pump house; and from Main #4 at Burnside, Blue Ridge, Roy Road, Markham, Layritz, Cherry Tree Bend and Sayward. In the Saanich Distribution System, water flowed generally in a northerly direction from Mains #1 and #3 and both east and west from Main #4.

There are 4 major pumping systems in the Saanich Distribution System. Maplewood pumps water north from Main #3, ending in the Gordon Head area. Cherry Tree Bend pumps from Main #4 to Wesley Reservoir and the west central high elevation area. The Mt. Tolmie/Plymouth Pump Station pumps water from Main #3 and the CRD Mt. Tolmie Reservoir to Saanich's Mt. Tolmie Reservoir and the Gordon Head area via a 610 mm-diameter (24") main.

Water from Sayward supplies the north end of the Saanich Distribution System via Main #4 with a southerly flow through Cordova Bay. Saanich also has a number of other small pressure zones controlled by pump stations.

The Saanich Distribution System includes some storage for balancing, fire and emergency purposes. The following distribution reservoirs are owned and operated by Saanich:

- Hartland Reservoir, a 1-cell, 454.6 m<sup>3</sup> (100,000 gallon) reservoir located on Hartland Road in Saanich.
- Mt. Tolmie Reservoir (Saanich), a 1-cell, 4,545 m<sup>3</sup> (1,000,000 gallon) reservoir located on the east side of the summit of Mt. Tolmie near Cromwell Reservoir in Saanich.
- Rithet Reservoir, a 1-cell, 16,807 m<sup>3</sup> (3,700,000 gallon) reservoir located at the end of Perez Drive in Broadmead in Saanich.
- Wesley Reservoir, a 2-cell, 3,182 m<sup>3</sup> (700,000 gallon) reservoir located at the end of Wesley Road on Haliburton Ridge in Saanich.

#### **2.4.7 Sidney Distribution System – Township of Sidney**

In 2016, drinking water was supplied to the northern portion of the Sidney Distribution System from the 300 mm-diameter water main on Mills Road via the 460 mm CRD transmission main on Mills Road from upstream of the Deep Cove Pump Station. The southern portion of the distribution system is supplied from a 300 mm main that is connected to CRD transmission system and McTavish Reservoir. Within the Sidney Distribution System, water flowed generally from the west via Mills Road and from the south via McTavish Reservoir and met in the middle of the distribution system with approximately 60% of the water coming from the Mills Road supply.

The Sidney Distribution System has no balancing, fire or emergency storage but rather relies on the CRD infrastructure to provide this.

#### **2.4.8 Victoria/Esquimalt Distribution System – City of Victoria / Township of Esquimalt**

**Note:** The City of Victoria owns and operates the water distribution system in the Township of Esquimalt.

In 2016, drinking water was supplied to the Victoria/Esquimalt Distribution System from Main #1 and Main #2 at David Street/Gorge Street and David Street/Rock Bay Avenue. From these supply points, the system divides into several smaller looped water mains within the distribution system. Water was also supplied to Victoria from Main #3 at Cook Street/Mallek Crescent, Sommerset Street/Tolmie Avenue, Douglas Street/Tolmie Avenue and Shelbourne/North Dairy. In general, water flows from a north to south direction.

Water was supplied at multiple locations to Vic West and Esquimalt from Main #2. These locations include Tyee Road/Bay Street, Burleith Crescent/Craigflower Road, Garthland Road/Craigflower Road and Admirals Road/Maple Bank Road.

The Victoria/Esquimalt Distribution System has no balancing, fire or emergency storage but rather relies on the CRD infrastructure to provide this.

### 3.0 MULTIPLE BARRIER APPROACH TO WATER QUALITY

CRD and the municipalities that operate their distribution systems use a multiple barrier approach to prevent the drinking water in the GVDWS from becoming contaminated. Multiple barriers can include procedures, operations, processes and physical components. In a drinking water system, any individual contamination barrier used in isolation has an inherent risk of failure and may result in contamination of the drinking water. However, if a number of individual barriers are used together in combination with each other and, especially if they are arranged so that they complement each other, these multiple barriers are a very powerful means of preventing drinking water contamination. All CRD-owned and operated, and most other large drinking water utilities, use the multiple barrier approach to prevent drinking water contamination. The exact types and applications of barriers are unique for each system in order to address the system-specific risks.

The following barriers are used in the GVDWS to prevent the drinking water from becoming contaminated:

1. **Good Water System Design.** Good water system design is 1 of the preeminent barriers to drinking water contamination as it allows all of the other components within the water system to operate in an optimal fashion and does not contribute to the deterioration of the quality of the drinking water contained within the system. Good water system design includes such aspects as: drinking water treatment plants that are easy to operate; piping appropriately sized to the number of users being supplied; and the use of appropriate pipe materials. All new designs are designed by qualified professionals registered in BC, reviewed and approved by qualified CRD or municipal staff, and approved and permitted by a Public Health Engineer from Island Health. This acts as a multiple check on good system design.
2. **Source Water Protection.** CRD uses what is considered the ultimate source water protection: ownership of the catchment (watershed) lands surrounding the source reservoirs. This land area is called the Greater Victoria Drinking Water Supply Area. Within this area, no public access, commercial logging, farming, mining, or recreation is permitted and no use of herbicides, pesticides, or fertilizers is allowed. This source water protection barrier eliminates many of organic and inorganic chemicals that can contaminate the source water and virtually eliminates the potential for human disease agents being present. Very few drinking water utilities in Canada and United States can claim this type of protection. In addition, the CRD Watershed Protection division operates a complete and comprehensive watershed management program that provides additional protection to the quality of Greater Victoria's source water.
3. **Water Disinfection.** The GVDWS is an unfiltered drinking water system that continues to meet the stringent United States Environmental Protection Agency (USEPA) criteria to remain an unfiltered surface water supply. The treatment process consists of primary disinfection (ultraviolet light and free chlorine) of the raw source water entering the treatment plant and secondary disinfection (chloramination) that provides a disinfectant residual in the distribution system. Although the water treatment barrier used in Greater Victoria is not as rigorous as that provided by most drinking water utilities using a surface water supply, the microbiological quality of the source water is exceptionally good and the Chief Medical Health Officer for Island Health has approved this treatment process as providing safe drinking water for the public.
4. **Distribution System Maintenance.** All water suppliers in the GVDWS provide good distribution system maintenance, including activities such as: annual water main flushing, hydrant maintenance, valve exercising, leak detection, and reservoir cleaning and disinfection. This barrier helps to promote good water quality within the distribution system.
5. **Infrastructure Replacement.** The timely replacement of aging water system infrastructure is an important mechanism to prevent the deterioration of water quality in the pipes and provides a continual renewal of the water system.
6. **Well Trained and Experienced Staff.** All water system operators must receive regular training and be certified to operate water system components. In addition, the laboratory staff cannot analyze drinking water samples in accordance with the *BC Drinking Water Protection Regulation* unless the laboratory has been inspected by representatives of the BC Ministry of Health and issued an operating certificate. CRD and municipal staff meet these requirements.

7. **Cross Connection Control.** Cross connection control provides a barrier to contamination by assisting in the detection of conditions that have the potential to introduce contaminants into the drinking water from another type of system. Therefore, in cooperation with the other water suppliers, in 2005, CRD implemented a regional Cross Connection Control program throughout the GVDWS.
8. **Water Quality Monitoring.** Rigorous water quality monitoring can be considered a barrier not only because it verifies the satisfactory operation of other barriers and detects contaminations quickly, but comprehensive monitoring data may also allow water suppliers to see trends and react proactively before a contamination occurs. The CRD has designed and executes a comprehensive water quality monitoring program for the GVDWS that collects daily bacteriological samples across the entire region for compliance purpose for the CRD water infrastructure but also for the municipal water distribution systems. This CRD monitoring program tests for water quality parameters beyond the legislated requirements to verify good drinking water quality in the GVDWS.



#### 4.0 WATER QUALITY REGULATIONS

The CRD and the municipal water suppliers in the GVDWS must comply with the British Columbia *Drinking Water Protection Act* and *Drinking Water Protection Regulation*. The regulation stipulates the following water quality and sampling criteria for water supply systems:

- No detectable *Escherichia coli* per 100 ml
- At least 90% of samples have no detectable total coliform bacteria per 100 ml and no sample has more than 10 total coliform bacteria per 100 ml
- 5,000–90,000 population served: 1 sample per month per 1,000 population served
- >90,000 population served: 90 + 1 samples per month per 10,000 in excess of 90,000 population served

In addition to the aforementioned water quality monitoring criteria by the *Drinking Water Protection Regulation*, as due diligence to ensure public safety and maintain public trust, the CRD Water Quality Monitoring Program also uses the much larger group of water quality parameters listed in the current version of the *Guidelines for Canadian Drinking Water Quality* (the Canadian Guidelines) for compliance purposes. These limits are provided in Appendix A, Tables 1, 2 and 3 under the column titled 'Canadian Guidelines'. The water quality limits in the Canadian Guidelines<sup>1</sup> fall into 1 of the following 5 categories:

1. **Maximum Acceptable Concentration (MAC).** This is a health-related limit and lists the maximum acceptable concentration of a substance that is known or suspected to cause adverse effects on health. Thus, an exceedance of a maximum acceptable concentration can be quite serious and requires immediate action by the water supplier.
2. **Aesthetic Objectives (AO).** These limits apply to certain substances or characteristics of drinking water that can affect its acceptance by consumers or interfere with treatment practices for supplying good quality drinking water. These limits are generally not health related unless the substance is well above the aesthetic objectives.
3. **Parameters without Guidelines.** Some chemical and physical substances have been identified as not requiring a numerical guideline because data currently available indicate that it poses no health risk or aesthetic problem at the levels currently found in drinking water in Canada. These substances are listed as 'No Guideline Required' in Appendix A, Tables 1, 2 and 3.
4. **Archived Parameters.** Guidelines are archived for parameters that are no longer found in Canadian drinking water supplies at levels that could pose a risk to human health, including pesticides that are no longer registered for use in Canada, and for mixtures of contaminants that are addressed individually. Some of these parameters are still being included in the current water quality monitoring program because the analytical laboratory includes them in their scans. These parameters are listed as 'Guideline Archived' in Appendix A, Tables 1, 2 and 3.
5. **Operational Guidance.** The limit was established based on operational considerations and listed as an Operational Guidance Value. For example, the limit for aluminum is designed to apply only to drinking water treatment plants using aluminum-based coagulants.

It should be noted that not all of the water quality parameters analyzed by the CRD Water Quality Monitoring Program have the Canadian Guidelines' limits, since some of these parameters are used for operational purposes. Where the Canadian Guidelines are silent for a particular parameter, the limit for that parameter is left blank in Appendix A, Tables 1, 2 and 3.

In addition to the Canadian provincial regulations and federal guidelines, on a voluntary basis, the CRD also complies with most of the USEPA rules and regulations. Some of the limits in the USEPA rules are used as the basis for CRD's water treatment goals.

---

<sup>1</sup> (see [http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum\\_guide-res\\_recom/index-eng.php](http://www.hc-sc.gc.ca/ewh-semt/pubs/water-eau/sum_guide-res_recom/index-eng.php))

The GVDWS, as an unfiltered surface water system, must also meet the provincial Drinking Water Treatment Objectives for Surface Water Supplies in B.C. which includes similar criteria as the conditions for filtration exemption in the Canadian Guidelines as well as the criteria for filtration exemption by the USEPA Surface Water Treatment Rules for Unfiltered Systems. In summary, the applicable criteria are:

- 4-log inactivation of viruses (met with chlorination).
- 3-log removal or inactivation of parasites (*Giardia* and *Cryptosporidium*) (met with UV disinfection).
- 2 forms of disinfection (UV and chlorination).
- Water entering disinfection facilities has average daily turbidity <1 NTU and not more than 2 days/year with an average daily turbidity of >5 NTU.
- No *E. coli* or total coliform in treated water.
- A watershed control program to minimize fecal, parasite and viral contamination of source water (in place).
- Detectable disinfectant residual in distribution system.
- *E. coli* in source water  $\leq 20$  CFU/100 mL.

## 5.0 OPERATIONAL CHANGES AND EVENTS – CRD SYSTEMS

### 5.1 Use of Goldstream Water

In 2016, the Goldstream Supply System was used between December 5 and December 17 to allow for a Kapoor Tunnel inspection including repair works to the tunnel inner walls. This period was also used as an opportunity to implement and carry out a comprehensive tunnel and main flushing program to remove sediments that accumulate in the tunnel and in the adjacent large diameter mains. This 12-day period on the Goldstream Supply System constitutes one of the longest time periods that GVDWS was supplied by the backup water source. The procedure was accompanied by daily monitoring of water quality, weather and stream flow indicators to ensure that an adverse water quality event could be avoided. During the morning of December 11, the Goldstream River flows increased due to heavy rainfall and snowmelt leading to an increase in raw water turbidity at the Japan Gulch Disinfection Facility. Between 4 a.m. and 11 a.m., the turbidity reached 1 NTU until a gate adjustment at the Goldstream dam was able to throttle the river flows and, therefore, decrease the turbidity to below 1 NTU again. This event did not necessitate a public advisory as per decision by the Medical Health Officer of Island Health.

### 5.2 Sooke Lake Reservoir

Figure 1 shows the Sooke Lake Reservoir water levels in 2016 compared to previous years. Due to a very dry spring and early summer, the lake levels started already dropping as of April. Until early October, the lake levels trended below the levels in previous years but then recovered very quickly due to a very wet fall. By the end of December, the lake had reached the full service level. The lower than average lake levels had no measurable impact on the water quality.

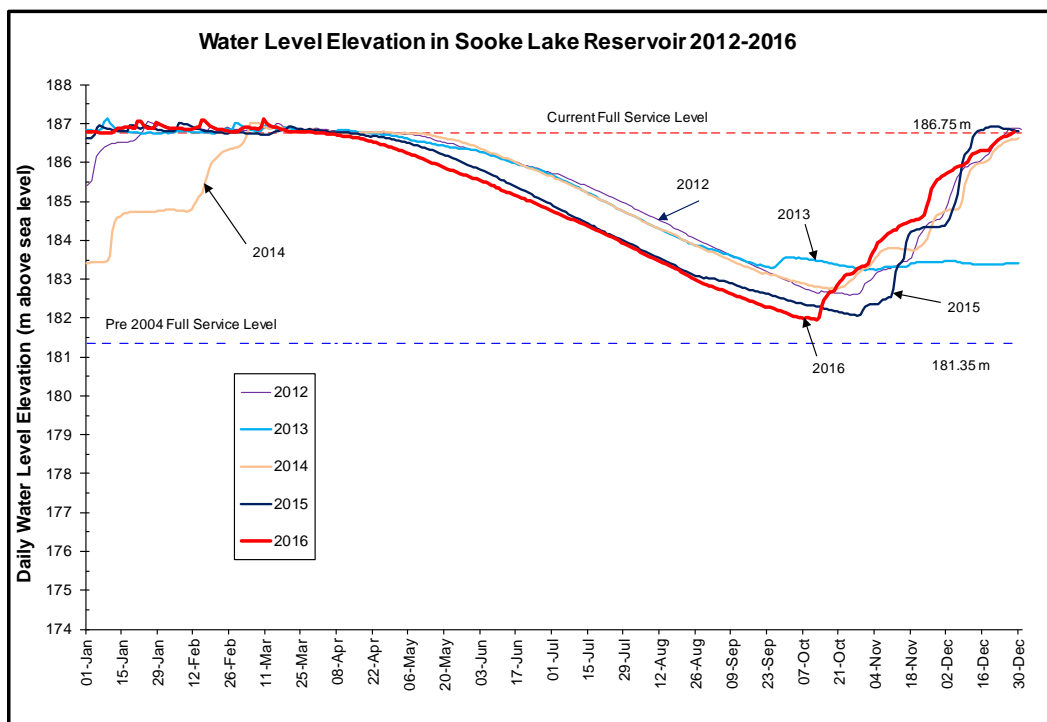


Figure 1 Water Level Elevation in Sooke Lake Reservoir, 2012–2016

### **5.3 Chlorine Dosage**

During 2016, CRD IWS did not change the chlorine dosage rate, which remained at 2.0 milligrams per litre (mg/L) at the Japan Gulch Disinfection Plant. At the Sooke River Road Disinfection Facility, the chlorine dose was adjusted upward twice during the course of the summer in an attempt to compensate for the widespread drop in chlorine residuals in large sections of the Sooke/East Sooke Distribution System. Upon initial failure to achieve the objective, the CRD treatment plant operators fine-tuned the chemical dosing ratio (chlorine/ammonia) to achieve the highest possible percentage of monochloramine, and installed a swing check valve near the Helgesen Reservoir to reduce the reservoir residence time. Both measures contributed to a significant improvement of the chlorine residual concentrations in the Sooke/East Sooke Distribution System.

### **5.4 CRD Reservoir Maintenance**

The CRD Water Quality section has initiated an internal project that reviews water quality data in each CRD-owned and operated transmission or distribution reservoir. Based on the findings, these facilities were sorted into risk categories and recommendations were made in respect to changes to operations or cleaning timing and cleaning frequencies. CRD operators have implemented the recommended changes in the Juan de Fuca Distribution System and results in 2016 indicate improved water quality in several reservoirs which in turn has already led to efficiencies and savings associated with the operations of these reservoirs. This project is expected to expand into the Saanich Peninsula and core area of the GVDWS.

## 6.0 WATER QUALITY MONITORING

The Water Quality section within the CRD Parks & Environmental Services department, is responsible for the collection, analysis and reporting of water quality information in all CRD-owned and operated portions of the GVDWS from the source reservoirs to the point of delivery (typically the water meter) to each consumer. While the municipal water suppliers are responsible for water quality and any potential corrective measures within their particular distribution system, CRD Water Quality staff provide water sampling and testing for regulatory compliance monitoring to these municipalities.

The CRD Water Quality section has dedicated professional staff that is trained to collect water samples from source water and treated water sampling locations across the region, as well as technical staff trained to analyze and interpret water quality data in support of operational decisions. The CRD Water Quality Laboratory is certified for a number of water quality test methods and is staffed with highly trained laboratory technicians. The CRD Aquatic Ecology Laboratory has professional staff specialized to analyze phyto- and zooplankton in lake water, test for cyanotoxins and understand the source water limnology.

### 6.1 CRD Water Quality Monitoring Program

The CRD Water Quality Monitoring Program consists of the following 3 components that provide direction for the collection and analysis of water quality samples from the water systems.

- **Compliance Monitoring:** The goal of the compliance monitoring is to ensure that water quality from source to consumer meets the relevant drinking water regulations and guidelines. Island Health, as the provincial regulator, has issued the CRD with 2 Operating Permits (for CRD water infrastructure in the Japan Gulch Service Area and in the Sooke Drinking Water Service Area). These Operating Permits require, in addition to the water quality and sampling criteria as per *Drinking Water Protection Regulation*, continuous monitoring of turbidity. The CRD Water Quality section, therefore, conducts bacteriological monitoring on the raw water entering the plants, treated water after the plant and at the first customer sampling locations, sampling locations on the large transmission mains and sampling locations in the CRD-owned distribution systems including distribution reservoirs. Bacteriological samples are collected at a frequency that meets the regulatory requirements and provides a consistent and day-to-day system-wide water quality oversight. Continuous turbidity monitoring as per Permits is accomplished by SCADA turbidity meters at each disinfection facility. Part of the compliance monitoring are the services provided by the CRD to the municipal water suppliers where CRD staff collects and analyzes bacteriological samples from inside the municipal water distribution systems, reports monthly results on the CRD website and includes the results and findings in this annual report.

As the GVDWS has been granted an exemption from conventional water treatment requirements for surface water source users by Island Health, it expected that the CRD closely monitors a number of water quality parameters in addition to the criteria listed in the regulations and in the Permits. As a result, the CRD has included in its compliance monitoring program a number of water quality parameters that are regularly tested on the raw as well as on the treated water to verify compliance with the Canadian Guidelines and USEPA rules and regulations. Such parameters in the raw water include parasites, organic and inorganic compounds including metals and various water chemistry and physical parameters. On the treated water these include disinfection by-products, metals and again water chemistry and physical parameters that are used to verify good drinking water quality.

- **Aquatic Ecology Monitoring:** The goal of the Aquatic Ecology Monitoring is to understand and document the components that affect or may affect the natural cycles of the source streams and reservoirs. The source reservoirs and streams in the Greater Victoria Water Supply Area (Map 1) are monitored according to the recommendations by the CRD Aquatic Ecology Lab as there are no legislated requirements for either sampling frequency or parameter selection for these water bodies. It is, however, important for the CRD as supplier of unfiltered surface water to have a comprehensive understanding of the natural processes taking place in the source waters and potential implications for the drinking water quality in the GVDWS. Depending on the season, the source lakes and their tributaries are sampled at a frequency ranging from monthly to weekly for parameters such as algal species, distribution and concentrations, zooplankton species and concentrations, chlorophyll-a concentrations and nutrient concentrations. Additional samples may be collected based on risk

management decisions for instance as a response to severe weather conditions or unusual observations.

- **Operational Water Quality Monitoring:** The CRD Water Quality Monitoring Program provides an audit function on all water quality-related aspects of the GVDWS including performance monitoring of the treatment plants and distribution system. A number of samples are specifically collected or test results being utilized to support operational decisions by the CRD and municipal system operators. Daily field tests of chloramine residual concentrations are conducted to verify the efficiency of the secondary disinfection region-wide. A number of qualitative (taste and odour) and quantitative tests (e.g., HPC, turbidity) are regularly performed on samples across the region to verify the need for specific system maintenance. The customer complaint monitoring is also part of this monitoring program component as a water quality complaint can give clues to ongoing system issues or identify water quality risks in the system. Water samples are collected from taps within individual houses or facilities in response to complaints from customers about the quality of water being received at their address.

## 6.2 Sampling Plans

The efforts to collect the required number of samples for the CRD Water Quality Monitoring Program are organized in 3 distinct sampling plans:

- The Watershed Sampling Plan manages the sampling frequency, schedule and parameter list for the source water lakes and tributaries and is based on an up-to-date risk to water quality assessment. Sooke Lake Reservoir is sampled from a boat at 3 dedicated lake sampling stations from weekly in the summer to bi-weekly in the winter. Goldstream Reservoir is sampled monthly from a boat at 2 dedicated lake sampling stations. Tributary creeks to Sooke Lake Reservoir are sampled monthly near their mouths. Significant tributary lakes in the Sooke Lake watershed, as well as Butchart Lake and Japan Gulch Reservoir in the Goldstream System are sampled quarterly by boat.
- The Treatment Plant Sampling Plan includes the daily samples collected at the Japan Gulch Disinfection Facility and First Customer location and the weekly samples collected at the Sooke River Road Disinfection Facility and the Sooke First Customer location. This plan is designed to verify adequate treatment at both treatment plants and to detect unusual water quality conditions before they spread across the systems.
- The Transmission and Distribution System Sampling Plan is a designed sampling plan that manages sampling at approximately 220 permanent sampling stations across the GVDWS including all municipal systems. These permanent sampling stations are installed on transmission mains, storage reservoirs, distribution mains and booster pump stations. The plan is designed to achieve an evenly distributed 2-week rotation for most sampling stations while providing a representative snapshot of the entire Japan Gulch Service Area each business day. The Sooke Drinking Water Service Area is sampled once per week. Samples collected on the daily runs as part of this plan are primarily used for compliance monitoring but also for operational purposes.

During a sampling plan review that scrutinized the number of samples actually collected versus required it became apparent that most municipalities fall short of their monthly required number of compliance samples. The municipalities have been notified and have requested that the CRD expand its services to each municipality to achieve compliance with the regulations. The CRD will be pursuing this request with the Regional Water Supply Commission.

When positive bacteriological results are found in a CRD-owned system, CRD sampling staff resamples those locations and, depending upon the situation, may direct CRD operators to flush the affected mains and/or drain and clean affected storage reservoirs. When positive bacteriological results are found in a municipal system, the CRD sampling staff resamples those locations and notifies the municipal operators of the results.

### 6.3 Bacteriological Analyses

A description of the bacteriological parameters used in the CRD Water Quality Monitoring Program and the regulatory limits that were in place in 2016 for those parameters are outlined below.

#### **Total Coliform Bacteria**

**Total coliforms.** Total coliforms are a group of bacteria found in high numbers in both human and animal intestinal (fecal) wastes and, therefore, are found in water that has been contaminated with fecal material. Total coliform bacteria are also ubiquitous in the environment (water, soil, vegetation). Thus, in the absence of *Escherichia coli*, the presence of total coliforms may indicate older fecal contamination, surface water infiltration, or the presence of decaying organic matter. While the total coliform bacteria group is a less reliable indicator of fecal contamination, because of its superior survival characteristics, it is preferred as an indicator of treatment adequacy in drinking water supply systems.

**Test Method.** In 2016, total coliform bacteria were analyzed using defined substrate technology (DST) at the CRD Water Quality Laboratory for membrane filtration, most probable number or presence-absence methods. The membrane filtration method used Chromocult media incubated at 35°C for 24 hours while the most probable number and presence-absence methods used Colilert-18 incubated at 35°C for 18–22 hours. Test results were reported as colony forming units (CFU) per 100 millilitres (mL) of water when using membrane filtration or most probable number per 100 mL and ‘Present’ or ‘Absent’ when using Colilert. Methods employing defined substrate technology rely on the fact that coliforms possess the enzyme  $\beta$ -galactosidase, which cleaves a chromogenic substrate thus releasing a chromogen (coloured compound) that can be measured.

In compliance with regulations, CRD Water Quality Monitoring Program tests for total coliforms to ensure treatment efficacy and to monitor intrusion of organisms into the system post treatment.

**Regulatory Limits.** Based on the requirements in the *Drinking Water Protection Regulation* and the Guidelines for Canadian Drinking Water Quality, the maximum acceptable concentration for the GVDWS is summarized as follows:

- No sample should contain more than 10 total coliform organisms per 100 mL.
- No consecutive sample from the same site should show the presence of coliform organisms.
- Not more than 10% of the samples based on a minimum of 10 samples should show the presence of coliform organisms.

#### **Escherichia Coli**

***Escherichia coli* (*E. coli*).** *E. coli* is the only member of the total coliform group found exclusively in the feces of human beings and warm-blooded animals. Although most members of this species are considered harmless, some strains of *E. coli* cause diarrhoeal illness. The presence of *E. coli* in water indicates recent fecal contamination and the possible presence of intestinal disease-causing bacteria, viruses, and protozoa. The absence of *E. coli* in drinking water generally indicates that the water is free of intestinal disease-causing bacteria.

**Test Method.** In 2016, *E. coli* were analyzed by the CRD Water Quality Laboratory using either membrane filtration (Chromocult media, 35°C, 24-hour incubation) or most probable number (Colilert-18, 35°C, 18–22-hour incubation). Test results were reported as colony forming units per 100 mL when using either membrane filtration or most probable number methods. The *E. coli* test measures bacteria possessing the enzymes  $\beta$ -galactosidase and  $\beta$ -glucuronidase.

**Regulatory Limits.** In disinfected drinking water, the maximum acceptable concentration of *E. coli* (both Federal and Provincial limits) is zero *E. coli* per 100 mL.

## **Heterotrophic Plate Count Bacteria**

**Heterotrophic Plate Count Bacteria.** Heterotrophic plate count bacteria (HPC7D) are used as a general measure of the bacterial population present in a drinking water system and in the raw source water. Under increasing nutrient conditions and/or a reduction in the concentration of chlorine residual, the heterotrophic bacteria are usually the first group to increase and provide an early warning of the potential growth of coliforms. Specifically, heterotrophic plate count bacteria are used to monitor the disinfection of the water at the disinfection plants, to track the decline in chlorine residuals in the distribution system and storage reservoirs and to ensure compliance with the regulations.

**Test Method.** In 2016, heterotrophic plate count bacteria were analyzed by the CRD Water Quality Laboratory using membrane filtration (R2A media, 21–25°C, 7-day incubation). As heterotrophic bacteria can be measured in several different ways, this method provides the quantity of heterotrophic bacteria capable of growing on R2A medium within 7 days at room temperature. Raw water samples and water leaving the treatment plant were analyzed for HPC7D bacteria. In addition, samples with low chlorine residual levels (below 0.2 mg/L) were also analyzed for HPC7D.

**Regulatory Limits.** There is no federal or provincial regulatory limit on the quantity of heterotrophic bacteria allowed in drinking water. Therefore, in the absence of a regulatory limit, the CRD Water Quality Monitoring Program uses an operational limit of 10,000 HPC7D bacteria per 1 mL of drinking water.

### **6.4 Certification and Audits**

To ensure that the analytical testing is performed to the highest possible standard, the Water Quality Laboratory participates in several types of external quality assurance and quality control (QA/QC) programs in addition to rigorous internal quality QA/QC procedures that are included as part of the methodology and are a normal component of good laboratory practice.

#### **6.4.1 Certification**

The Province of British Columbia requires that all laboratories analyzing drinking water samples be approved in writing by the Provincial Health Officer. Laboratory approval requires both an approval certificate and a proficiency testing certificate as noted below:

- **Water Bacteriology Testing Laboratory Approval Certificate.** This certificate is issued by the BC Provincial Health Officer for bacteriological testing of drinking water in the Province of British Columbia. This certificate is renewed every 3 years via an on-site inspection (audit) of the analytical laboratory.
- **Clinical Microbiology Proficiency Testing Program Certificate of Participation.** This certificate is issued by the Advisory Committee for Water Bacteriology Laboratories which is operated by the Department of Pathology and Laboratory Medicine at the University of British Columbia. Satisfactory performance is required to maintain laboratory certification.



## 7.0 WATER QUALITY RESULTS

The overview results of the 2016 CRD Water Quality Monitoring Program for the GVDWS are provided below. Water quality data are listed in Appendix A (Tables 1, 2 and 3). Note that the median (middle value between the high and low) is used in these tables rather than the average value as the median eliminates the effect of extreme values (very high or very low) on the average value and provides a more realistic representation of typical conditions.

### 7.1 Source Water Quality Results

**Total Coliform Bacteria.** Similar to previous years, the generally very low concentration of total coliform bacteria increased in the raw (untreated) source water entering the Japan Gulch Disinfection Plant during the summer and early fall of 2016 (Figure 2). The total coliform counts declined over the fall as the water temperature declined. With 241 samples analyzed in 2016, the total coliform concentration ranged from 0 to 613 CFU/100 mL with a median value of 9 CFU/100 mL. The types of total coliforms present were not indicative of any particular type of contamination.

***E. coli* Bacteria.** During more than 2 decades of monitoring bacteria within the GVDWS, it has been found that virtually 100% of the fecal coliform bacteria detected in the source water and the distribution system are *E. coli*. In 2016, as in previous years, the low detection of *E. coli* bacteria indicated that the raw water entering the Japan Gulch Disinfection Plant from Sooke Lake Reservoir was good quality source water and complied with the limit in the USEPA *Surface Water Treatment Rule* to remain an unfiltered drinking water supply (Figure 3).

In 2016, about 21% of the samples collected from the raw source water contained *E. coli* and those that were positive for *E. coli* have levels well below 20 CFU/100 mL. In 241 samples analyzed for *E. coli*, only some contained this bacteria and the concentration ranged from 0–9 CFU/100 mL with a median value of 0 CFU/100 mL. The slightly higher *E. coli* concentration during December can be attributed to the supply from the Goldstream system for a period of 12 days during the Kapoor Tunnel shut-down.

***Giardia* and *Cryptosporidium* Parasites.** In 2016, parasite samples were collected approximately bimonthly as part of CRD's routine compliance monitoring program. This reduced sampling frequency, relative to past years, was made after an evaluation of long-term data showed extremely low detection of these organisms. In 2016, 7 samples were collected for parasite analysis from the raw water sampling location at the Japan Gulch Treatment Plant. It should be noted that the efficiency of the analysis for detecting *Giardia*, and especially *Cryptosporidium*, is quite low (typically in the 15–25% range).

In 2016, no *Giardia* cysts were detected in all samples on the raw water entering the Japan Gulch Disinfection Plant which included 1 sample collected while being supplied by the Goldstream System (during Kapoor Tunnel shut-down in December 2016). Also no *Cryptosporidium* oocysts were detected in any 2016 sample. The 10-year median value for total *Giardia* cyst and total *Cryptosporidium* oocyst concentrations is 0. While these are extremely low values for a surface water supply, the addition of UV disinfection provides assurance that no infective parasites can enter the GVDWS.

The treatment target specified by the Canadian federal and provincial regulations as well as the USEPA *Surface Water Treatment Rule* require 3-log (99.9%) parasite inactivation to meet the filtration exemption criteria for surface water systems. Both CRD disinfection facilities provide UV treatment that, in conjunction with CRD's drinking watershed management concept, is able to meet these targets and, therefore, adequately protects the public from waterborne parasitic illnesses.

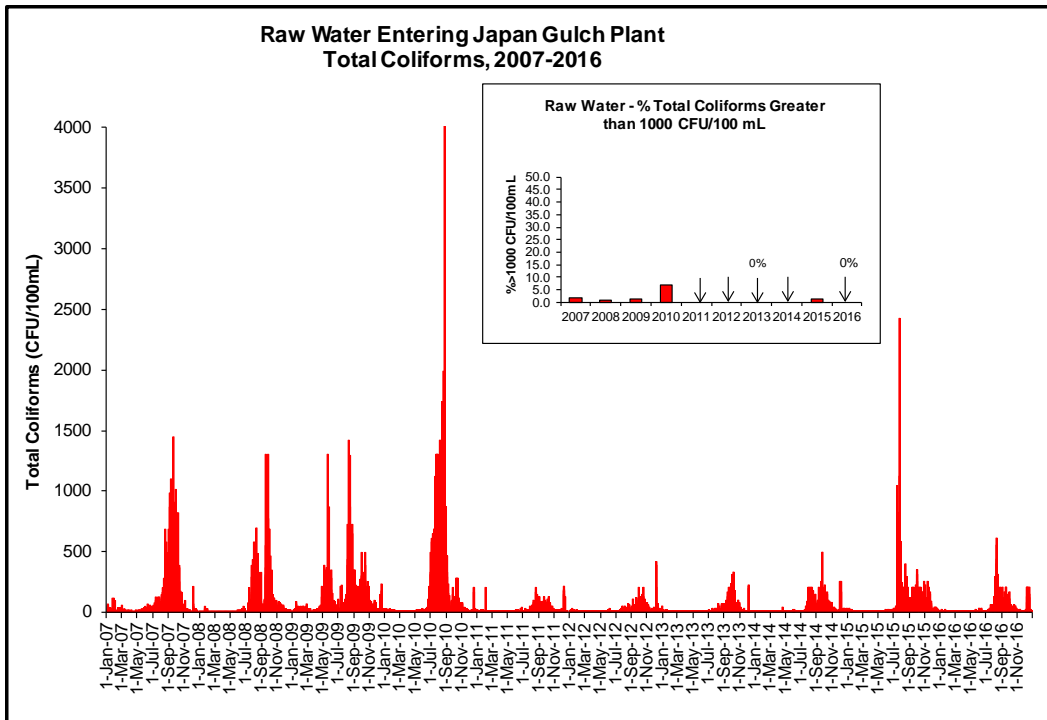


Figure 2 Raw Water Entering Japan Gulch Plant Total Coliforms 2007–2016

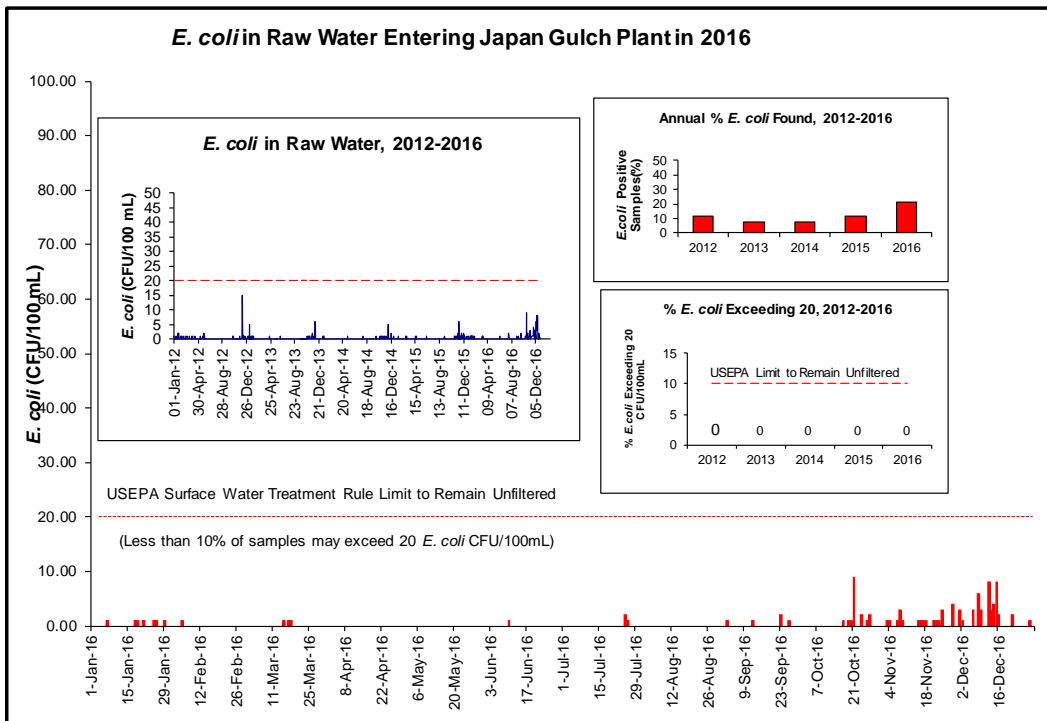


Figure 3 *E. coli* in Raw Water Entering Japan Gulch Plant in 2016


**Algae.** In 2016, algal activity in Sooke Lake Reservoir was the lowest it has been since about 2012. While there was a lack of high-magnitude algal blooms during this year, there were 3 distinct periods that were considered either strong algal dominance or a low-magnitude algal bloom (Figures 4A and 4B).

Similar to other lakes in this region, and as mentioned elsewhere in this report, Sooke Lake Reservoir exhibits vertical stratification during the spring, summer and early fall months where warmer, less dense surface water (the epilimnion) sits atop a layer of colder, denser water located on the bottom of the lake, called the hypolimnion. In 2016, the Sooke Lake Reservoir began to stratify in mid-April, coinciding with


warmer daytime temperatures which are the driver of the stratification process. At about the same time, a dominance of mixed algal species in both the south and north basins of Sooke Reservoir began. The south basin saw dominance shared by the fragile diatom species *Urosolenia eriensis* (Image 1) and small haptophyte species *Chrysochromulina parva* (Figures 4A, 5A). In the north basin, dominance was shared by the diatom species *Asterionella formosa* (Image 2) as well as the small cryptophyte species *Rhodomonas minuta* (Figures 4B, 5B). Dominance of diatom species in Sooke Lake Reservoir during spring are not unusual nor are they indicative of poor water quality; none of these algal species were of water quality concern.

As discussed below in the Raw Water Temperature section of this report, toward the end of April the intake tower gates were switched from drawing water from the lowest to highest elevation gates in attempts to preserve stratification (with special attention to the cooler hypolimnetic waters) of the intake basin. In mid-May, however, there began a dominance of a colonial species belonging to the chrysophyte (golden-brown) genus *Uroglena*. In past, this species has been known to bloom during the spring months in Sooke Lake Reservoir. Species belonging to this genus are of particular aesthetic water quality concern due to their ability to produce chemicals harmless to human health but that taste and smell fishy and, to some palates, metallic. Even though cell concentrations overall were lower in the south basin thus closest to the intake tower as compared to the north basin (Figures 4A and 4B), the odorous compounds produced by these algae are detectable at extremely low concentrations. With the arrival of a few complaints from residents and the possibility of bloom formation, staff took precautionary measures and switched the intake gates back down to draw water from the lowest elevation gates. This gate change meant drawing water from a lower depth in the lake where colonies were even less concentrated than the upper depths which remedied the fishy and metallic taste and odour complaints. Subsequently, this algal population did not increase in concentration to form a bloom of high magnitude as it has done a number of times in past years.

Throughout the summer months, algal concentrations remained near average. Toward the end of August began a very low level bloom of the colonial diatom species *Fragilaria crotonensis* (Image 3) along with a dominance of the small haptophyte species *Chrysochromulina parva* neither of which was of water quality concern.

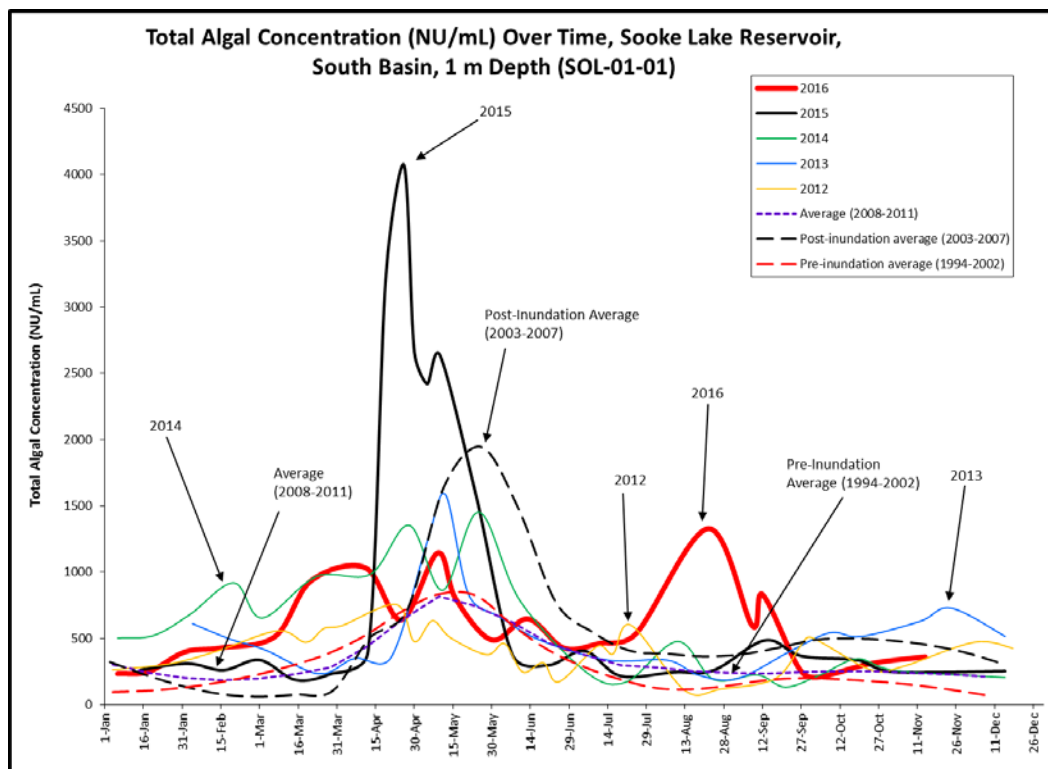


**Figure 4A Total Algal Concentration (Natural Units/mL) Over Time, Sooke Lake Reservoir, South Basin, 1 m Depth (SOL-01-01)**

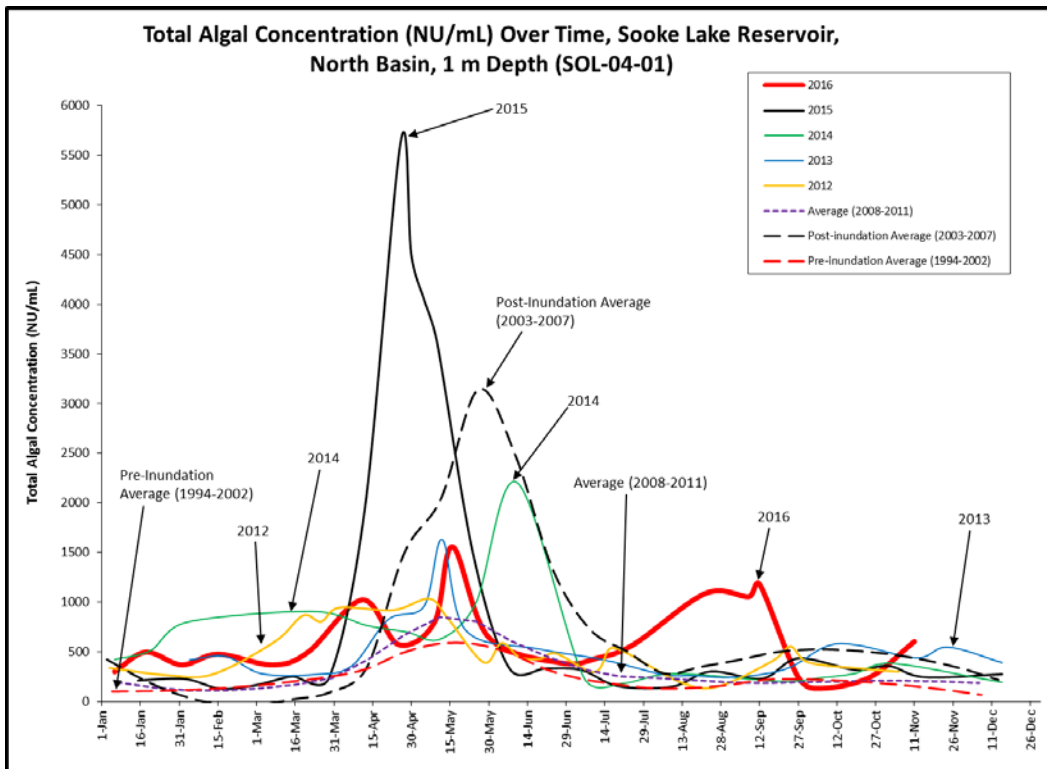


**Figure 4B Total Algal Concentration (Natural Units/mL) Over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01)**




**Image 1** Diatom species: *Urosolenia eriensis*

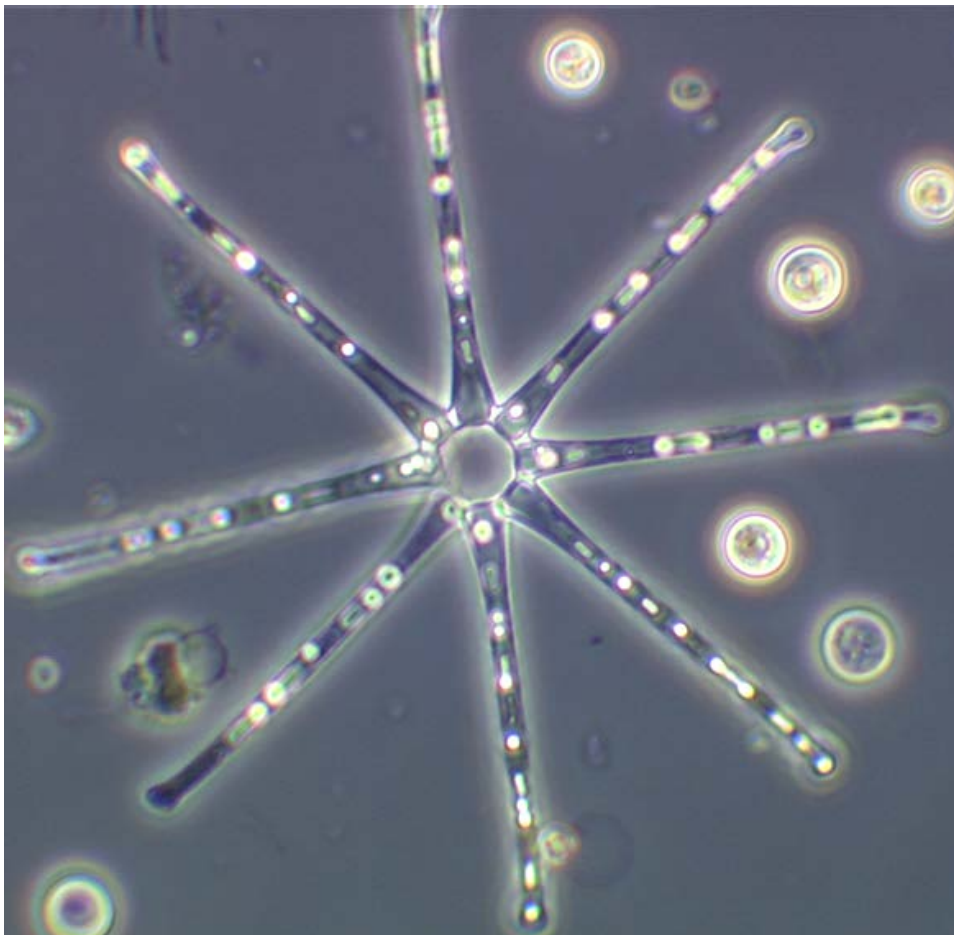


**Image 2** Diatom species: *Asterionella formosa* (star-shaped)

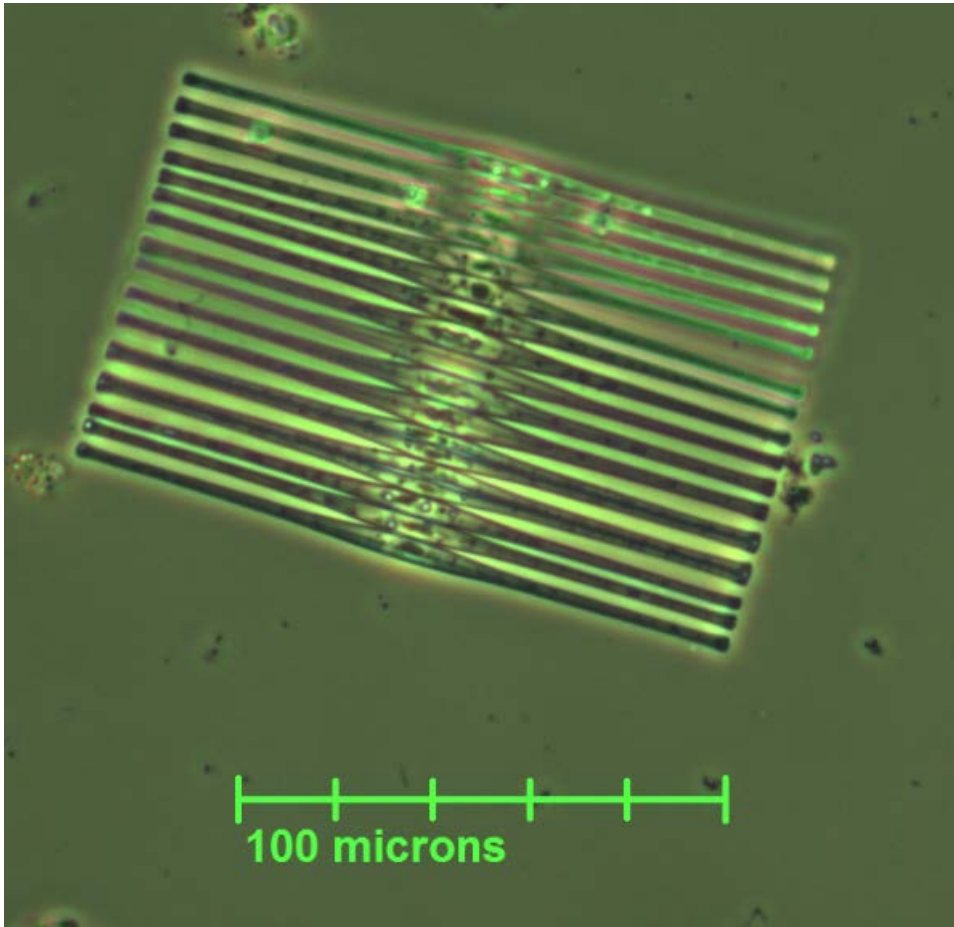

**Image 3** Diatom species: *Fragilaria crotonensis*

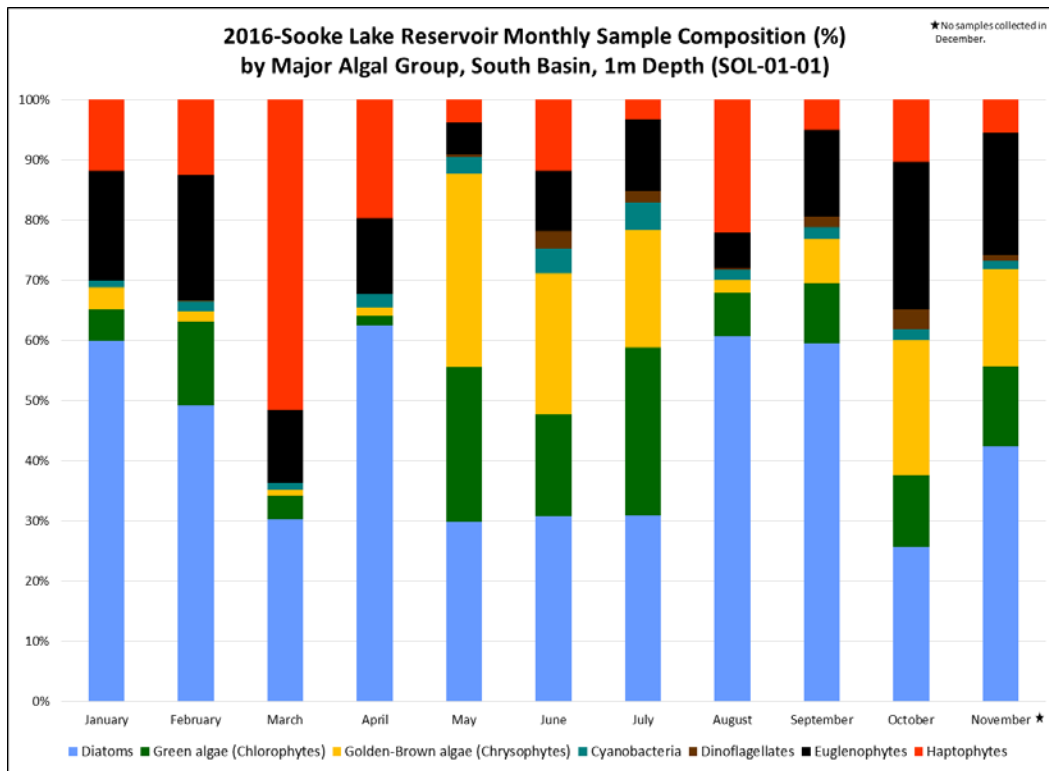

**Figure 5A** 2016 Sooke Lake Reservoir Monthly Sample Composition (%) by Major Algal Group, South Basin, 1 m Depth (SOL-01-01)

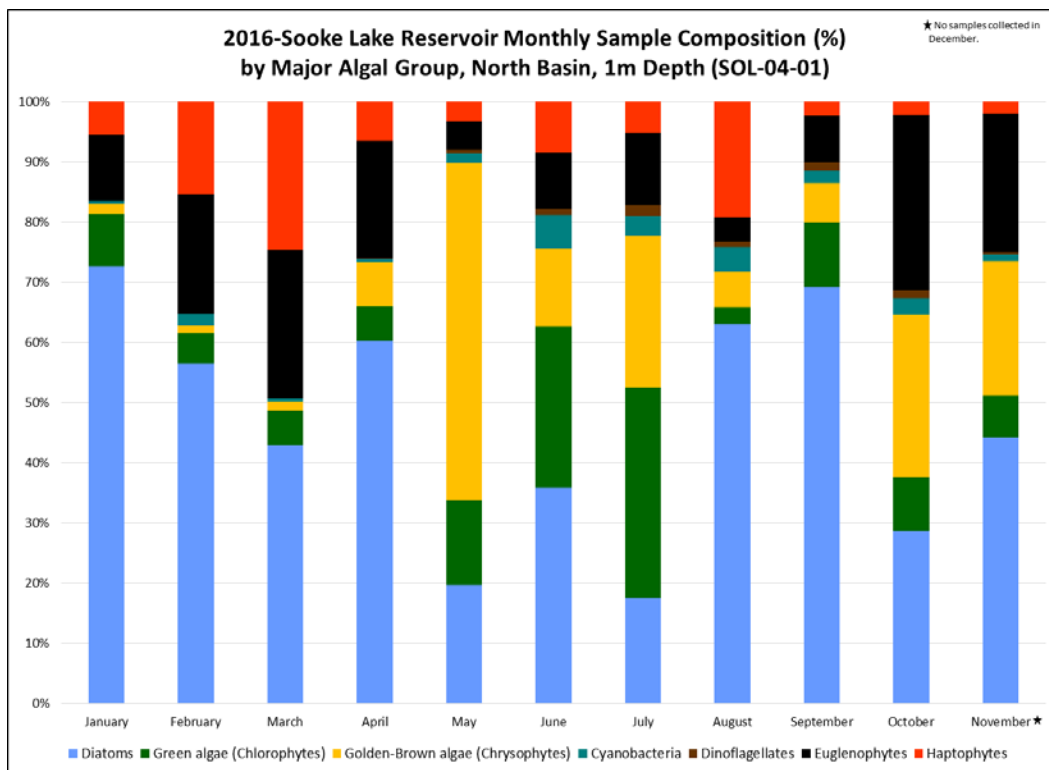

**Figure 5B** 2016 Sooke Lake Reservoir Monthly Sample Composition (%) by Major Algal Group, North Basin, 1 m Depth (SOL-04-01)


**Zooplankton.** Zooplankton are small invertebrate organisms in the water column possessing limited swimming ability; they are sometimes referred to as the planktonic animals. The average zooplankton length ranges from 0.1 to 4.0 mm; as a result some species can be seen with the unaided eye. Zooplankton are an important part of a lake trophic structure in that they feed upon the algae but are also a food source for fish.

The rotifers are the smallest of groups that constitute the zooplankton community in most lakes including Sooke Lake Reservoir. They are characterized by having on their head a band of hair-like structures called cilia which beat and aid in both motion and feeding with their preferred food sources being bacteria and small algal cells. Their method and speed of reproduction, as well as lack of defenses, allow their populations to fluctuate rapidly. They produce resting or overwintering eggs which emerge in spring when conditions become optimal. Rotifers are not a preferred food for fish but are vulnerable to predation by larger rotifer species as well as species belonging to other groups of zooplankton.


A second main group of zooplankton, the copepods, are larger than the rotifers and characterized by a streamlined, segmented body and a pair of antenna used for chemical and motion sensing, as well as swimming, which they do at a much faster speed than rotifers. They also possess an eye, allowing them to move quickly toward and away from a variety of stimuli such as light, predation by fish and other copepods and food sources of which they prefer algae, rotifers and other juvenile or adult copepods. Their life cycle is longer than that of the rotifers (weeks to months in length instead of days to weeks) and, unlike the rotifers, they undergo more than 10 emergent stages in progressing from egg to adult. Also unlike the rotifers, the copepods exhibit daily vertical migration in the water column where they tend to swim deeper during the daylight hours and rise toward the surface during the nighttime hours. Their strong swimming capability allows for this behaviour which is thought to occur mainly to avoid predation. The amplitude of their migration is species-specific and can range from one to hundreds of metres each day; regardless, the amplitude of migration is greatest during the summer and fall months.

Zooplankton trends in Sooke Lake Reservoir are generally typical of ecological succession models and 2016 was no exception. The rotifer population was quite low during the early year winter months but began to increase in concentration as they emerged from overwintering stages during the spring months in response to increasing algal populations as days lengthened and temperatures warmed (Figure 6A and 6B). As spring progressed, rotifer and algal continued to increase as did copepod concentrations in response since both are food sources for copepods (Figure 7A and 7B). Once early summer arrived, the predation pressure on algae caused a decrease in algal concentration (Figure 4A and 4B). At about the same time, juvenile fish tend to emerge who begin to prey intensely on the copepod population. Thus, toward the end of summer, copepod concentrations were decimated likely by juvenile fish thus releasing the rotifers from copepod predation (Figures 6A/B and 7A/B). In response the rotifer population was allowed to increase quickly which coincided with increased algal concentrations to feed the population (Figures 4A/B and 6A/B). Early fall tends to coincide with a decrease in fish predation pressure thus copepod populations begin to increase and feed on rotifers and algae, causing their numbers to decrease (Figures 4A/B, 6A/B, 7A/B). Toward mid-winter, zooplankton populations can be quite variable in response to a variety of complex environmental, behavioural, food availability and predation-related factors.




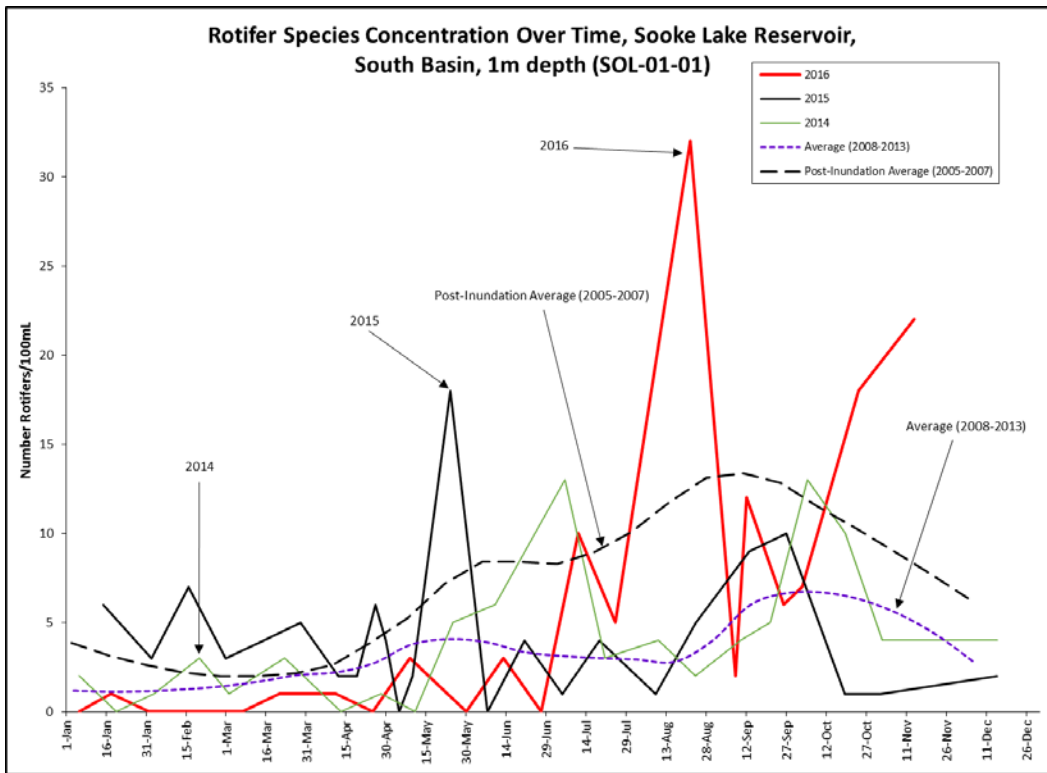


**Figure 6A** Total Numbers Rotifer Species over Time, Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01)

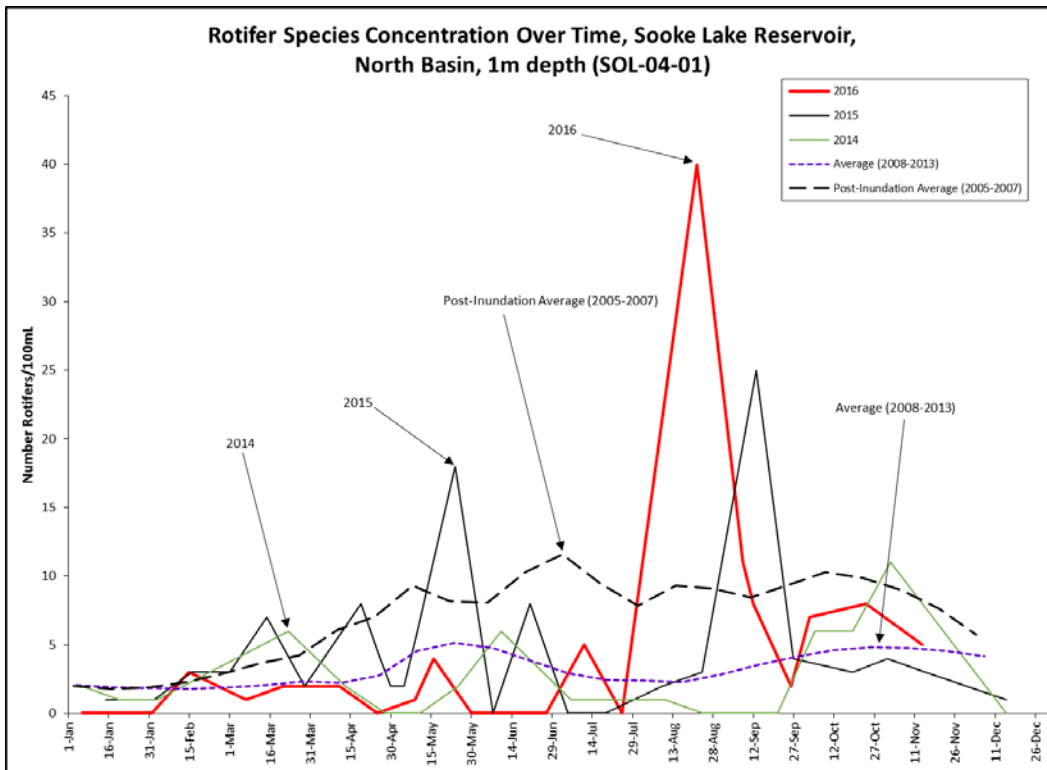

**Figure 6B** Total Numbers Rotifer Species over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01)

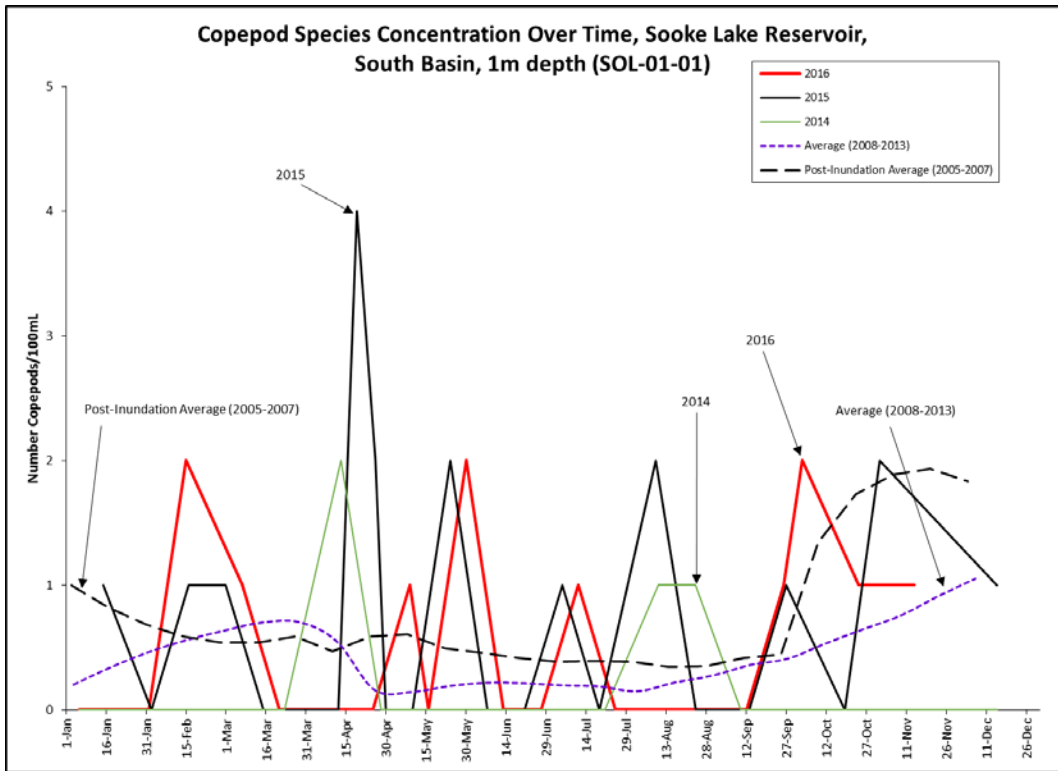


**Figure 7A** Total Numbers Copepod Species over Time, Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01)

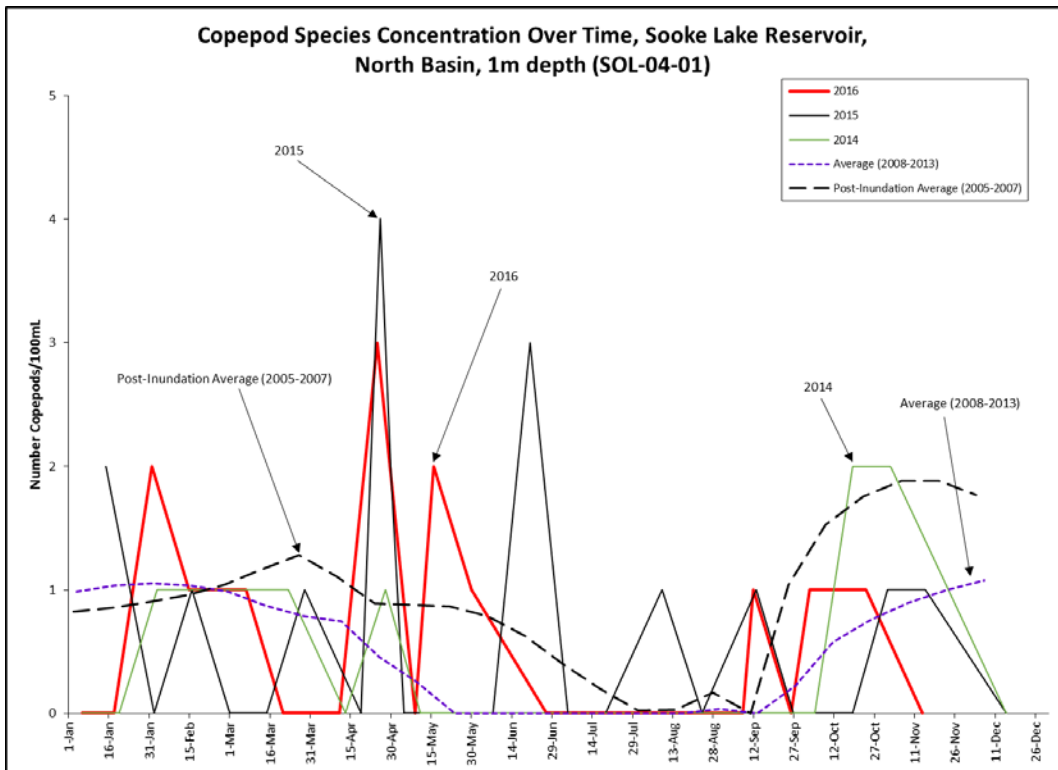

**Figure 7B** Total Numbers Copepod Species over Time, Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01)

**Turbidity.** The turbidity is continuously measures at both disinfection facilities and at the Sooke Lake intake tower but also sampled and lab tested daily from the Japan Gulch Disinfection Facility. Figure 8 shows that the source water turbidity was well under 1 NTU throughout 2016; however, during the summer season on watering days sediments in the Kapoor Tunnel and associated piping were dislodged and caused short period turbidity excursions to slightly above 1 NTU. These events usually occurred on Wednesdays, Thursdays and Sundays from 4 a.m. to approximately 10 or 11 a.m. during the peak summer demand times only at Japan Gulch and not at the Sooke River Road Disinfection Facility. SCADA monitoring data shows that the average daily turbidity was still below 1 NTU on these turbidity event days, but CRD has taken measures to mitigate these turbidity events at the Japan Gulch Disinfection Facility (changed watering restrictions in the region, thoroughly cleaned tunnel and piping in December 2016).

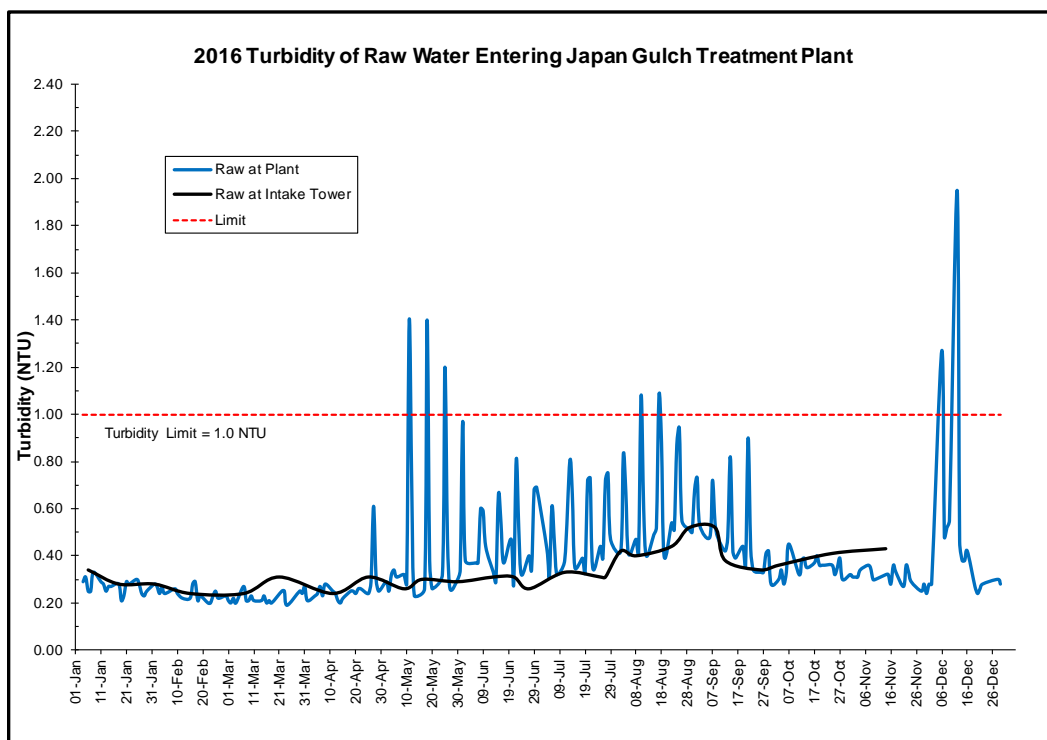


**Figure 8 2016 Turbidity of Raw Water Entering Japan Gulch Treatment Plant**

**Raw Water Temperature.** Cool water is beneficial in a distribution system because it reduces the potential for losses of chlorine residual and regrowth of bacteria. For that reason the Canadian Guidelines suggest a temperature limit of 15°C.

The temperature of the water entering the Japan Gulch Disinfection Facility in 2016 was higher than the long-term average until the beginning of October and then cooled slightly to follow the long-term average for the rest of the year (Figure 9). The typical sudden rise of raw water temperature in summer can be attributed to the depletion of the cool water stored in the hypolimnion water column of the reservoir's south basin due to the constant usage of the lowest elevation intake tower gates. The cool water stored in the hypolimnion of the much deeper north basin is currently inaccessible for CRD with the existing infrastructure. In 2016, the CRD has attempted the implementation of a water temperature management concept to mitigate the duration and magnitude of high raw water temperatures entering the plant. By mid-April 2016, the Sooke Lake South Basin stratification had consolidated and formed a well isolated cool water hypolimnetic zone. Following a strict water quality and lake level monitoring plan, CRD switched to the highest intake gate at the intake tower where water temperatures were still well below 15°C. By mid-May, a developing algal event with the potential to induce undesired tastes and odours to the drinking water necessitated the project to be aborted and the lowest intake gate was utilized again for the rest of the year. Temperature profile data from the south basin showed, however, that this concept is able to preserve the cool hypolimnetic waters during the time period that the upper intake gates are being used. Barring adverse algal events, the CRD will attempt this water temperature management concept in 2017 again.

High raw water temperatures are not a new problem for the CRD. Before the expansion of Sooke Lake Reservoir, the water temperature entering the plant reached 15°C as early as mid-June. In 2016, the temperature reached 15°C in early July and then remained above 15°C until early October.

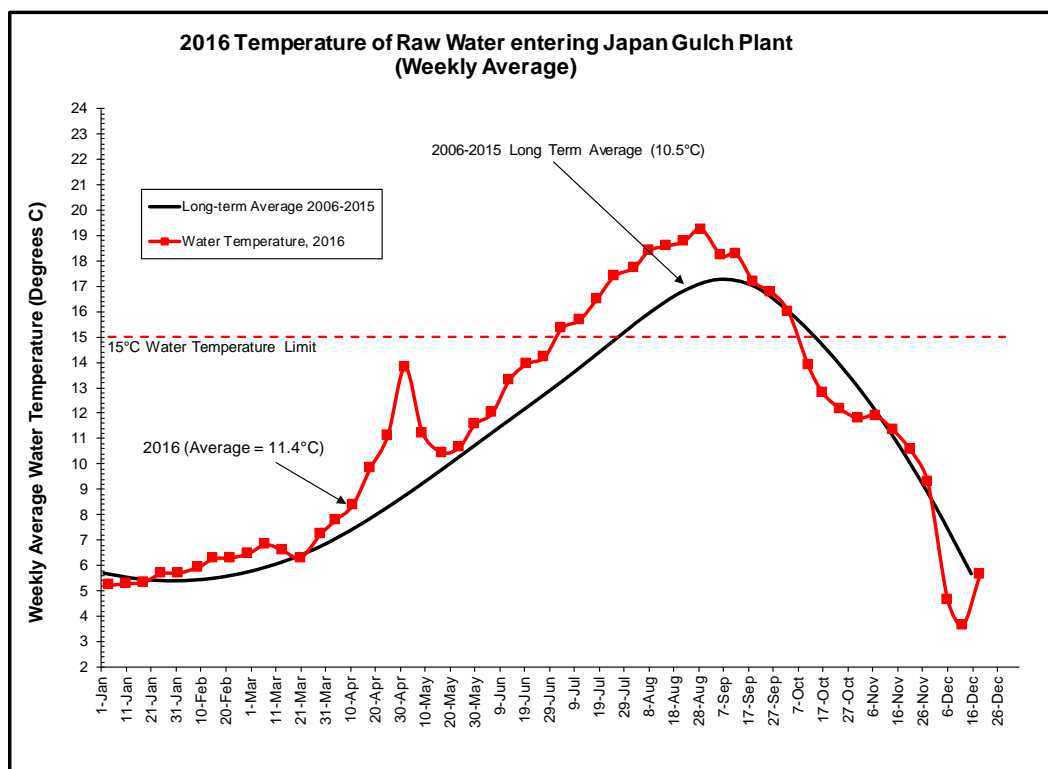

**Figure 9 2016 Temperature of Raw Water Entering Japan Gulch Plant (Weekly Average)**

**Physical/Chemical Parameters.** The raw water entering the Japan Gulch Disinfection Facility had the following physical and chemical characteristics:

- Median pH 7.29
- Median CaCO<sub>3</sub> Hardness: 17.1 mg/L
- Median Alkalinity: 15.4 mg/L
- Median Colour: 7.05 TCU
- Median Total Organic Carbon: 1.91 mg/L
- Median Conductivity (25°C): 42.85 µS/cm

**Inorganics/Metals.** Table 1 in Appendix A lists all the inorganic and metal parameters tested in the source water in 2016. No unusual or concerning levels or trends have been detected.

**Organics/Radionuclides.** Table 1 in Appendix A lists all the organic radiological parameters tested in the source water in 2016. Most of them were not-detected or in insignificant concentrations. These results confirm the high level of protection from any anthropogenic impacts on the supply watershed.

**Nutrients.** Figures 10–13 show the total nitrogen and the total phosphorus concentrations in both the South and north basin in 1 m depths in Sooke Lake Reservoir. While total phosphorus trended mostly below the long-term average in 2016, the total nitrogen fluctuated slightly above the long-term average trend line. A nitrogen spike in February 2016 is attributable to a significant rainfall and runoff event during that time. In general, the nutrient concentrations confirm the ultra-oligotrophic status (extremely unproductive) of Sooke Lake Reservoir which is positive for a drinking water supply source.

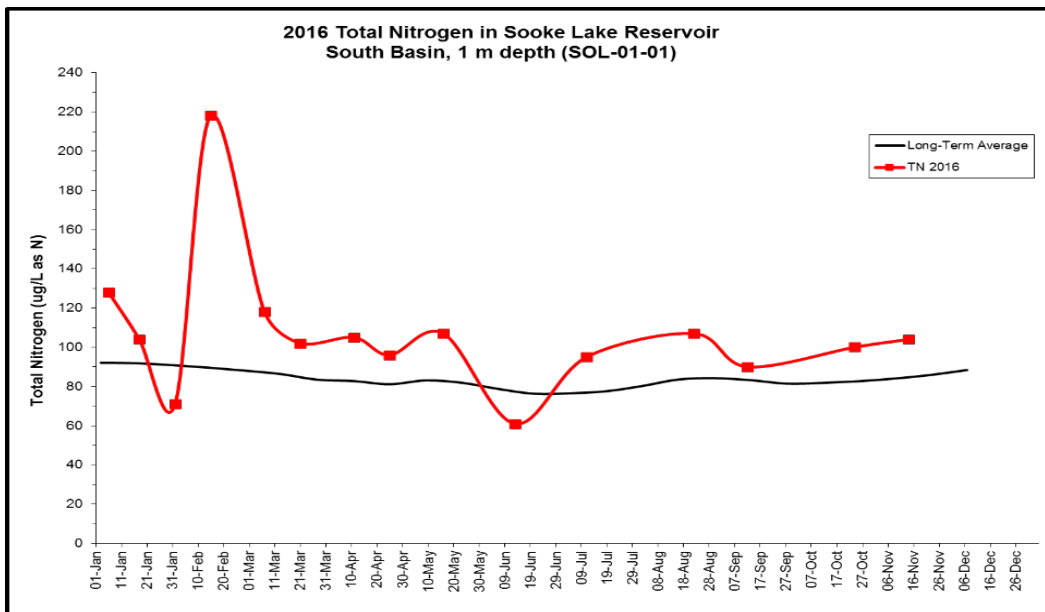


Figure 10 Total Nitrogen in Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01)

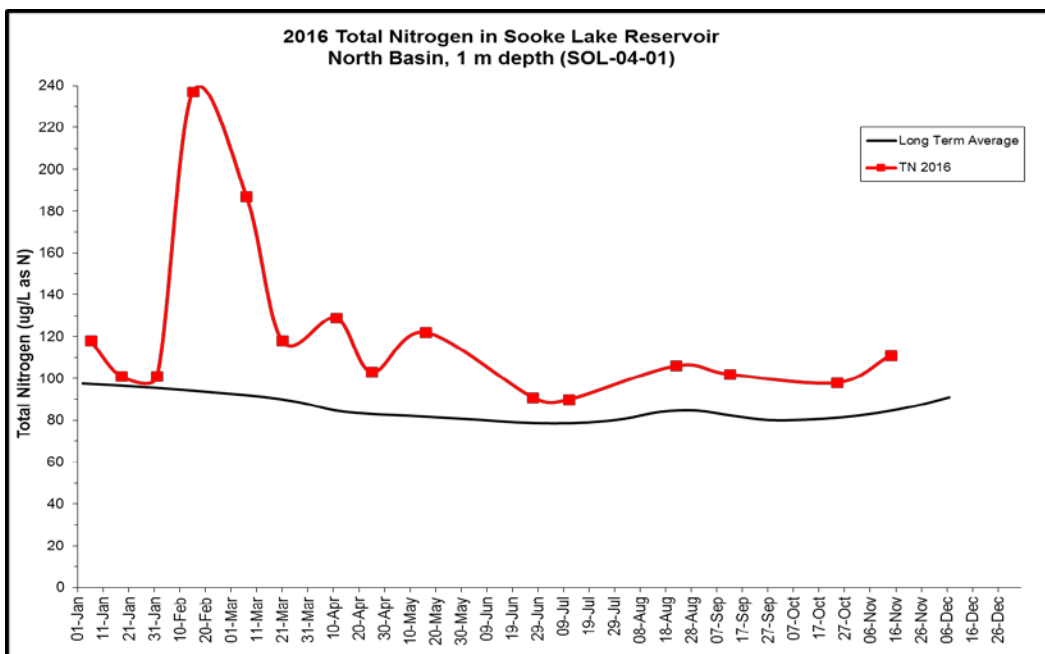


Figure 11 Total Nitrogen in Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01)

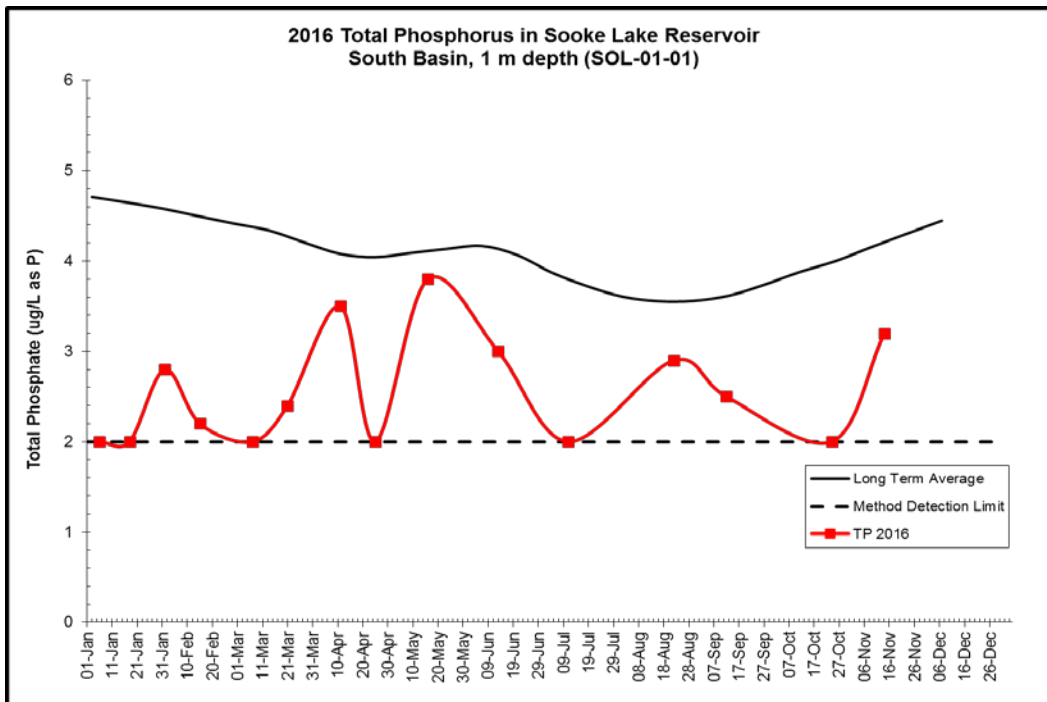


Figure 12 Total Phosphorus in Sooke Lake Reservoir, South Basin, 1 m depth (SOL-01-01)

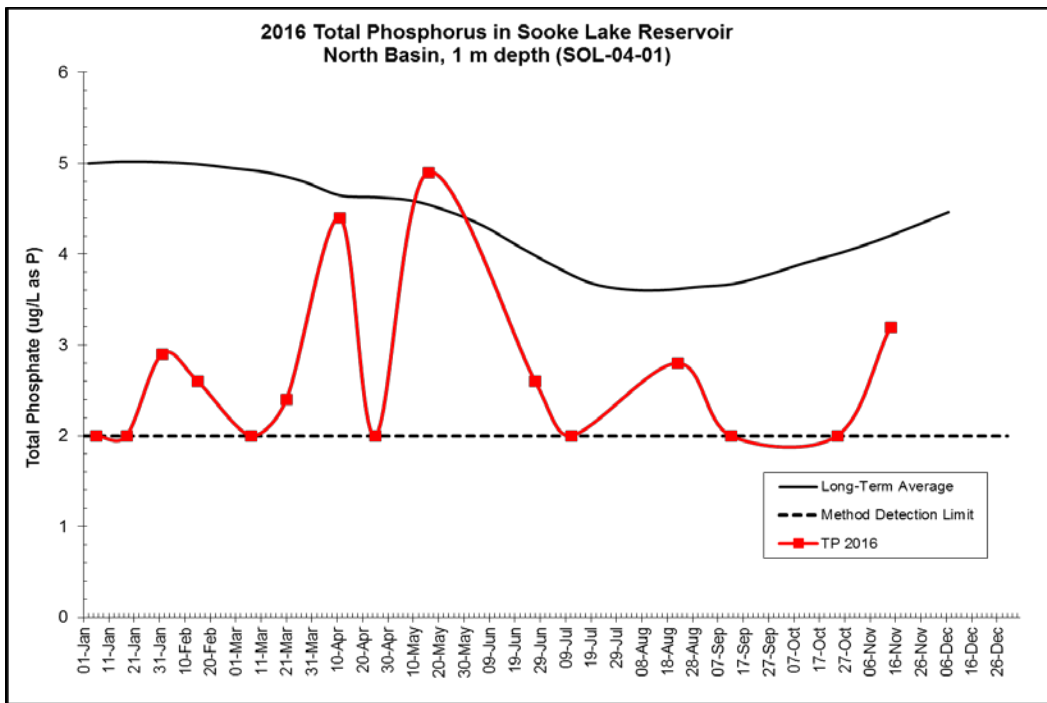



Figure 13 Total Phosphorus in Sooke Lake Reservoir, North Basin, 1 m depth (SOL-04-01)

## 7.2 Treatment Monitoring Results

The following sections summarize the water quality data collected and analyzed to monitor and verify the effectiveness of the disinfection process at both CRD disinfection facilities in the GVDWS.

### 7.2.1 Japan Gulch Disinfection Facility

**Bacteriological Results after UV Treatment.** Figure 14 shows the results from 241 samples collected and analyzed just downstream of the UV reactors. The results indicate that the UV treatment is capable of greatly reducing the *E. coli* and total coliform concentrations.

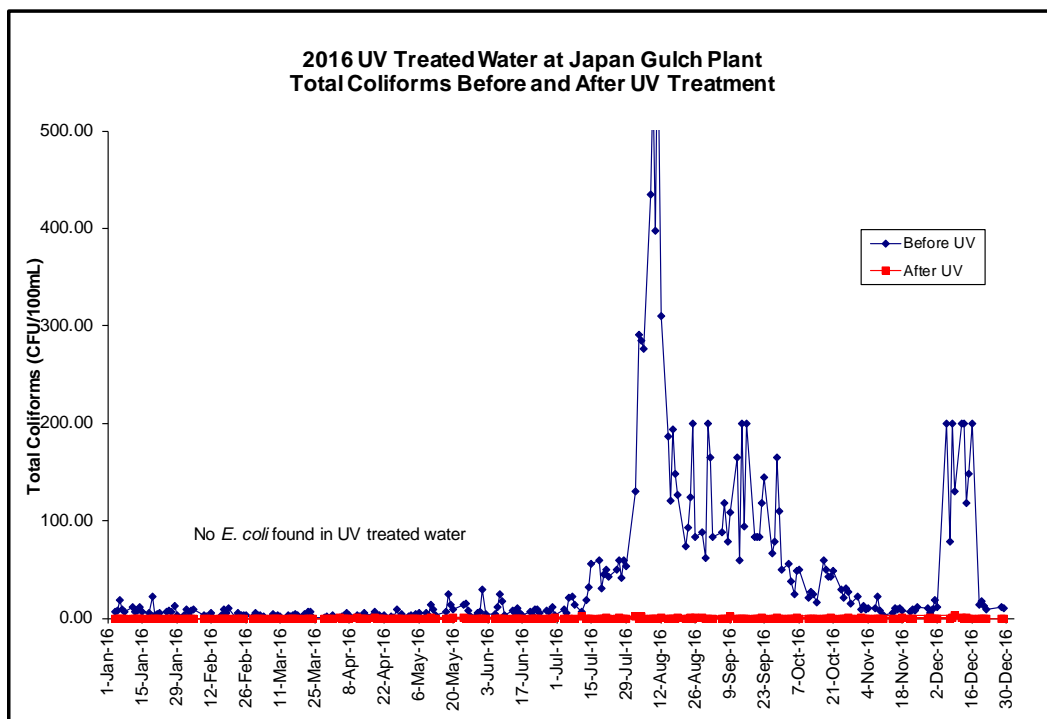


**Figure 14 2016 UV Treated Water at Japan Gulch Plant Total Coliforms Before and After UV Treatment**

**Treated Water at First Customer.** The data collected from the treated water sampling location near the first customer below the Japan Gulch Disinfection Facility indicated that the bacteriological quality of the disinfected water was good in all months of 2016 (Figure 15 and Appendix A, Table 2). In August and September, each 1 sample, representing under 10% of the monthly total at this location, tested positive for total coliform bacteria. While the regulations require 90% of all monthly samples in the entire system to be free of total coliform bacteria, the CRD monitors the first customer locations based on even more stringent criteria where water quality is gauged on the bacteriological results of this single location only. The occurrence of an occasional total coliform-positive result during the summer months at this location is not unusual and may be attributable to the high water temperatures in the raw and treated water. It does not indicate a failure of the treatment system or a contamination of the water system.

In all of 2016, there were 2 total coliform-positive samples in the 242 samples analyzed from this location (Figure 15). This is evidence of the effectiveness of the primary disinfection process consisting of UV and free chlorine disinfection since January 2004. The total chlorine residual ranged from 1.1 to 1.5 mg/L with a median value of 1.26 mg/L.

The median pH was 6.96 and the median total organic carbon concentration 1.77 mg/L at this sampling station in 2016. The disinfection by-product concentrations at this location ranged from 13–22 µg/L total trihalomethanes and 10–23 µg/L total haloacetic acids.

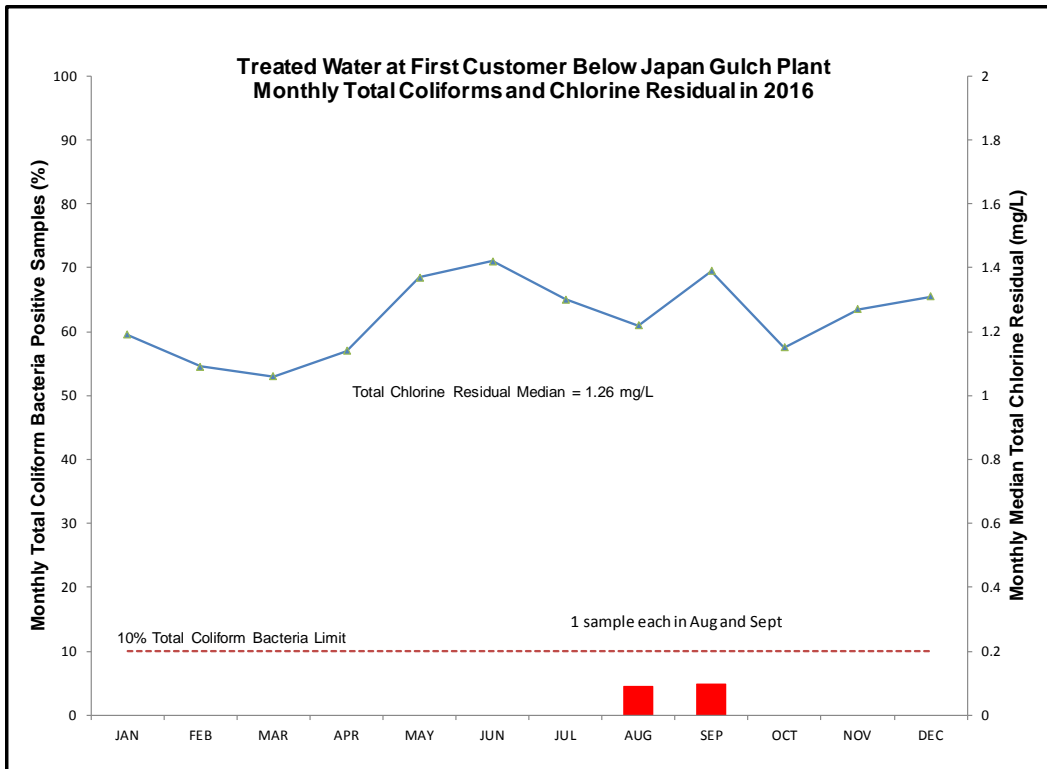


**Figure 15 Treated Water at First Customer below Japan Gulch Plant Monthly Total Coliforms and Chlorine Residual in 2016**

### 7.2.2 Sooke River Road Disinfection Facility

**Bacteriological Results after UV Treatment.** Figure 16 shows the results from 53 samples collected and analyzed just downstream of the UV reactors. The results indicate that the UV treatment is capable of greatly reducing the *E. coli* and total coliform concentrations.



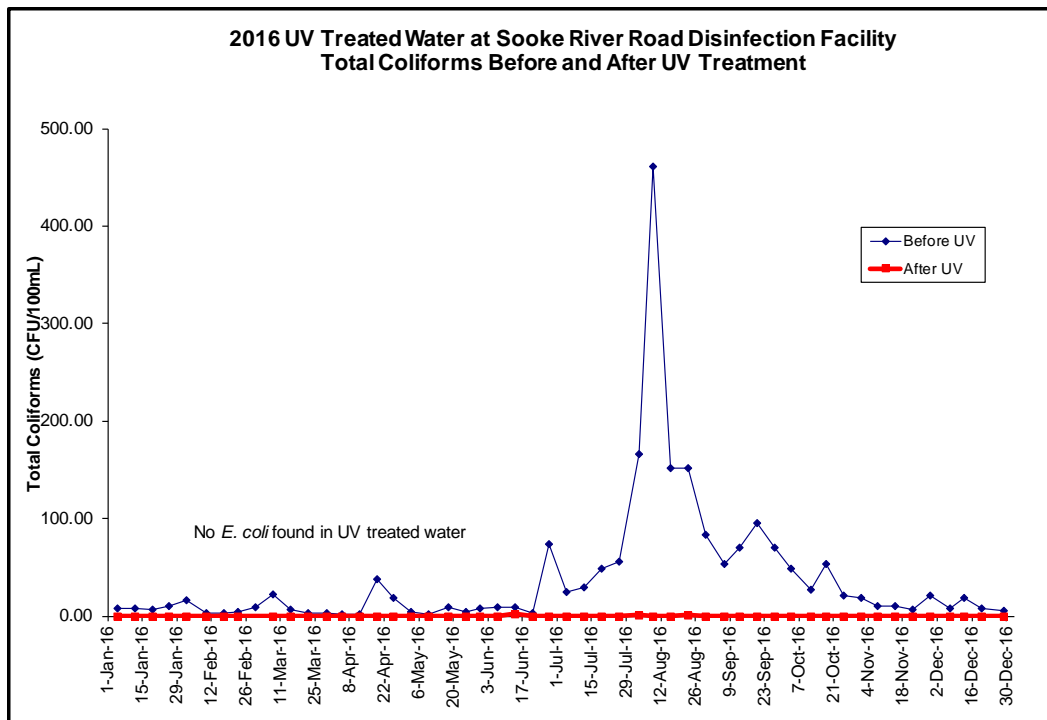


**Figure 16 2016 UV Treated Water at Sooke River Road Disinfection Facility Total Coliforms Before and After UV Treatment**

**Treated Water at First Customer.** The data collected from the treated water sampling location near the first customer below the Sooke River Road Disinfection Facility indicated that the bacteriological quality of the disinfected water was good in all months of 2016 (Figure 17). In March, 1 sample, representing over 10% of the monthly total at this location, tested positive for total coliform bacteria. While the regulations require 90% of all monthly samples in the entire system to be free of total coliform bacteria, the CRD monitors the first customer locations based on even more stringent criteria where water quality is gauged on the bacteriological results of this single location only. Due to the smaller amount of samples collected at this location (once per week) compared to the Japan Gulch First Customer location, 1 positive total coliform result automatically signifies an exceedance of the self-set criteria. It does not indicate a failure of the treatment system or a contamination of the water system.

In all of 2016, there was 1 total coliform-positive sample in the 53 samples analyzed from this location (Figure 17). This is evidence of the effectiveness of the primary disinfection process consisting of UV and free chlorine disinfection. The total chlorine residual ranged from 1.1 to 1.68 mg/L with a median value of 1.37 mg/L.

The median pH was 7.42 at this sampling station in 2016. The disinfection by-product concentrations were only analyzed on samples from the Sooke/East Sooke Distribution System downstream of the first customer sampling station.

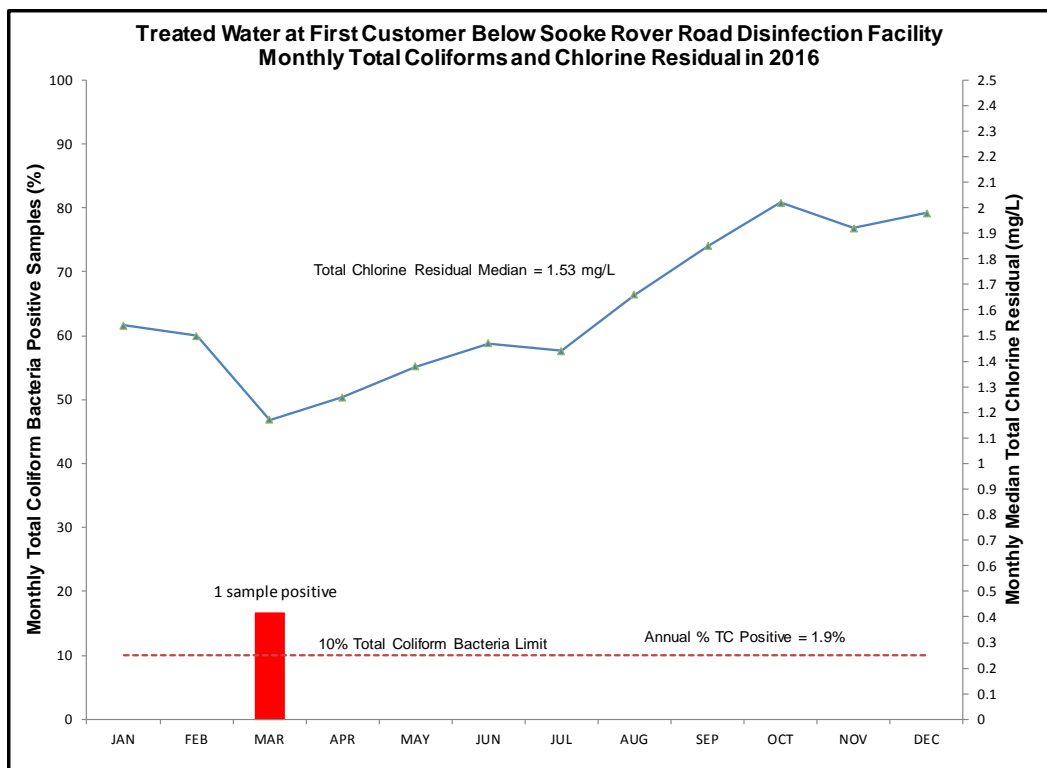

**Figure 17 Treated Water at First Customer below Sooke Rover Road Disinfection Facility, Monthly Total Coliforms and Chlorine Residual in 2016**

### 7.3 CRD Transmission System Results

The following sections summarize the water quality data collected and analyzed for monitoring and verifying the safety of the drinking water conveyed through the transmission system before it reaches the municipal distribution systems. Bacteriological results of the samples collected in the transmission system are considered for compliance purposes. There is no applicable requirement for monthly sample numbers for a transmission system. The number of samples collected monthly from CRD Transmission System infrastructure was based on a water quality risk assessment and based on professional judgement.

#### 7.3.1 Transmission Mains

**Bacteriological Results.** Figure 18 and Table 1 show the results from 483 CRD transmission main samples collected and analyzed in 2016. The results (no total coliform and no *E. coli* detected) indicate that the water delivered through the transmission mains was bacteriologically safe.

**Chlorine Residual.** Figure 18 demonstrates that the median total chlorine concentration in the transmission mains was well above 1 mg/L and provides, therefore, for adequate secondary disinfection within the transmission system and within most areas of the downstream municipal distribution systems.

**Water Temperature.** The annual median water temperature in the transmission mains was 11.99°C, with monthly medians ranging between 5.9°C (December) and 18.6°C (August) (Table 1).

**Table 1 2016 Bacteriological Quality of the CRD Transmission Mains**

Month	Samples Collected	Total Coliform (CFU/100 mL)				<i>E. coli</i> (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp.
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	36	0	0.0	0	0	0	8	0	1.20	6.6
FEB	40	0	0.0	0	0	0	6	0	1.10	6.9
MAR	42	1	2.4	0	0	0	6	0	1.14	7.8
APR	40	0	0.0	0	0	0	7	0	1.17	9.8
MAY	45	0	0.0	0	0	0	9	1	1.09	12.0
JUN	40	0	0.0	0	0	0	7	0	1.13	14.3
JUL	33	0	0.0	0	0	0	7	0	1.03	16.7
AUG	48	1	2.1	0	0	0	9	0	0.99	18.6
SEP	41	1	2.4	0	0	0	8	0	0.94	17.8
OCT	42	1	2.4	0	0	0	8	0	0.94	13.7
NOV	42	0	0.0	0	0	0	7	0	0.98	11.7
DEC	34	0	0.0	0	0	0	7	0	1.27	5.9
<b>TOTAL</b>	<b>483</b>	<b>4</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>89</b>	<b>1</b>	<b>1.08</b>	<b>11.9</b>


**Disinfection By-Products.** No data in 2016.

**Metals.** The CRD Water Quality Monitoring Program for the CRD Transmission System included regular metal tests in 5 strategic locations where the water transitions from the CRD Transmission System to a downstream distribution system. In particular, the CRD pays attention to metals commonly found in drinking water such as iron, manganese, copper and lead. In 1 location (Lansdowne and Foul Bay Road) where water flows from Main #3 into the Oak Bay Distribution System, elevated lead concentrations have been found in each of the 6 samples analyzed in 2016. The concentrations were below the MAC as per Canadian Guidelines, but an order of magnitude higher than in other samples across the GVDWS. Another sampling location (Cook and Mallek), where Main #3 connects with the City of Victoria Distribution System, 2 out of 2 samples (November and December 2016) had an exceedance (11.9 and 19.2 µg/L) of the lead MAC which is currently still 10 µg/L. It is unlikely that the lead sources lie within the CRD Transmission System but rather within the municipal systems and backflow patterns allow these lead concentrations to reach back into the transmission system. Follow-up investigations are underway and discussion with the affected municipalities will be forthcoming.

**Physical/Chemical Parameters.** The drinking water in the regional transmission mains had the following physical and chemical characteristics:

- Median pH 6.97
- Median CaCO<sub>3</sub> Hardness: 17.6 mg/L
- Median Alkalinity: 13.1 mg/L
- Median Colour: 4 TCU
- Median Turbidity: 0.33 mg/L
- Median Conductivity (25°C): 45.6 µS/cm

**Compliance Status.** The transmission mains of the CRD Transmission System were in full compliance with the *BC Drinking Water Protection Act and Regulation*.

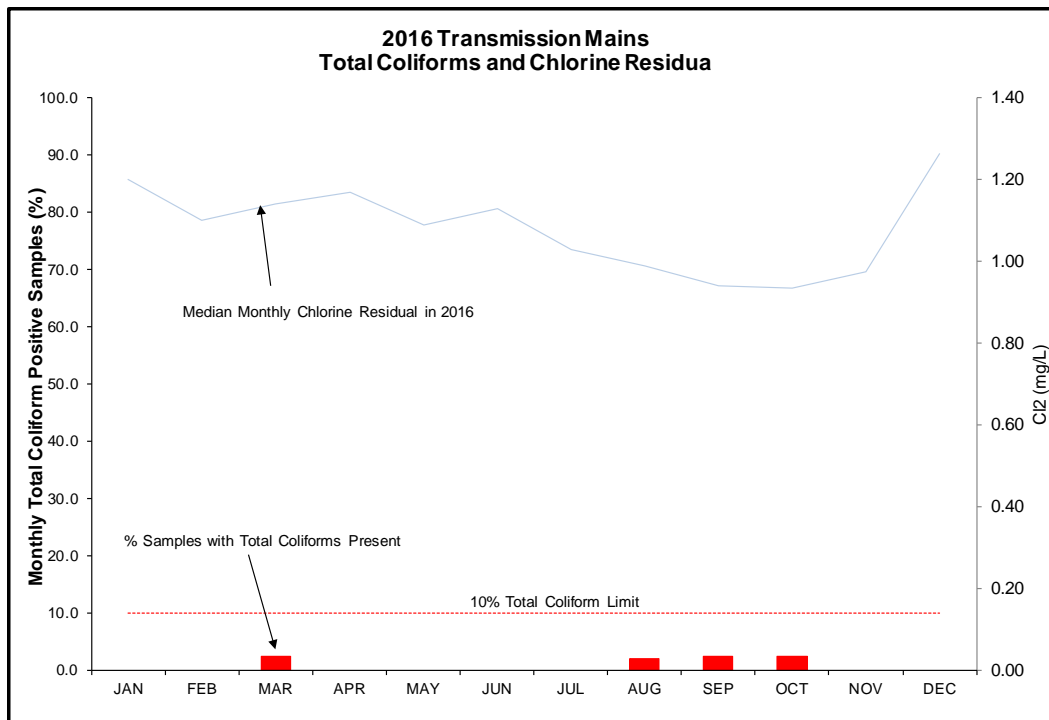

**Figure 18 2016 Transmission Mains Total Coliforms and Chlorine Residual**

### 7.3.2 Storage Reservoirs

**Bacteriological Results.** Figure 19 shows the 2016 results from 829 samples on CRD storage reservoirs that are considered part of the CRD Transmission System. The results indicate that the water in these storage reservoirs was bacteriologically safe. No sample exceeded the 10 CFU/100 mL total coliform concentration. There were no consecutive positive samples in 2016. This system complied with the 10% total coliform-positive limit for all months. The annual total coliform percentage positive was below the 10% limit at only 1.4% (Table 2). But the occasional total coliform-positive results also indicate that storage reservoirs are more vulnerable to bacteria regrowth and potential contamination due to the long retention times and generally much lower chlorine residual concentrations. Because of the higher risks to water quality in reservoirs compared to pipes, the CRD typically monitors the water quality closely in all of its storage reservoirs.

**Chlorine Residual.** Figure 19 indicates that the median total chlorine concentration in the storage reservoirs ranged from 0.85 mg/L in the winter to only 0.25 mg/L at the end of the summer.

**Water Temperature.** The annual median water temperature in the storage reservoirs was 12.6°C, with monthly medians ranging between 5.9°C (December) and 18.6°C (August) (Table 2).

**Table 2 2016 Bacteriological Quality of Storage Reservoirs**

Month	Samples Collected	Total Coliform (CFU/100 mL)				<i>E. coli</i> (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp.
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	64	0	0.0	0	0	0	2	0	0.58	6.5
FEB	59	0	0.0	0	0	0	3	1	0.58	7.5
MAR	75	1	1.3	0	0	0	4	0	0.49	8.1
APR	73	1	1.4	0	0	0	3	0	0.42	10.6
MAY	78	1	1.3	0	0	0	6	0	0.45	13.4
JUN	69	3	4.3	0	0	0	4	0	0.48	14.8
JUL	66	0	0.0	0	0	0	3	0	0.33	17.0
AUG	78	1	1.3	0	0	0	3	0	0.29	18.9
SEP	72	4	5.6	0	0	0	2	0	0.25	17.6
OCT	72	1	1.4	0	0	0	3	0	0.31	13.9
NOV	61	0	0.0	0	0	0	4	0	0.39	11.9
DEC	62	0	0.0	0	0	0	2	0	0.85	6.7
<b>TOTAL</b>	<b>829</b>	<b>12</b>	<b>1.4</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>39</b>	<b>1</b>	<b>0.43</b>	<b>12.6</b>

**Disinfection By-Products.** The CRD collected a total of 12 samples for a disinfection by-product analysis. The samples were collected at 2 storage reservoirs in the CRD Transmission System (Cloake Hill Reservoir and Upper Dean Park Reservoir). At both locations the CRD maintains a re-chlorination station that can boost free chlorine concentrations if the residuals fall below 0.2 mg/L. While this procedure is rarely exercised, any free chlorine concentration can lead to an increase in disinfection by-product formation. The median total trihalomethane (TTHM) and total haloacetic acid (HAA) concentrations are with 19 and 14 µg/L at Cloake Hill and 22 and 18 µg/L at Upper Dean, respectively, well below the MAC (TTHM = 100 and HAA = 80 µg/L) stipulated in the Canadian Guidelines.

**Physical/Chemical Parameters.** The drinking water in the regional transmission storage reservoirs had the following physical and chemical characteristics:

- Median pH 7.04
- Median Alkalinity: 13.7 mg/L
- Median Colour: 3.75 TCU
- Median Turbidity: 0.31 mg/L
- Median Conductivity (25°C): 49.2 µS/cm


**Nitrification.** Nitrification occurs in many chloraminated water systems. It is a complex bacteriological process in which ammonia is oxidized initially to nitrite and then to nitrate and is caused by 2 groups of bacteria that have low growth rates relative to other bacteria. Water temperature seems to be a critical factor for nitrification in distribution systems as it has been almost exclusively associated with warm water temperatures. Nitrification is also associated with high water age (reservoirs, dead ends, low-flow pipes) and with sediment biofilms.

Monitoring for nitrifying bacteria directly is inefficient; however, the extent of nitrification in the distribution system can be monitored by measuring chlorine residuals and nitrite (also nitrate, free ammonia). When the chlorine residuals drop (in the absence of any pipe break or plant disinfection failure) accompanied by increases of nitrite then nitrification is occurring. Since Greater Victoria’s source water has no background nitrite, the presence of nitrite in the distribution system is the best indicator of nitrification.

The control of nitrification in a chloraminated distribution system involves limiting the excess free ammonia leaving the disinfection plant, maintaining an adequate chlorine residual throughout the distribution system, minimizing water age in storage facilities and in the low-flow areas of the distribution system, and maintaining annual flushing routines to limit the accumulation of sediment and biofilm in the distribution system piping. CRD Water Quality section staff, in conjunction with CRD Operations and Engineering staff, are undertaking projects to optimize the reservoir and pipe cleaning schedules to address nitrification and other water quality affecting processes throughout the distribution systems. An upgrade project for the

Japan Gulch Disinfection Facility is underway which will improve the chemical dosing system and further reduce the potential for free ammonia in the treated water.

**Compliance Status.** The CRD-owned and operated storage reservoirs in the CRD Transmission System were in full compliance with the *BC Drinking Water Protection Act and Regulation*.

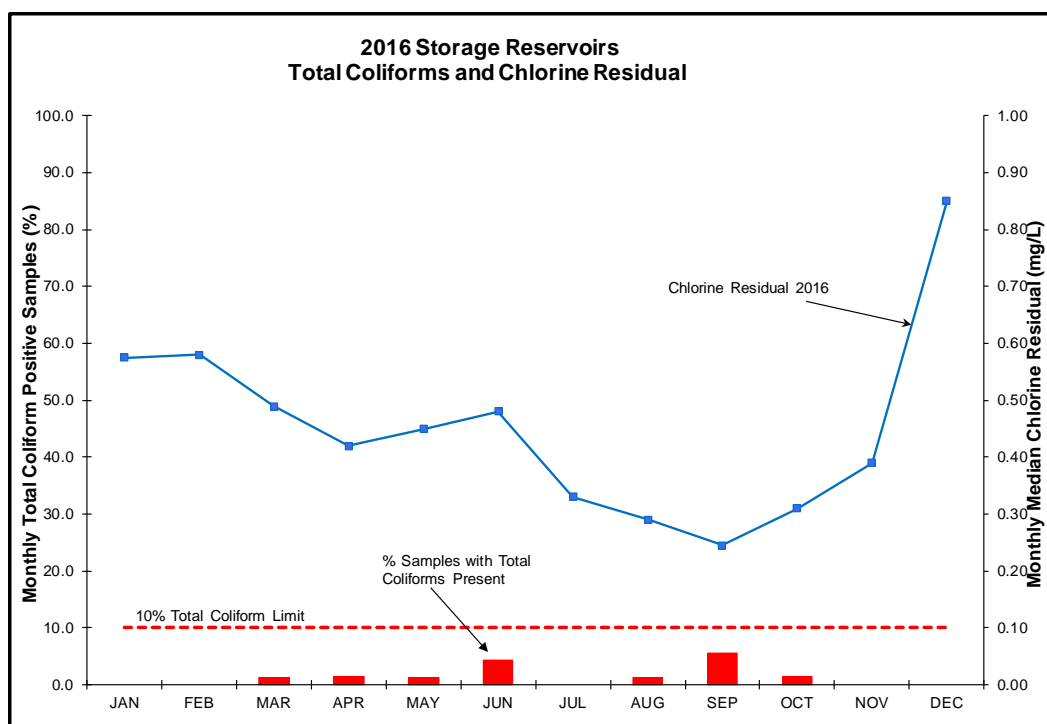

**Figure 19 2016 Storage Reservoirs Total Coliforms and Chlorine Residual**

## 7.4 Distribution System Results

The following sections summarize the water quality monitoring results within the various distribution systems and indicate the compliance status of each system.

### 7.4.1 Juan de Fuca Water Distribution System – West Shore Municipalities (CRD-owned and operated)

In 2016, 35 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the West Shore system.

**Sample Collection.** In 2016, 908 bacteriological and 64 water chemistry samples were collected from the Central Saanich Distribution System (Table 3). Based on current population data for the West Shore municipalities, 66 samples are required for bacteria testing each month. Table 3 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 12 samples collected in 2016. Four samples in April, 3 samples in June, 3 in August and 1 in September and October each. No sample exceeded the 10 CFU/100 mL total coliform concentration. There was 1 consecutive positive sample in June in 1 of the distribution reservoirs upon which the reservoir was drained and cleaned. This system complied with the 10% total coliform-positive limit for all months of the year during 2016. The annual total coliform percentage positive was well below the 10% limit at only 1.3% (Table 3).

Four samples tested positive for *E. coli* on April 20, 2016. The Drinking Water Officer of Island Health was notified the same day. Comprehensive resampling could not confirm the presence of *E. coli* in the drinking water in the area surrounding of the initial positive hits. An internal laboratory quality control investigation concluded that the samples were likely contaminated during laboratory processing and the initial *E. coli* positives were unrepresentative of the water quality conditions in the system.

**Chlorine Residual.** The annual median chlorine residual in the West Shore municipalities of the Juan de Fuca Water Distribution System was 0.65 mg/L (Table 3). The lowest monthly median was in September (0.31 mg/L) and the maximum monthly median was in December (0.96 mg/L) (Figure 20).

**Water Temperature.** The annual median water temperature in the Juan de Fuca Water Distribution System was 12.7°C, with monthly medians ranging between 6.5°C (January) and 18.9°C (August) (Table 3).

**Table 3 2016 Bacteriological Quality of the Juan de Fuca Distribution System – West Shore Municipalities (CRD)**

Month	Samples Collected	Total Coliform (CFU/100 mL)				<i>E. coli</i> (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp.
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	70	0	0.0	0	0	0	3	0	0.92	6.5
FEB	58	0	0.0	0	0	0	3	1	0.71	7.4
MAR	85	0	0.0	0	0	0	6	0	0.86	8.3
APR	85	4	4.7	0	0	4	5	0	0.77	11.2
MAY	85	0	0.0	0	0	0	8	0	0.79	13.5
JUN	76	3	3.9	1	0	0	5	0	0.68	15.0
JUL	73	0	0.0	0	0	0	5	0	0.49	17.3
AUG	88	3	3.4	0	0	0	6	0	0.62	18.9
SEP	79	1	1.3	0	0	0	5	0	0.31	18.0
OCT	78	1	1.3	0	0	0	5	0	0.46	13.7
NOV	63	0	0.0	0	0	0	5	0	0.46	12.1
DEC	68	0	0.0	0	0	0	5	0	0.96	6.7
<b>TOTAL</b>	<b>908</b>	<b>12</b>	<b>1.3</b>	<b>1</b>	<b>0</b>	<b>4</b>	<b>61</b>	<b>1</b>	<b>0.65</b>	<b>12.7</b>

**Disinfection By-Products.** No data collected in 2016.

**Physical/Chemical Parameters.** The drinking water in the West Shore municipalities of the Juan de Fuca Water Distribution System had the following physical and chemical characteristics:

- Median CaCO<sub>3</sub> Hardness: 18.3 mg/L
- Median Colour: 4.35 TCU
- Median Turbidity: 0.31 mg/L

**Metals.** The CRD Water Quality Monitoring Program for the West Shore municipalities included quarterly metal tests in 1 strategic location (Happy Valley and Dicker W.) in 2016. All metallic parameters including lead were well below the MAC or AO limits as per Canadian Guidelines.

**Compliance Status.** The West Shore municipalities of the Juan de Fuca Water Distribution System were in full compliance with the *BC Drinking Water Protection Act and Regulation*.

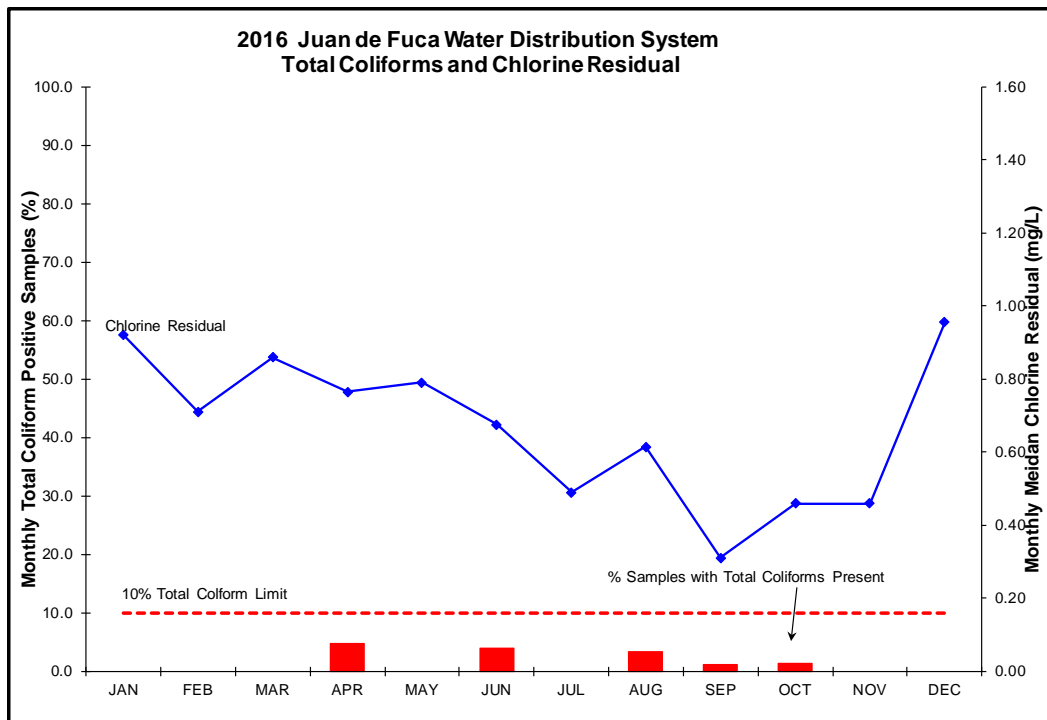


Figure 20 JDF – West Shore Distribution System Total Coliforms and Chlorine Residual

#### 7.4.2 Sooke/East Sooke Distribution System (CRD-owned and operated)

In 2016, 22 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the West Shore system. All Sooke/East Sooke sampling stations were sampled once per week.

**Sample Collection.** In 2016, 479 bacteriological and 69 water chemistry samples were collected from the Sooke/East Sooke Distribution System (Table 4). Based on current population data for the District of Sooke, 13 samples are required for bacteria testing each month. Table 4 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 7 samples collected in 2016. One sample in March, April and June each, 2 samples in August and 2 in October. One sample in October exceeded the 10 CFU/100 mL total coliform concentration. There were also no consecutive positive samples in 2016. This system complied with the 10% total coliform-positive limit for all months of the year during 2016 even though the first customer location in itself had 1 month of an exceedance of the CRD self-imposed 10% total coliform rule (see Section 7.2.2). The annual total coliform percentage positive was below the 10% limit at only 1.5% (Table 4).

One of the samples tested positive for *E. coli* on April 20, 2016. The Drinking Water Officer of Island Health was notified the same day. Comprehensive resampling could not confirm the presence of *E. coli* in the drinking water in the area surrounding of the initial positive hit. An internal laboratory quality control investigation concluded that the sample was likely contaminated during laboratory processing and the initial *E. coli* positive was unrepresentative of the water quality conditions in the system (see also under Section 7.4.1.).

**Chlorine Residual.** The annual median chlorine residual in the Sooke/East Sooke Distribution System was 0.33 mg/L (Table 4). The lowest monthly median was in August (0.09 mg/L) and the maximum monthly median was in December (1.23 mg/L). Due to the very low residual concentrations at the end of the summer, CRD took corrective actions that resulted in a significant recovery of total chlorine concentrations in the fall and winter of 2016 (see also Section 5.3) (Figure 21).

**Water Temperature.** The annual median water temperature in the Sooke/East Sooke Distribution System was 12.8°C, with monthly medians ranging between 6.7°C (January) and 18.9°C (August) (Table 4).



**Table 4 2016 Bacteriological Quality of the Sooke/East Sooke Distribution System (CRD)**

Month	Samples Collected	Total Coliform (CFU/100 ml)				E coli (CFU/100 ml)	Turbidity		Chlorine Residual Median mg/L Cl <sub>2</sub>	Water Temp Median °C
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10		Samples >0	Samples Collected >1 NTU		
JAN	37	0	0.0	0	0	0	0	0	0.47	6.7
FEB	30	0	0.0	0	0	0	0	0	0.31	7.7
MAR	44	1	2.3	0	0	0	0	0	0.30	8.5
APR	38	1	2.6	0	0	1	0	0	0.38	11.1
MAY	56	0	0.0	0	0	0	9	0	0.37	13.9
JUN	37	1	2.7	0	0	0	0	0	0.29	15.3
JUL	33	0	0.0	0	0	0	0	0	0.14	17.0
AUG	46	2	4.3	0	0	0	0	0	0.09	18.9
SEP	37	0	0.0	0	0	0	0	0	0.23	17.2
OCT	46	2	4.3	1	1	0	0	0	0.42	13.7
NOV	34	0	0.0	0	0	0	0	0	0.70	11.8
DEC	41	0	0.0	0	0	0	0	0	1.23	7.3
<b>TOTAL</b>	<b>479</b>	<b>7</b>	<b>1.5</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>9</b>	<b>0</b>	<b>0.33</b>	<b>12.8</b>

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** The drinking water in the Sooke/East Sooke Distribution System had the following physical and chemical characteristics:

- Median pH 7.51
- Median CaCO<sub>3</sub> Hardness: 18.8 mg/L
- Median Alkalinity: 17.3 mg/L
- Median Turbidity: 0.24 mg/L
- Median Conductivity (25°C): 63.1 µS/cm

**Metals.** The CRD Water Quality Monitoring Program for the Sooke/East Sooke system included quarterly metal tests in 1 strategic location (Whiffen Spit Road) in 2016. All metallic parameters including lead were well below the MAC or AO limits as per Canadian Guidelines.

**Compliance Status.** The Sooke/East Sooke Distribution System was in compliance with the *BC Drinking Water Protection Act and Regulation* except for 1 sample that exceeded the limit of 10 CFU/100 mL total coliform concentration.

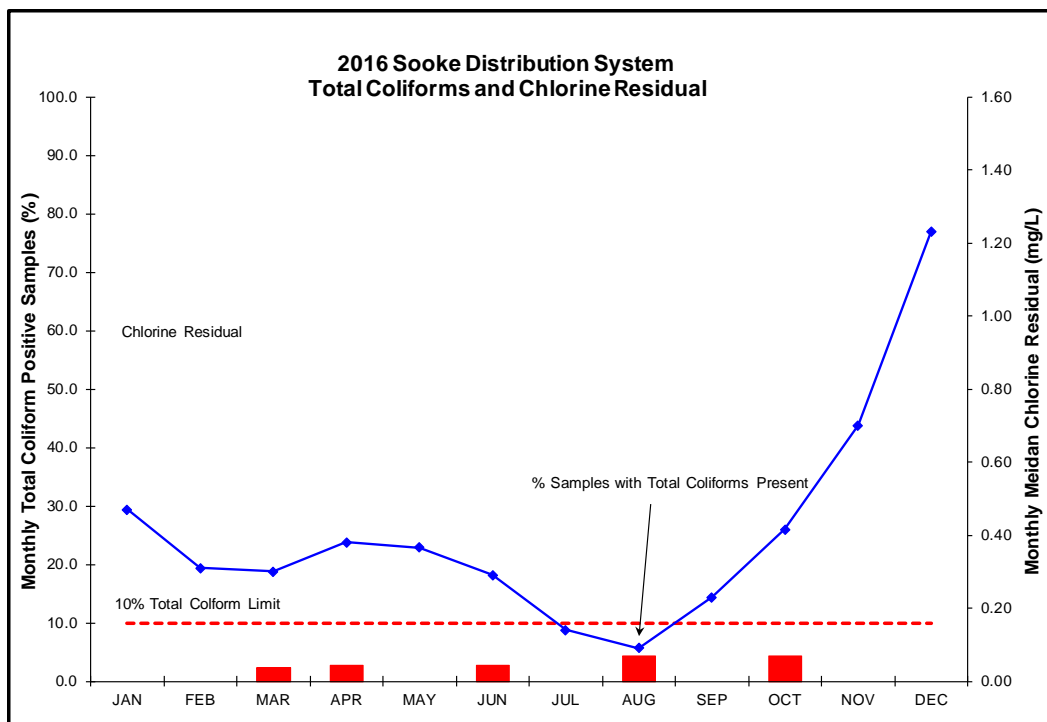

**Figure 21 Sooke/East Sooke Distribution System Total Coliforms and Chlorine Residual**

### 7.4.3 Central Saanich Distribution System – (District of Central Saanich owned and operated)

In 2016, 12 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the Central Saanich Distribution System. Central Saanich sampling stations are part of the daily distribution sampling runs by CRD staff.

**Sample Collection.** In 2016, 232 bacteriological and 127 water chemistry samples were collected from the Central Saanich Distribution System (Table 5). Based on current population data for the District of Central Saanich, 17 samples are required for bacteria testing each month. Table 5 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 10 samples collected in 2016 distributed fairly evenly throughout the year. Three samples exceeded the 10 CFU/100 mL total coliform concentration, 1 sample in April and 2 in June. The total coliform-positive sample in April was confirmed by a positive resample and the municipal water system operators carried out a system flush in the affected area upon which another set of resamples tested negative for total coliform bacteria. This system complied with the 10% total coliform positive limit for all months of 2016 except for June when 3 samples tested positive for total coliforms which represents 13.6% of all samples that month. The annual total coliform percentage positive was below the 10% limit at only 4.3% (Table 5).

None of the samples contained *E. coli* in 2016 (Table 5).

**Chlorine Residual.** The annual median chlorine residual in the Central Saanich Distribution System was 0.63 mg/L (Table 5). The lowest monthly median was in October (0.38 mg/L) and the maximum monthly median was in May and June (0.85 mg/L) (Figure 22).

**Water Temperature.** The annual median water temperature in the Juan de Fuca Water Distribution System was 13.0°C, with monthly medians ranging between 7.3°C (January) and 18.8°C (September) (Table 5).

**Table 5 2016 Bacteriological Quality of the Central Saanich Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	21	0	0.0	0	0	0	5	1	0.57	7.3
FEB	18	1	5.6	0	0	0	4	1	0.63	8.1
MAR	20	0	0.0	0	0	0	5	0	0.62	8.9
APR	23	2	8.7	1	1	0	3	0	0.63	11.4
MAY	18	1	5.6	0	0	0	4	1	0.85	13.4
JUN	22	3	13.6	0	2	0	5	0	0.85	15.1
JUL	18	1	5.6	0	0	0	5	0	0.68	17.2
AUG	22	1	4.5	0	0	0	7	3	0.57	18.8
SEP	17	0	0.0	0	0	0	4	0	0.51	17.7
OCT	18	0	0.0	0	0	0	5	1	0.38	14.8
NOV	20	1	5.0	0	0	0	5	0	0.55	12.7
DEC	15	0	0.0	0	0	0	5	0	0.69	8.9
<b>TOTAL</b>	<b>232</b>	<b>10</b>	<b>4.3</b>	<b>1</b>	<b>3</b>	<b>0</b>	<b>57</b>	<b>7</b>	<b>0.63</b>	<b>13.0</b>

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** The drinking water in the Central Saanich Distribution System had the following physical and chemical characteristics:

- Median pH 6.96
- Median CaCO<sub>3</sub> Hardness: 18.8 mg/L
- Median Alkalinity: 13.33 mg/L
- Median Turbidity: 0.36 mg/L
- Median Colour: 4.2 TCU
- Median Conductivity (25°C): 46.9 µS/cm

**Metals.** No data for 2016.

**Compliance Status.** The Central Saanich Distribution System was in compliance with the *BC Drinking Water Protection Act* and *Regulation* except for the months of April and June. April had 1 sample that exceeded the limit of 10 CFU/100 mL total coliform concentration and it had 2 consecutive positive samples. June had 2 samples that exceeded the limit of 10 CFU/100 mL total coliform concentration and the monthly percentage of samples that had total coliform positive results was greater than 10%.

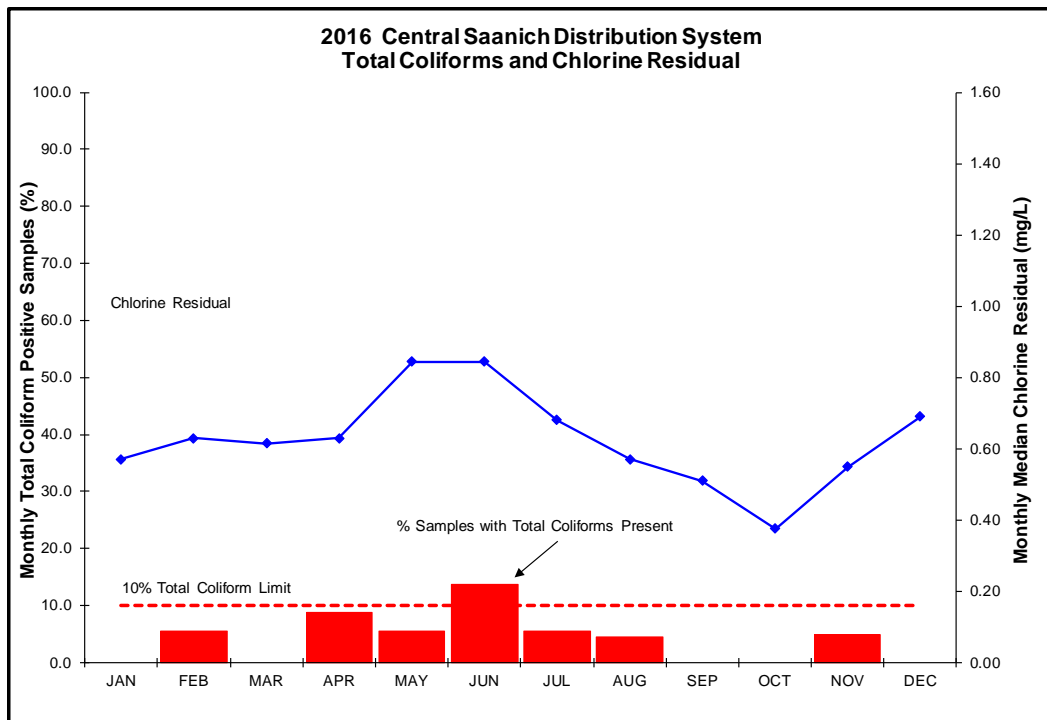

**Figure 22 Central Saanich Distribution System Total Coliforms and Chlorine Residual**

#### 7.4.4 North Saanich Distribution System – (District of North Saanich owned and operated)

In 2016, 10 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the North Saanich Distribution System. North Saanich sampling stations are part of the daily distribution sampling runs by CRD staff.

**Sample Collection.** In 2016, 199 bacteriological and 40 water chemistry samples were collected from the North Saanich Distribution System (Table 6). Based on current population data for the District of North Saanich, 19 samples are required for bacteria testing each month. Table 6 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** No total coliforms were found in all samples collected in 2016 (Table 6).

None of the samples contained *E. coli* in 2016 (Table 6).

**Chlorine Residual.** The annual median chlorine residual in the North Saanich Distribution System was 0.09 mg/L (Table 6). The lowest monthly median was in October and November (0.03 mg/L) and the maximum monthly median was in May (0.31 mg/L) (Figure 23).

**Water Temperature.** The annual median water temperature in the North Saanich Distribution System was 12.7°C, with monthly medians ranging between 7.5°C (January) and 18.9°C (August) (Table 6).

**Table 6 2016 Bacteriological Quality of North Saanich Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	17	0	0.0	0	0	0	1	0	0.06	7.5
FEB	14	0	0.0	0	0	0	0	0	0.09	8.0
MAR	17	0	0.0	0	0	0	1	0	0.08	9.1
APR	18	0	0.0	0	0	0	1	0	0.15	10.9
MAY	14	0	0.0	0	0	0	1	0	0.31	13.5
JUN	17	0	0.0	0	0	0	0	0	0.17	15.1
JUL	16	0	0.0	0	0	0	1	0	0.21	16.9
AUG	19	0	0.0	0	0	0	1	0	0.16	18.9
SEP	16	0	0.0	0	0	0	1	0	0.05	17.4
OCT	17	0	0.0	0	0	0	1	0	0.03	13.9
NOV	19	0	0.0	0	0	0	1	0	0.03	12.3
DEC	15	0	0.0	0	0	0	1	0	0.06	7.7
<b>TOTAL</b>	<b>199</b>	<b>0</b>	<b>0.0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>10</b>	<b>0</b>	<b>0.09</b>	<b>12.7</b>

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** The CRD collected a total of 6 samples in the North Saanich Distribution System for a disinfection by-product analysis. The samples were collected at 1 sampling station (10943 Boas Road). The results for TTHM ranged from 18 to 23 µg/L and for HAA from not detected to 7.6 µg/L and were, therefore, well under the MAC per Canadian Guidelines.

**Physical/Chemical Parameters.** The drinking water in the North Saanich Distribution System had the following physical and chemical characteristics:

- Median pH 7.05
- Median Colour: 4.45 TCU
- Median Turbidity: 0.33 mg/L
- Median Conductivity (25°C): 46.0 µS/cm

**Metals.** No data in 2016.

**Compliance Status.** The North Saanich Distribution System was in compliance with the *BC Drinking Water Protection Act and Regulation* during the months of August and November. During every other month in 2016, not enough compliance samples were collected to meet the regulatory requirements.

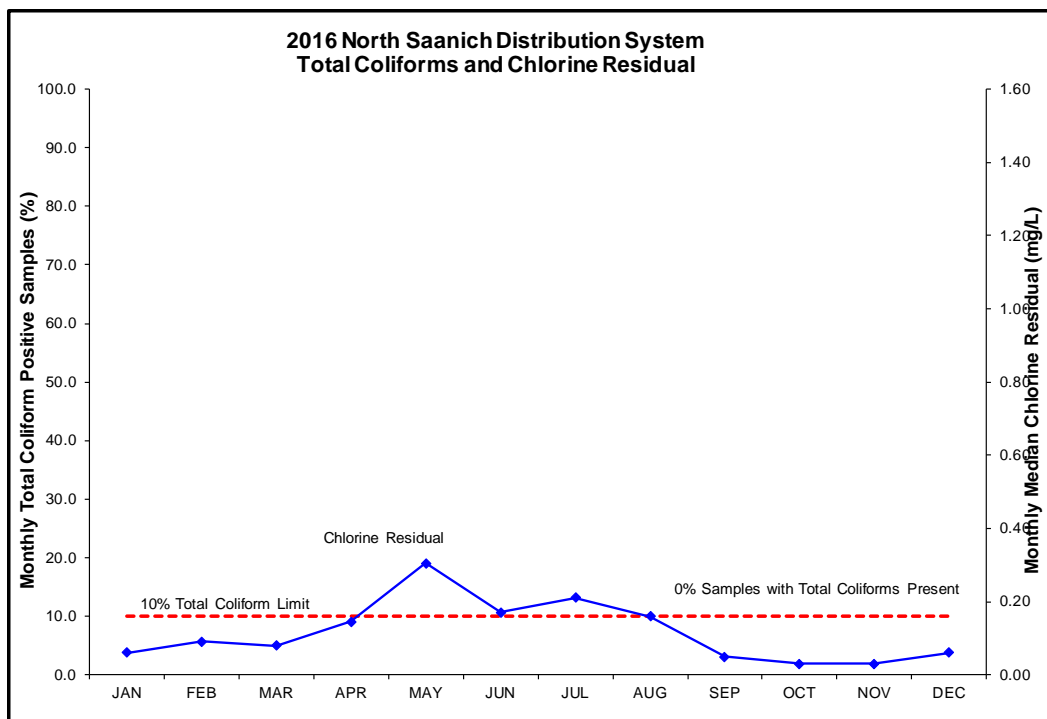

**Figure 23 North Saanich Distribution System Total Coliforms and Chlorine Residual**

#### 7.4.5 Oak Bay Distribution System – (District of Oak Bay owned and operated)

In 2016, 7 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the Oak Bay Distribution System. Oak Bay sampling stations are part of the daily distribution sampling runs by CRD staff.

**Sample Collection.** In 2016, 172 bacteriological and 104 water chemistry samples were collected from the Oak Bay Distribution System (Table 7). Based on current population data for the District of Oak Bay, 19 samples are required for bacteria testing each month. Table 7 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 2 samples collected in 2016. One sample in January and 1 in October. One sample exceeded the 10 CFU/100 mL total coliform concentration. There were no consecutive positive samples in 2016. This system complied with the 10% total coliform-positive limit for all months. The annual total coliform percentage positive was below the 10% limit at only 1.2% (Table 7).

None of the samples contained *E. coli* in 2016 (Table 7).

**Chlorine Residual.** The annual median chlorine residual in the Oak Bay Distribution System was 0.70 mg/L (Table 7). The lowest monthly median was in September (0.51 mg/L) and the maximum monthly median was in December (0.91 mg/L) (Figure 24).

**Water Temperature.** The annual median water temperature in the Oak Bay Distribution System was 13.2°C, with monthly medians ranging between 7.5°C (December) and 19.8°C (September) (Table 7).

**Table 7 2016 Bacteriological Quality of Oak Bay Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	15	1	6.7	0	0	0	2	0	0.87	7.8
FEB	13	0	0.0	0	0	0	1	0	0.72	8.1
MAR	14	0	0.0	0	0	0	2	0	0.71	9.6
APR	15	0	0.0	0	0	0	2	1	0.83	12.2
MAY	15	0	0.0	0	0	0	2	0	0.78	14.1
JUN	16	0	0.0	0	0	0	2	0	0.76	16.2
JUL	14	0	0.0	0	0	0	2	0	0.63	18.4
AUG	13	0	0.0	0	0	0	2	0	0.67	19.8
SEP	16	0	0.0	0	0	0	2	0	0.51	18.4
OCT	15	1	6.7	0	1	0	2	0	0.56	14.8
NOV	16	0	0.0	0	0	0	2	0	0.57	12.9
DEC	10	0	0.0	0	0	0	2	1	0.91	7.5
<b>TOTAL</b>	<b>172</b>	<b>2</b>	<b>1.2</b>	<b>0</b>	<b>1</b>	<b>0</b>	<b>23</b>	<b>2</b>	<b>0.70</b>	<b>13.2</b>

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** The drinking water in the Oak Bay Distribution System had the following physical and chemical characteristics:

- Median pH 7.01
- Median CaCO<sub>3</sub> Hardness: 17.1 mg/L
- Median Alkalinity: 14.2 mg/L
- Median Turbidity: 0.38 mg/L
- Median Conductivity (25°C): 48.0 µS/cm
- Median Colour: 4.25 TCU

**Metals.** No data in 2016

**Compliance Status.** The Oak Bay Distribution System was not in compliance with the *BC Drinking Water Protection Act and Regulation* due to the insufficient number of monthly compliance samples and 1 sample that exceeded the limit of 10 CFU/100 mL total coliform concentration.

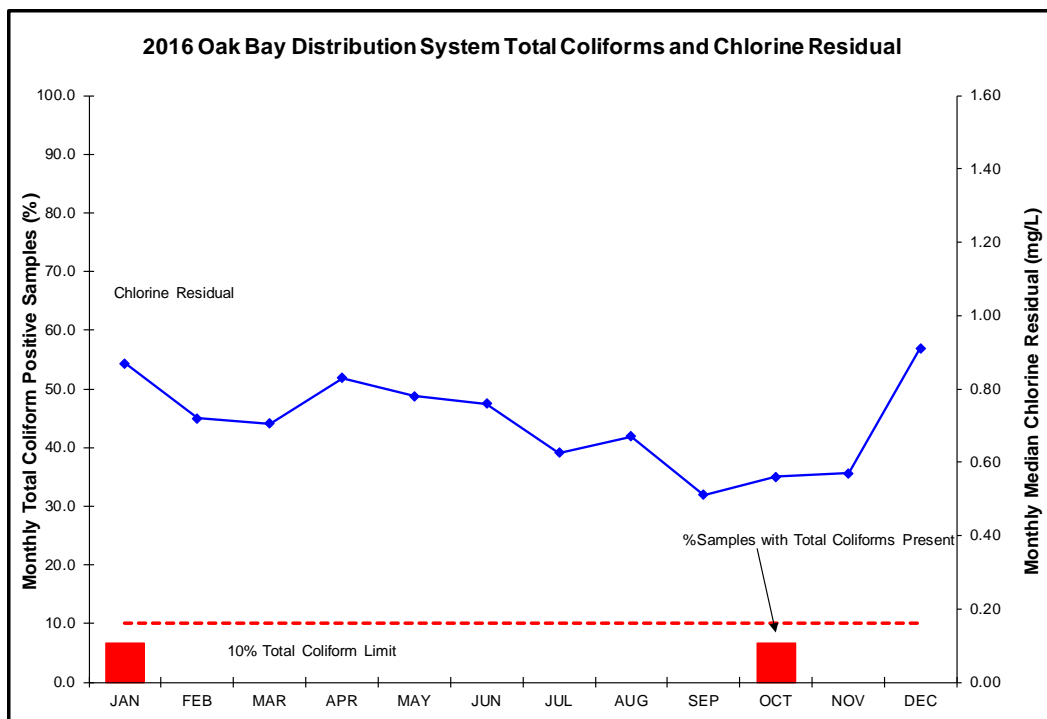

**Figure 24 Oak Bay Distribution System Total Coliforms and Chlorine Residual**

#### 7.4.6 Saanich Distribution System – (District of Saanich owned and operated)

In 2016, 64 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the Saanich Distribution System. Saanich sampling stations are part of the daily distribution sampling runs by CRD staff and a weekly run by Saanich staff.

**Sample Collection.** In 2016, 891 bacteriological and 602 water chemistry samples were collected from the Saanich Distribution System (Table 8). Based on current population data for the District of Saanich, 93 samples are required for bacteria testing each month. Table 8 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 27 samples collected in 2016. Total coliform-positive results occur more often during the summer months. Two samples exceeded the 10 CFU/100 mL total coliform concentration. On 4 occasions there were consecutive positive samples (3 in July and 1 in August). Saanich staff carried out localized system flushes in response to these consecutive events. This system complied with the 10% total coliform positive limit for all months. The annual total coliform percentage positive was below the 10% limit at only 3.0% (Table 8).

None of the samples contained *E. coli* in 2016 (Table 8).

**Chlorine Residual.** The annual median chlorine residual in the Saanich Distribution System was 0.47 mg/L (Table 8). The lowest monthly median was in October (0.3 mg/L) and the maximum monthly median was in May (0.63 mg/L) (Figure 25).

**Water Temperature.** The annual median water temperature in the Saanich Distribution System was 13.1°C, with monthly medians ranging between 7.9°C (January) and 19.3°C (August) (Table 8).



**Table 8 2016 Bacteriological Quality of Saanich Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	86	2	2.3	0	0	0	52	1	0.53	7.9
FEB	83	3	3.6	0	0	0	50	1	0.51	9.2
MAR	77	2	2.6	0	0	0	36	0	0.44	9.4
APR	73	0	0.0	0	0	0	38	0	0.53	11.9
MAY	71	1	1.4	0	0	0	38	0	0.63	13.9
JUN	76	3	3.9	0	0	0	38	1	0.57	15.1
JUL	74	6	8.1	3	1	0	37	0	0.51	18.0
AUG	74	2	2.7	1	1	0	39	0	0.43	19.3
SEP	82	5	6.1	0	0	0	39	0	0.43	17.8
OCT	70	2	2.9	0	0	0	37	1	0.30	14.7
NOV	69	1	1.4	0	0	0	38	2	0.47	12.0
DEC	56	0	0.0	0	0	0	38	2	0.43	8.2
<b>TOTAL</b>	891	27	3.0	4	2	0	480	8	0.47	13.1

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** The drinking water in the Saanich Distribution System had the following physical and chemical characteristics:

- Median pH 6.98
- Median Alkalinity: 13.4 mg/L
- Median Turbidity: 0.32 mg/L
- Median Conductivity (25°C): 47.1 µS/cm
- Median Colour: 4.4 TCU

**Metals.** No data in 2016

**Compliance Status.** The Saanich Distribution System was not in compliance with the *BC Drinking Water Protection Act and Regulation* due to the insufficient number of monthly compliance samples, two samples in July and August that exceeded the limit of 10 CFU/100 mL total coliform concentration and 4 consecutive total coliform positive results in July and August.

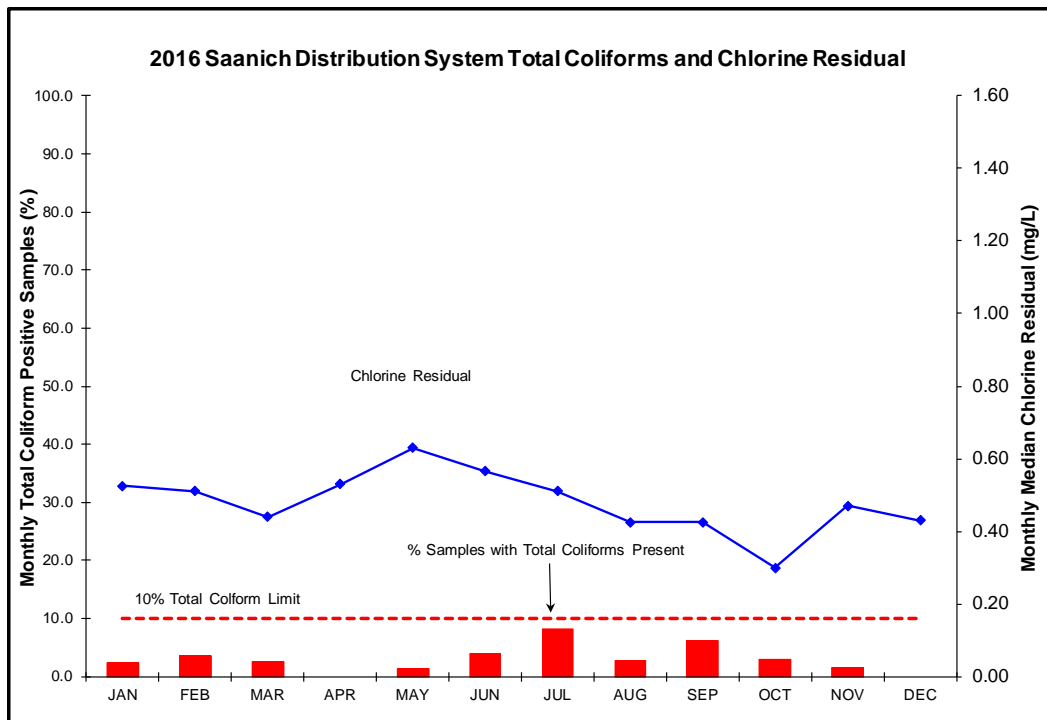

**Figure 25 Saanich Distribution System Total Coliforms and Chlorine Residuals in 2016**

#### 7.4.7 Sidney Distribution System – (Town of Sidney owned and operated)

In 2016, 6 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the Sidney Distribution System. Sidney sampling stations are part of the daily distribution sampling runs by CRD staff.

**Sample Collection.** In 2016, 118 bacteriological were collected from the Sidney Distribution System (Table 9). Based on current population data for the Town of Sidney, 12 samples are required for bacteria testing each month. Table 9 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 1 sample collected in 2016. No sample exceeded the 10 CFU/100 mL total coliform concentration. There were no consecutive positive samples. This system complied with the 10% total coliform-positive limit for all months. The annual total coliform percentage positive was below the 10% limit at only 0.8% (Table 9).

None of the samples contained *E. coli* in 2016 (Table 9).

**Chlorine Residual.** The annual median chlorine residual in the Sidney Distribution System was 0.48 mg/L (Table 9). The lowest monthly median was in September (0.25 mg/L) and the maximum monthly median was in May (0.7 mg/L) (Figure 26).

**Water Temperature.** The annual median water temperature in the Saanich Distribution System was 13.3°C, with monthly medians ranging between 7.5°C (January) and 18.9°C (August) (Table 9).

**Table 9 2016 Bacteriological Quality of Sidney Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	11	0	0.0	0	0	0	0	0	0.57	7.5
FEB	9	0	0.0	0	0	0	0	0	0.49	8.2
MAR	7	0	0.0	0	0	0	0	0	0.42	9.1
APR	12	0	0.0	0	0	0	0	0	0.58	10.9
MAY	11	0	0.0	0	0	0	0	0	0.70	13.9
JUN	11	1	9.1	0	0	0	0	0	0.51	15.1
JUL	10	0	0.0	0	0	0	0	0	0.43	17.0
AUG	10	0	0.0	0	0	0	0	0	0.44	18.9
SEP	12	0	0.0	0	0	0	0	0	0.25	18.2
OCT	9	0	0.0	0	0	0	0	0	0.35	14.9
NOV	9	0	0.0	0	0	0	0	0	0.55	12.7
DEC	7	0	0.0	0	0	0	0	0	0.70	7.6
<b>TOTAL</b>	<b>118</b>	<b>1</b>	<b>0.8</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0.48</b>	<b>13.3</b>

**Notes:**


TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius

**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** No data in 2016.

**Metals.** No data in 2016

**Compliance Status.** The Sidney Distribution System was in compliance with the *BC Drinking Water Protection Act and Regulation* during the months of April and September. During every other month in 2016, not enough compliance samples were collected to meet the regulatory requirements.

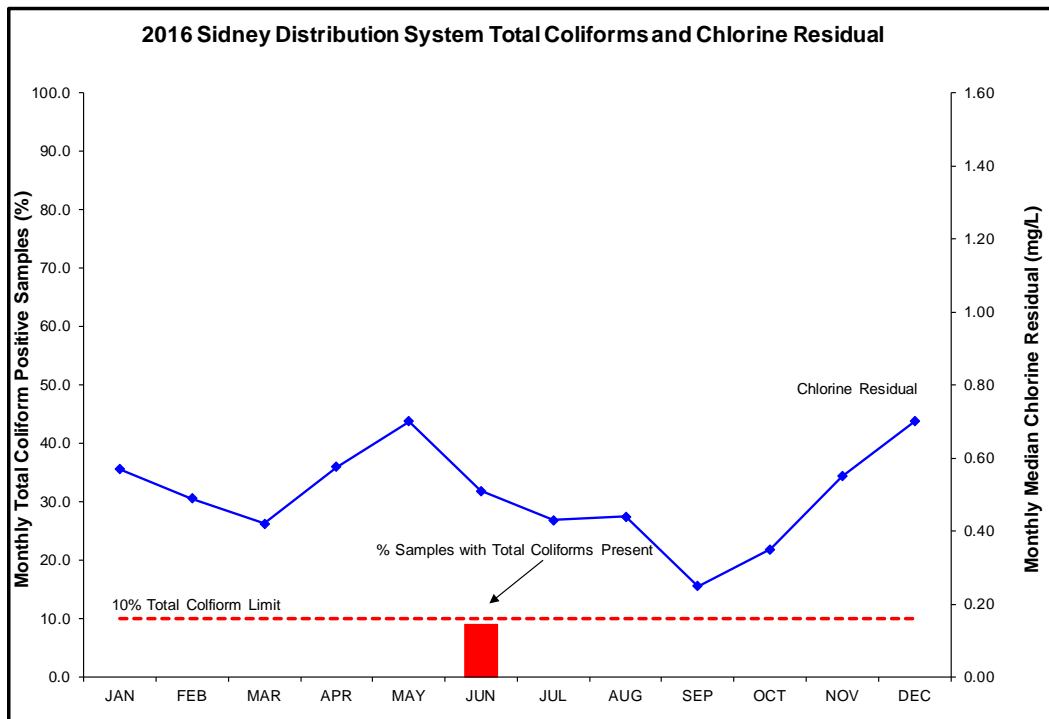

**Figure 26 Sidney Distribution System Total Coliforms and Chlorine Residuals in 2016**

#### 7.4.8 Victoria/Esquimalt Distribution System – (City of Victoria owned and operated)

In 2016, 12 sampling locations were used by the CRD Water Quality Monitoring Program to monitor the bacteriological quality of the water in the Victoria/Esquimalt Distribution System. Victoria/Esquimalt sampling stations are part of the daily distribution sampling runs by CRD staff.

**Sample Collection.** In 2016, 303 bacteriological and 163 water chemistry samples were collected from the Victoria/Esquimalt Distribution System (Table 10). Based on current population data for Victoria and Esquimalt, 92 samples are required for bacteria testing each month. Table 10 shows the number of monthly samples collected and analyzed for compliance.

**Bacteriological Results.** Total coliforms were found in 3 samples collected in 2016. One in June and 2 in August. No sample exceeded the 10 CFU/100 mL total coliform concentration. There were no consecutive positive samples. This system complied with the 10% total coliform positive limit for all months. The annual total coliform percentage positive was below the 10% limit at only 1.0% (Table 10).

None of the samples contained *E. coli* in 2016 (Table 10).

**Chlorine Residual.** The annual median chlorine residual in the Victoria/Esquimalt Distribution System was 0.72 mg/L (Table 10). The lowest monthly median was in November (0.54 mg/L) and the maximum monthly median was in January and February (0.88 mg/L) (Figure 27).

**Water Temperature.** The annual median water temperature in the Victoria/Esquimalt Distribution System was 14.1°C, with monthly medians ranging between 7.3°C (December) and 20.6°C (August) (Table 10).

**Table 10 2016 Bacteriological Quality of Victoria Distribution System**

Month	Samples Collected	Total Coliform (CFU/100 mL)				E coli (CFU/100 mL)	Turbidity		Chlorine Residual	Water Temp
		Samples TC>0	Percent TC>0	Resamples TC>0	Samples TC>10	Samples >0	Samples Collected	Samples >1 NTU	Median mg/L Cl <sub>2</sub>	Median °C
JAN	24	0	0.0	0	0	0	5	0	0.88	7.4
FEB	23	0	0.0	0	0	0	6	0	0.88	8.5
MAR	26	0	0.0	0	0	0	6	0	0.79	9.8
APR	25	0	0.0	0	0	0	5	0	0.79	13.0
MAY	27	0	0.0	0	0	0	6	0	0.74	15.6
JUN	27	1	3.7	0	0	0	5	0	0.87	17.0
JUL	22	0	0.0	0	0	0	5	0	0.66	19.2
AUG	29	2	6.9	0	0	0	7	0	0.56	20.6
SEP	26	0	0.0	0	0	0	5	0	0.55	18.8
OCT	25	0	0.0	0	0	0	5	0	0.60	14.8
NOV	26	0	0.0	0	0	0	7	1	0.54	12.8
DEC	23	0	0.0	0	0	0	6	0	0.64	7.3
<b>TOTAL</b>	<b>303</b>	<b>3</b>	<b>1.0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>68</b>	<b>1</b>	<b>0.72</b>	<b>14.1</b>

**Notes:**

TC = Total Coliforms, *E. coli* = *Escherichia coli* Cl<sub>2</sub> = chlorine, NTU = Nephelometric turbidity unit.  
 > = Greater than, mg/L = milligrams per litre, °C = degrees Celsius


**Disinfection By-Products.** No data for 2016.

**Physical/Chemical Parameters.** The drinking water in the Saanich Distribution System had the following physical and chemical characteristics:

- Median pH 7.00
- Median Turbidity: 0.31 mg/L
- Median Conductivity (25°C): 46.0 µS/cm
- Median Colour: 5.0 TCU

**Metals.** No data in 2016 from within this system. However data from some CRD-Victoria transition points indicate that there may be lead sources in certain City of Victoria distribution system sections.

**Compliance Status.** The Victoria/Esquimalt Distribution System was not in compliance with the *BC Drinking Water Protection Act and Regulation* due to the insufficient number of monthly compliance samples in 2016.

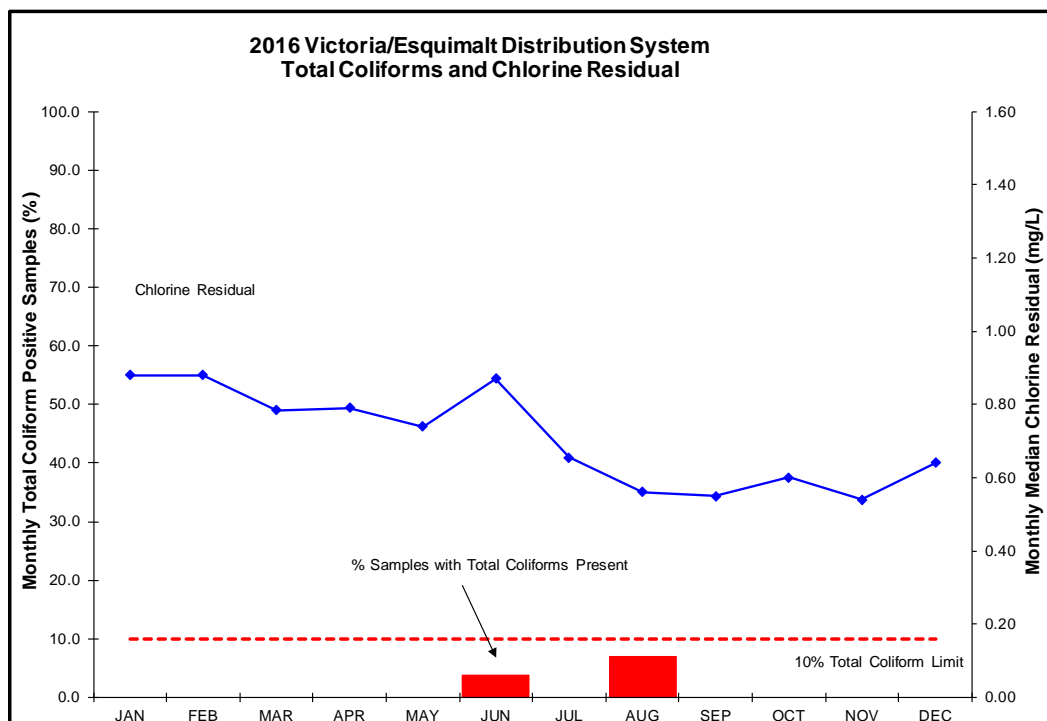

**Figure 27** Victoria/Esquimalt Distribution System Total Coliforms and Chlorine Residuals in 2016

### 7.5 Water Quality Complaints

Records of customer complaints about drinking water quality have been maintained since 1992. During this period, the number of complaints received by CRD staff ranged from a low of 83 in 2010 to a high of 424 in 2006. The peaks in 2003 and 2006 were associated with short duration algal blooms in September of 2003 and in May of 2006.

During the years that Sooke Lake Reservoir was being expanded and the water level in the reservoir raised, a higher number of water quality complaints was expected. The influence of raising the water level on the algal populations in Sooke Lake Reservoir is declining and this in turn has led to a decline in water quality complaints.

In 2016, as was the case in recent years, there was no single category of water quality complaint that stood out among the rest.

In addition to complaints, CRD staff received a number of queries from people who were concerned about the general safety of their drinking water. These concerns were addressed individually and, in general, most customers are content to know that CRD staff was actively sampling both the source water and the treated drinking water being delivered to their homes. For those people wanting to know more about the composition of their drinking water, they were either provided with the annual tables or directed to the CRD website.

## 8.0 CONCLUSIONS

1. The water quality data collected in 2016 indicate that the drinking water in Greater Victoria is of good quality and safe to drink. The drinking water temperature during 3 to 5 months in the summer (an aesthetic limit) is the only parameter that did not meet system-wide the water quality criteria listed in the *Guidelines for Canadian Drinking Water Quality*.
2. Greater Victoria continues to enjoy a water supply in which *Giardia* and *Cryptosporidium* parasites are below the levels commonly considered by the health authorities to be responsible for disease outbreaks.
3. The bacteriological quality of the raw source water was excellent in 2016. In 2016, the *E. coli* bacterial levels in the raw source water were low for the entire year. A slight increase in *E. coli* concentrations was due to the supply from the Goldstream System during the Kapoor Tunnel shut-down.
4. Consumers in the GVDWS receive drinking water that has very low disinfection byproducts. Overall levels of trihalomethanes and haloacetic acids remain well below the Canadian Guidelines' limits and the USEPA limits.
5. The algal activity in 2016 was very low in Sooke Lake Reservoir. Low nutrient concentrations limit the biological productivity of this lake which is very favourable for a drinking water source.
6. The number of water quality complaints received by CRD staff in 2016 was low and was similar to that in previous years.
7. The CRD Transmission System and the CRD Juan de Fuca – West Shore Municipalities Distribution System were in full compliance with the *BC Drinking Water Protection Regulation*.
8. The CRD Sooke/East Sooke Distribution System and the Central Saanich Distribution System met the monthly sampling requirements but had total coliform exceedances above the limits listed in the *BC Drinking Water Protection Regulation*.
9. The review of municipal monitoring programs indicates some deficiencies in sample frequencies as defined by the regulation. This will be addressed in a forthcoming report to the Regional Water Supply Commission.
10. A separate investigation looked at biological lead concentrations in exceedance of current Canadian guidelines and potential lead sources within the distribution system. The results have been shared with municipal staff and response plans are ongoing.

APPENDIX A

TABLE 1. 2016 UNTREATED (RAW) WATER QUALITY ENTERING JAPAN GULCH PLANT

(Guideline values provide reference only for untreated water)

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum    Maximum		≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
<b>Physical Parameters</b> (ND means less than instrument can detect)										
Alkalinity, Total	mg/L	15.4	11	9.92    16.7			14.9	127	8.84 - 19.1	12/yr
Carbon, Dissolved Organic	mg/L as C	1.91	11	0.97    3.34			1.93	115	0.97 - 4.65	12/yr
Carbon, Total Organic	mg/L as C	1.91	12	1    2.71		Guideline Archived	2.05	116	1.00 - 5.19	12/yr
Colour, True	TCU	7.05	54	4.4    13		≤15 AO	6.5	555	2.80 - 15.2	52/yr
Conductivity @ 25 C	uS/cm	42.85	54	33.6    47.4			41.9	530	27.50 - 56.4	52/yr
Hardness as CaCO <sub>3</sub>	mg/L	17.1	17	11.7    18.9			17.1	202	6.95 - 20.9	12/yr
pH	pH units	7.29	54	7.06    7.46		6.5 - 8.5 AO	7.23	530	6.73 - 7.66	52/yr
Tannins and Lignins	mg/L	0.12	2	ND    0.19		Guideline Archived	0.23	22	ND - 0.35	2/yr
Total Dissolved Solids	mg/L	26	12	16.0    37		≤500 AO	26.1	150	ND - 48.0	12/yr
Total Suspended Solids	mg/L	ND	12	ND    2			0.67	150	ND - 4.67	12/yr
Total Solids	mg/L	32	12	16    45			27.0	146	14.0 - 45.0	12/yr
Turbidity, Grab Samples	NTU	0.32	240	0.19    1.95		1.0 Operational Guideline	0.34	2457	0.19 - 1.95	250/yr
Ultraviolet Absorption, 5 cm	Abs. @254 nm	0.27	52	0.17    0.47			0.26	511	0.16 - 0.51	52/yr
Ultraviolet Transmittance	%	88.45	52	79.9    91.9			88.0	1294	0.20 - 94.4	52/yr
Water Temp., Grab Samples	degrees C	11.5	243	2.9    19.9		≤15 AO	10.3	2520	2.9 - 20.1	250/yr
<b>Non-Metallic Inorganic Chemicals</b> (ND means less than instrument can detect)										
Bromide	ug/L as Br	10.5	2	10    11			1.90	95	ND - 22.8	12/yr
Chloride	mg/L as Cl	2.25	2	1.7    2.8		≤ 250 AO	2.92	21	ND - 4.58	2/yr
Cyanide	mg/L as Cn	0	2	ND    ND		0.2 MAC	ND	19	ND - ND	2/yr
Fluoride	mg/L as F	0.02	2	0.01    0.02		1.5 MAC	0.01	20	ND - 0.13	2/yr
Nitrate, Dissolved	ug/L as N	15	12	ND    35		10000 MAC	13.8	107	ND - 69.2	12/yr
Nitrite, Dissolved	ug/L as N	ND	11	ND    ND		1000 MAC	ND	105	ND - ND	12/yr
Nitrate + Nitrite	ug/L as N	20.5	12	ND    35			14.3	107	ND - 69.2	12/yr
Nitrogen, Ammonia	ug/L as N	20	12	ND    110			4.94	109	ND - 110	12/yr
Nitrogen, Total Kjeldahl	ug/L as N	100.5	12	59    307			75.67	107	24.8 - 307	12/yr
Nitrogen, Total	ug/L as N	115	12	84    307			89.4	112	22.0 - 307	12/yr
Phosphate, Ortho, Dissolved	ug/L as P	ND	12	ND    ND			0.6	106	ND - 11.5	12/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Phosphate, Total, Dissolved	ug/L as P	<b>3.6</b>	12	2.3	5.9		2.52	110	ND - 6.64	12/yr
Phosphate, Total	ug/L as P	<b>3.05</b>	12	2.4	5.2		4.2	111	ND - 13.10	12/yr
Silica	mg/L as SiO <sub>2</sub>	<b>3.59</b>	12	2.96	4.25		3.84	95	0.09 - 6.31	12/yr
Silicon	ug/L as Si	<b>1,900</b>	6	1,600	2,220		1,825.00	104	681 - 2,860	12/yr
Sulphate	mg/L as SO <sub>4</sub>	<b>1.55</b>	12	ND	1140	≤ 500 AO	1.78	111	ND - 1,140	12/yr
Sulphide	mg/L as H <sub>2</sub> S	<b>0.01</b>	1	0.01	0.01	≤ 0.05 AO	ND	19	ND - 0.08	2/yr
Sulphur	mg/L as S	<b>ND</b>	6	ND	ND	-	ND	103	ND - 3.00	12/yr
<b>Metallic Inorganic Chemicals</b> (ND means less than instrument can detect)										
Aluminum	ug/L as Al	<b>15.3</b>	6	9	21.2	200 Operational Guideline	15.85	104	3.90 - 81.0	6/yr
Antimony	ug/L as Sb	<b>ND</b>	6	ND	ND	6 MAC	ND	104	ND - ND	6/yr
Arsenic	ug/L as As	<b>ND</b>	6	ND	ND	10 MAC	ND	104	ND - 0.30	6/yr
Barium	ug/L as Ba	<b>3.8</b>	6	3.5	4	1000 MAC	4	104	ND - 5.30	6/yr
Beryllium	ug/L as Be	<b>ND</b>	6	ND	ND		ND	104	ND - ND	6/yr
Bismuth	ug/L as Bi	<b>ND</b>	6	ND	ND		ND	103	ND - ND	6/yr
Boron	ug/L as B	<b>ND</b>	6	ND	ND	5000 MAC	ND	104	ND - 50.0	6/yr
Cadmium	ug/L as Cd	<b>ND</b>	6	ND	ND	5 MAC	ND	104	ND - 0.20	6/yr
Calcium	mg/L as Ca	<b>4.91</b>	6	4.81	5.49		5	104	2.06 - 6.13	6/yr
Chromium	ug/L as Cr	<b>ND</b>	6	ND	ND	50 MAC	ND	104	ND - 4.00	6/yr
Cobalt	ug/L as Co	<b>ND</b>	6	ND	ND		ND	104	ND - ND	6/yr
Copper	ug/L as Cu	<b>1.23</b>	6	1.15	13.9	≤ 1000 AO	1.3	104	ND - 30.5	6/yr
Iron	ug/L as Fe	<b>28.5</b>	6	15	57	≤ 300 AO	33.5	104	12.00 - 205	6/yr
Lead	ug/L as Pb	<b>ND</b>	6	ND	ND	10 MAC	ND	104	ND - 0.60	6/yr
Lithium	ug/L as Li	<b>ND</b>	6	ND	ND		ND	104	ND - ND	6/yr
Magnesium	mg/L as Mg	<b>1.17</b>	6	1.14	1.26		1.18	104	0.44 - 1.60	6/yr
Manganese	ug/L as Mn	<b>6.35</b>	6	2	15.4	≤ 50 AO	5.9	104	ND - 81.8	6/yr
Mercury, Total	ug/L as Hg	<b>ND</b>	6	ND	ND	1.0 MAC	ND	104	ND - 0.16	6/yr
Molybdenum	ug/L as Mo	<b>ND</b>	6	ND	ND		ND	104	ND - ND	6/yr
Nickel	ug/L as Ni	<b>ND</b>	6	ND	ND		ND	104	ND - 3.00	6/yr
Potassium	mg/L as K	<b>0.14</b>	6	0.12	0.15		0.15	104	ND - 0.23	6/yr
Selenium	ug/L as Se	<b>ND</b>	6	ND	ND	50 MAC	ND	104	ND - ND	6/yr
Silver	ug/L as Ag	<b>ND</b>	6	ND	ND		ND	104	ND - 0.02	6/yr
Sodium	mg/L as Na	<b>1.73</b>	6	1.63	1.86	≤ 200 AO	1.71	104	0.65 - 2.91	6/yr
Strontium	ug/L as Sr	<b>14.9</b>	6	14.2	16.1		15.6	104	ND - 21.8	6/yr



Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Thallium	ug/L as Tl	ND	6	ND	ND		ND	104	ND - ND	6/yr
Tin	ug/L as Sn	ND	6	ND	ND		ND	104	ND - ND	6/yr
Titanium	mg/L as Ti	ND	6	ND	ND		ND	104	ND - ND	6/yr
Vanadium	ug/L as V	ND	6	ND	ND		ND	104	ND - ND	6/yr
Zinc	ug/L as Zn	ND	6	ND	5.1	≤ 5000 AO	ND	104	ND - 82.9	6/yr
Zirconium	ug/L as Zr	ND	6	ND	ND	-	ND	104	ND - ND	6/yr
<b>Microbial Parameters</b>										
<b>Coliform Bacteria</b>										
<i>Coliforms, Total</i>	Coliforms/100 mL	9	241	ND	613		18	2460	ND - 4,838	250/yr
<i>E. coli</i>	<i>E. coli</i> /100 mL	ND	241	ND	9		ND	2460	ND - 165	250/yr
<b>Heterotrophic / Other Bacteria</b>										
Hetero. Plate Count, 28C (7 day)	CFU/1 mL	410	237	10	2580		380	2427	ND - 7,200	250/yr
<b>Cyanobacterial Toxins</b>										
<i>Anatoxin a</i>	ug/L	Analyzed as required - last analyzed in 2005					ND	2	ND - ND	Special
<i>Microcystin-LR</i>	ug/L	Analyzed as required - last analyzed in 2011				1.5 MAC (Total Microcystins)	ND	11	ND - 0.34	Special
<b>Parasites</b>										
No MAC Established										
<i>Cryptosporidium</i> , Total oocysts	oocysts/100 L	ND	7	ND	ND	Zero detection desirable	0	76	0 - 2	4/yr
<i>Cryptosporidium</i> , Viable oocysts	oocysts/100 L	ND	7	ND	ND	Zero detection desirable	0	62	0-1	4/yr
<i>Giardia</i> , Total cysts	cysts/100 L	ND	7	ND	ND	Zero detection desirable	0	76	0-2	4/yr
<i>Giardia</i> , Viable cysts	cysts/100 L	ND	7	ND	ND	Zero detection desirable	0	62	0-1	4/yr
<b>Radiological Parameters</b> (ND means less than instrument can detect)										
Gross alpha radiation	Bq/L	ND	1			0.5 (Screening)	ND	24	ND - 0.04	2/yr
Gross beta radiation	Bq/L	ND	1			1.0 (Screening)	0.02	24	ND - 0.11	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Iodine-131	Bq/L	ND	1			6 Bq/L	ND	14	0	Special
Cesium-134	Bq/L	ND	1				ND	14	ND - 0.20	Special
Cesium-137	Bq/L	ND	1			10 Bq/L	ND	14	0	Special
Ruthenium-103	Bq/L	ND	1				ND	12	0	
Uranium	ug/L as U	ND	6	ND	ND	20 MAC	ND	104	0	6/yr
<b>Organic Parameters</b> (ND means less than instrument can detect)										
<b>Pesticides/Herbicides</b>										
1,4-DDD	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
1,4'-DDE	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
1,4'-DDT	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
2,4,5-T	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
2,4,5-TP (Silvex)	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
2,4-D	ug/L	ND	2	ND	ND	100 MAC	ND	20	ND - ND	2/yr
2,4-D (BEE)	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr
2,4-DB	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
2,4-DP (Dichlorprop)	ug/L	ND	2	ND	ND		ND	12	ND - ND	2/yr
4,4'-DDD	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
4,4'-DDE	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
4,4'-DDT	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Aldicarb	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Aldrin	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Atrazine	ug/L	ND	2	ND	ND	5.0 MAC	ND	19	ND - ND	2/yr
Azinphos-methyl	ug/L	ND	2	ND	ND	20 MAC	ND	19	ND - ND	2/yr
BHC (alpha)	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
BHC (beta)	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
BHC (delta)	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
Bendiocarb	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Bromacil	ug/L	ND	2	ND	ND		ND	11	ND - ND	Irregular
Bromoxynil	ug/L	ND	2	ND	ND	5.0 MAC	ND	16	ND - ND	2/yr
Carbaryl	ug/L	ND	2	ND	ND	90 MAC	ND	20	ND - ND	2/yr
Carbofuran	ug/L	ND	2	ND	ND	90 MAC	ND	20	ND - ND	2/yr
Chlordane (alpha)	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	2/yr
Chlordane (gamma)	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Chlorpyrifos (Dursban)	ug/L	ND	2	ND	ND	90 MAC	ND	19	ND - ND	2/yr
Cyanazine (Bladex)	ug/L	ND	2	ND	ND	Guideline Archived	ND	15	ND - ND	2/yr
Demeton	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
Diazinon	ug/L	ND	2	ND	ND	20 MAC	ND	20	ND - ND	2/yr
Dicamba	ug/L	ND	2	ND	ND	120 MAC	ND	21	ND - ND	2/yr
Diclofop-methyl	ug/L	ND	2	ND	ND	9.0 MAC	ND	15	ND - ND	2/yr
Dichlorvos	ug/L	ND	2	ND	ND		ND	12	ND - ND	2/yr
Dieldrin	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Dimethoate	ug/L	ND	2	ND	ND	20 MAC	ND	20	ND - ND	2/yr
Dinoseb	ug/L	ND	2	ND	ND	Guideline Archived	ND	13	ND - ND	2/yr
Diquat	ug/L	ND	2	ND	ND	70 MAC	ND	17	ND - ND	2/yr
Endosulfan I	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Endosulfan II	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Endosulfan Sulphate	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
Endosulfan (Total)	ug/L	ND	2	ND	ND		ND	12	ND - ND	2/yr
Endrin	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Endrin Aldehyde	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
Endrin Ketone	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr
Ethion	ug/L	ND	2	ND	ND		ND	17	ND - ND	2/yr
Ethyl Parathion	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr
Fenchlorophos (Rannel)	ug/L	ND	2	ND	ND		ND	12	ND - ND	2/yr
Fenthion	ug/L	ND	2	ND	ND		ND	17	ND - ND	2/yr
Fonofos	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Glyphosate	ug/L	ND	2	ND	ND	280 MAC	ND	19	ND - ND	2/yr
Heptachlor	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Heptachlor Epoxide	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Lindane (BHC-gamma)	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Malathion	ug/L	ND	2	ND	ND	190 MAC	ND	20	ND - ND	2/yr
2-Methyl-4-chlorophenoxyacetic acid	ug/L	ND	2	ND	ND	100 MAC	ND	20	ND - ND	2/yr
MCCPP	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Methoxychlor	ug/L	ND	2	ND	ND	Guideline Archived	ND	18	ND - ND	2/yr
Methyl Parathion	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Metolachlor	ug/L	ND	2	ND	ND	50 MAC	ND	19	ND - ND	2/yr
Metribuzin (Sencor)	ug/L	ND	2	ND	ND	80 MAC	ND	13	ND - 0.00	2/yr
Mevinphos	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Mirex	ug/L	ND	2	ND	ND	Guideline Archived	ND	13	ND - ND	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Nitritotriacetic acid (NTA)	mg/L	0.06	2	ND	0.1	0.4 MAC	ND	17	ND - 0.10	2/yr
Parathion	ug/L	ND	2	ND	ND	Guideline Archived	ND	11	ND - ND	Irregular
Paraquat (ion)	ug/L	ND	2	ND	ND	7 MAC	ND	17	ND - ND	2/yr
Phorate	ug/L	ND	2	ND	ND	2.0 MAC	ND	19	ND - ND	2/yr
Phosmet	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
Picloram	ug/L	ND	2	ND	ND	190 MAC	ND	20	ND - ND	2/yr
Simazine	ug/L	ND	2	ND	ND	10 MAC	ND	18	ND - ND	2/yr
Temephos	ug/L	ND	2	ND	ND	Guideline Archived	ND	6	ND - ND	Irregular
Terbufos	ug/L	ND	2	ND	ND	1.0 MAC	ND	19	ND - ND	2/yr
Toxaphene	ug/L	ND	2	ND	ND	Guideline Archived	ND	19	ND - ND	2/yr
Trifluralin	ug/L	ND	2	ND	ND	45 MAC	ND	17	ND - ND	2/Yyr
<b>Polycyclic Aromatic Hydrocarbons (PAH's)</b>										
Acenaphthene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Acenaphthylene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Anthracene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Benzo(a)anthracene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.02	2/yr
Benzo(a)pyrene	ug/L	ND	2	ND	ND	0.01 MAC	ND	18	ND - ND	2/yr
Benzo(b)fluoranthene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Benzo(g,h,i)perylene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.05	2/yr
Benzo(k)fluoranthene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Chrysene	ug/L	0.02	2	ND	0.03	Guideline Archived	ND	20	ND - 0.03	2/yr
Dibenz(a,h)anthracene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.04	2/yr
Fluoranthene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.02	2/yr
Fluorene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.03	2/yr
Indeno(1,2,3-c,d)pyrene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Naphthalene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Phenanthrene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - 0.08	2/yr
Pyrene	ug/L	ND	2	ND	ND	Guideline Archived	ND	20	ND - ND	2/yr
Volatile Hydrocarbons	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr
<b>Phenols</b>										
2,3,4,6-Tetrachlorophenol	ug/L	ND	2	ND	ND	100 MAC and ≤ 1.0 AO	ND	15	ND - ND	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
2,4,6-Trichlorophenol	ug/L	ND	2	ND	ND	5.0 MAC and ≤ 2.0 AO 900 MAC and ≤ 0.3 AO	ND	19	ND - ND	2/yr
2,4-Dichlorophenol	ug/L	ND	1	ND	ND		ND	17	ND - ND	2/yr
2,4-Dimethylphenol	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2,4-Dinitrophenol	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2-Chlorophenol	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2-Nitrophenol	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
4,6-Dinitro-2-Methylphenol	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
4-Chloro-3-Methylphenol	ug/L	ND	2	ND	ND		ND	18	ND - ND	2/yr
4-Nitrophenol	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Alpha-Terpineol	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
Pentachlorophenol	ug/L	ND	2	ND	ND	60 MAC and ≤ 30 AO	ND	18	ND - ND	2/yr
Phenol	ug/L	ND	4	ND	1.20		ND	22	ND - 6.20	2/yr
<b>Polychlorinated Biphenyls (PCBs)</b>										
PCB-1016	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1221	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1232	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1242	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1248	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1254	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
PCB-1260	ug/L	ND	2	ND	ND	Guideline Archived	ND	13	ND - ND	Irregular
Total PCBs	ug/L	ND	2	ND	ND	Guideline Archived	ND	12	ND - ND	Irregular
<b>Other Synthetic Chemicals</b>										
1,1,1-Trichloroethane	ug/L	ND	2	ND	ND	14 MAC	ND	20	ND - ND	2/yr
1,1,1,2-Tetrachloroethane	ug/L	ND	2	ND	ND		ND	15	ND - ND	2/yr
1,1,2,2-Tetrachloroethane	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
1,1,2-Trichloroethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,1-Dichloroethane	ug/L	ND	2	ND	ND		ND	21	ND - ND	2/yr
1,1-Dichloroethylene	ug/L	ND	2	ND	ND		ND	19	ND - ND	2/yr
1,2,3-Trichlorobenzene	ug/L	ND	2	ND	ND		ND	7	ND - ND	Irregular
1,2,4-Trichlorobenzene	ug/L	ND	2	ND	ND		ND	23	ND - 0.20	2/yr
1,2-Dibromoethane	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
1,2-Dichlorobenzene	ug/L	ND	2	ND	ND	200 MAC and ≤ 3.0 AO 5.0 MAC	ND	20	ND - ND	2/yr
1,2-Dichloroethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,2-Dichloroethylene (cis)	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,2-Dichloroethylene (trans)	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,2-Dichloropropane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,2-Diphenylhydrazine	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
1,3-Dichlorobenzene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,3-Dichloropropene (cis)	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,3-Dichloropropene (trans)	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
1,4-Dichlorobenzene	ug/L	ND	2	ND	ND	5.0 MAC and ≤ 1.0 AO	ND	20	ND - ND	2/yr
2,4-Dinitrotoluene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2,6-Dinitrotoluene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2-Chloronaphthalene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
2-Methylnaphthalene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
3,3'-Dichlorobenzidene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
4-Bromophenyl-phenylether	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
4-Chlorophenyl-phenylether	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Atrazine	ug/L	ND	2	ND	ND	5.0 MAC	ND	19	ND - ND	2/yr
Benzene	ug/L	ND	2	ND	ND	5.0 MAC	ND	20	ND - ND	2/yr
Benzidine	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
<i>Bis(-2-chloroethoxy) methane</i>	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
<i>Bis(-2-chloroethyl) ether</i>	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
<i>Bis(2-chloroisopropyl) ether</i>	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Bis(2-ethylhexyl) phthalate	ug/L	0.8	2	ND	1.1		ND	21	ND - 1.70	2/yr
Bromobenzene		ND	2	ND	ND		ND	19	ND - ND	Irregular
Bromoform		ND	2	ND	ND		ND	6	ND - ND	2/yr
Bromomethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Butylbenzyl phthalate	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Carbon Tetrachloride	ug/L	ND	2	ND	ND	2.0 MAC	ND	20	ND - ND	2/yr
Chloroform		ND	2	ND	ND		ND	20	ND - ND	2/yr
Chloroethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Chloromethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Desethyl Atrazine	ug/L	ND	2	ND	ND		ND	20	ND - ND	Irregular
Dibromochloromethane	ug/L	ND	2	ND	ND		ND	10	ND - ND	2/yr
Dibromomethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Dichlorodifluoromethane	ug/L	ND	2	ND	ND		ND	12	ND - ND	2/yr

Appendix A, Table 1, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Dichloromethane	ug/L	ND	2	ND	ND	50 MAC	ND	15	ND - ND	2/yr
Diethyl phthalate	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
Dimethyl phthalate	ug/L	0.05	2	ND	0.08		ND	20	ND - 0.60	2/yr
Di-n-butyl phthalate	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Di-n-ocyl phthalate	ug/L	2.46	2	ND	4.9		ND	19	ND - 4.90	2/yr
Diuron	ug/L	ND	2	ND	ND	150 MAC	ND	20	ND - ND	2/yr
Ethylbenzene	ug/L	ND	2	ND	ND	≤ 140 MAC and ≤ 1.6 AO	ND	14	ND - ND	2/yr
Formaldehyde	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Hexachlorobenzene	ug/L	ND	2	ND	ND		ND	19	ND - 0.02	2/yr
Hexachlorobutadiene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Hexachlorocyclopentadiene	ug/L	ND	2	ND	ND		ND	23	ND - ND	2/yr
Hexachloroethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Isophorone	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Methyltertiarybutylether (MTBE)	ug/L	ND	2	ND	ND	15 AO	ND	20	ND - ND	2/yr
Monochlorobenzene	ug/L	ND	2	ND	ND	80 MAC and ≤ 30 AO	ND	19	ND - ND	2/yr
N-nitrosodimethylamine (NDMA)	ug/L	ND	2	ND	ND	0.04 MAC	ND	20	ND - ND	2/yr
Nitrobenzene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
N-nitroso-di-n-propylamine	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
N-nitrosodiphenylamine	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Octachlorostyrene	ug/L	ND	2	ND	ND		ND	13	ND - ND	2/yr
Styrene	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Tetrachloroethylene	ug/L	ND	2	ND	ND	30 MAC	ND	20	ND - ND	2/yr
Toluene	ug/L	ND	2	ND	ND	60 MAC and ≤ 24 AO	ND	20	ND - ND	2/yr
Triallate	ug/L	ND	2	ND	ND	Guideline Archived	ND	14	ND - ND	2/yr
Trichloroethylene	ug/L	ND	2	ND	ND	5.0 MAC	ND	18	ND - ND	2/yr
Trichlorofluoromethane	ug/L	ND	2	ND	ND		ND	20	ND - ND	2/yr
Trichlorotrifluoroethane	ug/L	ND	2	ND	ND		ND	7	ND - ND	Irregular
Vinyl Chloride	ug/L	ND	2	ND	ND	2.0 MAC	ND	20	ND - ND	2/yr
o-Xylene	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
m&p-Xylene	ug/L	ND	2	ND	ND		ND	14	ND - ND	2/yr
Xylenes (Total)	ug/L	ND	2	ND	ND	90 MAC and ≤ 20 AO	ND	20	ND - ND	2/yr

Notes: mg/L = milligrams per litre; ug/L = micrograms per litre; ND = Not Detected; CFU = Colony Forming Units; NTU = Nephelometric Units; TCU = True Colour Units; AO = Aesthetic Objective; MAC = Max. Acceptable Conc.; Median = middle point of all values





APPENDIX A

TABLE 2. 2016 TREATED WATER QUALITY AFTER JAPAN GULCH PLANT

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
<b>Physical Parameters</b> (ND means less than instrument can detect)										
Alkalinity, Total	mg/L	13.1	11	7.16	14.8		13	121	6.92 - 18.8	12/yr
Carbon, Dissolved Organic	mg/L	2.00	10	1.03	2.41		2.01	116	1.03 - 3.83	12/yr
Carbon, Total Organic	mg/L	1.77	10	1.03	2.33	Guideline Archived	2.1	116	1.03 - 3.70	12/yr
Colour, True	TCU	4.10	54	2.50	10	≤ 15 AO	4.1	555	1.30 - 11.9	52/yr
Conductivity @ 25 C	uS/cm	45.1	54	35.9	65.3		43.9	517	30.5 - 65.3	52/yr
Hardness as CaCO <sub>3</sub>	mg/L	17.50	23	12.00	22.10		17.4	185	7.19 - 22.1	12/yr
Odour	Odour Profile	Trace	240	Odour free	Moderate	Inoffensive	Trace	2438	Odour free - Strong	250/yr
pH	pH units	6.96	53	6.65	7.35	7.0-10.5 AO	7.03	514	6.53 - 7.99	52/yr
Taste	Flavour Profile	Trace	240	Taste Free	Moderate	Inoffensive	Trace	2433	Taste free-Strong	250/yr
Total Dissolved Solids	mg/L	24	11	16	41	≤500 AO	26.9	149	12.0 - 41.0	12/yr
Total Suspended Solids	mg/L	ND	11	ND	1.00		0.5	149	ND - 11.0	12/yr
Total Solids	mg/L	28	11	21	41		27.8	145	11.0 - 42.0	12/yr
Turbidity, Grab Samples	NTU	0.31	240	0.17	2.60	1 Operational and ≤ 5 AO	0.35	2458	0.17 - 38.1	250/yr
Water Temperature, Grab Samples	degrees C	11.2	238	2.5	19.7	≤ 15 AO	9.8	2576	2.50 - 20.0	250/yr
<b>Non-Metallic Inorganic Chemicals</b> (ND means less than instrument can detect)										
Bromide	ug/L as Br	31	2	24	38		0.35	93	ND - 43.00	12/yr
Chloride	mg/L as Cl	4.25	2	3.7	4.8	≤ 250 AO	4.09	22	ND - 5.43	2/yr
Cyanide	mg/L as Cn	0.0014	2	0.0013	0.0016	0.2 MAC	ND	20	ND - 0.00	2/yr
Fluoride	mg/L as F	0.02	2	0.02	0.02	1.5 MAC	0.01	21	ND - 0.13	2/yr
Nitrate, Dissolved	ug/L as N	15	12	ND	36	10000 MAC	20.31	105	ND - 75.08	12/yr
Nitrite, Dissolved	ug/L as N	ND	12	ND	25	1000 MAC	ND	101	ND - 25.00	12/yr
Nitrate + Nitrite	ug/L as N	17.5	12	ND	36		20.6	105	ND - 75.08	12/yr
Nitrogen, Ammonia	ug/L as N	115	12	0.11	180		107.43	114	ND - 310.00	12/yr
Nitrogen, Total Kjeldahl	ug/L as N	237.5	12	74	411		226.85	104	42.27 - 411.00	12/yr
Nitrogen, Total	ug/L as N	248.5	12	104	411		244	109	60.12 - 411.00	12/yr
Phosphate, Ortho, Dissolved	ug/L as P	ND	12	ND	ND		0.66	104	ND - 2.41	12/yr
Phosphate, Total, Dissolved	ug/L as P	3.65	12	2.6	9.9		2.9	109	ND - 9.90	12/yr
Phosphate, Total	ug/L as P	3.05	12	2.5	7.2		4.51	108	1.51 - 8.60	12/yr
Silica	mg/L as SiO <sub>2</sub>	3.93	11	2.91	4.28		3.71	92	0.09 - 5.61	12/yr
Silicon	ug/L as Si	2,035	12.00	1,590	2,740		1,830.00	107	693.00 - 2,740.00	12/yr

Appendix A, Table 2, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Sulphate	mg/L as SO4	<b>1.46</b>	12	0.87	2.81	≤ 500 AO	1.73	108	0.80 - 5.31	12/yr
Sulphide	mg/L as H2S	<b>0.01</b>	1	0.01	0.01	≤ 0.05 AO	ND	20	ND - 0.09	2/yr
Sulfur	mg/L as S	<b>ND</b>	12	ND	ND		ND	108	ND - 4.00	12/yr
<b>Metallic Inorganic Chemicals</b> (ND means less than instrument can detect)										
Aluminum	ug/L as Al	<b>17.75</b>	12	8.4	22.6	100 AO and 200 Operational	16	107	4.50 - 67.70	12/yr
Antimony	ug/L as Sb	<b>ND</b>	12	ND	ND	6 MAC	ND	107	ND	12/yr
Arsenic	ug/L as As	<b>ND</b>	12	ND	0.17	10 MAC	ND	107	ND - 0.20	12/yr
Barium	ug/L as Ba	<b>3.81</b>	12	3.3	4.1	1000 MAC	4	107	ND - 5.00	12/yr
Beryllium	ug/L as Be	<b>ND</b>	12	ND	ND		ND	106	ND - 0.10	12/yr
Bismuth	ug/L as Bi	<b>ND</b>	12	ND	0.01		ND	107	ND - 1.00	12/yr
Boron	ug/L as B	<b>ND</b>	12	ND	ND	5000 MAC	ND	107	ND - 50.00	12/yr
Cadmium	ug/L as Cd	<b>ND</b>	12	ND	0.06	5 MAC	ND	107	ND - 0.30	12/yr
Calcium	mg/L as Ca	<b>5.14</b>	12	4.71	6.82		5.03	107	2.10 - 6.82	12/yr
Chromium	ug/L as Cr	<b>ND</b>	12	ND	1.2	50 MAC	ND	107	ND - 1.20	12/yr
Cobalt	ug/L as Co	<b>ND</b>	12	ND	0.04		ND	107	ND - 0.04	12/yr
Copper	ug/L as Cu	<b>15.85</b>	12	1.03	25.8	≤ 1000 AO	21.7	107	ND - 202.00	12/yr
Iron	ug/L as Fe	<b>33.5</b>	12	16	98	≤ 300 AO	32.5	107	13.90 - 198.00	12/yr
Lead	ug/L as Pb	<b>ND</b>	12	ND	0.08	10 MAC	ND	107	ND - 0.92	12/yr
Lithium	ug/L as Li	<b>ND</b>	12	ND	0.58		ND	107	ND - 0.58	12/yr
Magnesium	mg/L as Mg	<b>1.19</b>	12	1.02	1.29		1.18	107	0.47 - 1.60	12/yr
Manganese	ug/L as Mn	<b>5.3</b>	12	1.9	30.6	≤ 50 AO	5	107	ND - 48.00	12/yr
Mercury, Total	ug/L as Hg	<b>ND</b>	11	ND	ND	1.0 MAC	ND	106	ND - 0.04	12/yr
Molybdenum	Ug/L as Mo	<b>ND</b>	12	ND	ND		ND	107	ND - 5.00	12/yr
Nickel	mg/L as Ni	<b>ND</b>	12	ND	1.6		ND	107	ND - 16.00	12/yr
Potassium	mg/L as K	<b>0.14</b>	12	0.11	0.22		0.15	107	ND - 0.22	12/yr
Selenium	ug/L as Se	<b>ND</b>	12	ND	ND	50 MAC	ND	107	ND - 0.10	12/yr
Silver	ug/L as Ag	<b>ND</b>	12	ND	0.06		ND	107	ND - 0.06	12/yr
Sodium	mg/L as Na	<b>1.71</b>	12	1.57	1.9	≤ 200 AO	1.7	107	0.67 - 3.56	12/yr
Strontium	ug/L as Sr	<b>15.45</b>	12	13.6	16.3		15.6	107	6.30 - 19.70	12/yr
Thallium	ug/L as Tl	<b>ND</b>	12	ND	ND		ND	107	ND	12/yr
Tin	ug/L as Sn	<b>ND</b>	12	ND	0.22		ND	107	ND - 0.22	12/yr
Titanium	ug/L as Ti	<b>ND</b>	12	ND	ND		ND	107	ND	12/yr
Uranium	ug/L as U	<b>ND</b>	12	ND	0.02	20 MAC	ND	107	ND - 0.02	12/yr
Vanadium	ug/L as V	<b>ND</b>	12	ND	ND		ND	107	ND	12/yr

Appendix A, Table 2, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
Zinc	ug/L as Zn	ND	12	ND	9.99	≤ 5000 AO	ND	107	ND - 82.00	12/yr
Zirconium	ug/L as Zr	ND	12	ND	ND		ND	107	ND	12/yr
<b>Microbial Parameters</b> (ND means less than method or instrument can detect)										
<b>Coliform Bacteria</b>										
<i>Coliforms, Total</i>	CFU/100 mL	0	242	0	14	0 MAC	0	2462	0 - 21	250/yr
<i>E. coli</i>	CFU/100 mL	0	242			0 MAC	0	2462		250/yr
<b>Heterotrophic/Other Bacteria</b>										
Hetero. Plate Count, 28C (7 day)	CFU/1 mL	0	236	0	290		0	2404	0 - 7800	250/yr
<b>Disinfectants</b> (ND means less than instrument can detect)										
<b>Disinfectants</b>										
Chlorine, Total Residual	mg/L as Cl <sub>2</sub>	1.26	242	0.46	1.64	3.0 MAC (chloramines)	1.22	2618	0.36 - 1.99	250/yr
Dichloramine	mg/L as Cl <sub>2</sub>	0.63	234	0.01	1.51		0.9	2510	ND - 1.66	250/yr
Monochloramine	mg/L as Cl <sub>2</sub>	0.47	234	0.02	1.2		0.2	2506	ND - 1.22	250/yr
<b>Disinfection By-Products</b> (ND means less than instrument can detect)										
Total Trihalomethanes (TTHM)	ug/L	18	6	13	22	100 MAC	16.4	58	0.00 - 30.50	6/yr
Haloacetic Acids (*5 Total, HAA5)	ug/L	16	5	10	23	80 MAC	12.22	55	1.01 - 65.00	6/yr

Notes: mg/L = milligrams per litre; ug/L = micrograms per litre; ND = Not Detected; CFU = Colony Forming Units; NTU = Nephelometric Units; TCU = True Colour Units; AO = Aesthetic Objective; MAC = Max. Acceptable Conc.; Median = middle point of all values



APPENDIX A

TABLE 3. 2016 TREATED WATER QUALITY AFTER SOOKE PLANT

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
<b>Physical Parameters</b> (ND means less than instrument can detect)										
Alkalinity, Total	mg/L	16.4	11	15.3	18.2		15.5	125	10.20 - 19.40	12/yr
Colour, True	TCU	3.4	52	1.9	11.3	≤ 15 AO	3.5	506	ND - 11.30	52/yr
Conductivity @ 25 C	uS/cm	60.4	52	54.6	67.7		54.5	507	39.90 - 67.70	52/yr
Odour	Flavour Profile	Trace	52	free	Moderate	Inoffensive	Trace	504	Odour free - Strong	52/yr
pH	pH units	7.42	52	7.15	7.82	7.0-10.5 AO	7.29	507	6.32 - 7.88	52/yr
Taste	Flavour Profile	Trace	52	free	Moderate	Inoffensive	Trace	503	Taste free-Strong	52/yr
Turbidity, Grab Samples	NTU	0.33	52	0.18	0.95	1 MAC	0.31	508	0.17 - 1.70	52/yr
Water Temperature, Grab Samples	degrees C	11.3	53.0	1.2	18.1	≤ 15 AO	10.5	513	1.19 - 19.60	52/yr
<b>Microbial Parameters</b> (ND means less than instrument can detect)										
<b>Coliform Bacteria</b>										
Coliform, Total	CFU/100 mL	0	53	0	1	0 MAC	0	513	0-12	52/yr
<i>E. coli</i>	CFU/100 mL	ND	53	ND	ND	0 MAC	ND	513		52/yr
<b>Heterotrophic Bacteria</b>										
<i>Hetero. Plate Count, 28C (7 day)</i>	CFU/1 mL	0	51	0	210		0	426	0 - 1230	52/yr
<b>Disinfectants</b> (ND means less than instrument can detect)										
<b>Disinfectants</b>										
Chlorine, Total Residual	mg/L as Cl <sub>2</sub>	1.37	48	1.1	1.68	3.0 MAC (chloramines)	1.1	419	0.36 - 1.84	52/yr
Dichloramine	mg/L as Cl <sub>2</sub>	0.66	46	0.11	1.35		0.4	415	0.02 - 1.32	52/yr
Monochloramine	mg/L as Cl <sub>2</sub>	0.28	46	0.08	1.17		0.46	415	0.01 - 1.09	52/yr

Appendix A, Table 3, continued

PARAMETER		2016 ANALYTICAL RESULTS				CANADIAN GUIDELINES	TEN YEAR RESULTS (2007-2016)			Target Sampling Frequency
Parameter Name	Units of Measure	Median Value	Samples Analyzed	Range Minimum	Maximum	≤ = Less than or equal to	10 Year Median	Samples Analyzed	Range Minimum - Maximum	
<b>Metallic Inorganic Chemicals</b> (ND means less than instrument can detect)										
Aluminum	ug/L as Al	10.3	5	7.70	22.70	200 Operational Guideline	10.3	5	7.70 - 22.7	12/yr
Antimony	ug/L as Sb	ND	5	ND	ND	6 MAC	ND	5	ND	12/yr
Arsenic	ug/L as As	ND	5	ND	ND	10 MAC	ND	5	ND	12/yr
Barium	ug/L as Ba	3.80	5	3.70	4.20	1000 MAC	3.80	5	3.70 - 4.20	12/yr
Beryllium	ug/L as Be	ND	5	ND	ND		ND	5	ND	12/yr
Bismuth	ug/L as Bi	ND	5	ND	ND		ND	5	ND	12/yr
Boron	ug/L as B	ND	5	ND	ND	5000 MAC	ND	5	ND	12/yr
Cadmium	ug/L as Cd	ND	5	ND	ND	5 MAC	ND	5	ND	12/yr
Calcium	mg/L as Ca	5.08	5	4.96	5.43		5.08	5	4.96 - 5.43	12/yr
Chromium	ug/L as Cr	ND	5	ND	ND	50 MAC	ND	5	ND	12/yr
Cobalt	ug/L as Co	ND	5	ND	ND		ND	5	ND	12/yr
Copper	ug/L as Cu	52.9	5	31.5	80.4	≤ 1000 AO	52.90	5	31.5 - 80.4	12/yr
Iron	ug/L as Fe	34	5	24	53	≤ 300 AO	34.00	5	24.0 - 53.0	12/yr
Lead	ug/L as Pb	0.46	5	0.27	0.64	10 MAC	0.46	5	0.27 - 0.64	12/yr
Lithium	ug/L as Li	ND	5	ND	ND		ND	5	ND	12/yr
Magnesium	mg/L as Mg	1.20	5	1.14	1.34		1.20	5	1.14 - 1.34	12/yr
Manganese	ug/L as Mn	4.10	5	2.40	10	≤ 50 AO	4.10	5	2.40 - 10.0	12/yr
Mercury, Total	ug/L as Hg	ND	5	ND	ND	1.0 MAC	ND	5	ND	12/yr
Molybdenum	ug/L as Mo	ND	5	ND	ND		ND	5	ND	12/yr
Nickel	ug/L as Ni	ND	5	ND	ND		ND	5	ND	12/yr
Potassium	mg/L as K	0.14	5	0.13	0.25		0.14	5	0.13 - 0.25	12/yr
Selenium	ug/L as Se	ND	5	ND	ND	50 MAC	ND	5	ND	12/yr
Silver	ug/L as Ag	ND	5	ND	ND		ND	5	ND	12/yr
Sodium	mg/L as Na	5.01	5	4.40	7.02	≤ 200 AO	5.01	5	4.40 - 7.02	12/yr
Strontium	ug/L as Sr	15.1	5	14	16.2		15.10	5	14.0 - 16.2	12/yr
Thallium	ug/L as Tl	ND	5	ND	ND		ND	5	ND	12/yr
Tin	ug/L as Sn	ND	5	ND	ND		ND	5	ND	12/yr
Titanium	ug/L as Ti	ND	5	ND	ND		ND	5	ND	12/yr
Uranium	ug/L as U	ND	5	ND	ND	20 MAC	ND	5	ND	12/yr
Vanadium	ug/L as V	ND	5	ND	ND		ND	5	ND	12/yr
Zinc	ug/L as Zn	ND	5	ND	ND	≤ 5000 AO	ND	5	ND	12/yr
Zirconium	ug/L as Zr	ND	5	ND	ND		ND	5	ND	12/yr

Notes: mg/L = milligrams per litre; ug/L = micrograms per litre; ND = Not Detected; CFU = Colony Forming Units; NTU = Nephelometric Units; TCU = True Colour Units; AO = Aesthetic Objective; MAC = Max. Acceptable Conc.; Median = middle point of all values