



## Belanko™ Double pole Switches 20 A


Cat. No(s): 6 170 70/71/72/73 - 6 172 70 - 6 173 70/71/72/73 - 6 174 70/71/72/73

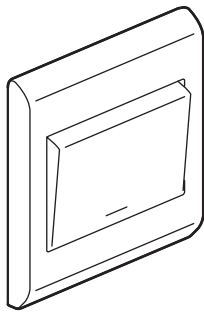

6 170 70/71

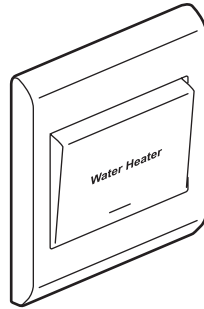

6 170 72

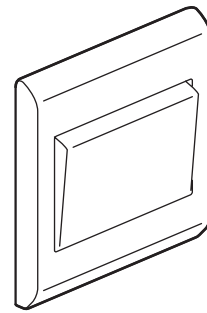

6 170 73


### 1. USE

Double pole switches, large rocker, complete delivered.  
 For surface or flush-mounting back box to be min. 35 mm deep.  
 Supplied with 2 screws M3.5 for BS boxes..

### 2. RANGE

	White	Ivory	Dark Grey	Brown
1 gang 1-way switch + red neon indicator	6 170 70	6 172 70	6 173 70	6 174 70
1 gang 1-way switch + red neon indicator + earth connection	6 170 71	-	6 173 71	6 174 71
1 gang 1-way switch + red neon indicator + earth connection with "Water Heater" marking	6 170 72	-	6 173 72	6 174 72
1 gang 1-way switch without neon	6 170 73	-	6 173 73	6 174 73

### 3. OVERALL DIMENSIONS (mm)

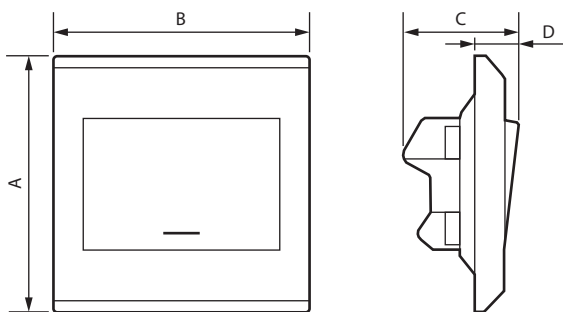

A	B	C	D
86	86	38.5	14.5

### 4. CONNECTION

Type of terminals : with screws  
 Terminal capacity: 2 x 4 mm<sup>2</sup> - 3 x 2.5 mm<sup>2</sup> - 1 x 6 mm<sup>2</sup>  
 Stripping length: 8 mm  
 Screwdriver: 4 mm flat blade  
 Compatible with flexible or rigid cables

### 5. TECHNICAL CHARACTERISTICS

#### ■ 5.1 Mechanical characteristics

Impact tests: IK 04  
 Penetration by solid bodies/liquids: IP 40

#### ■ 5.2 Material characteristics

Thermoplastic with glossy finish  
 Colour: White T084

Ivory  
 Dark Grey  
 Brown

Halogen free  
 UV resistant

Self-extinguishing:  
 850° C / 30 s for insulating parts holding live parts in place.  
 650° C / 30 s for other parts made of insulating materials.

#### ■ 5.3 Electrical characteristics

Voltage: 250 V~  
 Current: 20 A  
 Frequency: 50/60 Hz

#### ■ 5.4 Climatic characteristics

Storage temperature: - 10° C to + 70° C  
 Use temperature: - 5° C to + 35° C

### 6. CLEANING

Clean the surface with a cloth.  
 Do not use acetone, tar-removing cleaning agents or trichloroethylene.

Resistance to the following cleaning substances:  
 Hexane (EN 60669-1), Methylated spirit, Soapy water, Diluted ammonia, Diluted pure bleach 10%, Glass cleaning product.

**Caution:** An initial test is required for the use of other special maintenance products.

### 7. STANDARDS AND APPROVALS

Compliance with standards of installation and manufacturing.  
 See e.catalogue.