



NEW STYLE TRANSFER ASSEMBLY (Old Style Switch Other Side)
 Allows multiple RXT transfer switches to be installed in series WITHOUT the installation of an RDT transfer switch

ATTENTION: JUMPER MUST BE INSTALLED OR THE PRODUCT WARRANTY WILL BE VOIDED

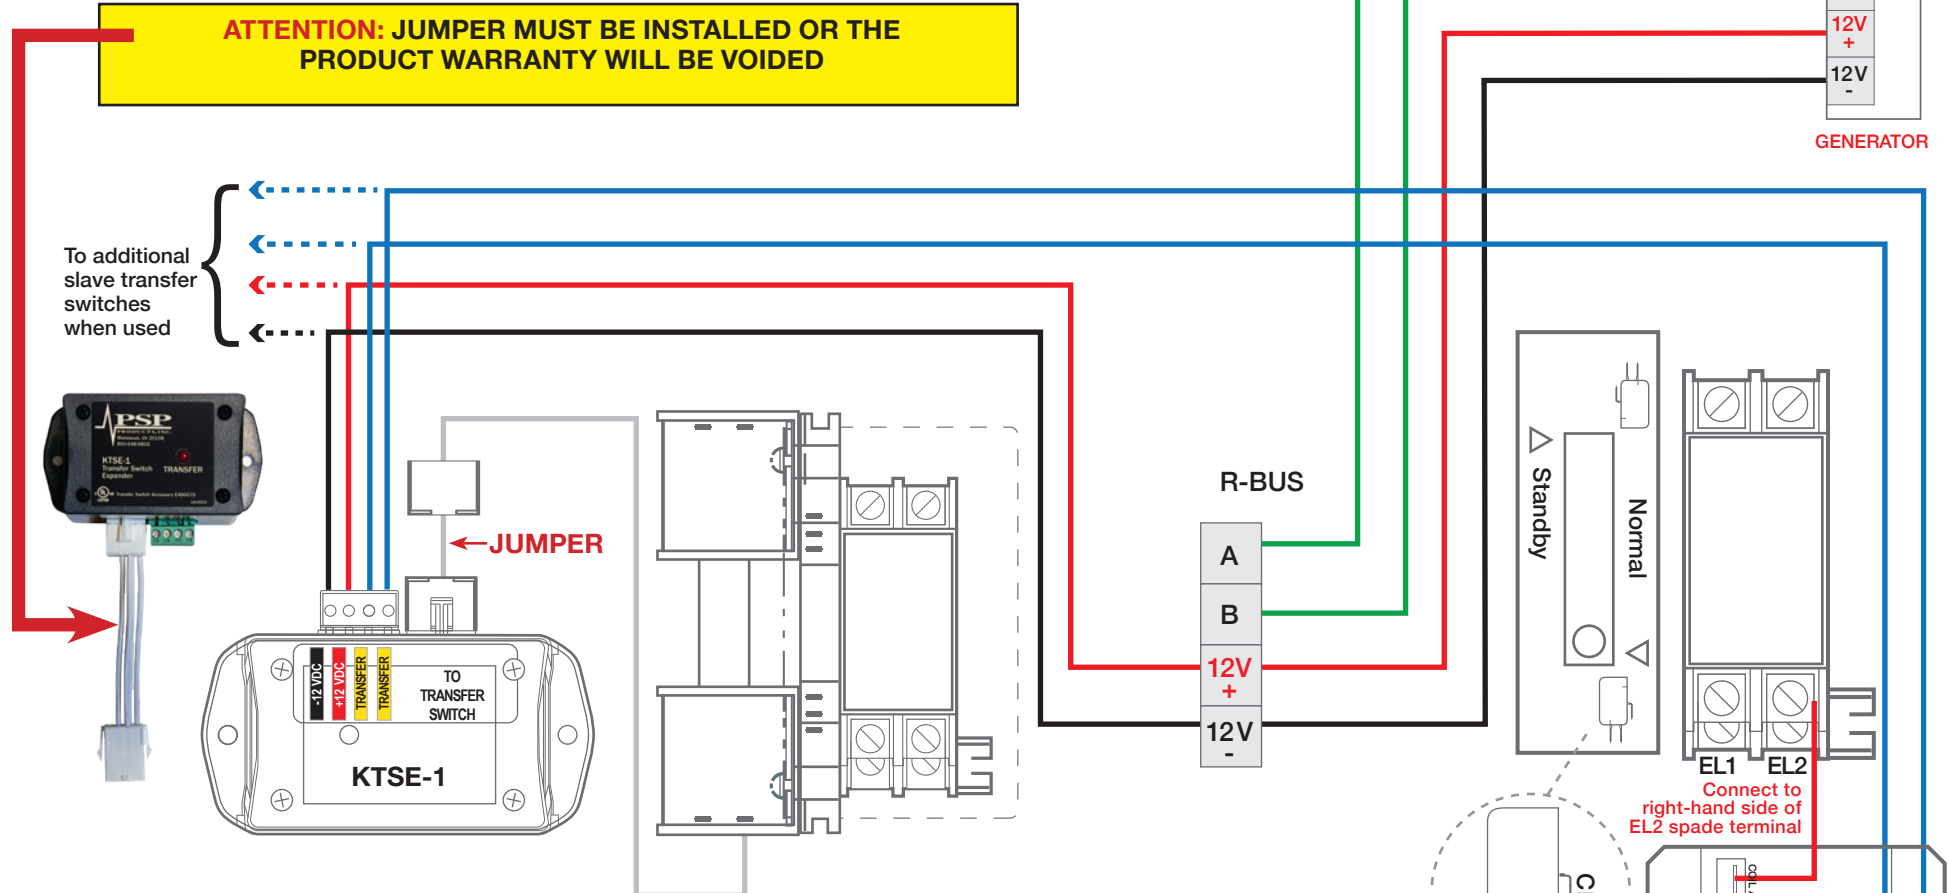

Remove connector P-13 and remove RXT control board. Insert connector P-13 plug into KTSE-1 Expander Module and attach to side panel of enclosure. Note: The RXT control board is not required to operate the transfer switch in the SLAVE mode and can be returned to inventory.

SLAVE RXT

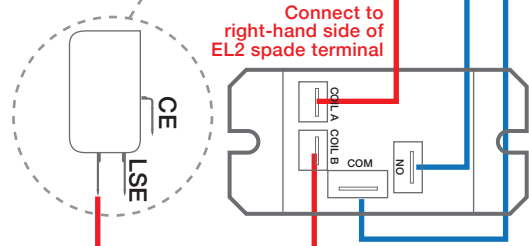

Connect coil B to the ONLY open terminal on the bottom micro-switch

MASTER RXT




Important: Risk of electrical shock.
 This device should only be installed by qualified personnel.

Technical Assistance Call: 703-687-4057

OLD STYLE TRANSFER ASSEMBLY

Allows multiple RXT transfer switches to be installed in series WITHOUT the installation of an RDT transfer switch

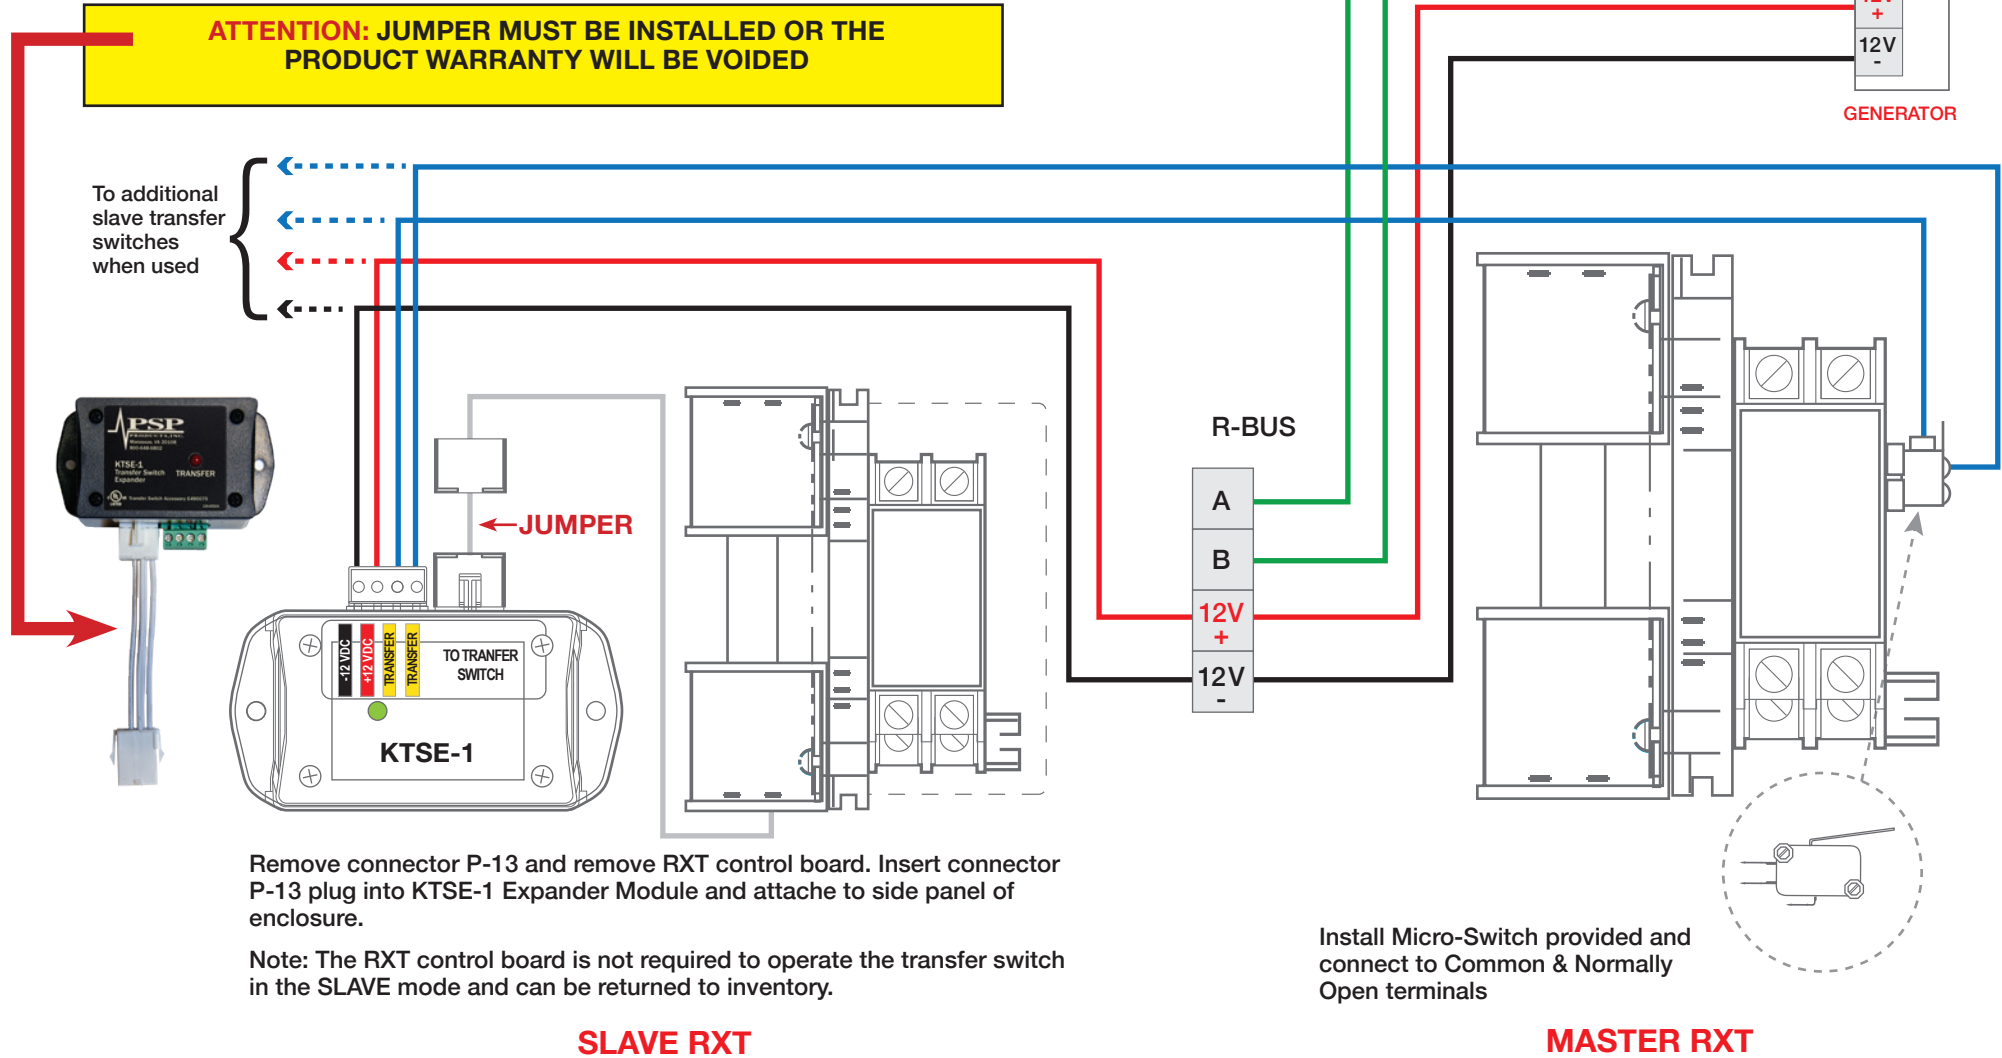

Important: Risk of electrical shock.
 This device should only be installed by qualified personnel.

Technical Assistance Call: 703-687-4057